



Source Water Assessment

A Hydrogeologic Susceptibility and Vulnerability Assessment for 33 Mile Roadhouse, Haines, Alaska PWSID #113536

DRINKING WATER PROTECTION PROGRAM REPORT NO. 701

Alaska Department of Environmental Conservation

Source Water Assessment for 33 Mile Roadhouse Haines, Alaska PWSID #113536

DRINKING WATER PROTECTION PROGRAM REPORT NO. 701

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

CONTENTS

SECTION	Executive Summary 33 Mile Roadhouse Public Drinking Water System 33 Mile Roadhouse Drinking Water Protection Area Inventory of Potential and Existing Contaminant Sources Ranking of Contaminant Risks Vulnerability of 33 Mile Roadhouse Drinking Water System References	Page 1 1 1 2 2 2 5
TABLE	TABLES 1. Definition of Zones 2. Susceptibility 3. Contaminant Risks 4. Overall Vulnerability	2 3 3 3
	APPENDICES	
APPENDIX	 A. 33 Mile Roadhouse Drinking Water Protection Area (Map 1) B. Vulnerability Analysis for Contaminant Source Inventory and Risk Ranking for 33 Mile Roadhouse Public Drinking Water Source (Charts 1 – 8) 	

Drinking Water Protection Program Alaska Department of Environmental Conservation

EXECUTIVE SUMMARY

The public water system for 33 Mile Roadhouse is a Class B (transient/non-community) water system consisting of one well. The 33 Mile Roadhouse is located at Mile 33 of Haines Highway, Haines, Alaska. The wellhead received a susceptibility rating of Low and the aquifer received a susceptibility rating of High. Combining these two ratings produces a Medium rating for the natural susceptibility of the well. There are no identified potential and current sources of contaminants for 33 Mile Roadhouse public drinking water source. Identified potential and existing sources of contamination would be considered sources of bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals. Overall, the public water sources for 33 Mile Roadhouse received a vulnerability rating of Low for bacteria and viruses, nitrates and nitrites, and volatile organic chemicals.

33 MILE ROADHOUSE PUBLIC DRINKING WATER SYSTEM

33 Mile Roadhouse public water system is a Class B (transient/non-community) water system. The system consists of one well near Haines, Alaska. Haines is located on Portage Cove, between the Chilkoot and Chilkat Inlets, on the upper arm of Lynn Canal, approximately 80 air miles northwest of Juneau (please see the inset of Map 1 in Appendix A for location). The population of Haines is approximately 2,300.

Haines averages about 60 inches of precipitation per year; and approximately 133 inches of snow. The groundwater sources underlying the area are recharged through the infiltration of precipitation and surface water. Groundwater sources in the region generally occur in the fractured bedrock and unconsolidated sediments deposited by glaciers and/or rivers. The elevation for the 33 Mile Roadhouse public water system is approximately 150 feet above mean sea level.

According to a Sanitary Survey dated December 24, 1999, there is one well that was installed July 1992. This well consists of 6-inch diameter casing and is 150 feet below ground surface. The well screen is 6 feet.

The Sanitary Survey indicates that the well is located at the base of a steep hill and is not suitable for future development. Although a well log was not available for review, the Sanitary Survey indicates the well is not grouted to ADEC standards. Proper grouting provides added protection against contaminants traveling along the well casing and into source waters.

This system operates year round, and serves approximately 2 residents and 25 non-residents through the service connection.

33 MILE ROADHOUSE DRINKING WATER PROTECTION AREA

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the area that contributes water to the well, the groundwater recharge area. This area is designated as the Drinking Water Protection Area (DWPA). Because releases of contaminants within the DWPA are most likely to impact the drinking water well, this area will serve as the focus for voluntary protection efforts. An analytical calculation was used to determine the size and shape of the DWPA. The input parameters describing the attribute of the aquifer in this calculation were adopted from the U.S. Geological Survey (Patrick, Brabets, and Glass, 1989), and State of Alaska Department of Water Resources (Jokela, et. al., 1991). Additional methods were also used to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at a meaningful DPWA (Please refer to the Guidance Manual for Class B Public Water Systems for additional information).

The DWPAs established for wells by the ADEC are usually separated into four zones. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well.

The TOT for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the four protection area zones for wells and the calculated time-of-travel for each:

Table 1. Definition of Zones

Zone	Definition
A	¹ / ₄ the distance for the 2-yr. time-of-travel
В	Less than the 2 year time-of-travel
C	Less Than the 5 year time-of-travel
D	Less than the 10 year time-of-travel

The DWPA for 33 Mile Roadhouse extends due north of the well. Because the upland groundwater system may include fractured bedrock, the TOT may be more rapid than predicted. For this reason, the zones related to TOT have been expanded at the upland base. There is no development in the vicinity of the well (See Map 1 of Appendix A).

INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the 33 Mile Roadhouse DWPA. This inventory was completed through a search of agency records and other publicly-available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class B public water system assessments, three categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses:
- Nitrates and/or nitrites;
- Volatile organic chemicals

RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a

"potential" or "existing" source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

- Low;
- Medium:
- High; and
- Very High.

The TOT for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. Bacteria and Viruses are only inventoried in Zones A and B because of their short life span. Only "Very High" and "High" rankings are inventoried within the outer Zone D due to the probability of contaminant dilution by the time the contaminants get to the well.

VULNERABILITY OF 33 MILE ROADHOUSE DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility; and
- Contaminant risks.

Appendix B contains eight charts, which together form the 'Vulnerability Analysis' for a source water assessment for a public drinking water source. Chart 1 analyzes the 'Susceptibility of the Wellhead' to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the 'Susceptibility of the Aquifer' to contamination by looking at the naturally occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes 'Contaminant Risks' for the drinking water source with respect to bacteria and viruses. The 'Contaminant Risks' portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the well. Lastly, Chart 4 contains the 'Vulnerability Analysis for Bacteria and Viruses'. Charts 5 through 8 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites and volatile organic chemicals, respectively.

A score for the Natural Susceptibility is reached by considering the properties of the well and the aquifer.

Susceptibility of the Wellhead (0 – 25 Points) (Chart 1 of Appendix B)

Susceptibility of the Aquifer (0 – 25 Points) (Chart 2 of Appendix B)

Natural Susceptibility (Susceptibility of the Well) (0-50 Points)

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings

40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

The well for 33 Mile Roadhouse is completed in an unconfined aquifer. Because unconfined aquifers are recharged by surface water and precipitation that migrates downward from the surface, contaminants at the surface have the potential to adversely impact this aquifer. Table 2 shows the Susceptibility scores and ratings for 33 Mile Roadhouse

Table 2. Susceptibility

	Score	Rating
Susceptibility of the		
Wellhead	5	Low
Susceptibility of the		
Aquifer	11	Medium
Natural Susceptibility	16	Low

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. This score has been derived from an examination of existing and historical contamination that has been detected at the drinking water source through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings

40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

Table 3. Contaminant Risks

Category	Score	Rating
Bacteria and Viruses	0	Low
Nitrates and/or Nitrites	0	Low
Volatile Organic Chemicals	0	Low

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

Natural Susceptibility (0 – 50 points)
$$+$$
 Contaminant Risks (0 – 50 points)

Vulnerability of the Drinking Water Source to Contamination (0 – 100).

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings

80 to 100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores (0 - 100) and ratings for each of the three categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

Table 4. Overall Vulnerability

Category	Score	Rating
Bacteria and Viruses	20	Low
Nitrates and Nitrites	20	Low
Volatile Organic Chemicals	20	Low

Bacteria and Viruses

The contaminant risk for bacteria and viruses is **Low** (See Chart 3 – Contaminant Risks for Bacteria and Viruses in Appendix B).

Only a small amount of bacteria and viruses are required to endanger public health. Bacteria and viruses sampling data indicated there were no recent sample results. Combining the contaminant risks with the overall natural susceptibility of the well, the vulnerability of the well to contamination by bacteria and viruses is **Low**.

Nitrates and Nitrites

The contaminant risk for nitrates and nitrites is **Low** (See Chart 5 - Contaminant Risks for Nitrates and/or Nitrites in Appendix B).

Sampling history indicates that nitrates have not been detected in the water. Due to the high solubility and weak retention by soil, nitrates are very mobile, moving at approximately the same rate as water.

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to contamination by nitrates and nitrites is **Low**.

Volatile Organic Chemicals

The contaminant risk for volatile organic chemicals is **Low** (See Chart 7 – Contaminant Risks for Volatile Organic Chemicals in Appendix B).


There are no recent sample data available for the drinking water at 33 Mile Roadhouse for volatile organic chemicals. Combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination by volatile organic chemicals is **Low**.

REFERENCES

- Alaska Department of Community and Economic Development (ADCED), 2002 [WWW document]. URL http://www.dced.state.ak.us/mra/CF_BLOCK.cfm.
- Alaska Geospatial Data Clearinghouse, 2003. URL: http://agdc.usgs.gov/data/datasets.html.
- Gehrels, G.E., Berg, H.C., Geologic Map of Southeastern Alaska: U.S. Geological Survey Map (scale 1:600,000), Map I-1867, 1sheet.
- Jokela, J.B., Munter, J.A., and Evans, J.G., 1991, Ground-water resources of the Palmer-Big Lake area, Alaska: a conceptual model. Division of Geological &Geophysical Surveys Reports of Investigations 90-4, State of Alaska Department of Natural Resources, Fairbanks, AK.
- King, P.B., compiler, 1969, Tectonic map of North America: US Geological Survey Map, (scale 1:5,000,000) 2 sheets.
- Patrick, L.D., Brabets, T.P., and Glass, R.L., 1989, Simulation of ground-water flow at Anchorage, Alaska: US Geological Survey Water-Resources Investigations Report 88-4139, 41p.
- United States Environmental Protection Agency (EPA), 2002 [WWW document]. URL: http://www.epa.gov/safewater/mcl.html.

APPENDIX A

33 Mile Roadhouse Drinking Water Protection Area Location Map (Map 1)

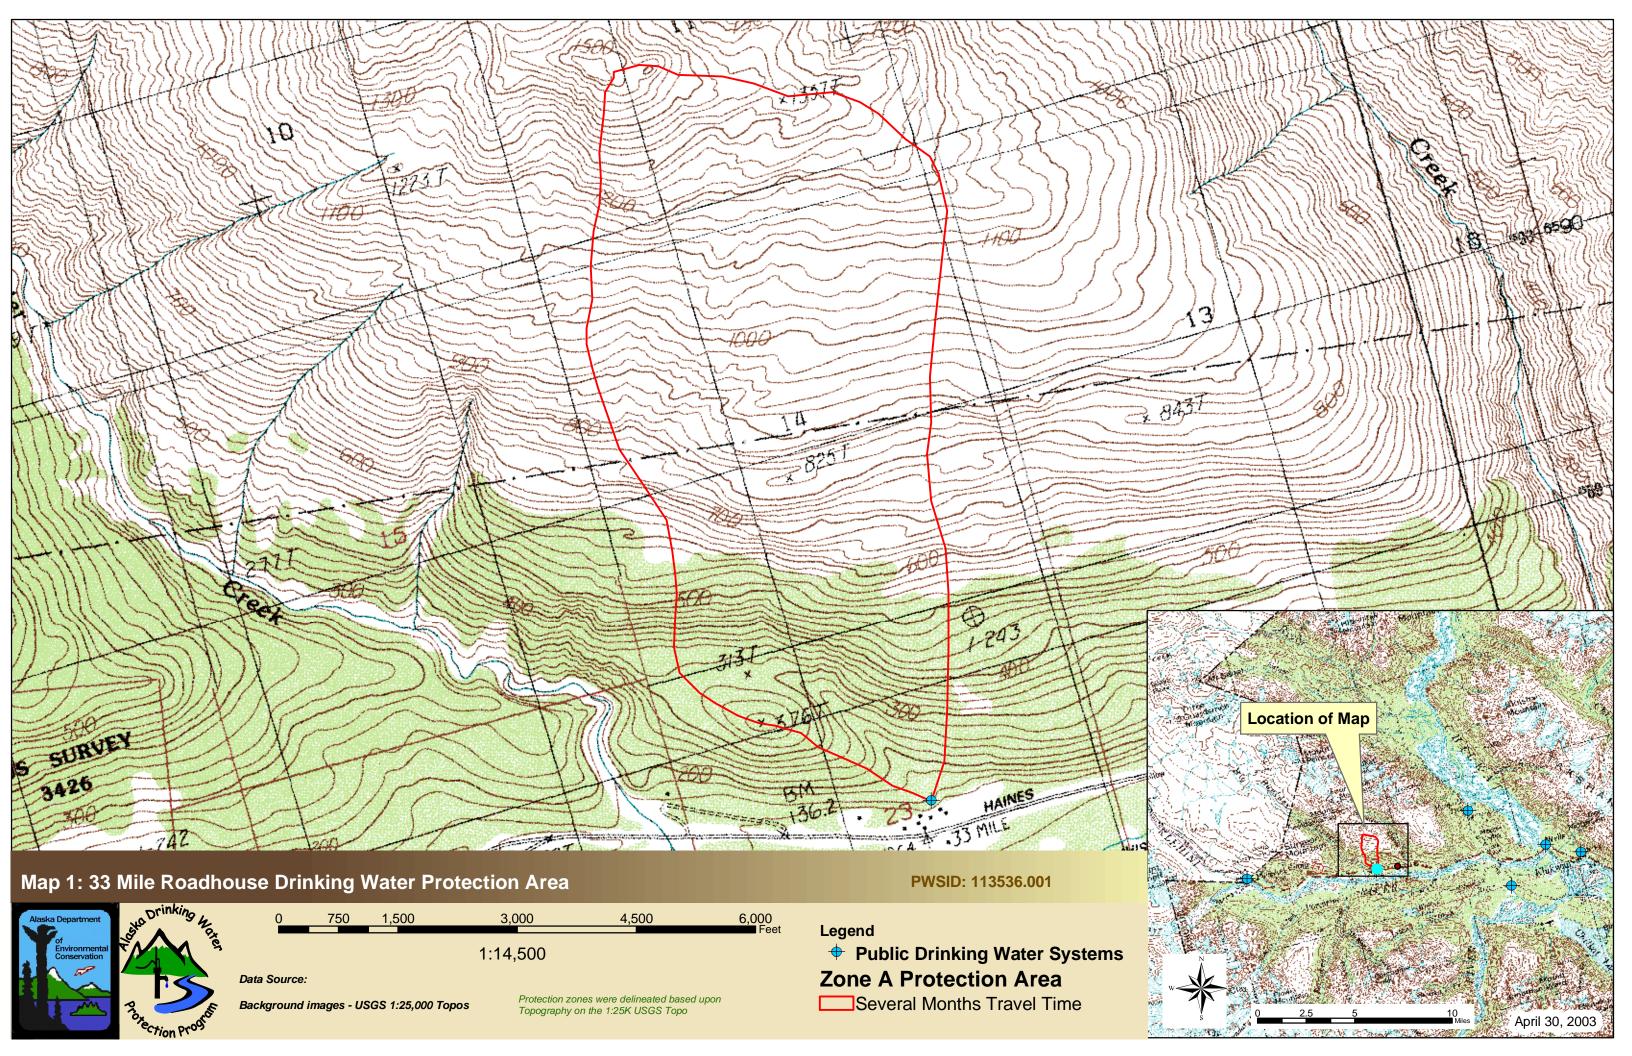

APPENDIX B

Vulnerability Analysis for 33 Mile Roadhouse Public Drinking Water Source (Charts 1-8)

APPENDIX C

Vulnerability Analysis for 33 Mile Roadhouse Public Drinking Water Source (Charts 1-8)

Chart 1. Susceptibility of the wellhead - 33 Mile Roadhouse

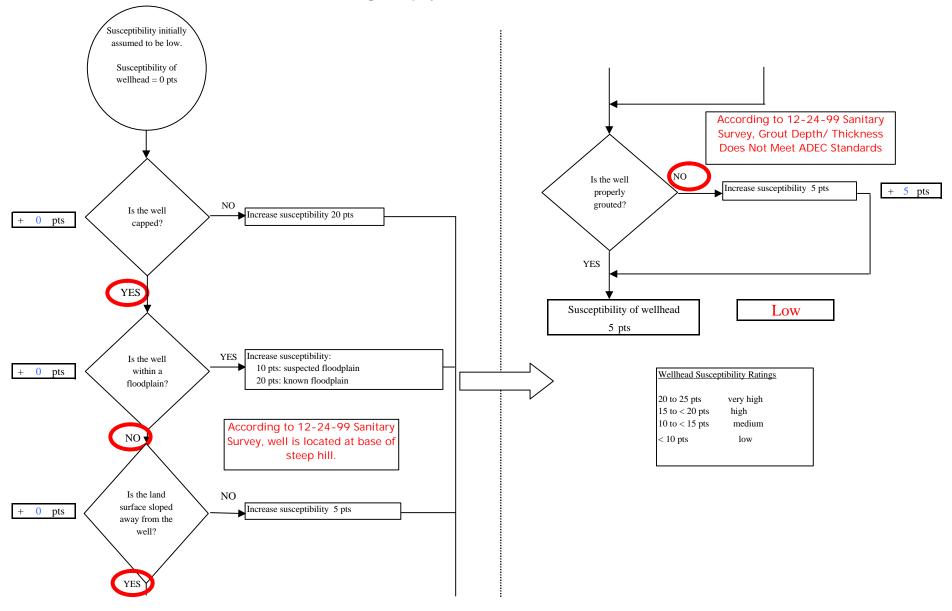
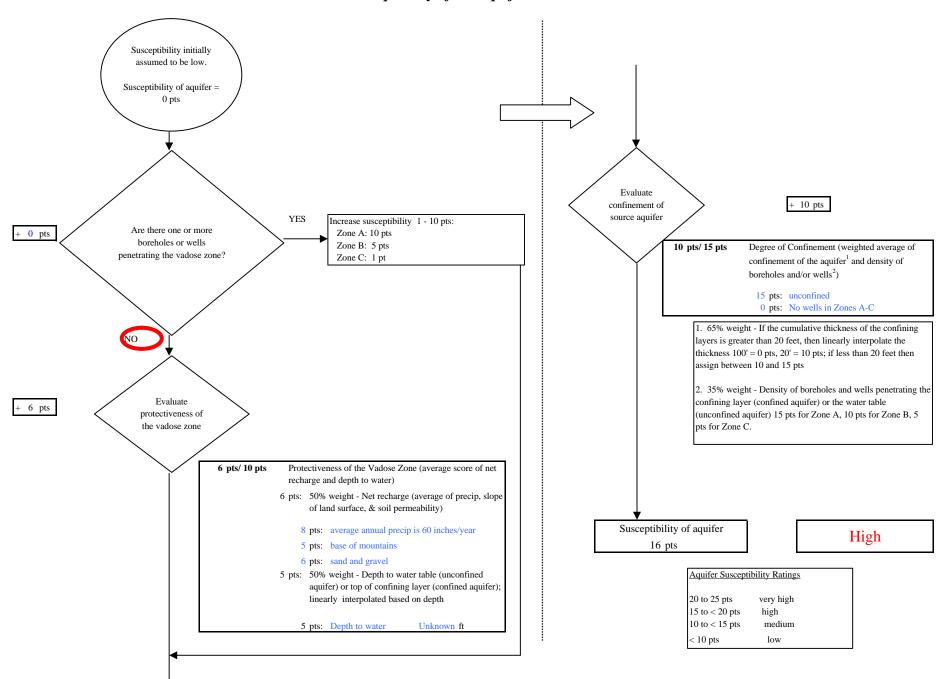
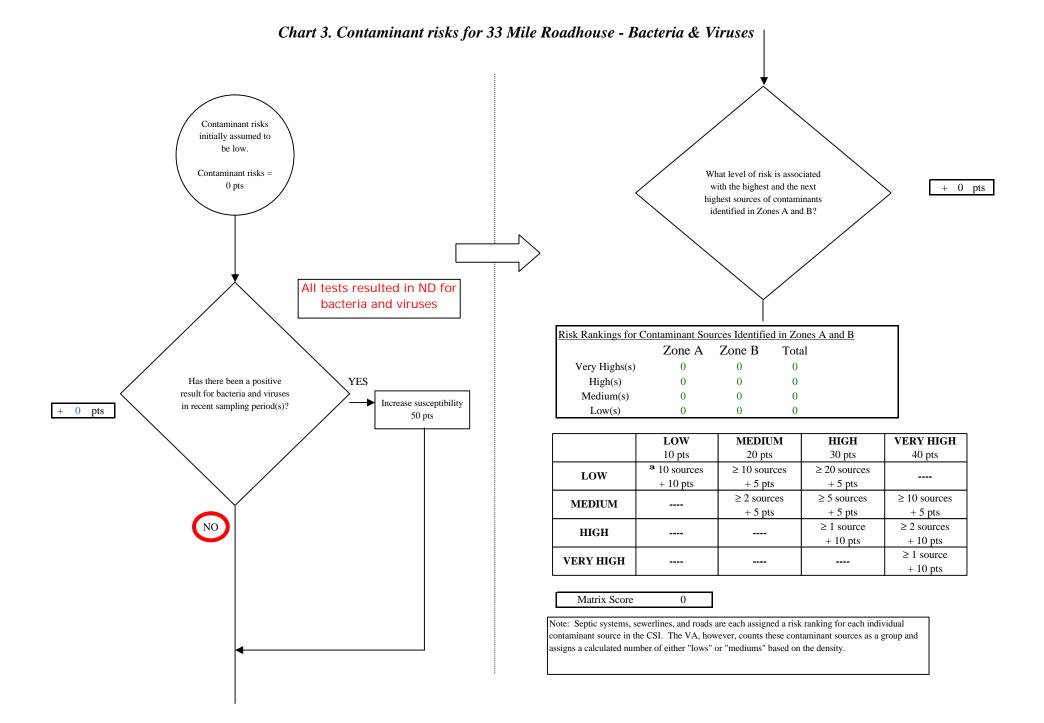
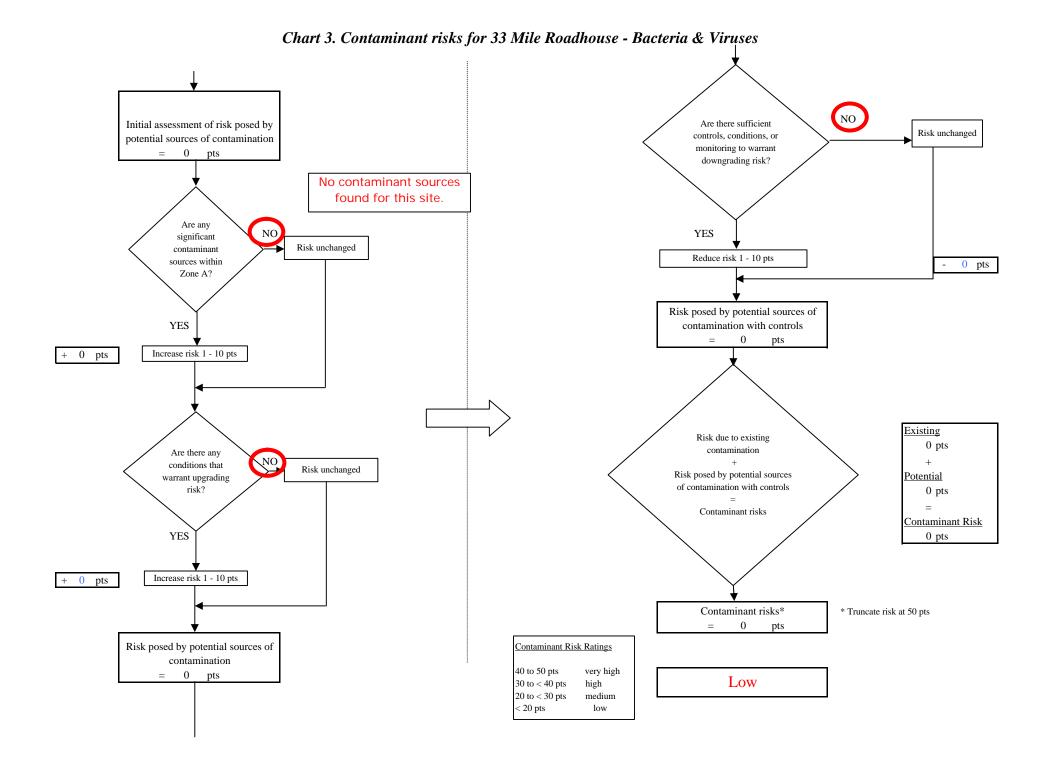
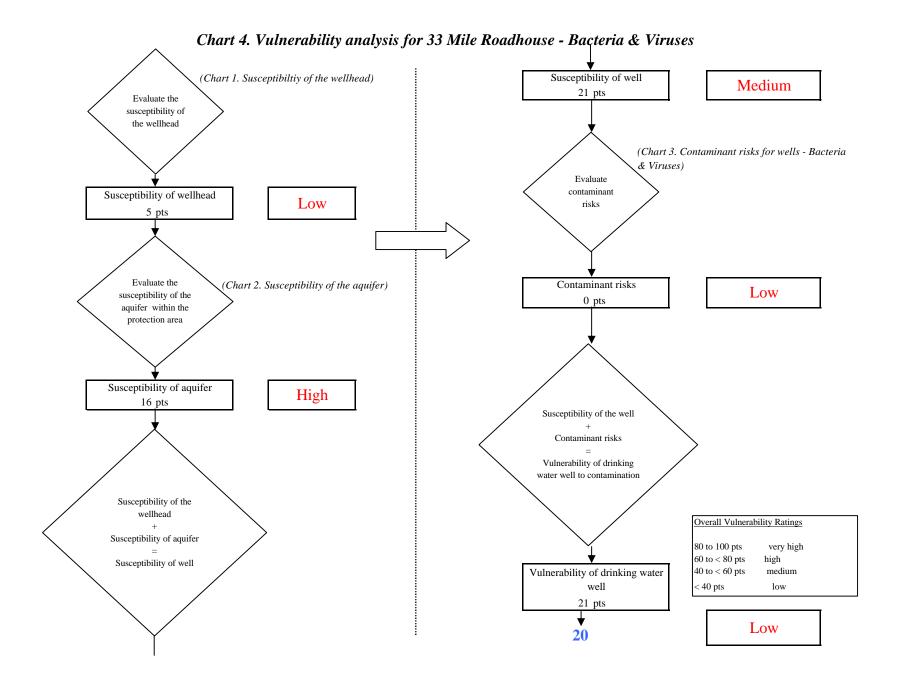


Chart 2. Susceptibility of the aquifer - 33 Mile Roadhouse










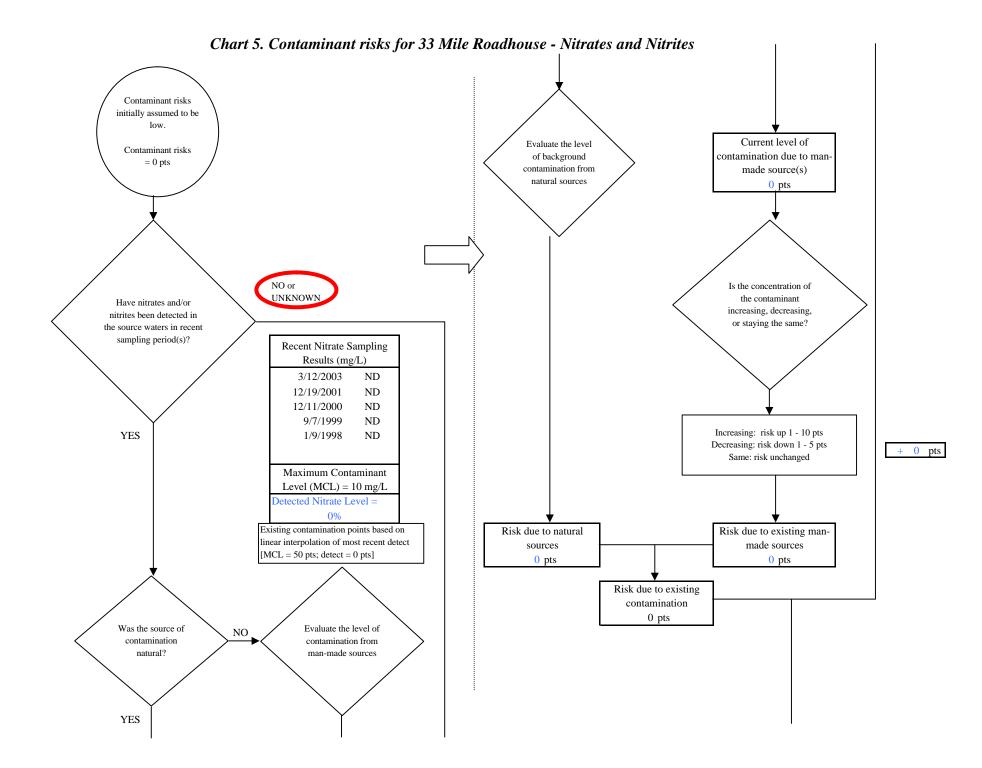


Chart 5. Contaminant risks for 33 Mile Roadhouse - Nitrates and Nitrites

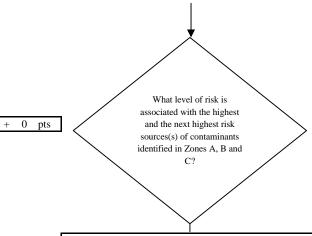



Risk Levels for Contaminant Sources identified in Zones A, B and C				
	Zone A	Zones B&C	Total	
Very Highs(s)	0	0	0	
High(s)	0	0	0	
Medium(s)	0	0	0	
Low(s)	0	0	0	


	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	* 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	
MEDIUM		≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH			≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH				≥ 1 source + 10 pts

Matrix Score 0	Matrix Score	0
----------------	--------------	---

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

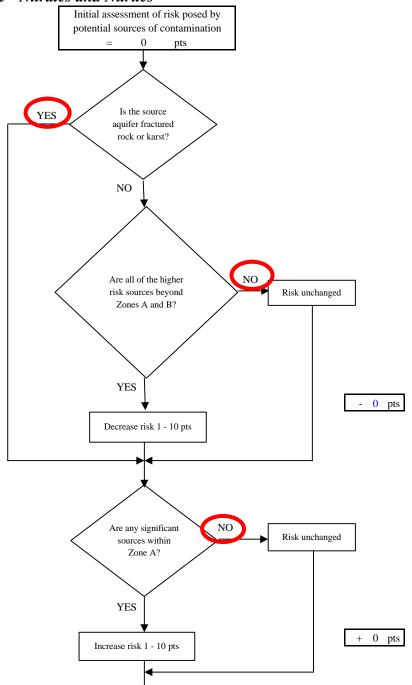

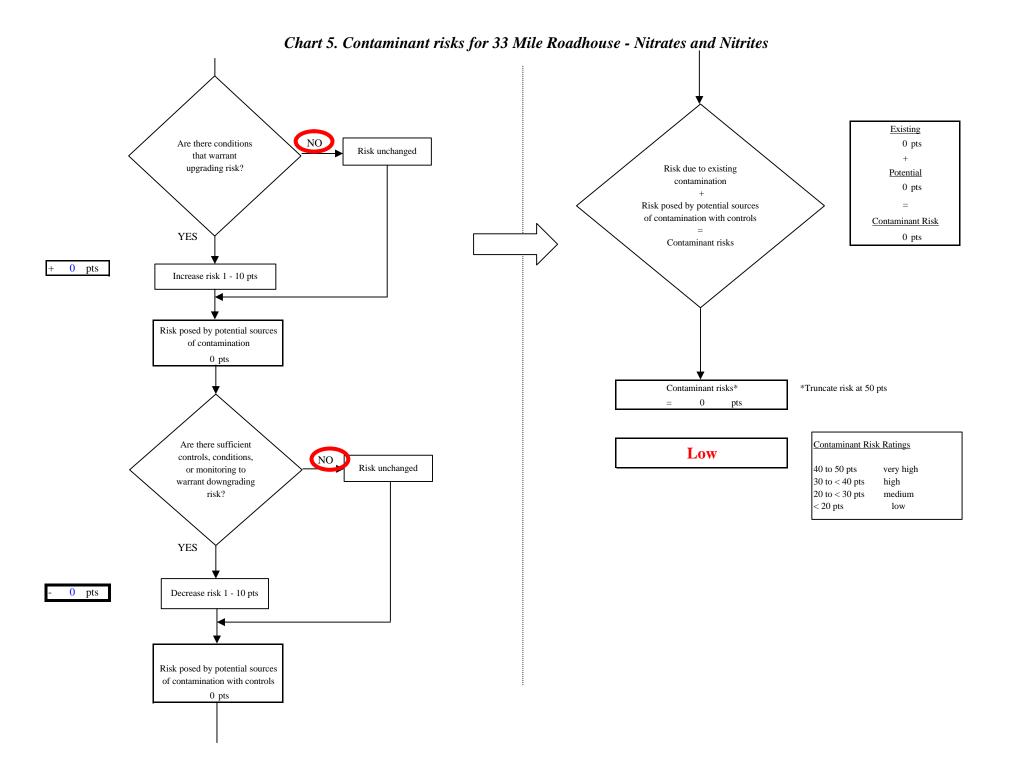

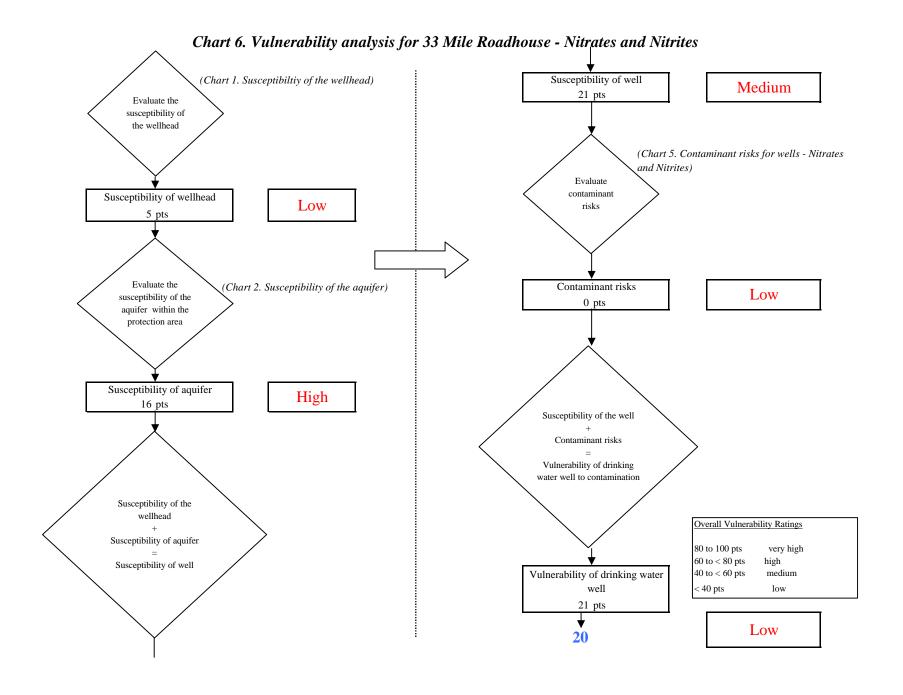


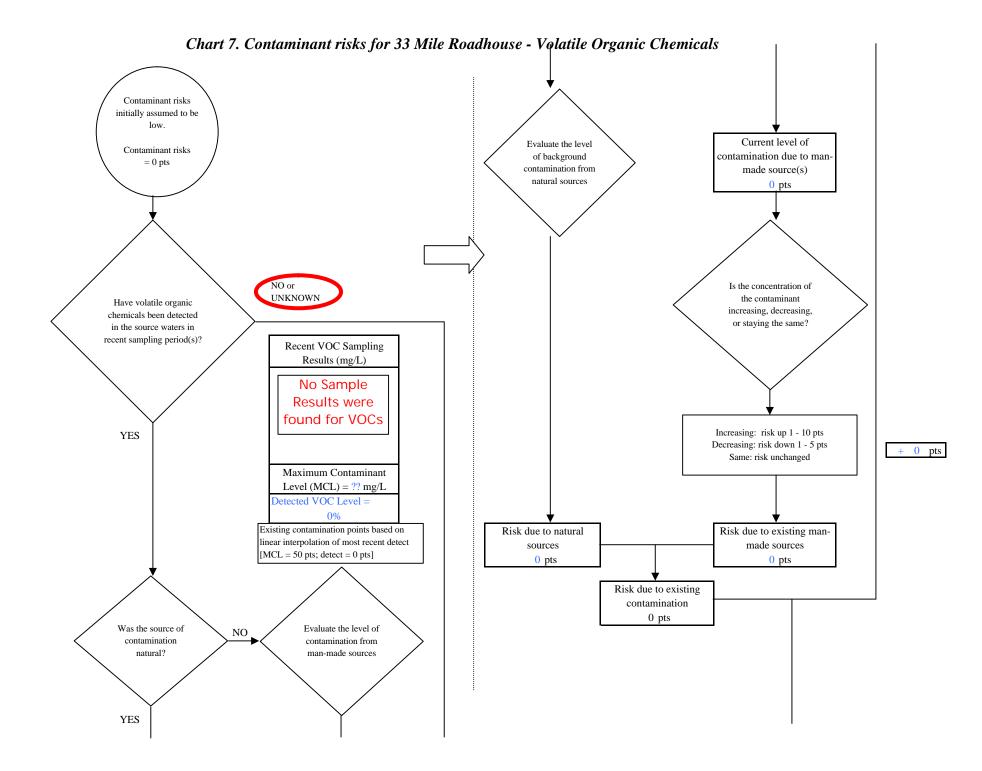


Chart 7. Contaminant risks for 33 Mile Roadhouse - Volatile Organic Chemicals

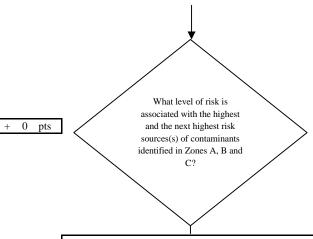

Risk Levels for Contaminant Sources identified in Zones A, B and C				
	Zone A	Zones B&C	Total	
Very Highs(s)	0	0	0	
High(s)	0	0	0	
Medium(s)	0	0	0	
Low(s)	0	0	0	

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	* 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	
MEDIUM		≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH			≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH				≥ 1 source + 10 pts

Matrix Score	0
Matrix Score	0

Note: Septic systems, sewerlines, and roads are each assigned a risk ranking for each individual contaminant source in the CSI. The VA, however, counts these contaminant sources as a group and assigns a calculated number of either "lows" or "mediums" based on the density.

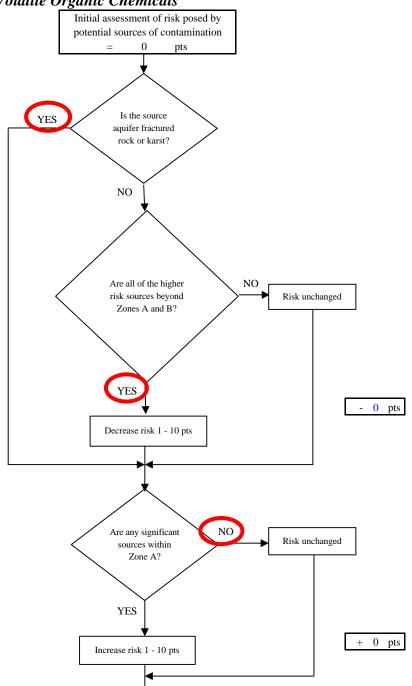


Chart 7. Contaminant risks for 33 Mile Roadhouse - Volatile Organic Chemicals Existing NO Are there conditions 0 pts Risk unchanged that warrant upgrading risk? Risk due to existing Potential contamination 0 pts Risk posed by potential sources of contamination with controls Contaminant Risk YES 0 pts Contaminant risks 0 pts Increase risk 1 - 10 pts Risk posed by potential sources of contamination 0 pts Contaminant risks* *Truncate risk at 50 pts 0 Are there sufficient Contaminant Risk Ratings Low controls, conditions, NO Risk unchanged 40 to 50 pts or monitoring to very high 30 to < 40 pts warrant downgrading high risk? 20 to < 30 pts medium < 20 pts low YES 0 pts Decrease risk 1 - 10 pts Risk posed by potential sources of contamination with controls

0 pts

