



# **Source Water Assessment**

A Hydrogeologic Susceptibility and Vulnerability Assessment for the Community of Point Hope

Point Hope, Alaska

PWSID # 320426.001

September 2004

Drinking Water Protection Program Report #1263 Alaska Department of Environmental Conservation

# Source Water Assessment for the Community of Point Hope

Point Hope, Alaska

PWSID# 320426.001

September 2004

Drinking Water Protection Program Report #1263

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

## **CONTENTS**

			Page		
SECTION  Executive Summary Drinking Water System And Area Overview Point Hope Drinking Water Protection Area Inventory of Potential and Existing Contaminant Sources Ranking of Contaminant Risks Vulnerability of the Drinking Water System References					
		TABLES			
TABLE	<ol> <li>Definition of Zones</li> <li>Susceptibility of the Water Source</li> <li>Point Hope Contaminant Risks</li> <li>Point Hope Overall Vulnerability</li> </ol>				
		APPENDICES			
APPENDIX	A.	Point Hope Drinking Water Protection Area (Map 1)			
	B.	Contaminant Source Inventory and Risk Rankings (Tables 1 - 5)			
	C.	Point Hope Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map 2)			
	D.	Vulnerability Analysis and Contaminant Risks (Charts $1-13$ )			

## Source Water Assessment for the Community of Point Hope Water System

# **Drinking Water Protection Program Alaska Department of Environmental Conservation**

#### EXECUTIVE SUMMARY

The Point Hope water system is a Class A (community) water system that obtains water from 7-Mile Lake. The intake is located approximately 7-miles east of Point Hope and is accessible via gravel road. Access to the reservoir area is not restricted. The overall protection area is approximately 8 square miles in size and received a susceptibility rating of "high". A rating of high to very high is typical for all systems with surface water intakes. Potential and existing sources of the following contaminants were evaluated for the Source Water Assessment: bacteria and viruses, nitrates and/or nitrites, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, volatile organic chemicals, and other organic chemicals. snowmachine activity was identified as a potential source of contaminants for the drinking water source. This evaluation included all available water sampling data submitted to ADEC by the system operator. The samples may have been collected from either raw water or post-treated water. Combining the susceptibility of the surface water source with the contaminant risks, this water system has received a vulnerability rating of "low" for synthetic organic chemicals and other organic chemicals; and "medium" for bacteria and viruses, nitrates and nitrites, heavy metals, and volatile organic chemicals. This assessment can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of Point Hope to protect public health.

## DRINKING WATER SYSTEM AND AREA OVERVIEW

Point Hope (Sec. 16, T034N, R035W, Kateel River Meridian) is located near the tip of Point Hope peninsula, a large gravel spit that forms the westernmost extension of the northwest Alaska coast, 330 miles southwest of Barrow (Please see the inset of Map 1 in Appendix A for location). The current population of Point Hope is approximately 709 (ADCED, 2003). The Point Hope water system is a Class A (community) water system that serves the residential. The intake is located at 7-Mile Lake approximately 7-miles east of Point Hope and is accessible via gravel road. (See Map 1 of Appendix A).

The climate is arctic. Temperatures range from -49 to 78. Precipitation is light, 10 inches annually, with snowfall of 36 inches. The Chukchi Sea is ice-free from late June until mid-September (ADCED, 2003).

The 1998 Sanitary Survey indicates that the intake is screened, maintained and is inspected regularly. The survey estimates the system's average daily output to be 144,000-gallons. No volume information for 7-Mile Lake was provided by the operator.

# POINT HOPE DRINKING WATER PROTECTION AREA

Identifying the pathways most likely for surface contamination to reach water intake areas is the first step in determining the water system's risk. These are initially determined by looking at the drainage area contributing overland water flow to a surface water source intake. The entire drainage area is also known as the "drinking water protection area". Please refer to pages 10-11of the "Guidance Manual for Class A Public Water Systems" for additional information.

The protection area established for surface water sources by the ADEC is usually separated into three zones, limited by the watershed boundary. These zones correspond to the overland-flow distance that water travels to get to the source. The ADEC Drinking Water Protection Program's Technical Advisory Committee developed guidelines for derivation of these zones in 1998. The following is a summary of the three protection area zones:

Table 1. Definition of Zones

Zone	Definition
A	Areas within 1000-ft of lakes or streams
В	Areas within 1-mile of lakes or streams
C	The watershed boundary
C	The watershed boundary

The protection area for the Point Hope water intake includes each of these Zones, although, due to the size of the watershed, Zones B and C cover the same area (See Map 1 of Appendix A).

## INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the Point Hope protection area. This inventory was completed through a search of agency records and other publicly available information. There is a wide array of potential contamination sources to surface water. These contaminants are found within agricultural, residential, commercial, and industrial areas, but *can also occur within areas that have little or no development*.

For Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses:
- Nitrates and/or nitrites;
- Volatile organic chemicals;
- Heavy metals, cyanide, and other inorganic chemicals;
- Synthetic Organic Chemicals; and
- Other Organic Chemicals.

Sources identified in the Point Hope protection area are displayed on Map 2 of Appendix C and summarized in Table 1 of Appendix B.

### RANKING OF CONTAMINANT RISKS

Once potential and existing sources of contamination have been identified, they are assigned a ranking according to what category and level of risk they represent. Ranking of contaminant risks for "potential" or "existing" sources of contamination is a function of the toxicity and the volume of specific contaminants associated with that source. Rankings include:

Low;Medium;High; andVery High.

The time-of-travel for contaminants within the water is dependent on the physical and chemical characteristics of each contaminant. Bacteria and Viruses are only inventoried in Zone A because of their short life span. Only "Very High" and "High" rankings are inventoried within Zones B and C due to the probability of contaminant dilution by the time the contaminants reach the water intake.

The remaining tables in Appendix B (if necessary) contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses,

nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide, and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals.

# VULNERABILITY OF THE DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Surface Water Susceptibility; and
- Contaminant risks.

Appendix D contains 13 charts, which together form the 'Vulnerability Analysis' for the public drinking water Source Water Assessment. Chart 1 analyzes the 'Susceptibility of the Surface Water Source' to contamination by looking at the climate, terrain, and intake location. Chart 2 analyzes 'Contaminant Risks' for the drinking water source with respect to bacteria and viruses. The 'Contaminant Risks' portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the intake area. Chart 3 contains the 'Vulnerability Analysis for Bacteria and Viruses', which is a composite score of the Vulnerability Analysis and the overall Susceptibility. Charts 4 through 13 repeat the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, evanide, and other inorganic chemicals. synthetic organic chemicals, and other organic chemicals, respectively.

A score for the Surface Water Susceptibility of the source is reached by considering the properties of the water intake and the surrounding area. The derivation of this information is presented below and the data for this source is shown in Chart 1 of Appendix D.

Susceptibility of the Surface Water Source – always considered to be "high" (30 points)

+

Adequate Construction of the Intake (0-5 Points)

+

Runoff Potential Within Zone B (0 - 5 Points)

+

Dilution Capacity of the Surface Water (0 - 10 Points)

=

Natural Susceptibility (0 – 50 Points)

A ranking is assigned for the Surface Water Susceptibility according to the point score:

Surface Water Source Susceptibility Ratings

40 to 50 pts Very High
30 to < 40 pts High

Table 2. Susceptibility of the Water Source

	Score	Rating
Minimum Allowable	30	
Susceptibility		
Intake Construction	0	
Adequate		
Runoff Potential	0	
Dilution Capacity	5	
Overall Susceptibility	35	High

For contaminants, risks to a drinking water source depend on the type, number or density, and distribution of the contaminant sources. The Contaminant Risk score has been derived from an examination of existing, and historical contamination sources that have been detected in the protection area through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as the susceptibility:

Contaminant Risk Ratings					
40 to 50 pts	Very High				
30 to < 40 pts	High				
20 to < 30 pts	Medium				
< 20 pts	Low				

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

**Table 3. Point Hope Contaminant Risks** 

Category	Score	Rating
Bacteria and Viruses	12	Low
Nitrates and/or Nitrites	14	Low
Volatile Organic Chemicals	12	Low
Heavy Metals, Cyanide, and		
Other Inorganic Chemicals	12	Low
Synthetic Organic Chemicals	0	Low
Other Organic Chemicals	0	Low

Finally, an overall vulnerability score is assigned for each contaminant type by combining each of the contaminant risk scores with the susceptibility score:

Susceptibility of the Surface Water Source

$$(0-50 \text{ points})$$

+

Contaminant Risks (0 - 50 points)

=

Vulnerability of the Drinking Water Source to Contamination (0 - 100).

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings						
80 to 100 pts	Very High					
60 to < 80 pts	High					
40 to < 60 pts	Medium					
< 40 pts	Low					

Table 4 contains the overall vulnerability scores and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

Table 4. Point Hope Overall Vulnerability

Score	Rating
45	Medium
45	Medium
45	Medium
45	Medium
35	Low
35	Low
	45 45 45 45 45 35

### **Bacteria and Viruses**

The contaminant risk for bacteria and viruses is "low". Typically, coliform detection in raw water samples collected from surface water sources is normal. (See Chart 2 – Contaminant Risks for Bacteria and Viruses in Appendix D).

Coliforms (a bacteria) are found naturally in the environment and although they aren't necessarily a health threat, they are an indicator of other potentially harmful bacteria in the water, more specifically, fecal coliforms and E. coli which only come from human and animal fecal waste. Harmful bacteria can cause diarrhea, cramps, nausea, headaches, or other symptoms

(EPA, 2003). Positive samples increase the overall vulnerability of the drinking water source, indicating that the source is susceptible to bacteria and virus contamination.

No positive bacteria counts have been detected in recent sampling.

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the source, the overall vulnerability of the source to bacteria and virus contamination is "medium".

#### **Nitrates and Nitrites**

The contaminant risk for nitrates and nitrites is "low" (See Chart 4 - Contaminant Risks for Nitrates and/or Nitrites in Appendix D). Nitrates are very mobile, moving at approximately the same rate as water.

Sampling history for the water source indicates that nitrates have been detected at levels below the MCL in samples collected in 1998 through 2002. The Maximum Contaminant Level (MCL) for nitrates is 10 milligrams per liter (mg/L). The MCL is the maximum level of contaminant that is allowed to exist in drinking water and still be consumed by humans without harmful health effects (EPA, 2003).

Possible sources of nitrates/nitrites could be from human/animal activity along roads, ATV trails, or snowmachine trails located within the protection area.

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the source, the overall vulnerability of the source to contamination is "medium".

#### **Volatile Organic Chemicals**

The contaminant risk for volatile organic chemicals is "low" (See Chart 6 – Contaminant Risks for Volatile Organic Chemicals in Appendix D).

Chloroform and trihalomethanes were detected at levels below the MCL during sampling in 2002-2003, although both of these chemicals typically originate during the process of water treatment and not from the source waters. The MCL for chloroform is 0.2 milligrams per liter (mg/L) and the MCL for total trihalomethanes is 0.1 mg/L.

Possible sources of volatile organic chemicals could be from human/animal activity along roads, ATV trails, or snowmachine trails or from fuel storage tanks located within the protection area. After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the source, the overall vulnerability of the source to contamination is "medium".

#### Heavy Metals, Cyanide, and Other Inorganic Chemicals

The contaminant risk for heavy metals is "low". Copper was detected in samples collected during 2002, although in levels below the MCL (See Chart 8 – Contaminant Risks for Heavy Metals, Cyanide, and Other Inorganic Chemicals in Appendix D). The MCL for copper is 1.3 mg/l. and the MCL for lead is 0.015 mg/l.

The most common source of these chemicals is the infrastructure of the distribution system following the treatment process and not from the source waters. Additional sources of heavy metals could be from activity along roads, ATV trails, or snowmachine trails or from fuel storage tanks located within the protection area.

After combining the contaminant risk for heavy metals with the natural susceptibility of the source, the overall vulnerability of the well to contamination is "medium".

### **Synthetic Organic Chemicals**

The contaminant risk for synthetic organic chemicals is "low". After combining the contaminant risk with the natural susceptibility of the source, the overall vulnerability to synthetic organic chemicals of the source is "low" (See Chart 11 – Contaminant Risks for Synthetic Organic Chemicals in Appendix D).

Review of the historical sampling data indicates that test results for ethylene dibromide in 2002 were negative.

## **Other Organic Chemicals**

The contaminant risk for other organic chemicals is "low". After combining the contaminant risk with the natural susceptibility of the source, the overall vulnerability to other organic chemicals of the source is "low" (See Chart 13 – Contaminant Risks for Other Organic Chemicals in Appendix D).

A possible source of other organic chemicals could be from activity along roads within the protection area.

Review of the historical sampling data indicates that no other organic chemicals have been sampled recently.

## **Using the Source Water Assessment**

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of Point Hope and the North Slope Borough to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of the drinking water source.


## **REFERENCES**

 $A lask a \ Department \ of \ Community \ and \ Economic \ Development \ (ADCED), \ 2003 \ [WWW \ document]. \ URL \ http://www.dced.state.ak.us/cbd/commdb/CF\_COMDB.htm$ 

United States Environmental Protection Agency (EPA), 2003 [WWW document]. URL http://www.epa.gov/safewater/mcl.html.

## **APPENDIX A**

Point Hope
Drinking Water Protection Area Location Map
(Map 1)

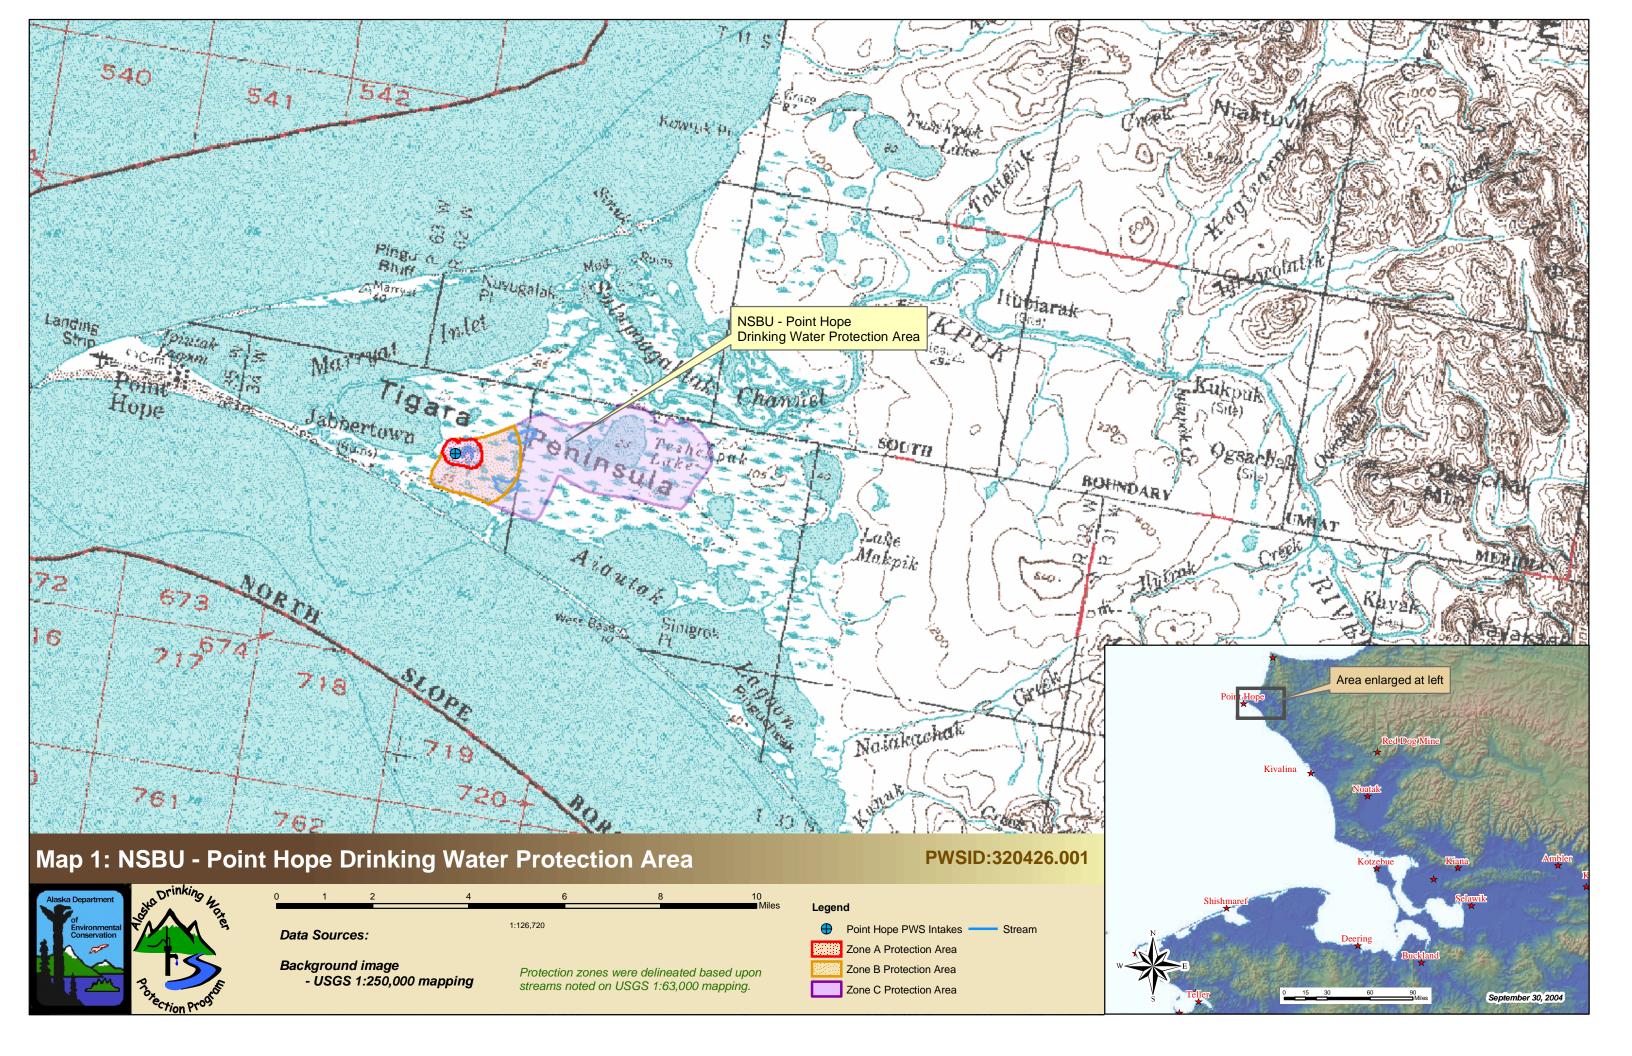

## APPENDIX B

Contaminant Source Inventory and Risk Rankings (Tables 1 - 5)

## Contaminant Source Inventory for NSBU - Point Hope

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Map Number	Comments
ATV / Dogsled / Snowmachine Trails	X33	X33 - 1	A	2	1998 Sanitary Survey

## Contaminant Source Inventory and Risk Ranking for NSBU - Point Hope Sources of Bacteria and Viruses

PWSID 320426.001

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
ATV / Dogsled / Snowmachine Trails	X33	X33 - 1	A	Low	2	1998 Sanitary Survey

## Contaminant Source Inventory and Risk Ranking for NSBU - Point Hope Sources of Nitrates/Nitrites

PWSID 320426.001

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
ATV / Dogsled / Snowmachine Trails	X33	X33 - 1	A	Low	2	1998 Sanitary Survey

# Contaminant Source Inventory and Risk Ranking for NSBU - Point Hope

PWSID 320426.001

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
ATV / Dogsled / Snowmachine Trails	X33	X33 - 1	A	Low	2	1998 Sanitary Survey

# Contaminant Source Inventory and Risk Ranking for NSBU - Point Hope


PWSID 320426.001

## Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
ATV / Dogsled / Snowmachine Trails	X33	X33 - 1	A	Low	2	1998 Sanitary Survey

## **APPENDIX C**

Point Hope
Drinking Water Protection Area
and Potential and Existing Contaminant Sources
(Map 2)

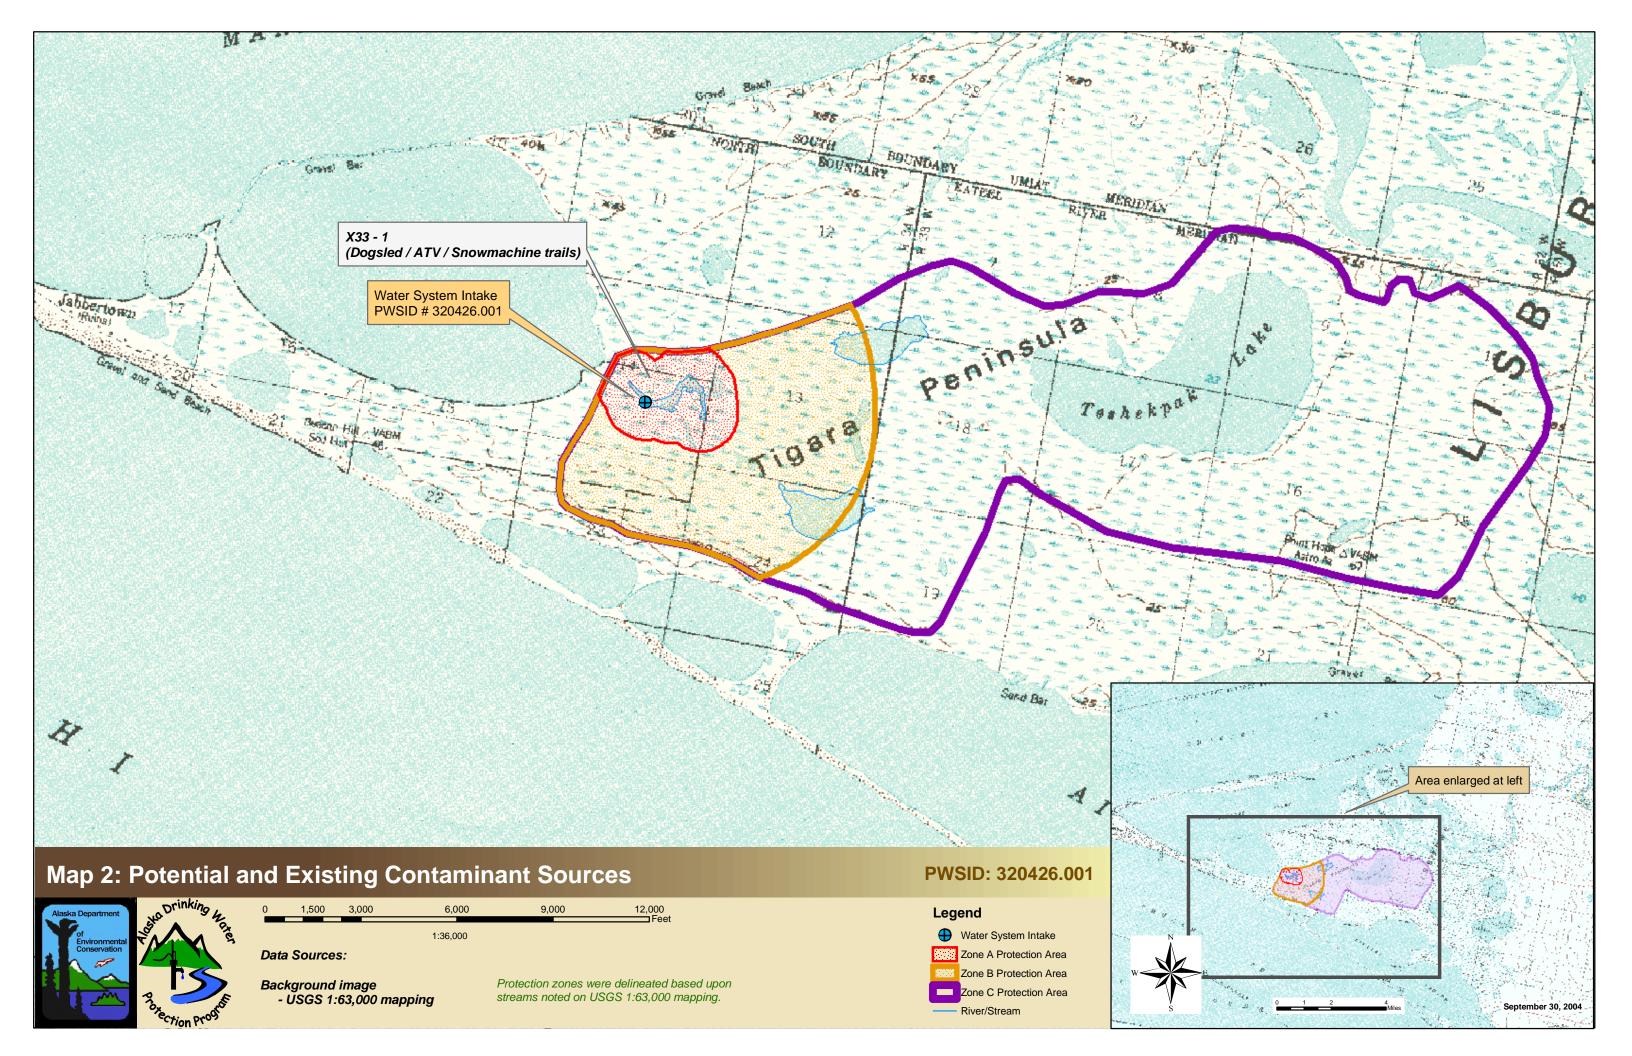

## APPENDIX D

# **Vulnerability Analysis and Contaminant Risks** (Charts 1-13)



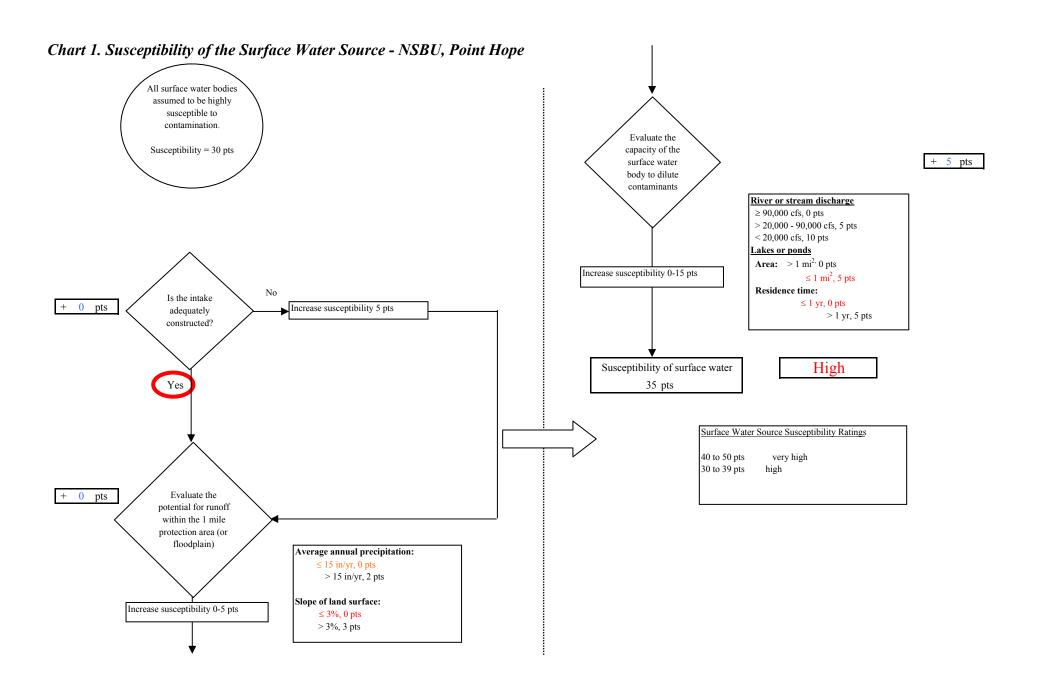



Chart 2. Contaminant risks for NSBU, Point Hope - Bacteria & Viruses

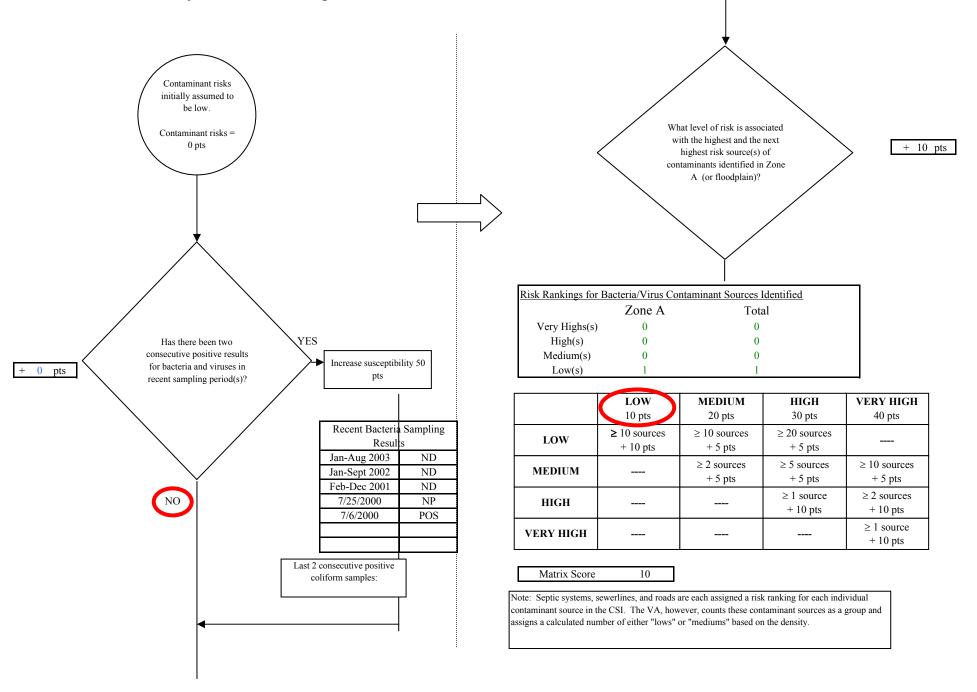


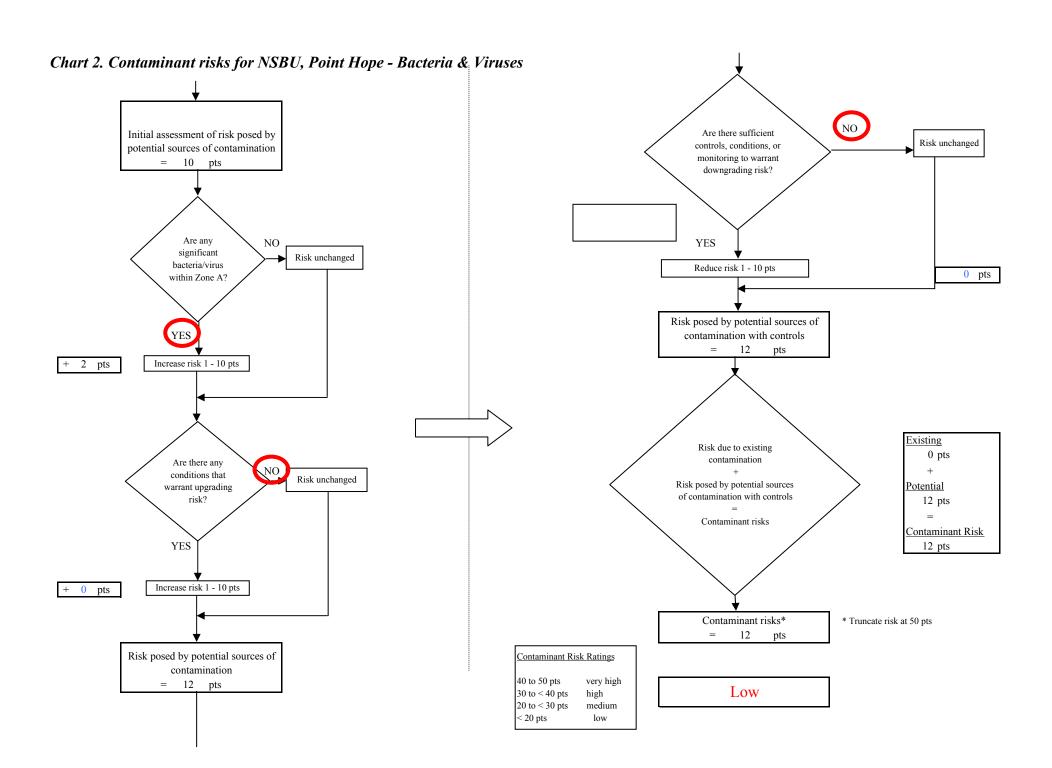

Page 3 of 24


Chart 3. Vulnerability analysis for NSBU, Point Hope - Bacteria & Viruses

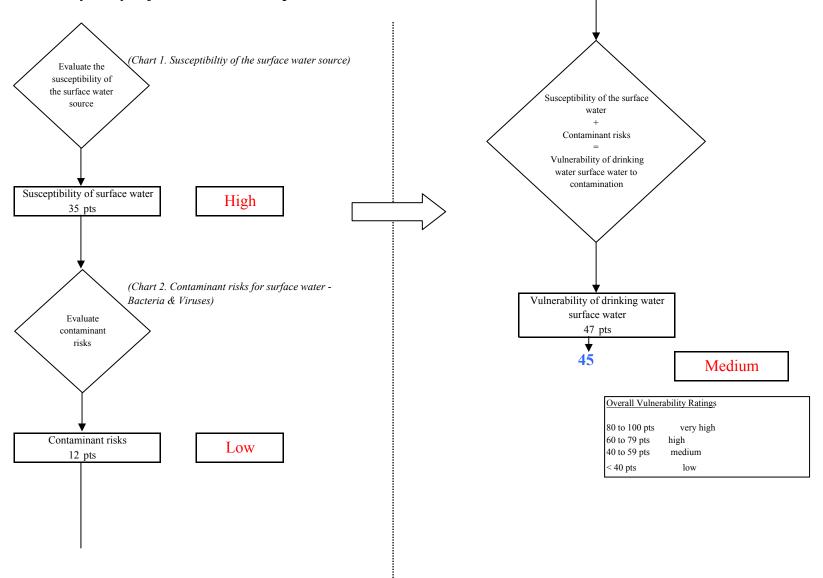

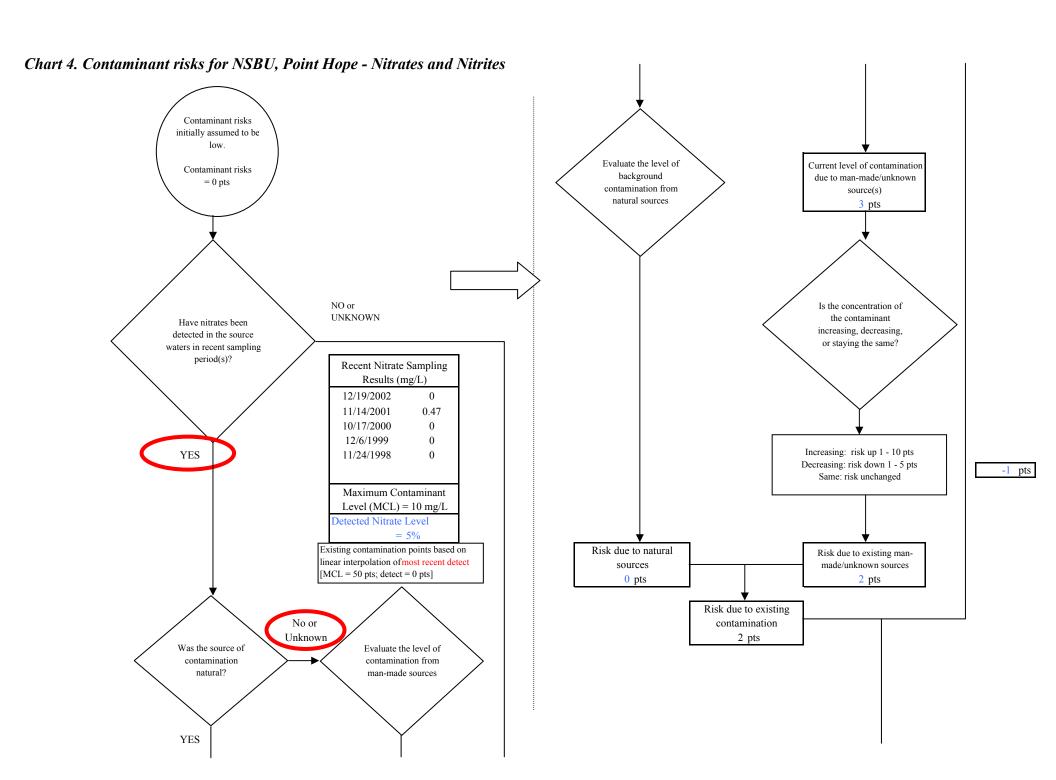

Page 5 of 24


Chart 4. Contaminant risks for NSBU, Point Hope - Nitrates and Nitrites

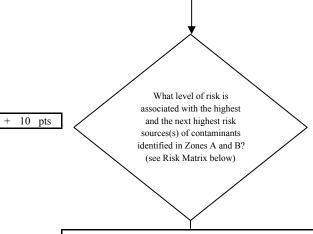


Risk Levels for Nitrate/I	Nitrite Sources	identified in Zoi	nes A and B
	Zone A	Zone B	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	0		0
Low(s)	1		1

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	
MEDIUM		≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH			≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH				≥ 1 source + 10 pts


Matrix Score 10

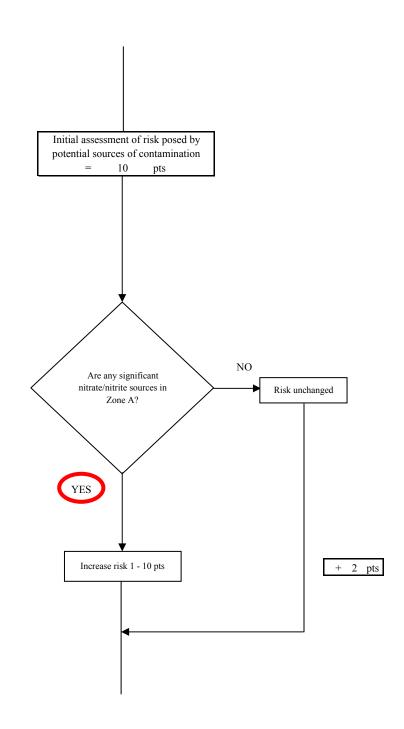


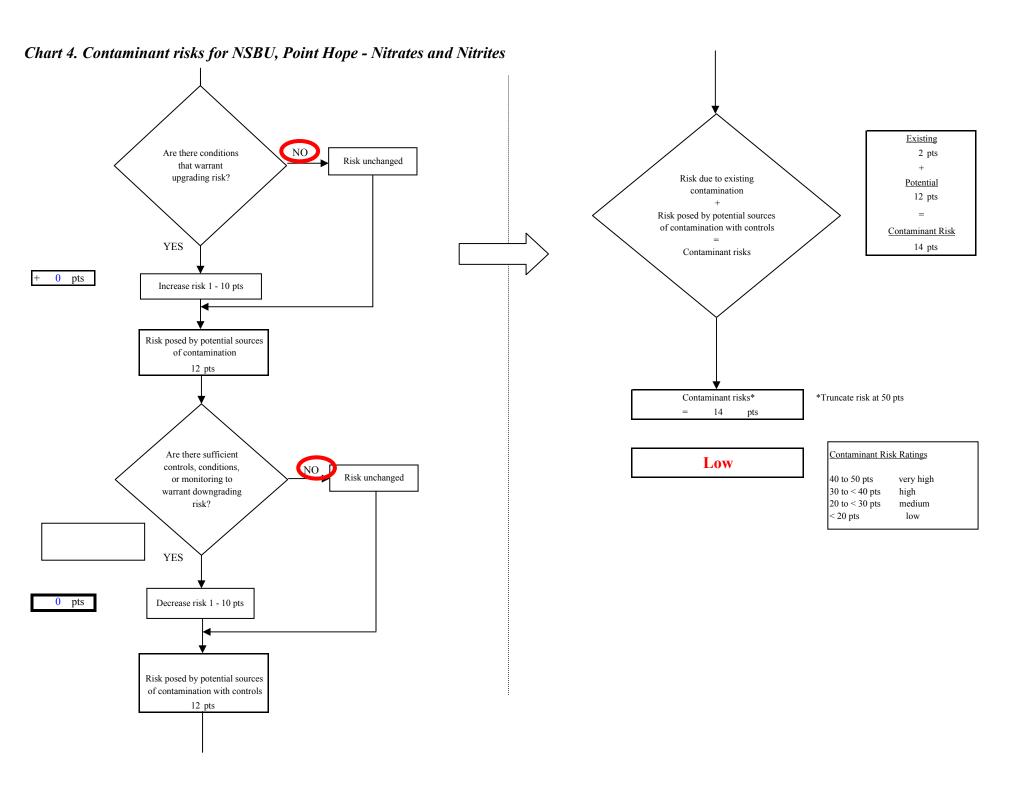

Page 7 of 24


Chart 5. Vulnerability analysis for NSBU, Point Hope - Nitrates and Nitrites

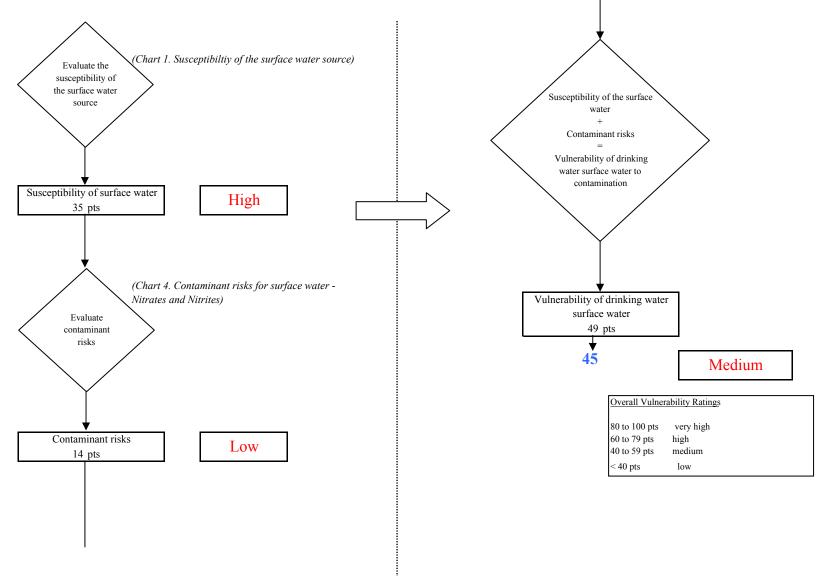

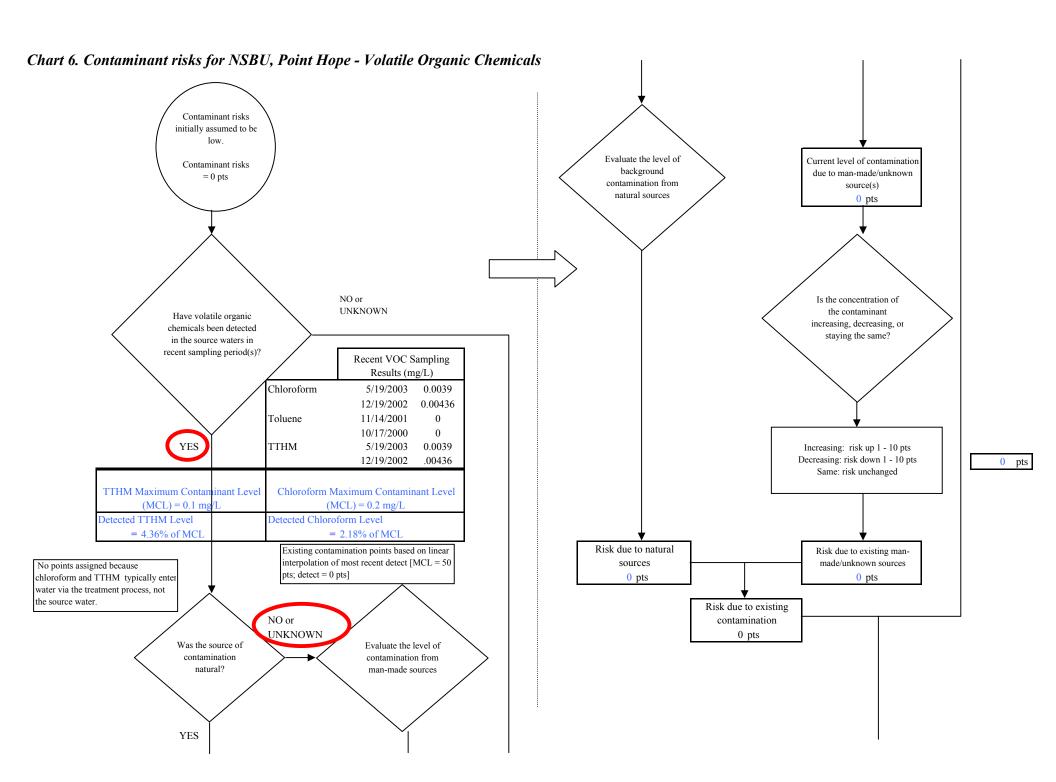


Page 9 of 24


Chart 6. Contaminant risks for NSBU, Point Hope - Volatile Organic Chemicals

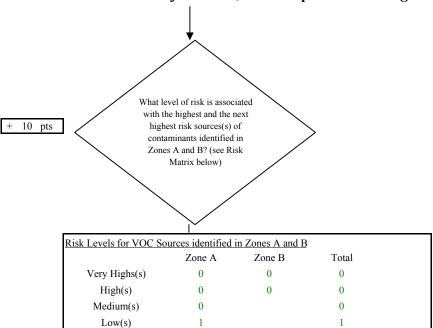

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	
MEDIUM		≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH			≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH				≥ 1 source + 10 pts


Matrix Score 10

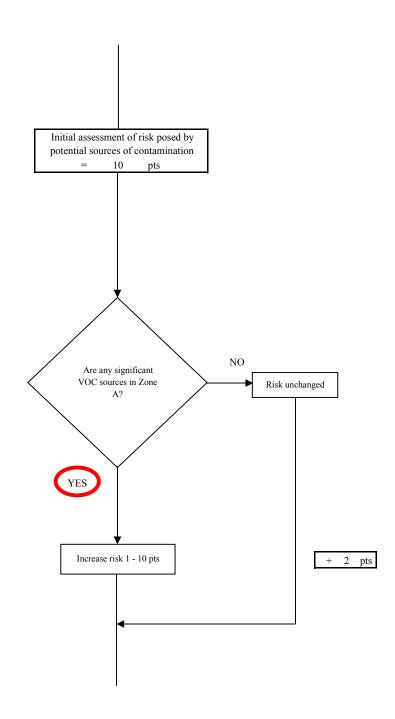

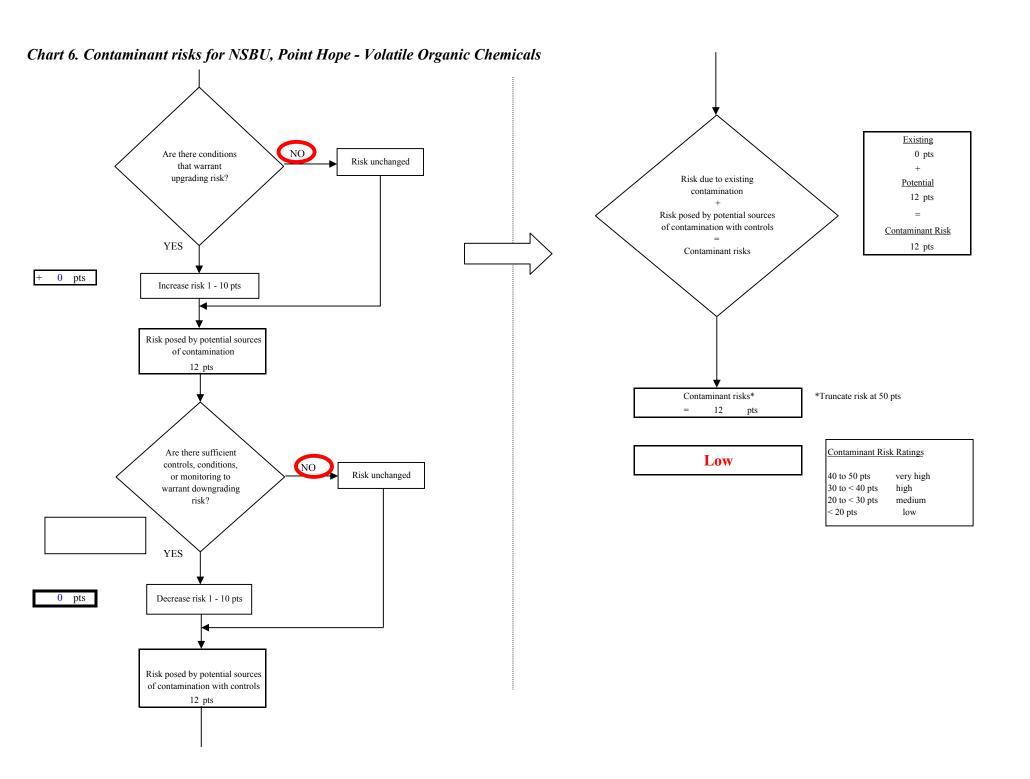


Page 11 of 24

Chart 7. Vulnerability analysis for NSBU, Point Hope - Volatile Organic Chemicals (Chart 1. Susceptibiltiy of the surface water source) Evaluate the susceptibility of the surface water Susceptibility of the surface source water Contaminant risks Vulnerability of drinking water surface water to contamination Susceptibility of surface water High 35 pts (Chart 6. Contaminant risks for surface water -Vulnerability of drinking water Volatile Organic Chemicals) surface water Evaluate 47 pts contaminant risks 45 Medium Overall Vulnerability Ratings 80 to 100 pts very high Contaminant risks 60 to 79 pts high Low 40 to 59 pts medium 12 pts < 40 pts low

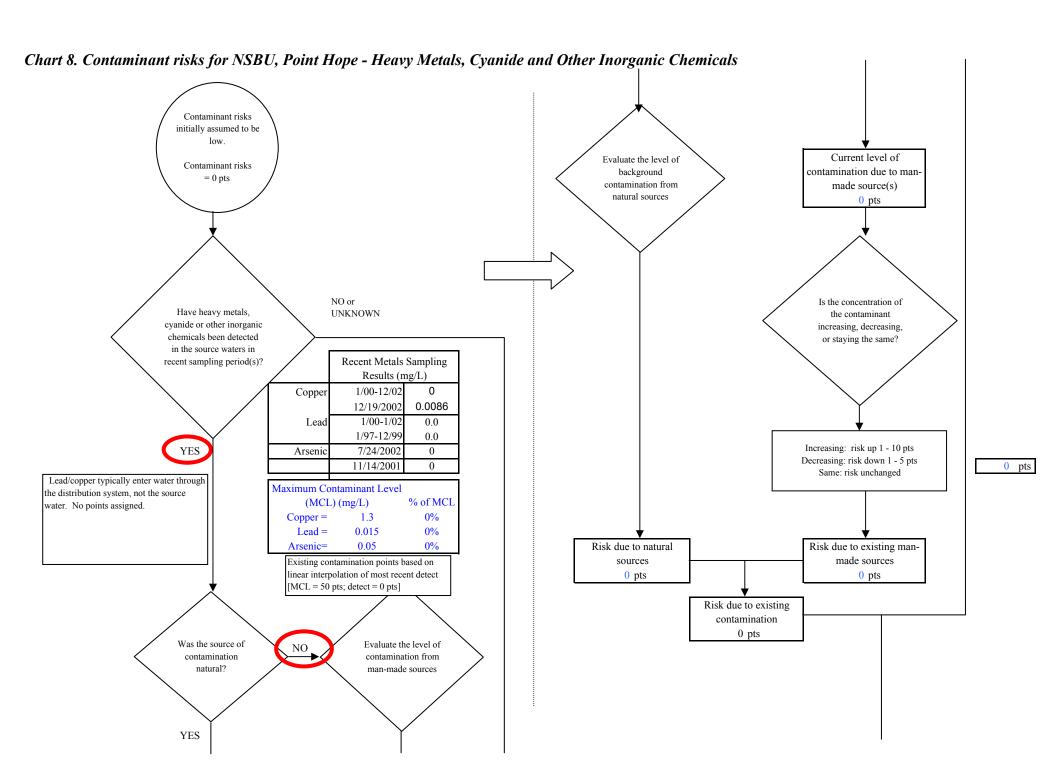

Page 13 of 24


Chart 8. Contaminant risks for NSBU, Point Hope - Heavy Metals, Cyanide and Other Inorganic Chemicals

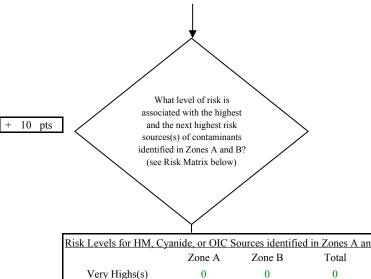


Risk Levels for HM, Cy	vanide, or OIC S	Sources identifie	d in Zones A and B	
	Zone A	Zone B	Total	
Very Highs(s)	0	0	0	
High(s)	0	0	0	
Medium(s)	0		0	
Low(s)	1		1	

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	
MEDIUM		≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH			≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH				≥ 1 source + 10 pts


Matrix Score 10	
-----------------	--

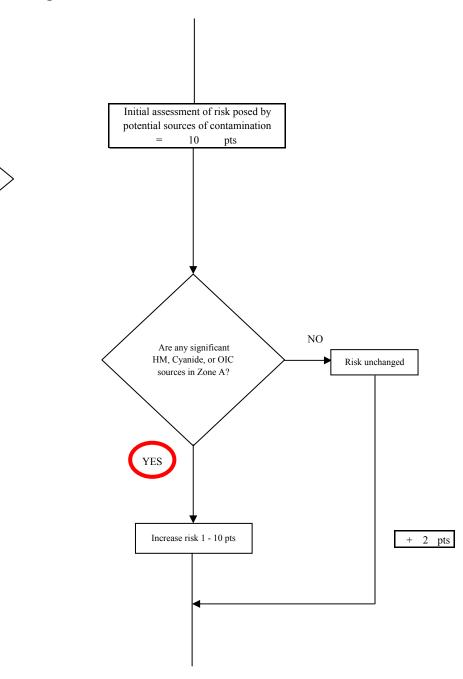

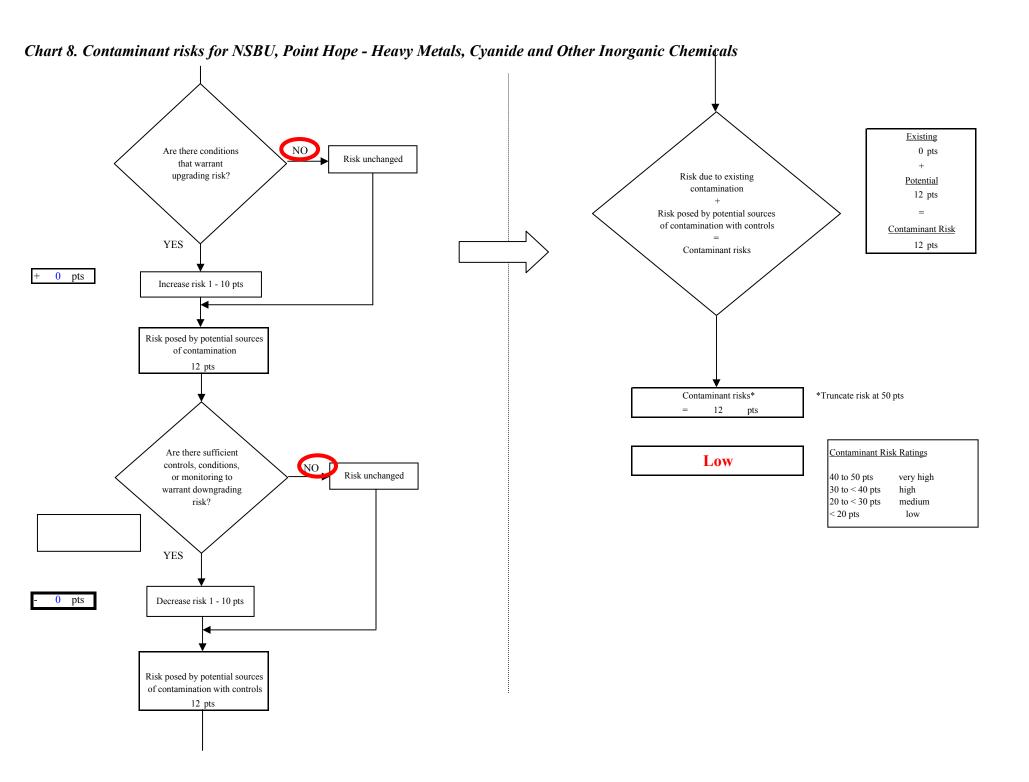


Page 15 of 24

Chart 9. Vulnerability analysis for NSBU, Point Hope - Heavy Metals, Cyanide and Other Inorganic Chemicals (Chart 1. Susceptibiltiy of the surface water source) Evaluate the susceptibility of the surface water Susceptibility of the surface source water Contaminant risks Vulnerability of drinking water surface water to contamination Susceptibility of surface water High 35 pts (Chart 8. Contaminant risks for surface water -Heavy Metals, Cyanide and Other Inorganic Chemicals) Vulnerability of drinking water surface water Evaluate 47 pts contaminant risks 45 Medium Overall Vulnerability Ratings 80 to 100 pts very high Contaminant risks 60 to 79 pts high Low 40 to 59 pts medium 12 pts < 40 pts low

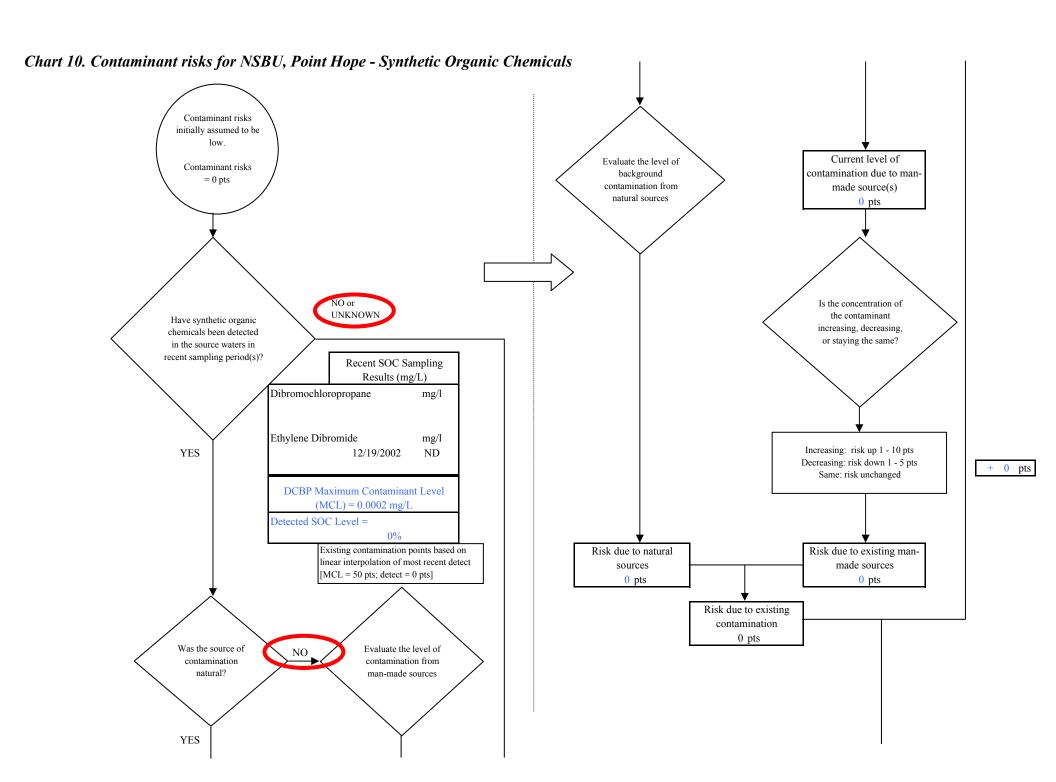

Page 17 of 24


Chart 10. Contaminant risks for NSBU, Point Hope - Synthetic Organic Chemicals

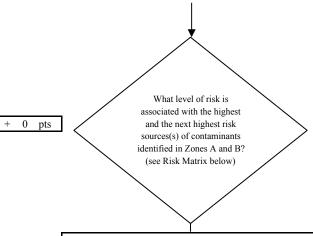


Risk Levels for SOC So	urces identified	in Zones A and	<u>C</u>
	Zone A	Zone B	Total
Very Highs(s)	0	0	0
High(s)	0	0	0
Medium(s)	0	0	0
Low(s)	0	0	0


	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	
MEDIUM		≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH			≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH				≥ 1 source + 10 pts


Matrix Score 0

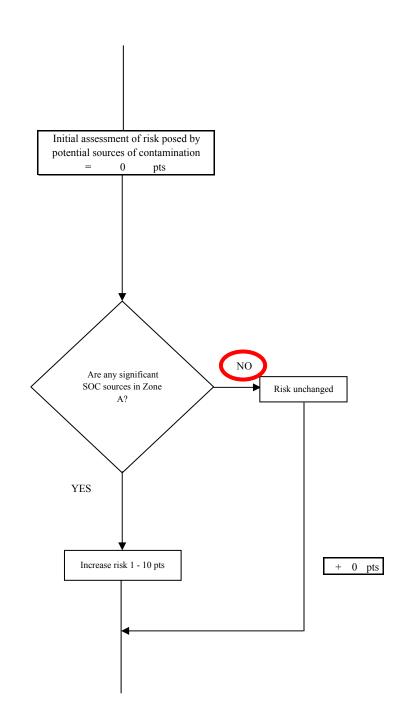

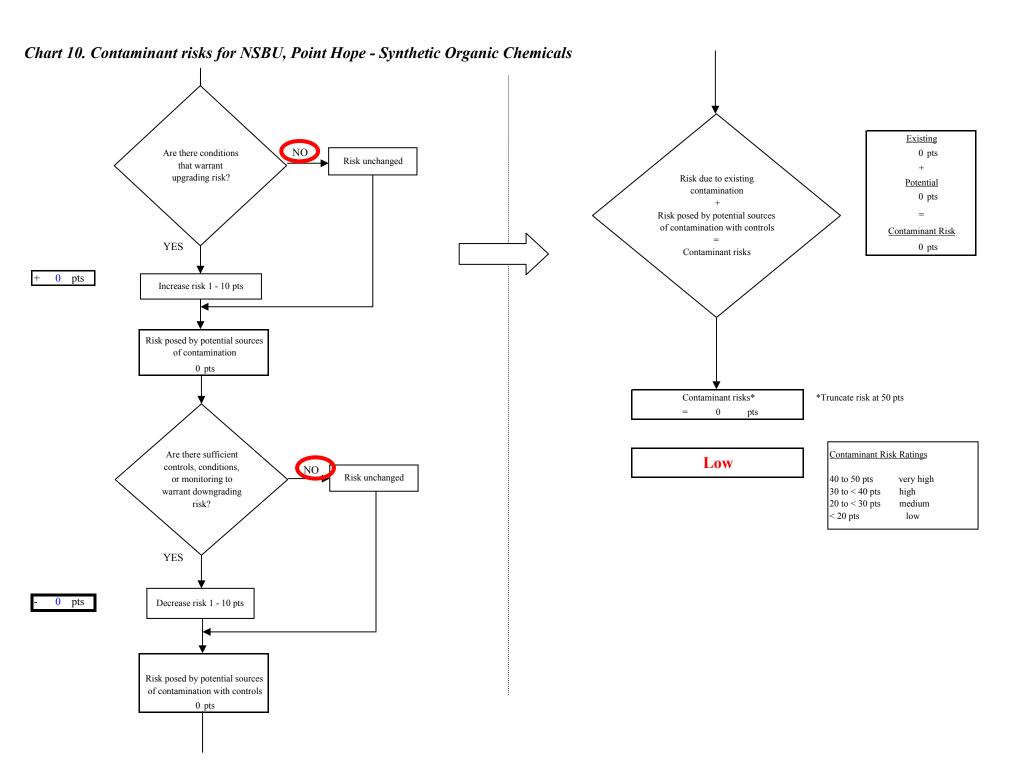


Page 19 of 24

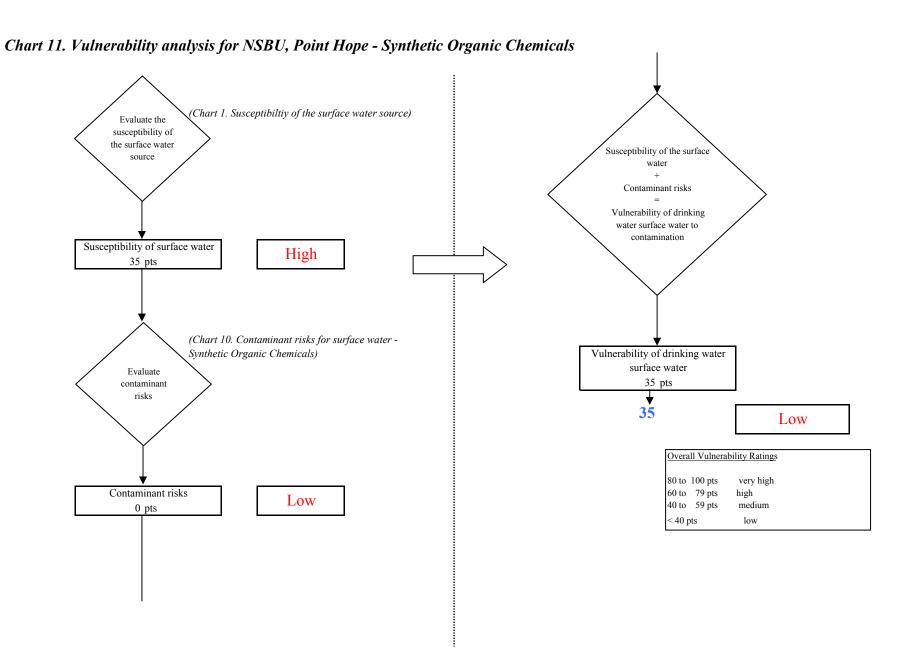

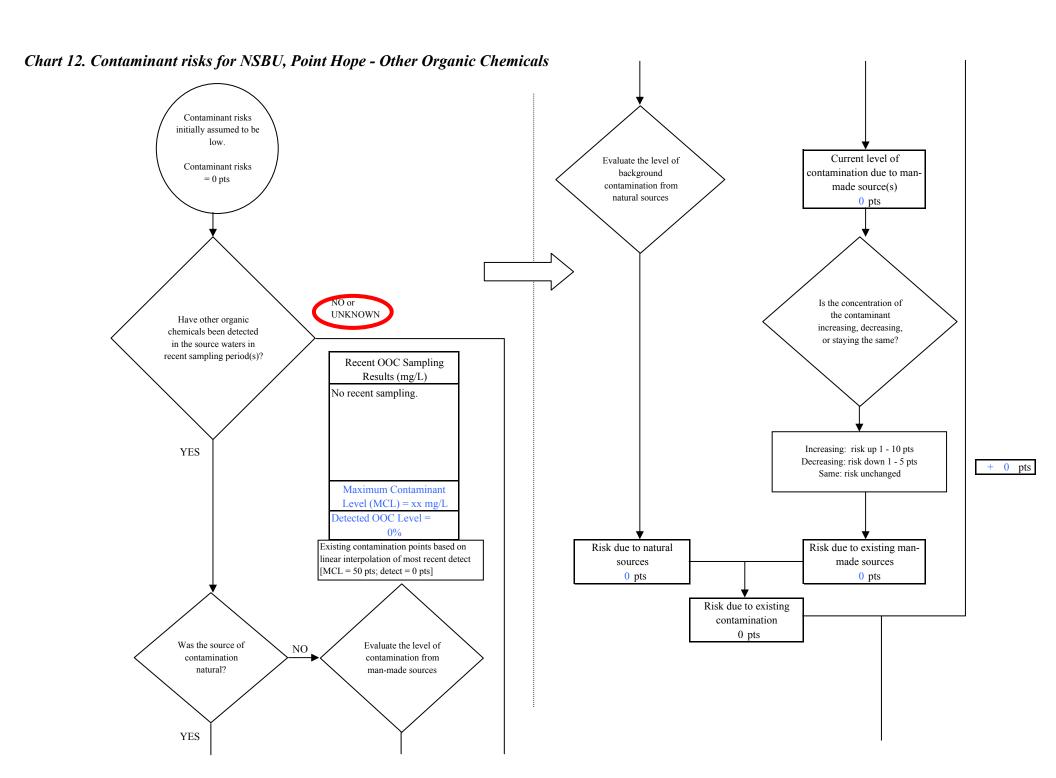

Page 21 of 24


Chart 12. Contaminant risks for NSBU, Point Hope - Other Organic Chemicals

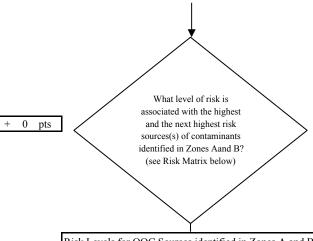


F	Risk Levels for OOC So	ources identified	in Zones A and	<u>l B</u>	
		Zone A	Zone B	Total	
	Very Highs(s)	0	0	0	
	High(s)	0	0	0	
	Medium(s)	0	0	0	
	Low(s)	0	0	0	

	LOW 10 pts	MEDIUM 20 pts	HIGH 30 pts	VERY HIGH 40 pts
LOW	≥ 10 sources + 10 pts	≥ 10 sources + 5 pts	≥ 20 sources + 5 pts	
MEDIUM		≥ 2 sources + 5 pts	≥ 5 sources + 5 pts	≥ 10 sources + 5 pts
HIGH			≥ 1 source + 10 pts	≥ 2 sources + 10 pts
VERY HIGH				≥ 1 source + 10 pts

Matrix Score 0
----------------

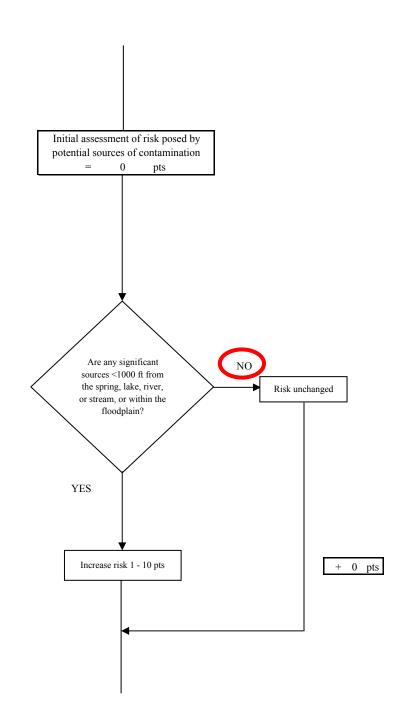

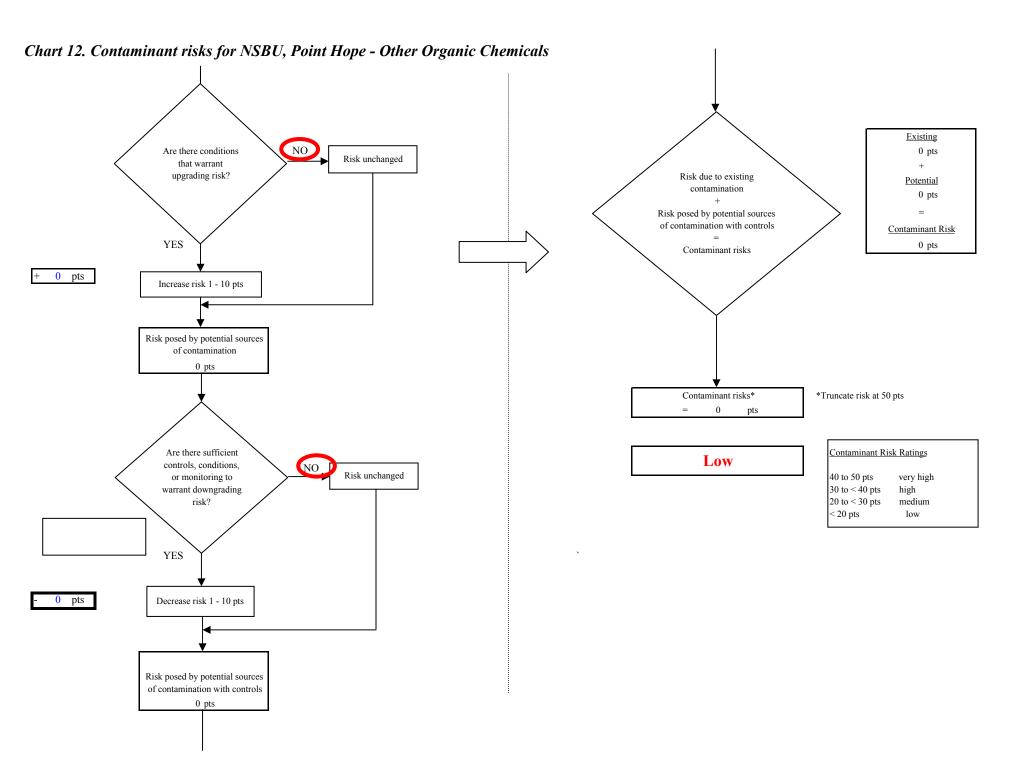

Page 23 of 24

Chart 13. Vulnerability analysis for NSBU, Point Hope - Other Organic Chemicals (Chart 1. Susceptibiltiy of the surface water source) Evaluate the susceptibility of the surface water Susceptibility of the surface source water Contaminant risks Vulnerability of drinking water surface water to contamination Susceptibility of surface water High 35 pts (Chart 12. Contaminant risks for surface water -Other Organic Chemicals) Vulnerability of drinking water surface water Evaluate 35 pts contaminant risks 35 Low Overall Vulnerability Ratings 80 to 100 pts very high Contaminant risks 60 to 79 pts high Low 40 to 59 pts medium 0 pts < 40 pts low