

---

# Source Water Assessment

A Hydrogeologic Susceptibility and  
Vulnerability Assessment for  
Moose River RV Park - Well #3  
Public Drinking Water System,  
Sterling, Alaska  
PWSID # 249009.002

DRINKING WATER PROTECTION REPORT 1714

Alaska Department of Environmental Conservation

January, 2009

# Source Water Assessment for Moose River RV Park - Well #3 Public Drinking Water System, Sterling, Alaska PWSID# 249009.002

## DRINKING WATER PROTECTION REPORT 1714

The Drinking Water Protection (DWP) section of the Drinking Water Program is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (DEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the DWP staff at the following toll-free number 1-866-956-7656.

January, 2009

## CONTENTS

	Page		Page
Executive Summary.....	1	Ranking of Contaminant Risks .....	2
Moose River RV Park - Well #3		Vulnerability of Moose River RV Park - Well #3	
Public Drinking Water System .....	1	Drinking Water System.....	3
Moose River RV Park - Well #3		References .....	5
Drinking Water Protection Area.....	1	Appendix A .....	7
Inventory of Potential and		Appendix B .....	9
Existing Contaminant Sources.....	2	Appendix C .....	11

## TABLES

Table 1. Definition of Zones.....	2
Table 2. Susceptibility .....	3
Table 3. Contaminant Risks.....	3
Table 4. Overall Vulnerability.....	4

## APPENDICES

- APPENDIX      A. Moose River RV Park - Well #3 Drinking Water Protection Area (Map A)
- B. Contaminant Source Inventory for Moose River RV Park - Well #3 (Table 1)
- Contaminant Source Inventory and Risk Ranking for Moose River RV Park - Well #3 – Bacteria and Viruses (Table 2)
- Contaminant Source Inventory and Risk Ranking for Moose River RV Park - Well #3 – Nitrates/Nitrites (Table 3)
- Contaminant Source Inventory and Risk Ranking for Moose River RV Park - Well #3 – Volatile Organic Chemicals (Table 4)
- C. Moose River RV Park - Well #3 Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)

# Source Water Assessment for Moose River RV Park - Well #3

## Source of Public Drinking Water, Sterling, Alaska

---

### Drinking Water Protection Alaska Department of Environmental Conservation

#### EXECUTIVE SUMMARY

The public water system for Moose River RV Park is a Class B (transient/non-community) water system consisting of three wells located in Sterling, Alaska. This Source Water Assessment applies to Well #3. The wellhead received a susceptibility rating of **Low** and the aquifer received a susceptibility rating of **Low**. Combining these two ratings produces a **Low** rating for the natural susceptibility of the well. Identified potential and existing sources of contaminants for Moose River RV Park - Well #3 public drinking water source include: assumed septic systems; assumed residential heating oil tanks; roads, a coal mine (active or inactive), and an Open Leaking Underground Fuel Storage Tank (LUST) site. These identified potential and existing sources of contamination are considered as sources of bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals. Overall, the public water sources for Moose River RV Park - Well #3 received a vulnerability rating of **Low** for bacteria and viruses, **Low** for nitrates and nitrites, and **Low** for volatile organic chemicals. This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of Moose River RV Park to protect public health.

#### MOOSE RIVER RV PARK - WELL #3 PUBLIC DRINKING WATER SYSTEM

Moose River RV Park public water system is a Class B (transient/non-community) water system. The system consists of three wells and is located at Mile 81.5 of the Sterling Highway, in Sterling, Alaska (see Map A in Appendix A). This Source Water Assessment has been prepared for Well #3. The community of Sterling (population 5,123) sits at the junction of the Moose and Kenai Rivers, approximately 18 miles east of the City of Kenai. It lies within the Kenai Peninsula Borough, which has a population of approximately 50,000 and encompasses an area of more than 25,600 square miles (KPB, 2008).

The Sterling area receives 20 inches of precipitation annually, and average temperatures range from 4 to 22 degrees Fahrenheit in the winter and from 45 to 65 degrees Fahrenheit in the summer (ADCCED, 2009).

There is no public water supply or sewage system in the area, as all households use individual water wells and

septic systems. Natural gas is supplied to the area by Enstar while electricity is provided by Homer Electric Association (ADCCED, 2009).

The Kenai Peninsula is divided into two distinct geographic regions: the Kenai Mountains to the east and the Kenai Lowlands to the west. The Kenai Lowlands are a glaciated coastal shelf approximately 100 miles long, bordered on the west and north by Cook Inlet and on the east by the northeast-trending Kenai Mountains. The Lowlands are predominately drained by the Kenai River and contain the communities of Sterling, Soldotna, Kenai, Nikiski, Clam Gulch, and Homer. The Kenai Mountains extend from the southern tip of the Peninsula north to Turnagain Arm, and include the communities of Hope, Moose Pass, Cooper Landing, and Seward (Karlstrom, 1964).

The most significant groundwater resources in the Kenai Lowlands are contained in coarse-grained sands and gravels. They are characterized by high rates of recharge, and are usually found in flood plain, river terrace, and alluvial deposits. Unsorted glacial moraine and drift deposits generally have poor groundwater yields, as do discontinuous layers of confining clays and silt that are common throughout unconsolidated cover. Unconsolidated sediment is more common in the northern portions of the Lowlands, where it locally hosts thicker, more extensive clay aquitards and multiple aquifers.

Most of the wells in the Sterling area are deep, with depths ranging from 50 to 200 feet. Static water levels in many of these wells are between 10 and 30 feet below the surface. Although groundwater quality can vary significantly over short distances, groundwater supplies are generally abundant in the area. (The preceding summary of regional geology and hydrogeology is based on studies by: Bailey and Hogan (1995); Freethey and Scully (1980); Glass (1996); Hartman, *et al.* (1972); and Karlstrom (1964).)

According to the well log, Moose River RV Park - Well #3 extends approximately 200 feet below the ground surface and is completed in a confined aquifer.

This system operates a coffee shop year-round and an RV park seasonally from May to October. It serves up to one hundred non-residents through twenty-four service connections.

### **MOOSE RIVER RV PARK - WELL #3 DRINKING WATER PROTECTION AREA**

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the drinking water protection area. The drinking water protection area is the area circling the well (the area influenced by pumping) and also the area upgradient of the well, usually forming a parabola shape. Because releases of contaminants within the protection area are most likely to impact the well, this area will serve as the focus for voluntary protection efforts.

There are many different methods for calculating the size of protection areas. Drinking Water Protection (DWP) uses a combination of two simple groundwater flow equations, the Thiem and uniform flow equations for all groundwater wells screened in unconsolidated material. The orientation of the protection zone is then drawn using a water table elevation map (if available) or a land surface elevation map of the area. The protection zone calculated by DWP is an estimate using the available information and resources, and may differ slightly from the actual capture zone. Because of uncertainties and changing site conditions, a factor of safety is added to the protection zone to form the drinking water protection area for the well.

The parameters used to calculate the shape of this protection zone are general for the whole alluvial plain and were obtained from various United States Geological Survey (USGS) reports, area well logs, and the Groundwater textbook by Freeze and Cherry (Freeze and Cherry, 1979).

The protection areas established for wells by the DEC are usually separated into two zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well. An analytical calculation was used to determine the size and shape of the protection area.

The time-of-travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the two protection area zones for wells and the calculated time-of-travel for each:

**Table 1. Definition of Zones**

<b>Zone</b>	<b>Definition</b>
A	Several months time-of-travel
B	Less than the 2 year time-of-travel

The drinking water protection area for Moose River RV Park - Well #3 was determined using an analytical calculation and includes Zones A and B (see Map A in Appendix A).

### **INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES**

DWP has completed an inventory of potential and existing sources of contamination within the Moose River RV Park - Well #3 drinking water protection area. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class B public water system assessments, the following three categories of drinking water contaminants were inventoried:

- Bacteria and viruses;
- Nitrates and/or nitrites;
- Volatile organic chemicals

The sources are displayed on Map C of Appendix C and summarized in Table 1 of Appendix B.

### **RANKING OF CONTAMINANT RISKS**

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a “potential” or “existing” source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

- Low;
- Medium;
- High; and
- Very High.

Tables 2 through 4 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, and volatile organic chemicals.

### VULNERABILITY OF MOOSE RIVER RV PARK - WELL #3 DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural Susceptibility; and
- Contaminant Risks.

A score for the Natural Susceptibility of the well is reached by considering the properties of the well and the aquifer.

Susceptibility of the Wellhead (0-25 Points)

+

Susceptibility of the Aquifer (0-25 Points)

=

Natural Susceptibility of the Well (0-50 Points)

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings	
40-50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Factors contributing to the susceptibility of the wellhead are: whether the sanitary seal is in place, protection from flooding, and if the well casing is properly grouted.

The wellhead for the Moose River RV Park - Well #3 received a **Low** susceptibility rating. The most recent sanitary survey (06/06/2003) indicates that a sanitary seal is installed on the well, the land surface is sloped away from the well, and the well is grouted according to DEC regulations. Sanitary seals prevent potential contaminants from entering the well, while sloping of the land surface away from the wellhead provides adequate surface water drainage, and concrete or grouting around the wellhead helps to prevent potential contaminants from traveling down the outside of the well casing.

Factors contributing to the susceptibility of the aquifer are: whether the aquifer is confined or unconfined, whether the well is completed in unconsolidated or fractured bedrock, whether wells and bore holes are penetrating the aquifer and, if applicable, the depth and thickness of the confining layer.

The Moose River RV Park - Well #3 system draws water from a confined aquifer overlain by a 167-foot thick confining layer of brown and blue clay. It received a **Low** susceptibility rating because of the deep nature of the aquifer and the thick confining layer. Deeper aquifers are more protected from surface contaminants while thicker confining layers provide greater protection from any contamination that does manage to penetrate to that depth.

Table 2 summarizes the Susceptibility scores and ratings for the Moose River RV Park - Well #3 system.

**Table 2. Susceptibility**

	Score	Rating
Susceptibility of the Wellhead	0	Low
Susceptibility of the Aquifer	5	Low
Natural Susceptibility	5	Low

Contaminant risks are derived from an evaluation of the routine sampling results of the water system and the presence of potential sources of contamination. Contaminant risks to a drinking water source depend on the type and distribution of contaminant sources. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings	
40-50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants for the Moose River RV Park - Well #3 system.

**Table 3. Contaminant Risks**

Category	Score	Rating
Bacteria and Viruses	12	Low
Nitrates and/or Nitrites	13	Low
Volatile Organic Chemicals	25	Medium

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

$$\begin{array}{r} \text{Natural Susceptibility (0-50 Points)} \\ + \\ \text{Contaminant Risks (0-50 Points)} \\ = \\ \text{Vulnerability of the Drinking Water Source to} \\ \text{Contamination (0-100 Points)} \end{array}$$

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings	
80-100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores (0-100) and ratings for each of the three categories of drinking water contaminants for the Moose River RV Park - Well #3 system. Note: scores are rounded off to the nearest five.

**Table 4. Overall Vulnerability**

Category	Score	Rating
Bacteria and Viruses	15	Low
Nitrates and/or Nitrites	20	Low
Volatile Organic Chemicals	30	Low

### Bacteria and Viruses

The contaminant risk to the drinking water well for bacteria and viruses is determined to be **Low** with assumed septic systems and roads contributing to the risk to the drinking water well.

Coliforms (a bacteria) are found naturally in the environment and while not necessarily a direct health threat, they are an indicator of other potentially harmful bacteria in the water, more specifically fecal coliforms and E. coli. These bacteria only come from human and animal fecal waste and can cause diarrhea, cramps, nausea, headaches, and other symptoms (EPA, 2008).

Samples testing positive for bacteria and viruses increase the overall vulnerability of the drinking water source by indicating that the source is susceptible to bacteria and virus contamination. Only a small number of bacteria and viruses are required to endanger public health.

Bacteria and viruses have not been detected during the last 5 years of sampling at Moose River RV Park - Well #3 (data reviewed in April, 2008).

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Low**.

### Nitrates and Nitrites

The contaminant risk for nitrates and nitrites for Moose River RV Park - Well #3 is determined to be **Low** with assumed septic systems and roads contributing to the risk to the drinking water well.

The sampling history for Moose River RV Park - Well #3 indicates that nitrates and nitrites have been detected in the last 5 years, with the highest concentration of 1.62 mg/L detected on 06/09/2006 (data reviewed in April, 2008).

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Low**.

### Volatile Organic Chemicals

The contaminant risk for volatile organic chemicals is determined to be **Medium** with assumed septic systems, assumed heating oil tanks, roads, and coal mining (active or inactive) contributing to the risk to the drinking water well.

The drinking water at Moose River RV Park - Well #3 has not recently been sampled for volatile organic chemicals (data reviewed in April, 2008).

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Low**.

### Using the Source Water Assessment

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of Moose River RV Park to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of the Moose River RV Park - Well #3 drinking water source.

## REFERENCES

- Alaska Department of Commerce, Community and Economic Development (ADCCED), Accessed 2009 [WWW document]. URL: [http://www.commerce.state.ak.us/dca/commdb/CF\\_COMDB.htm](http://www.commerce.state.ak.us/dca/commdb/CF_COMDB.htm)
- Bailey, B.J., and Hogan, E.V., 1995. Overview of environmental and hydrogeologic conditions near Kenai, Alaska. U.S. Geological Survey Open-File Report 95-410, 18 p.
- Freethy, G.W., and Scully, D.R. 1980. Water Resources of the Cook Inlet Basin, Alaska. U.S. Geological Survey Hydrologic Investigation Atlas HA-620, prepared in cooperation with Alaska Water Study Committee, State of Alaska Department of Natural Resources, and Division of Geological and Geophysical Surveys.
- Freeze, R.A. and Cherry, J.A., 1979. Groundwater. Prentice-Hall, Englewood Cliffs, NJ.
- Glass, Roy, L. 1996. Groundwater Conditions and Quality in the Western Part of the Kenai Peninsula, Southcentral Alaska. U.S. Geological Survey Open File Report 94-466, prepared in cooperation with the Alaska Department of Natural Resources, Kenai Peninsula Borough, and Kenai Soil and Water Conservation District.
- Hartman, D.C., Pessel, G.H., and McGee, D.I., 1972. Kenai Group of Cook Inlet Basin, Alaska: State of Alaska. Open File Report #49, Department of Natural Resources Division of Geological and Geophysical Surveys, 5p.
- Karlstrom, T.N.V. 1964. Quaternary geology of the Kenai Lowland and glacial history of the Cook Inlet region, Alaska. U.S. Geological Survey Professional Paper 443, 64 p
- Kenai Peninsula Borough (KPB), Accessed 2008 [WWW document].  
URL: <http://www.borough.kenai.ak.us/>.
- United States Environmental Protection Agency (EPA), Accessed 2008 [WWW document].  
URL: <http://www.epa.gov/safewater/contaminants/index.html>.




## **APPENDIX A**

### **Moose River RV Park - Well #3 Drinking Water Protection Area Location Map (Map A)**



Public Water Well System for PWS #249009.002 Moose River RV Park - Well #3

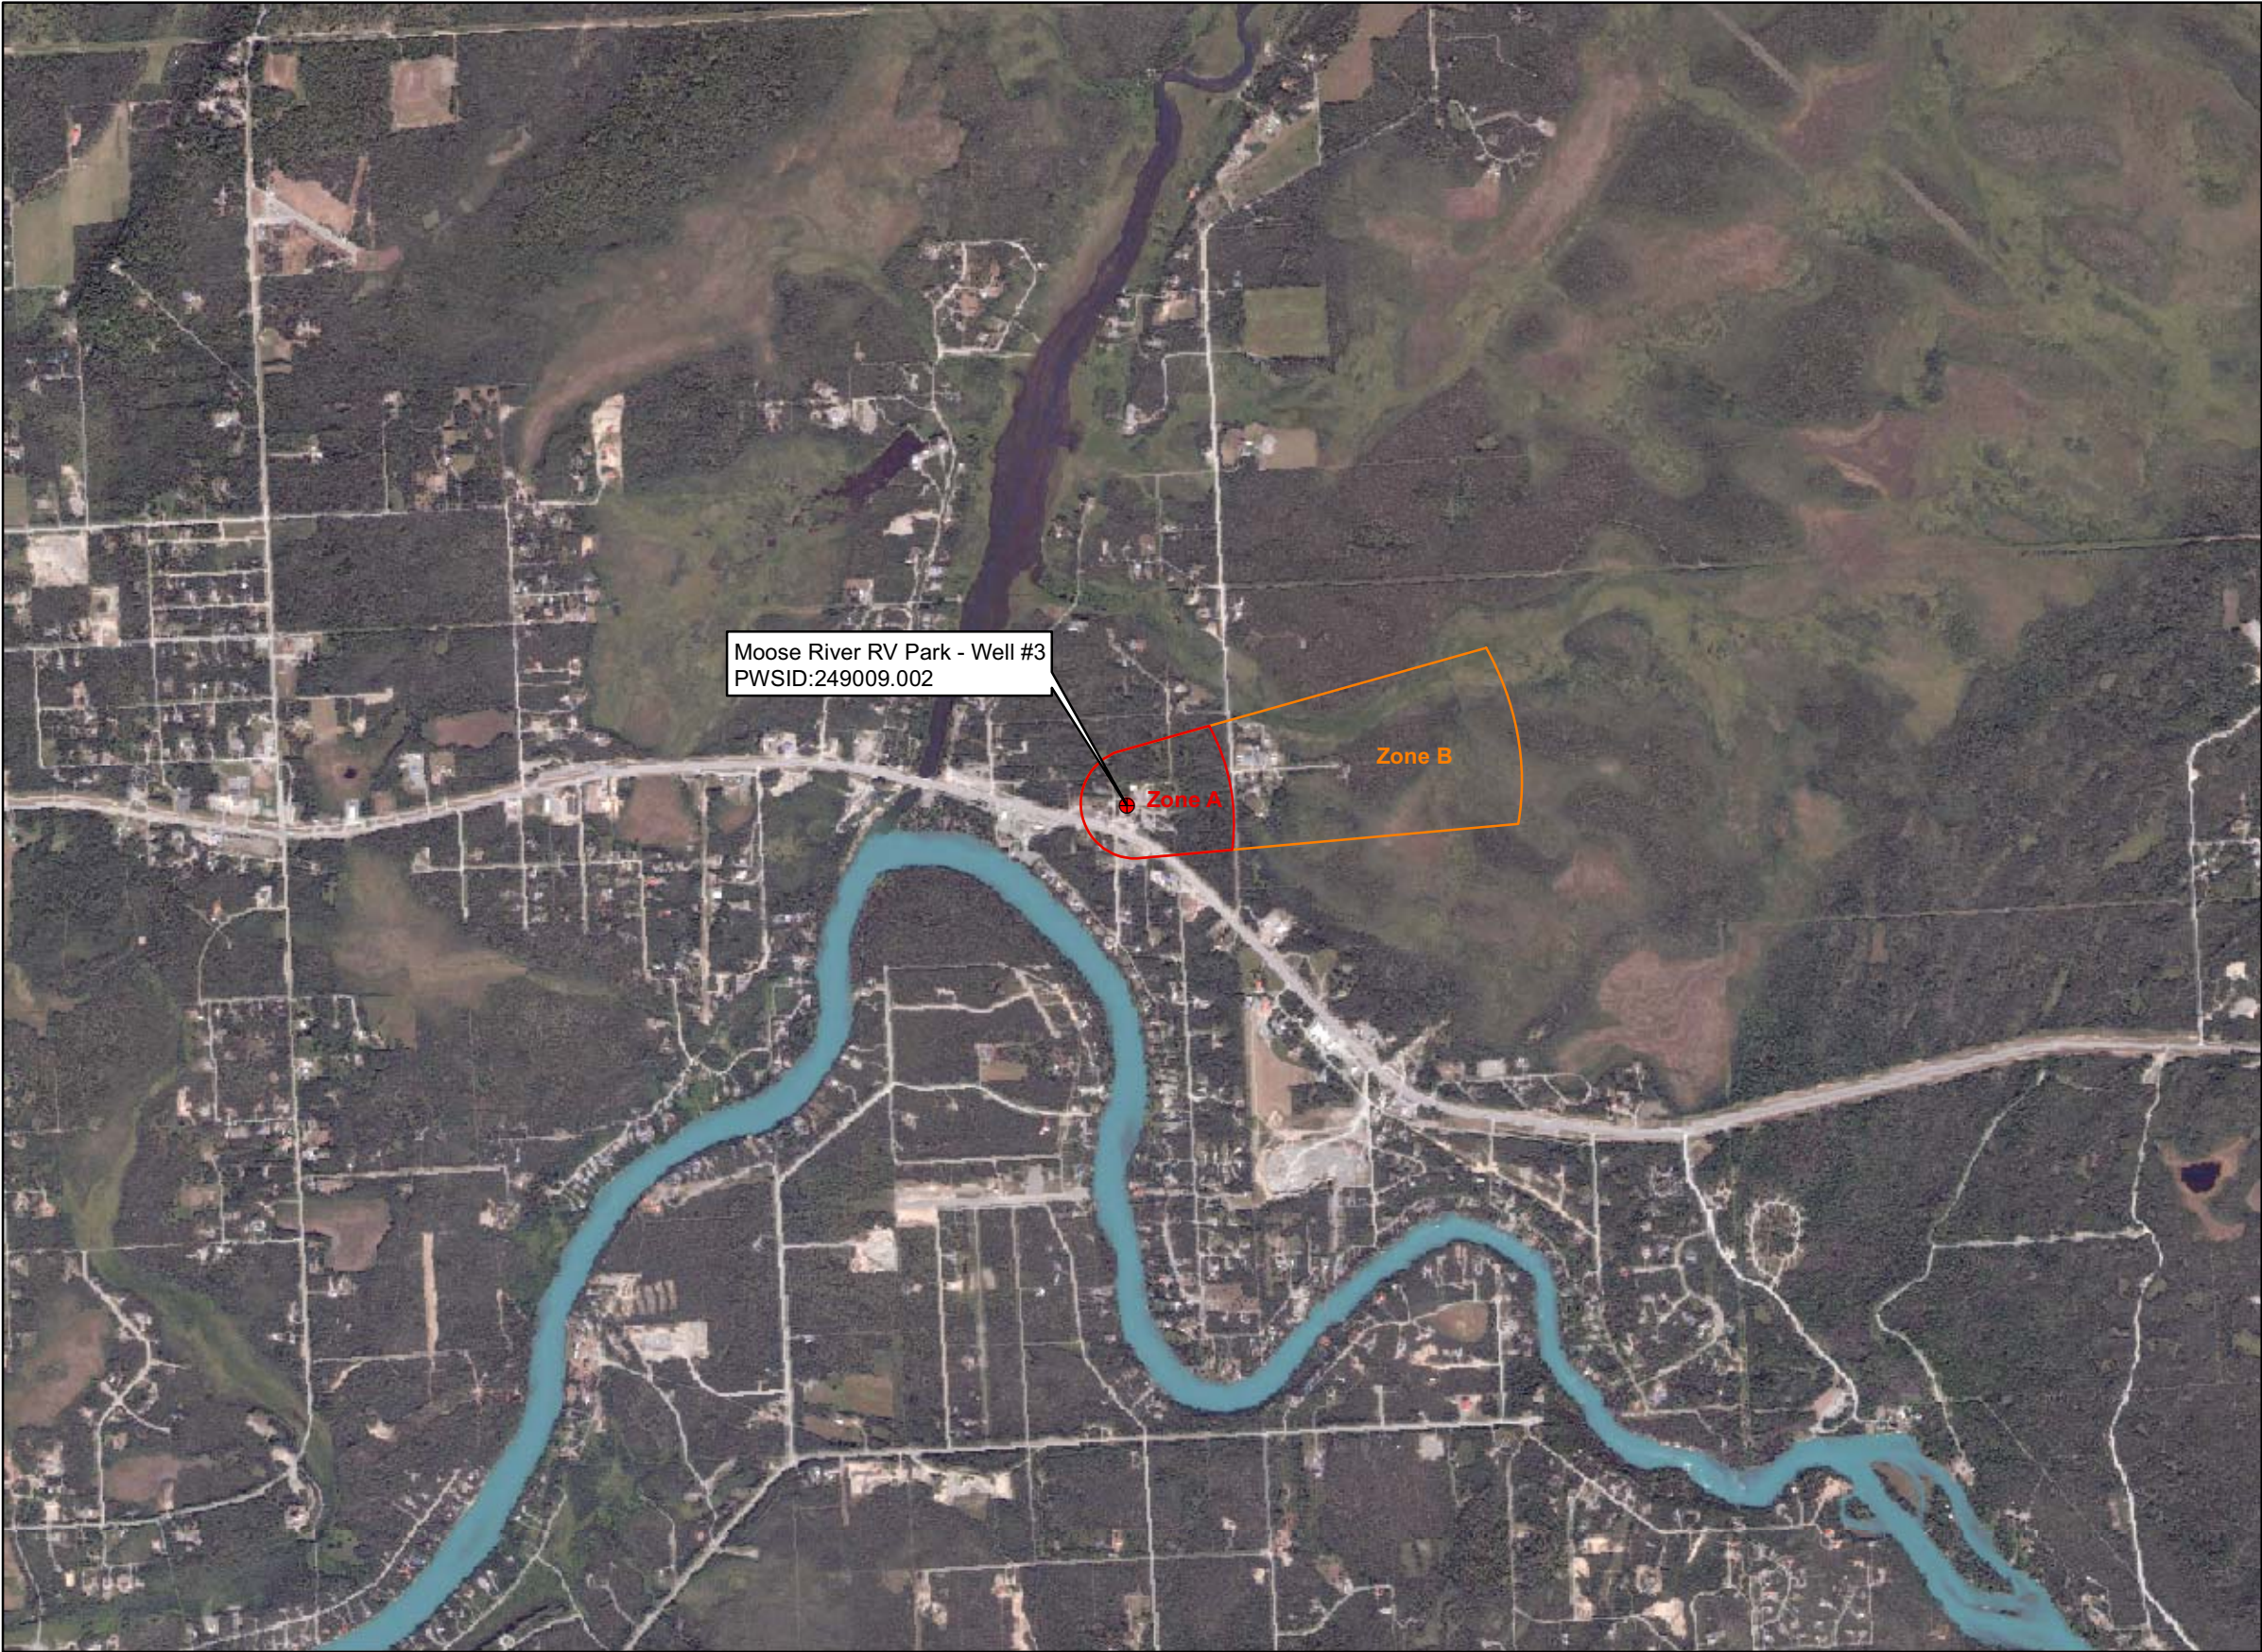

**Legend**

● Class B Public Water System Well

**Groundwater Protection Zones**

□ Zone A Protection Area - Several Months Travel Time



□ Zone B Protection Area - 2 Years Travel Time

**Data Sources:**  
Contaminant Sources, Public Water System Wells, Alaska Department of Environmental Conservation (ADEC)

**All other data:**  
Kenai Borough Imagery

**Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class B Public Water Systems" published by ADEC**

**URS Corporation does not guarantee the accuracy or validity of the data provided.**

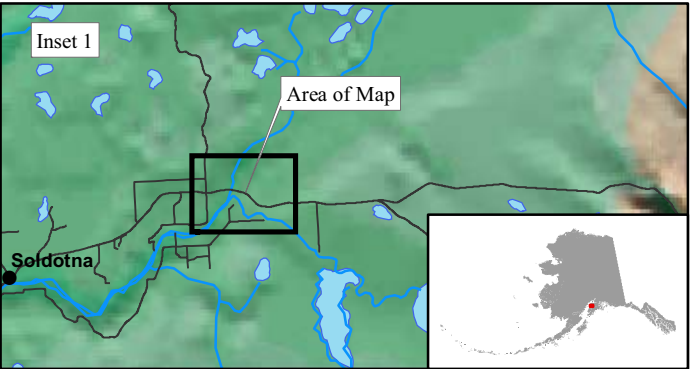

Moose River RV Park - Well #3  
PWS 249009.002

**Appendix A Map A**



## **APPENDIX B**

### **Contaminant Source Inventory and Risk Ranking for Moose River RV Park - Well #3 (Tables 1-4)**

**Table 1****Contaminant Source Inventory for  
Moose River RV Park****PWSID 249009.002**

<b>Contaminant Source Type</b>	<b>Contaminant Source ID</b>	<b>CS ID tag</b>	<b>Zone</b>	<b>Map Number</b>	<b>Comments</b>
Coal mining (active or inactive?)	E01	E01	A	C	
Septic systems (serves one single-family home)	R02	R02	A	C	6 assumed septic systems
Tanks, heating oil, residential (above ground)	R08	R08	A	C	6 assumed heating oil tanks
Highways and roads, paved (cement or asphalt)	X20	X20	A	C	1 road
Coal mining (active or inactive?)	E01	E01	B	C	
Septic systems (serves one single-family home)	R02	R02	B	C	7 assumed septic systems
Tanks, heating oil, residential (above ground)	R08	R08	B	C	7 assumed heating oil tanks
Highways and roads, paved (cement or asphalt)	X20	X20	B	C	1 road

**Table 2**

*Contaminant Source Inventory and Risk Ranking for  
Moose River RV Park  
Sources of Bacteria and Viruses*

**PWSID 249009.002**

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Septic systems (serves one single-family home)	R02	R02	A	Low	C	6 assumed septic systems
Highways and roads, paved (cement or asphalt)	X20	X20	A	Low	C	1 road
Septic systems (serves one single-family home)	R02	R02	B	Low	C	7 assumed septic systems
Highways and roads, paved (cement or asphalt)	X20	X20	B	Low	C	1 road

**Table 3**

*Contaminant Source Inventory and Risk Ranking for  
Moose River RV Park  
Sources of Nitrates/Nitrites*

**PWSID 249009.002**

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Septic systems (serves one single-family home)	R02	R02	A	Low	C	6 assumed septic systems
Highways and roads, paved (cement or asphalt)	X20	X20	A	Low	C	1 road
Septic systems (serves one single-family home)	R02	R02	B	Low	C	7 assumed septic systems
Highways and roads, paved (cement or asphalt)	X20	X20	B	Low	C	1 road

**Table 4**

*Contaminant Source Inventory and Risk Ranking for  
Moose River RV Park  
Sources of Volatile Organic Chemicals*

**PWSID 249009.002**


<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Coal mining (active or inactive?)	E01	E01	A	High	C	
Septic systems (serves one single-family home)	R02	R02	A	Low	C	6 assumed septic systems
Tanks, heating oil, residential (above ground)	R08	R08	A	Medium	C	6 assumed heating oil tanks
Highways and roads, paved (cement or asphalt)	X20	X20	A	Low	C	1 road
Coal mining (active or inactive?)	E01	E01	B	High	C	
Septic systems (serves one single-family home)	R02	R02	B	Low	C	7 assumed septic systems
Tanks, heating oil, residential (above ground)	R08	R08	B	Medium	C	7 assumed heating oil tanks
Highways and roads, paved (cement or asphalt)	X20	X20	B	Low	C	1 road

## **APPENDIX C**

### **Moose River RV Park - Well #3 Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)**



Public Water Well System for PWS #249009.002 Moose River RV Park - Well #3  
Showing Potential and Existing Sources of Contamination

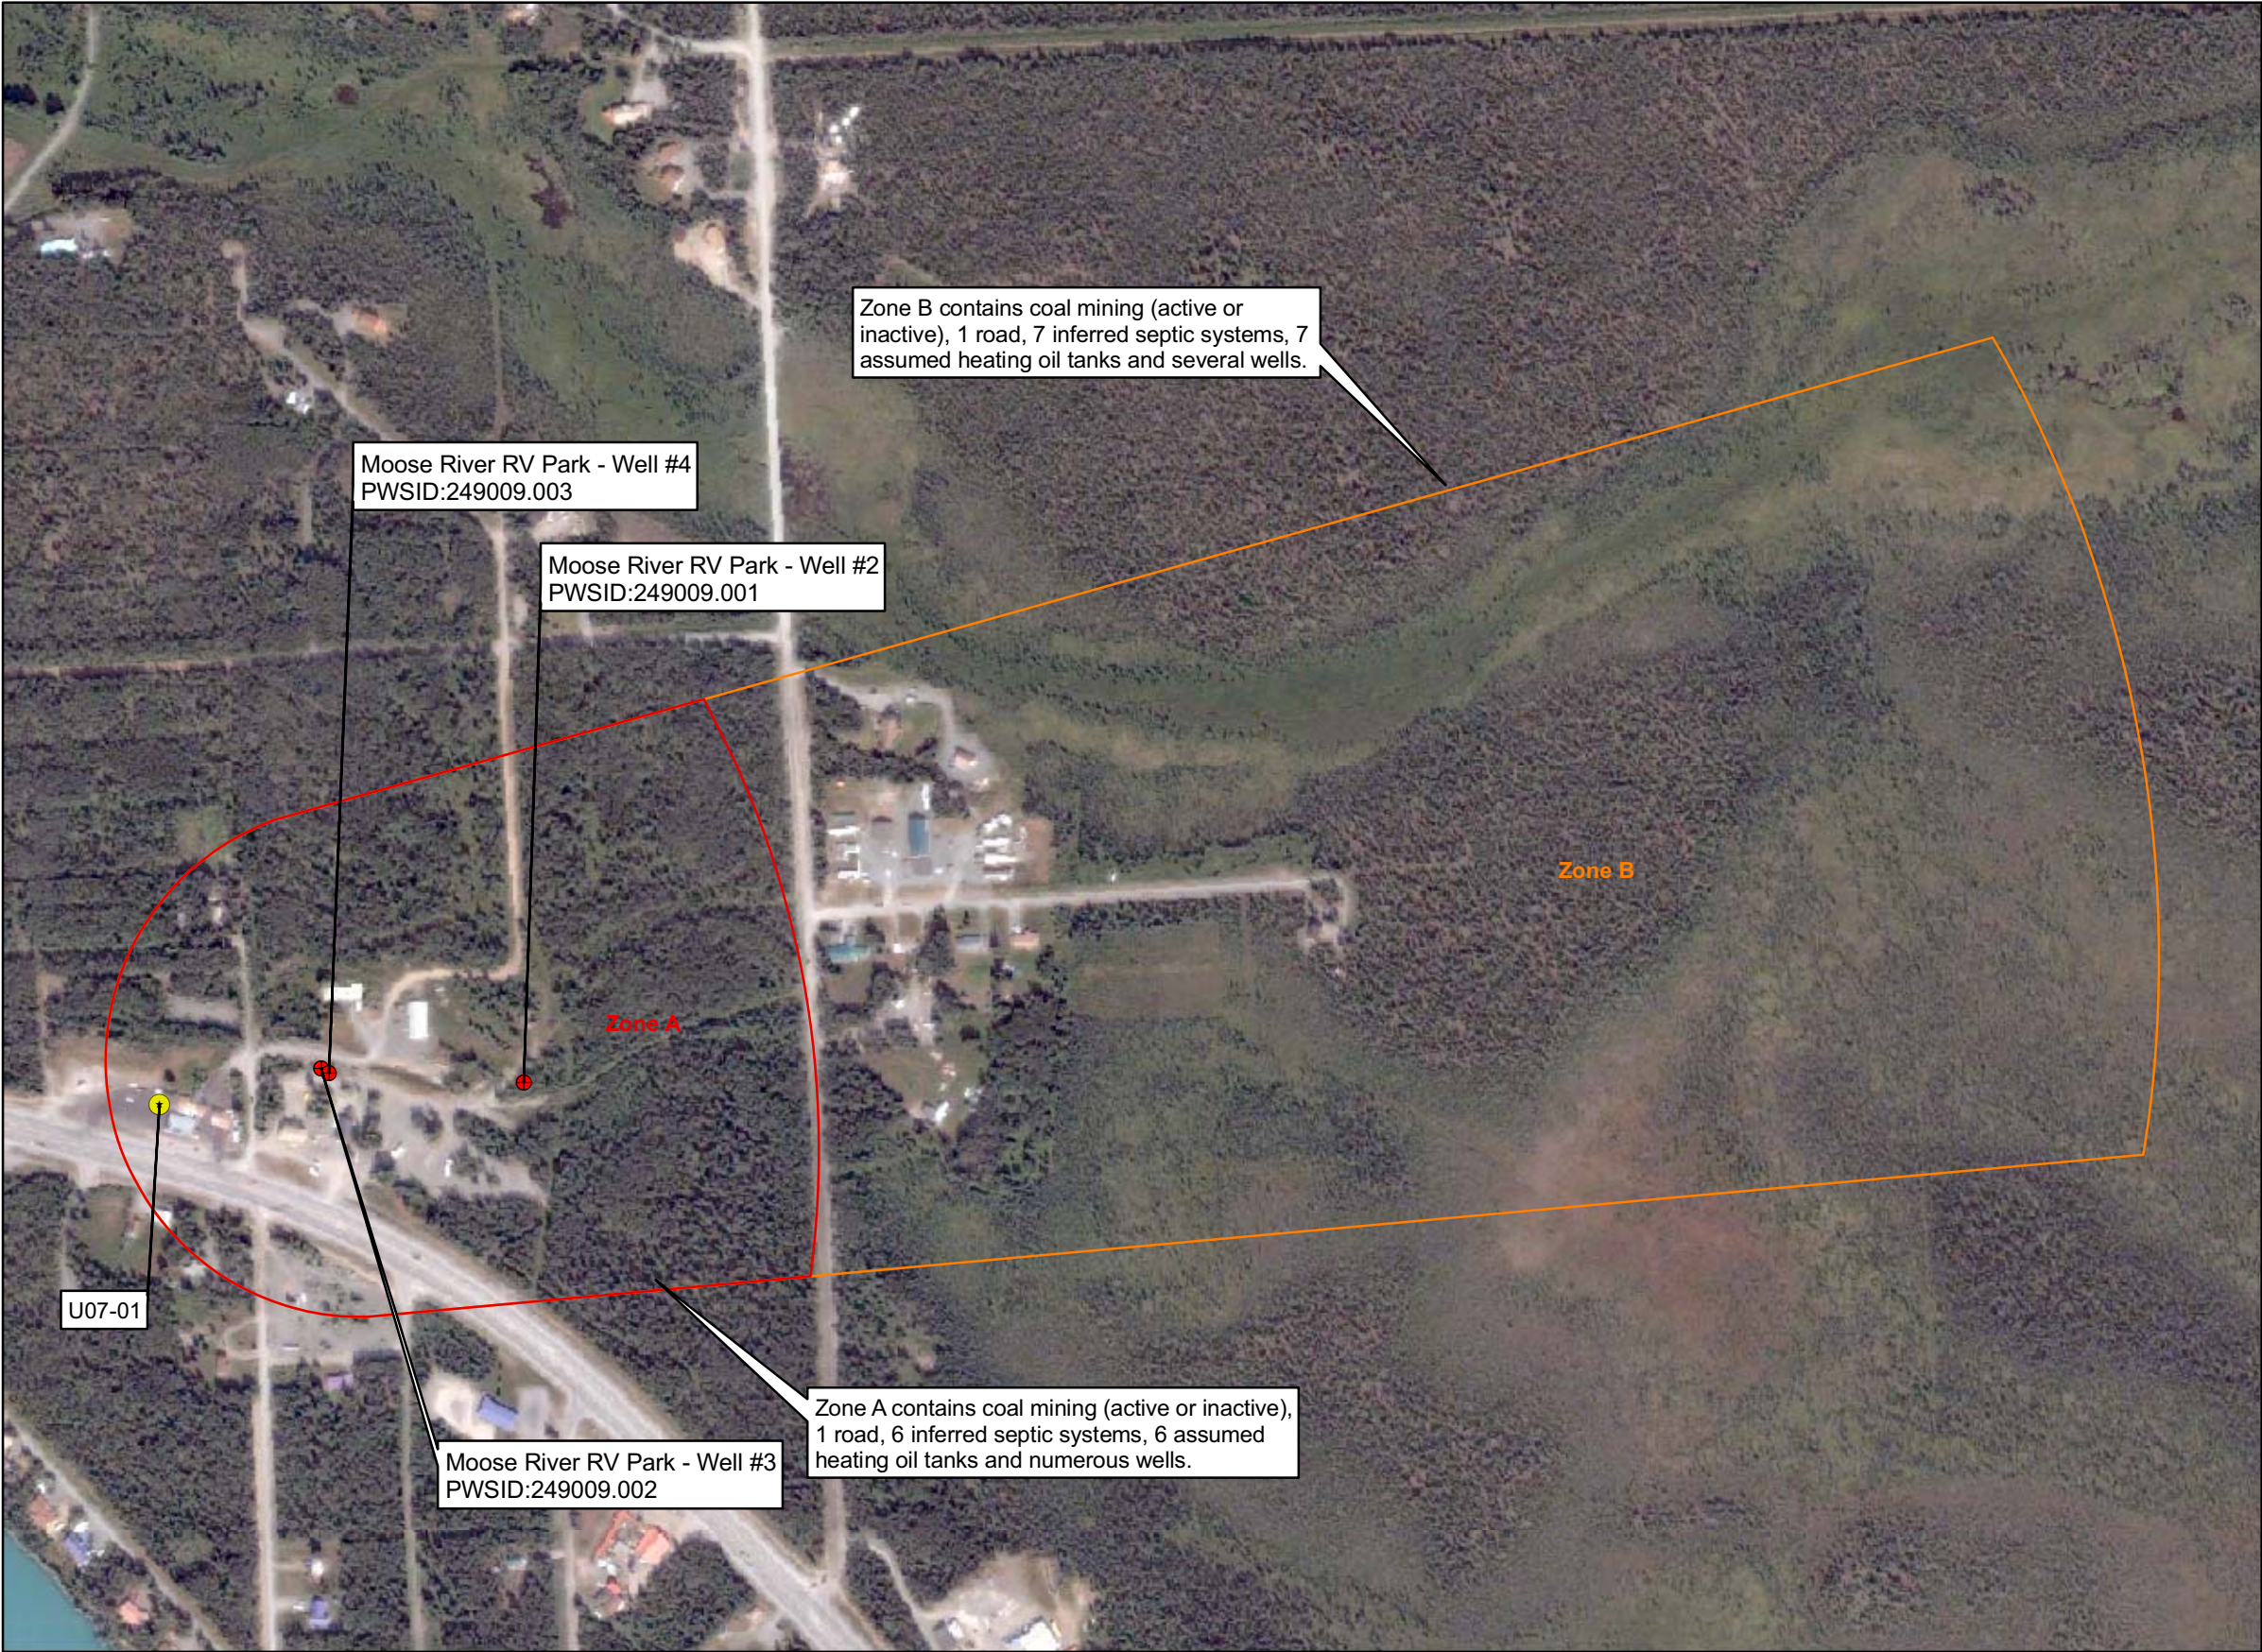

Legend

Class B Public Water System Well

Groundwater Protection Zones

Zone A Protection Area - Several Months Travel Time

Zone B Protection Area - 2 Years Travel Time

Potential and Existing Contaminant Sources



Open Leaking Underground Fuel Storage Tank (LUST) Sites (U07)

Data Sources:  
Contaminant Sources, Public Water System Wells, Alaska Department of Environmental Conservation (ADEC)

All other data:  
Kenai Borough Imagery

Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class B Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or validity of the data provided.

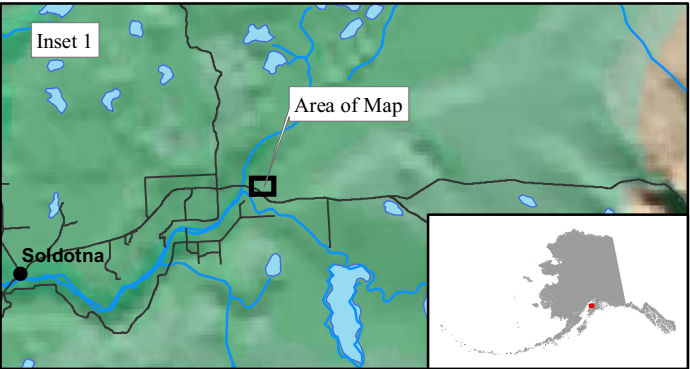

0 500 1,000 2,000 Feet

Moose River RV Park - Well #3  
PWS 249009.002

Appendix C Map C