



---

# Source Water Assessment

A Hydrogeologic Susceptibility and  
Vulnerability Assessment for  
the Tanana Health Center  
Drinking Water System,  
Tanana, Alaska

PWSID # 360395.001

June 2004

DRINKING WATER PROTECTION PROGRAM REPORT 1345  
Alaska Department of Environmental Conservation

# Source Water Assessment for the Tanana Health Center Drinking Water System Tanana, Alaska

PWSID # 360395.001

DRINKING WATER PROTECTION PROGRAM REPORT 1345

The Drinking Water Protection Program (DWPP) is producing Source Water Assessments in compliance with the Safe Drinking Water Act Amendments of 1996. Each assessment includes a delineation of the source water area, an inventory of potential and existing contaminant sources that may impact the water, a risk ranking for each of these contaminants, and an evaluation of the potential vulnerability of these drinking water sources.

These assessments are intended to provide public water systems owners/operators, communities, and local governments with the best available information that may be used to protect the quality of their drinking water. The assessments combine information obtained from various sources, including the U.S. Environmental Protection Agency, Alaska Department of Environmental Conservation (ADEC), public water system owners/operators, and other public information sources. The results of this assessment are subject to change if additional data becomes available. It is anticipated this assessment will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of public drinking water source. If you have any additional information that may affect the results of this assessment, please contact the Program Coordinator of DWPP, (907) 269-7521.

## CONTENTS

EXECUTIVE SUMMARY .....	1	INVENTORY OF POTENTIAL AND EXISTING	
PUBLIC DRINKING WATER SYSTEM .....	1	CONTAMINANT SOURCES .....	2
DRINKING WATER PROTECTION AREA.....	2	RANKING OF CONTAMINANT RISKS .....	2
		VULNERABILITY OF DRINKING WATER	
		SYSTEM .....	3

## TABLES

Table 1. Definition of Zones .....	2
Table 2. Susceptibility .....	3
Table 3. Contaminant Risks .....	4
Table 4. Overall Vulnerability .....	4

## APPENDICES

APPENDIX	A. Tanana Health Center Public Water System Drinking Water Protection Area (Map A)
	B. Contaminant Source Inventory for Tanana Health Center Public Water System (Table 1)
	Contaminant Source Inventory and Risk Ranking for Tanana Health Center Public Water System – Bacteria and Viruses (Table 2)
	Contaminant Source Inventory and Risk Ranking for Tanana Health Center Public Water System – Nitrates/Nitrites (Table 3)
	Contaminant Source Inventory and Risk Ranking for Tanana Health Center Public Water System – Volatile Organic Chemicals (Table 4)
	Contaminant Source Inventory and Risk Ranking for Tanana Health Center Public Water System – Heavy Metals, Cyanide and Other Inorganic Chemicals (Table 5)
	Contaminant Source Inventory and Risk Ranking for Tanana Health Center Public Water System – Other Organic Chemicals (Table 6)
	C. Tanana Health Center Public Water System Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)
	D. Vulnerability Analysis for Contaminant Source Inventory and Risk Ranking for Tanana Health Center Public Water System Public Drinking Water Source (Charts 1 – 14)

# Source Water Assessment for the Tanana Health Center Community Source of Public Drinking Water, Tanana, Alaska

---

## Drinking Water Protection Program Alaska Department of Environmental Conservation

### EXECUTIVE SUMMARY

The Tanana Health Center Public Water System (PWS) has one well. The well (PWS No. 360395.001) has been used as a drinking water source since it was drilled in 1976.

The well is a Class A (community and non-transient non-community) water system located south of the pumphouse and Health Center in Tanana, Alaska. Available records indicate that the drinking water is filtered and treated with sodium hypochlorite. Records also indicate that secondary storage with a capacity of 60,000-gallons is available. This system operates year round and serves approximately 12 residents and 95 non-residents through 15 service connections. The wellhead received a susceptibility rating of **Medium** and the aquifer received a susceptibility rating of **Very High**. Combining these two ratings produce a **High** rating for the natural susceptibility of the well.

Identified potential and current sources of contaminants for the public drinking water source include: gasoline stations, wastewater treatment facilities, large-capacity septic systems, fuel tanks, and ADEC recognized contaminated sites. A detailed inventory can be found in Table 1 of Appendix B. These identified potential and existing sources of contamination are considered sources of bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals contaminant categories.

Overall, the well received a vulnerability rating of **Very High** for bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, and other organic chemicals and a vulnerability rating of **High** for the synthetic organic chemicals contaminant categories.

### PUBLIC DRINKING WATER SYSTEM

The Tanana Health Center PWS well is a Class A (community/non-transient/non-community) public

water system. The system is located south of the pumphouse and Health Center in Tanana, Alaska (Sec. 17, T004N, R022W, Fairbanks Meridian, see Map A of Appendix A). The community of Tanana is located about two miles west of the junction of the Tanana and Yukon Rivers, 130 air miles west of Fairbanks. The community has a population of 290 (ADCED, 2003). Average annual precipitation in Tanana is 13 inches, including approximately 50 inches of snowfall. Temperatures can be as extreme as -71 to 94°F.

The residents of Tanana haul most of their water supply from the community water system. Honeybuckets and pit privies are used for sewage disposal (ADCED, 2003). Tanana residents rely on the Tanana Power Company for electricity, which is powered by diesel and wind turbine. Residents dispose of refuse at the Class III landfill, which is operated by the City of Tanana.

According to information supplied by ADEC for the Tanana Health Center PWS, the depth of the well is 155 feet below the ground surface. Based on available well construction details, the well is assumed to be screened in a confined aquifer. The well is suspected to be located within a floodplain. While the well is located approximately 2 miles away from the river it is conservatively assumed to be located in a suspected floodplain.

Information acquired from an May 1991 sanitary survey for the PWS indicated that the land surface was sloped away from the well. Generally, land surfaces that slope away from the wellhead promote surface water drainage, which reduces the potential of contaminant migration down the well casing annulus. The sanitary survey indicates that the well is grouted according to ADEC regulations. Proper grouting provides added protection against contaminants traveling along the well casing annulus and into source waters.

Soils in the Tanana area are generally described as organic near the surface, overlying a silt layer. The silt layer is found to be overlying sand and gravel, and the sand and gravel generally overlays bedrock.

The soil/bedrock interface is not easily identifiable due to weathering of the uppermost bedrock. Bedrock types encountered are sandstone, claystone, and schist (VSW, 1997).

## DRINKING WATER PROTECTION AREA

In order to evaluate whether a drinking water source is at risk, we must first evaluate what are the most likely pathways for surface contamination to reach the groundwater. These areas are determined by looking at the characteristics of the soil, groundwater, aquifer, and well.

The most probable area for contamination to reach the drinking water well is the area that contributes water to the well, the groundwater recharge area. This area is designated as the drinking water protection area (DWPA). Because releases of contaminants within the protection area are most likely to impact the drinking water well, this area will serve as the focus for voluntary protection efforts. An analytical calculation was used to determine the size and shape of the DWPA for the Tanana Health Center PWS. The input parameters describing the attributes of the aquifer in this calculation were adopted from Groundwater (Freeze and Cherry, 1979). Available geology and groundwater contours were also considered to take into account any uncertainties in groundwater flow and aquifer characteristics to arrive at a meaningful protection area.

The protection areas established for wells by the ADEC are usually separated into four zones, limited by the watershed. These zones correspond to differences in the time-of-travel (TOT) of the water moving through the aquifer to the well (Please refer to the Guidance Manual for Class A Public Water Systems for additional information).

The time of travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. The following is a summary of the four protection area zones for wells and the calculated time -of-travel for each:

**Table 1. Definition of Zones**

Zone	Definition
A	¼ the distance for the 2-yr. time -of-travel
B	Less than the 2 year time-of-travel
C	Less Than the 5 year time -of-travel
D	Less than the 10 year time -of-travel

The DWPA for the Tanana Health Center PWS was determined using an analytical calculation and

includes Zones A, B, C and D (See Map A of Appendix A).

## INVENTORY OF POTENTIAL AND EXISTING CONTAMINANT SOURCES

The Drinking Water Protection Program has completed an inventory of potential and existing sources of contamination within the Tanana Health Center PWS DWPA. This inventory was completed through a search of agency records and other publicly available information. Potential sources of contamination to the drinking water aquifer include a wide range of categories and types. Potential drinking water contaminants are found within agricultural, residential, commercial, and industrial areas, but can also occur within areas that have little or no development.

For the basis of all Class A public water system assessments, six categories of drinking water contaminants were inventoried. They include:

- Bacteria and viruses,
- Nitrates and/or nitrites,
- Volatile organic chemicals,
- Heavy metals, cyanide and other inorganic chemicals,
- Synthetic organic chemicals, and
- Other organic chemicals.

The sources are displayed on Map C of Appendix C and summarized in Table 1 of Appendix B.

## RANKING OF CONTAMINANT RISKS

Once the potential and existing sources of contamination have been identified, they are assigned a ranking according to what type and level of risk they represent. Ranking of contaminant risks for a “potential” or “existing” source of contamination is a function of toxicity and volumes of specific contaminants associated with that source. Rankings include:

- Low,
- Medium,
- High, and
- Very High.

The time-of-travel for contaminants within the water varies and is dependent on the physical and chemical characteristics of each contaminant. Bacteria and Viruses are only inventoried in Zones A and B because of their short life span. Only “Very High” and “High” rankings are inventoried within the outer

Zone D due to the probability of contaminant dilution by the time the contaminants get to the well.

Tables 2 through 7 in Appendix B contain the ranking of potential and existing sources of contamination with respect to bacteria and viruses, nitrates and/or nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, and other organic chemicals.

## VULNERABILITY OF THE DRINKING WATER SYSTEM

Vulnerability of a drinking water source to contamination is a combination of two factors:

- Natural susceptibility, and
- Contaminant risks.

Appendix D contains fourteen charts, which together form the 'Vulnerability Analysis' for a source water assessment for a public drinking water source. Chart 1 analyzes the 'Susceptibility of the Wellhead' to contamination by looking at the construction of the well and its surrounding area. Chart 2 analyzes the 'Susceptibility of the Aquifer' to contamination by looking at the naturally occurring attributes of the water source and influences on the groundwater system that might lead to contamination. Chart 3 analyzes 'Contaminant Risks' for the drinking water source with respect to bacteria and viruses. The 'Contaminant Risks' portion of the analysis considers potential sources of contaminants as well as a review of contamination that has or may have occurred, but has not arrived or been detected at the well. Chart 4 contains the 'Vulnerability Analysis for Bacteria and Viruses'. Charts 5 through 14 contain the Contaminant Risks and Vulnerability Analyses for nitrates and nitrites, volatile organic chemicals, heavy metals, cyanide and other inorganic chemicals, synthetic organic chemicals, and other organic chemicals, respectively.

A score for the Natural Susceptibility is reached by considering the properties of the well and the aquifer.

Susceptibility of the Wellhead (0 – 25 Points)  
(Chart 1 of Appendix D)

+

Susceptibility of the Aquifer (0 – 25 Points)  
(Chart 2 of Appendix D)

=

Natural Susceptibility (Susceptibility of the Well)  
(0 – 50 Points)

A ranking is assigned for the Natural Susceptibility according to the point score:

Natural Susceptibility Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

The Tanana Health Center PWS's water well is completed in a confined aquifer. Confined aquifers are less susceptible to potential groundwater quality impacts posed by the migration of surface water contaminants downward from the surface. Table 2 shows the susceptibility scores and ratings for this PWS.

**Table 2. Susceptibility**

	Score	Rating
Susceptibility of the Wellhead	10	Medium
Susceptibility of the Aquifer	25	Very High
Natural Susceptibility	35	High

Contaminant risks to a drinking water source depend on the type, number or density, and distribution of contaminant sources. This score has been derived from an examination of existing and historical contamination that has been detected at the drinking water source through routine sampling. It also evaluates potential sources of contamination. Flow charts are used to assign a point score, and ratings are assigned in the same way as for the natural susceptibility:

Contaminant Risk Ratings	
40 to 50 pts	Very High
30 to < 40 pts	High
20 to < 30 pts	Medium
< 20 pts	Low

Table 3 summarizes the Contaminant Risks for each category of drinking water contaminants.

**Table 3. Contaminant Risks**

Category	Score	Rating
Bacteria and Viruses	50	Very High
Nitrates and/or Nitrites	50	Very High
Volatile Organic Chemicals	50	Very High
Heavy Metals, Cyanide and		
Other Inorganic Chemicals	50	Very High
Synthetic Organic Chemicals	28	Medium
Other Organic Chemicals	50	Very High

Finally, an overall vulnerability score is assigned for each water system by combining each of the contaminant risk scores with the natural susceptibility score:

$$\begin{array}{r}
 \text{Natural Susceptibility (0 – 50 points)} \\
 + \\
 \text{Contaminant Risks (0 – 50 points)} \\
 = \\
 \text{Vulnerability of the} \\
 \text{Drinking Water Source to Contamination (0 – 100).}
 \end{array}$$

Again, rankings are assigned according to a point score:

Overall Vulnerability Ratings	
80 to 100 pts	Very High
60 to < 80 pts	High
40 to < 60 pts	Medium
< 40 pts	Low

Table 4 contains the overall vulnerability scores (0 – 100) and ratings for each of the six categories of drinking water contaminants. Note: scores are rounded off to the nearest five.

**Table 4. Overall Vulnerability**

Category	Score	Rating
Bacteria and Viruses	85	Very High
Nitrates and Nitrites	85	Very High
Volatile Organic Chemicals	85	Very High
Heavy Metals, Cyanide and		
Other Inorganic Chemicals	85	Very High
Synthetic Organic Chemicals	65	High
Other Organic Chemicals	85	Very High

### Bacteria and Viruses

The contaminant risk for bacteria and viruses is **Very High**. The risk is primarily attributed to the presence of large capacity septic systems located in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 2 – Appendix B).

Coliforms (a bacteria) are found naturally in the environment and although they aren't necessarily a health threat, they are an indicator of other potentially harmful bacteria in the water, more specifically, fecal coliforms and E. coli, which only come from human and animal fecal waste. Harmful bacteria can cause diarrhea, cramps, nausea, headaches, or other symptoms (EPA, 2002). Positive samples increase the overall vulnerability of the drinking water source, indicating that the source is susceptible to bacteria and virus contamination.

No positive bacteria counts have been reported in recent (within five years) sampling events (See Chart 3 – Contaminant Risks for Bacteria and Viruses in Appendix D). Only a small amount of bacteria and viruses are required to endanger public health.

After combining the contaminant risk for bacteria and viruses with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**.

### Nitrates and Nitrites

The contaminant risk for nitrates and nitrites is **Very High**. The risk to this source of public drinking water is primarily attributed to the presence of large capacity septic systems located in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 3 – Appendix B).

Nitrates are very mobile, moving at approximately the same rate as water. The sampling history for this well indicates that nitrates have been detected in recent sampling events, but have not exceeded the MCL of 10 mg/L. Nitrate concentrations in uncontaminated groundwater are typically less than 2 mg/L; therefore, nitrate concentrations above 2 mg/L may be indicative of man-made sources (See Chart 5 – Contaminant Risks for Nitrates and/or Nitrites in Appendix D).

Nitrate levels are often derived from the decomposition of organic matter in soils. Although the nitrate source is unknown, such occurrences may be attributed to septic systems or other sources.

After combining the contaminant risk for nitrates and nitrites with the natural susceptibility of the well, the overall vulnerability of the well to nitrate and nitrite contamination is **Very High**.

### **Volatile Organic Chemicals**

The contaminant risk for volatile organic chemicals is **Very High**. The risk is primarily attributed to the presence of Gasoline stations, ADEC recognized contaminated sites, and fuel tanks located in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 4 – Appendix B).

Recent sampling results indicate the presence total trihalomethanes (TTHM's). TTHM's are considered byproducts of the water treatment process and are not representative of source water conditions. Risk points were not assigned because the MCL was not exceeded in recent sampling results (See Chart 7 – Contaminant Risks for Volatile Organic Chemicals in Appendix D).

Other possible sources of volatile organic chemicals include facilities with automobiles, residential areas, fuel tanks, and roads. See Table 4 in Appendix B for a complete listing.

After combining the contaminant risk for volatile organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**.

### **Heavy Metals, Cyanide and Other Inorganic Chemicals**

The contaminant risk for heavy metals, cyanide and other inorganic chemicals is **Very High**. The risk is primarily attributed to the presence of lead and copper in recent sampling results and motor vehicle waste injection wells located in Zone A. Numerous other potential contaminant sources are also found within the protection area (see Table 5 – Appendix B).

Based on review of recent sampling records for this PWS, high levels of copper and lead have been detected that have exceeded their MCL's of 1.3 and 0.015 mg/L (respectively) (see Chart 9 – Contaminant Risks for Heavy Metals, Cyanide, and Other Inorganic Chemicals in Appendix D).

The reported concentrations of copper are likely attributed to the water treatment/conveyance system and may be indicative of recent maintenance to the system. Risk points were assigned due to the MCL being exceeded.

After combining the contaminant risk for heavy metals, cyanide and other inorganic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**.

### **Synthetic Organic Chemicals**

The contaminant risk for synthetic organic chemicals is **Medium**. The risk is primarily attributed to an airport located in Zone B and a cemetery located in Zone A. Numerous other contaminant sources are also located within the protection area (see Table 6 – Appendix B).

No recent sampling data was available in ADEC records for the Tanana Health Center PWS (See Chart 11 – Contaminant Risks for Synthetic Organic Chemicals in Appendix D).

After combining the contaminant risk for synthetic organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **High**.

### **Other Organic Chemicals**

The contaminant risk for other organic chemicals is **Very High**. The risk is primarily attributed to the presence of bulk fuel facilities located in Zone A.

No recent sampling data was available in ADEC records for the Tanana Health Center PWS (See Chart 13 – Contaminant Risks for Other Organic Chemicals in Appendix D).

After combining the contaminant risk for other organic chemicals with the natural susceptibility of the well, the overall vulnerability of the well to contamination is **Very High**.

### **Using the Source Water Assessment**

This assessment of contaminant risks can be used as a foundation for local voluntary protection efforts as well as a basis for the continuous efforts on the part of the community of Tanana to protect public health. It is anticipated that Source Water Assessments will be updated every five years to reflect any changes in the vulnerability and/or susceptibility of the drinking water source.



## REFERENCES

- Alaska Department of Community and Economic Development (ADCED), 2003 [WWW document]. URL: [http://www.dced.state.ak.us/cbd/commdb/CF\\_COMDB.htm](http://www.dced.state.ak.us/cbd/commdb/CF_COMDB.htm)
- Alaska Department of Environmental Conservation, Contaminated Sites Database, 2003 [WWW database], URL [http://www.state.ak.us/dec/dspar/csites/cs\\_search.htm](http://www.state.ak.us/dec/dspar/csites/cs_search.htm)
- Alaska Department of Environmental Conservation, Leaking Underground Storage Tank Database, 2003 [WWW database], URL [http://www.dec.state.ak.us/spar/stp/ust/search/fac\\_search.asp](http://www.dec.state.ak.us/spar/stp/ust/search/fac_search.asp)
- Freeze, R. A., and Cherry, J.A. 1979, Groundwater, Prentice-Hall, Englewood Cliffs, New Jersey
- Village Safe Water, 1997, Correspondence from ADEC file and Montgomery Watson Water Source Evaluation for Tanana, Alaska
- United States Environmental Protection Agency (EPA), 2002 [WWW document]. URL <http://www.epa.gov/safewater/mcl.html>.

## **APPENDIX A**

### **Drinking Water Protection Area Location Map (Map A)**

## **APPENDIX B**

### **Contaminant Source Inventory and Risk Ranking (Tables 1-7)**

## **APPENDIX C**


### **Drinking Water Protection Area and Potential and Existing Contaminant Sources (Map C)**

## **APPENDIX D**

### **Vulnerability Analysis for Public Drinking Water Source (Charts 1-14)**



Public Water Well System for PWS # 360395.001 Tanana Health Center

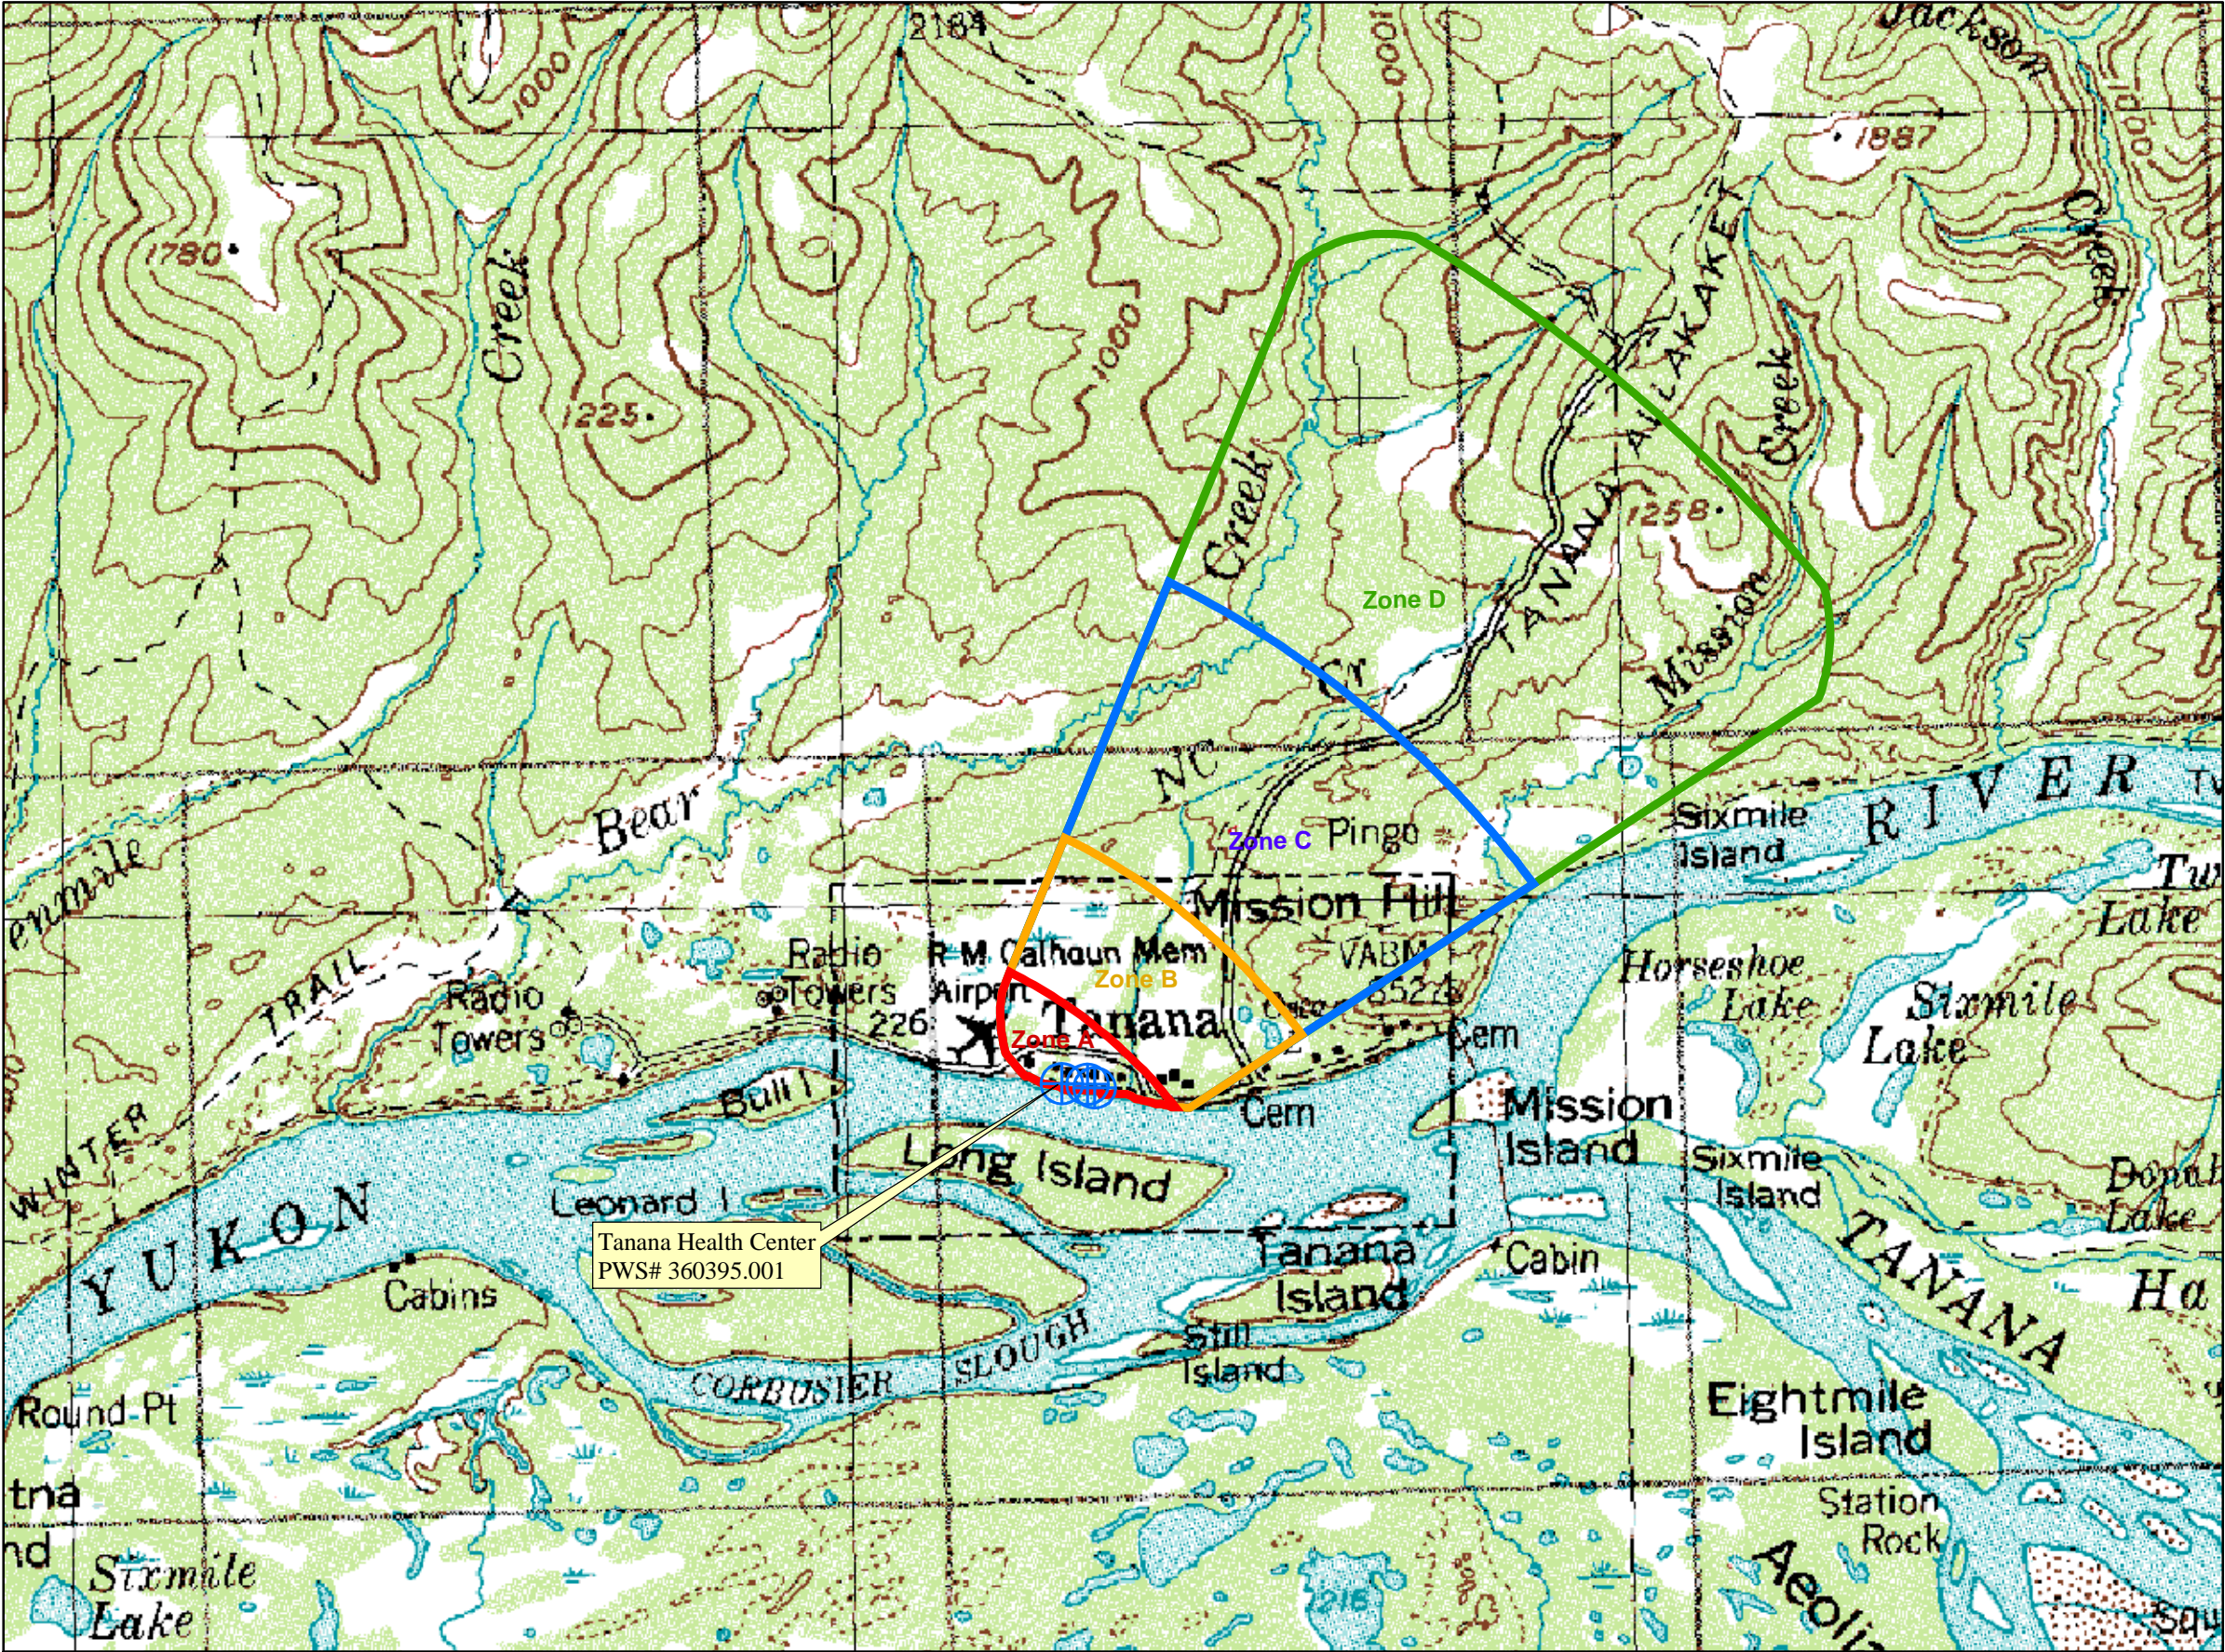

**LEGEND**

Public Water System Well

**Hydrography/Physical**

Parcels

Stream

Lake or Pond

Contours

**Transportation**

Primary Route (Class 1)

Secondary Route (Class 2)

Road (Class 3)

Road (Class 4)

Road (Class 5, Four-wheel drive)

**Groundwater Protection Zones**

Zone A Protection Area- Several Months Travel Time

Zone B Protection Area- 2 Years Travel Time


Zone C Protection Area- 5 Years Travel Time

Zone D Protection Area- 10 Years Travel Time

Data Sources:  
Contaminant Sources, Public Water System Wells, Contours  
Alaska Department of Environmental Conservation (ADEC)

All other data:  
United States Geological Survey (USGS)  
Drinking Water Protection Areas based on "Alaska Drinking  
Water Protection Program - Guidance Manual for Class A  
Public Water Systems" published by ADEC

URS Corporation does not guarantee the accuracy or  
validity of the data provided.

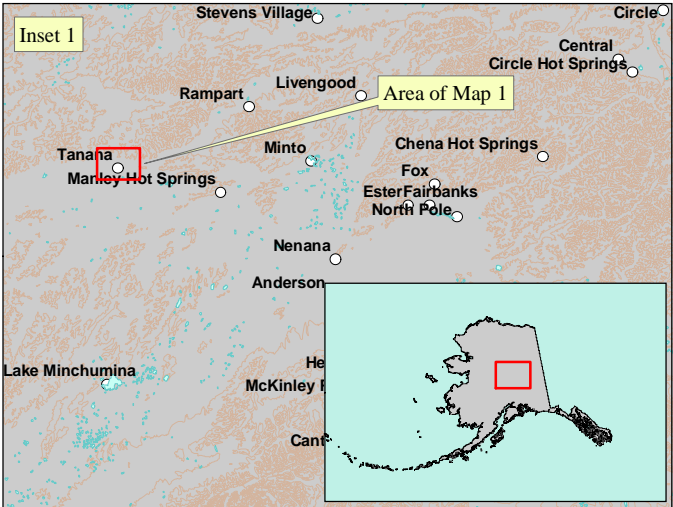

0 1 2 4 6 8 Miles

Tanana Health Center  
PWS# 360395.001  
Appendix A Map A



**Table 1**

**Contaminant Source Inventory for  
Tanana Health Center**

**PWSID 360395.001**

<b>Contaminant Source Type</b>	<b>Contaminant Source ID</b>	<b>CS ID tag</b>	<b>Zone</b>	<b>Map Number</b>	<b>Comments</b>
Gasoline stations (without repair shop)	C15	C15-01	A	C	TANANA GAS COMPANY
Laundromats without dry cleaning	C22	C22-01	A	C	Washeteria and Water Treatment Plant
Motor /motor vehicle repair shops	C31	C31-01	A	C	City Garage
Motor /motor vehicle repair shops	C31	C31-02	A	C	Bear Creek RRS Vehicle Maint Shop
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	A	C	Assume 10 or less sewer lines in Zone A
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	A	C	
Domestic wastewater treatment plants	D05	D05-01	A	C	Sewage Lagoon
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	C	FAA - TANANA
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	A	C	FAA - TANANA
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	A	C	TANANA-AK NATIVE HEALTH CLINIC
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-04	A	C	TANANA-VSW
Pit toilets (open hole), nonresidential (one or more)	D16	D16-01	A	C	Assume 100 or less pit toilets/outhouses in Zone A
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-01	A	C	Bear Creek RRS Vehicle Maint Shop
Septic systems (serves one single-family home)	R02	R02-01	A	C	Assume 10 or less septic systems in Zone A
Tanks, heating oil, residential (above ground)	R08	R08-01	A	C	Assume 30 or less residential heating oil tanks in Zone A
Tanks, diesel (above ground)	T06	T06-01	A	C	School Backup Generator
Tanks, diesel (underground)	T08	T08-01	A	C	TANANA GAS COMPANY
Closed tanks, diesel (underground)	T09	T09-01	A	C	TANANA HEALTH CENTER
Closed tanks, diesel (underground)	T09	T09-02	A	C	TANANA HEALTH CENTER

<b>Contaminant Source Type</b>	<b>Contaminant Source ID</b>	<b>CS ID tag</b>	<b>Zone</b>	<b>Map Number</b>	<b>Comments</b>
Tanks, gasoline (underground)	T12	T12-01	A	C	TANANA GAS COMPANY
Tanks, gasoline (underground)	T12	T12-02	A	C	TANANA GAS COMPANY
Tanks, gasoline (underground)	T12	T12-03	A	C	TANANA GAS COMPANY
Closed tanks, gasoline (underground)	T13	T13-01	A	C	Tanana Commercial
Closed tanks, gasoline (underground)	T13	T13-02	A	C	ADOTPF - TANANA AIRPORT
Closed tanks, gasoline (underground)	T13	T13-03	A	C	ADOTPF - TANANA AIRPORT
Closed tanks, gasoline (underground)	T13	T13-04	A	C	ADOTPF - TANANA AIRPORT
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	A	C	Tanana Power Company
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	A	C	Tanana Health Center
Tanks, heating oil, nonresidential (aboveground)	T14	T14-03	A	C	Dons Video
Tanks, heating oil, nonresidential (aboveground)	T14	T14-04	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-05	A	C	Telephone Company
Tanks, heating oil, nonresidential (aboveground)	T14	T14-06	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-07	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-08	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-09	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-10	A	C	Tanana Volunteer Fire/EMS
Tanks, heating oil, nonresidential (aboveground)	T14	T14-11	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-12	A	C	Tanana City Police
Tanks, heating oil, nonresidential (aboveground)	T14	T14-13	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-14	A	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-15	A	C	MAUDREY J SOMMER SCHOOL
Tanks, heating oil, nonresidential (aboveground)	T14	T14-16	A	C	



<b>Contaminant Source Type</b>	<b>Contaminant Source ID</b>	<b>CS ID tag</b>	<b>Zone</b>	<b>Map Number</b>	<b>Comments</b>
Tanks, heating oil, nonresidential (underground)	T16	T16-01	A	C	TANANA ZONE HEADQUARTER
Tanks, heating oil, nonresidential (underground)	T16	T16-02	A	C	FAA - TANANA
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-01	A	C	Tanana City Drinking Water Well. Reckey: 1996310130501. Status: Active. Increasing concentrations of benzene have been measured in drinking water supply wells beginning in 1992. Benzene concentrations below MCLs.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-02	A	C	FAA Tanana Station. Reckey: 1994310134901. Status: Active. Petroleum hydrocarbon contamination present in site soils and groundwater; free product present in wells at various locations at the facility, including wells adjacent to the Yukon River.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-03	A	C	Bear Creek RRS White Alice Site
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-04	A	C	Bear Creek RRS Vehicle Maint Shop. Reckey: 198931X902546. Status: Active. Contaminants include POL products, metals from waste oils, batteries, and diesel fuel. Soil contamination is extensive.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-05	A	C	Tanana Health Center. Reckey: 1982310136302. Status: Active. Fuel spill from AST in 1975. Contaminated well abandoned in 1976. Fuel spill at pumphouse in 1984.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-06	A	C	Tanana Health Center. Reckey: 1982310136302. Status: Active. Fuel spill from AST in 1975. Contaminated well abandoned in 1976. Fuel spill at pumphouse in 1984.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-07	A	C	FAA Tanana FABLM/AK Fire Serv.F.S. Reckey: 1989310902514. Status: Active. Reported potential contaminants onsite in unknown quantities include petroleum, oil, lubricant waste, PCBs, asbestos, solvents, herbicides, paints, antifreeze.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-08	A	C	Bear Creek RRS POL Storage Area. Reckey: 198931X102544. Status: Active. The POL storage area was operated from 1959 to 1975. Diesel fuel leaks occurred from valves and pipes. The extent of contamination is unknown.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-09	A	C	Bear Creek Radio Relay Station. Reckey: 198931X902510. Status: Active. Soil contaminated by PCBs and vandalism of transformers caused oil leakage. Other possible contaminants include petroleum products, and halogenated/non-halogenated solvents.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-10	A	C	Bear Creek RRS Landfill. Reckey: 198931X902545. Status: Active. Diesel fuel, waste oil, metals, and PCBs are the contaminants of concern. Soil contamination is extensive.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-11	A	C	Bear Creek RRS Vehicle Maint Shop. Reckey: 198931X902546. Status: Active. Contaminants include POL products, metals from waste oils, batteries, and diesel fuel. Soil contamination is extensive.

<b>Contaminant Source Type</b>	<b>Contaminant Source ID</b>	<b>CS ID tag</b>	<b>Zone</b>	<b>Map Number</b>	<b>Comments</b>
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-12	A	C	BLM/AK Fire Service Housing Complex. Reckey: 1993310126601. Status: Inactive. Groundwater impacted and contamination moving towards Yukon river 200 yards from site.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-13	A	C	FAA Tanana Station. Reckey: 1994310134901. Status: Active. Petroleum hydrocarbon contamination present in site soils and groundwater; free product present in wells at various locations at the facility, including wells adjacent to the Yukon River.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-14	A	C	Tanana Lot 3 Former Tank Farm. Reckey: 2001310105901. Status: Active. Petroleum contamination in the DRO range at 33,200ppm. Drinking water well within 100 feet of contaminated area tested clean of petroleum contaminants.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-15	A	C	Tanana Power Company. Reckey: 2002310108501. Status: Active. Surface soils with dark stains and devoid of vegetation. Elevated levels of BTEX, GRO, DRO, RRO, SVOCs, PAHs and trace levels of pesticides (DDT).
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-01	A	C	TANANA ZONE HEADQUARTER
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-02	A	C	FAA - TANANA
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-03	A	C	TANANA GAS COMPANY
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-04	A	C	TANANA HEALTH CENTER
Water supply wells	W09	W09-01	A	C	Tanana City Drinking Water Well
Cemeteries	X01	X01-01	A	C	
Municipal or city parks (with green areas)	X04	X04-01	A	C	
Petroleum product bulk station/terminals	X11	X11-01	A	C	Bulk Fuel Storage-City
Petroleum product bulk station/terminals	X11	X11-02	A	C	Bulk Fuel Storage-Tanana Power Company
Petroleum product bulk station/terminals	X11	X11-03	A	C	Bulk Fuel Storage-Tribal Council
Petroleum product bulk station/terminals	X11	X11-04	A	C	Dons Video
Petroleum product bulk station/terminals	X11	X11-05	A	C	School Backup Generator
Petroleum product bulk station/terminals	X11	X11-06	A	C	School-north
Petroleum product bulk station/terminals	X11	X11-07	A	C	School-USTs
Petroleum product bulk station/terminals	X11	X11-08	A	C	Waheteria

<b><i>Contaminant Source Type</i></b>	<b><i>Contaminant Source ID</i></b>	<b><i>CS ID tag</i></b>	<b><i>Zone</i></b>	<b><i>Map Number</i></b>	<b><i>Comments</i></b>
Boat yards and marinas	X15	X15-01	A	C	Dock
Highways and roads, dirt/gravel	X24	X24-01	A	C	Assume 1-20 roads in Zone A
Pipelines (oil and gas)	X28	X28-01	A	C	Barge to Bulk Fuel Tanks
Pipelines (oil and gas)	X28	X28-02	A	C	Barge to Bulk Fuel Tanks
Electric power generation (fossil fuels)	X36	X36-01	A	C	Tanana Power Company
Firehouses	X38	X38-01	A	C	Tanana Volunteer Fire/EMS
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	A	C	Tanana Health Center
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-02	A	C	TANANA HEALTH CENTER
Airports	X14	X14-01	B	C	TANANA LANDING STRIP

Table 2

*Contaminant Source Inventory and Risk Ranking for  
Tanana Health Center  
Sources of Bacteria and Viruses*

PWSID 360395.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Laundromats without dry cleaning	C22	C22-01	A	Low	C	Washeteria and Water Treatment Plant
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	A	Medium	C	Assume 10 or less sewer lines in Zone A
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	A	High	C	
Domestic wastewater treatment plants	D05	D05-01	A	Medium	C	Sewage Lagoon
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	High	C	FAA - TANANA
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	A	High	C	FAA - TANANA
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	A	High	C	TANANA-AK NATIVE HEALTH CLINIC
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-04	A	High	C	TANANA-VSW
Pit toilets (open hole), nonresidential (one or more)	D16	D16-01	A	Medium	C	Assume 100 or less pit toilets/outhouses in Zone A
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-01	A	Low	C	Bear Creek RRS Vehicle Maint Shop
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 10 or less septic systems in Zone A
Municipal or city parks (with green areas)	X04	X04-01	A	Medium	C	
Highways and roads, dirt/gravel	X24	X24-01	A	Low	C	Assume 1-20 roads in Zone A
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	A	Medium	C	Tanana Health Center
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-02	A	Medium	C	TANANA HEALTH CENTER

Table 3

*Contaminant Source Inventory and Risk Ranking for  
Tanana Health Center  
Sources of Nitrates/Nitrites*

PWSID 360395.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Laundromats without dry cleaning	C22	C22-01	A	Low	C	Washeteria and Water Treatment Plant
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	A	Medium	C	Assume 10 or less sewer lines in Zone A
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	A	High	C	
Domestic wastewater treatment plants	D05	D05-01	A	Medium	C	Sewage Lagoon
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	High	C	FAA - TANANA
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	A	High	C	FAA - TANANA
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	A	High	C	TANANA-AK NATIVE HEALTH CLINIC
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-04	A	High	C	TANANA-VSW
Pit toilets (open hole), nonresidential (one or more)	D16	D16-01	A	Medium	C	Assume 100 or less pit toilets/outhouses in Zone A
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 10 or less septic systems in Zone A
Cemeteries	X01	X01-01	A	Medium	C	
Municipal or city parks (with green areas)	X04	X04-01	A	Medium	C	
Highways and roads, dirt/gravel	X24	X24-01	A	Low	C	Assume 1-20 roads in Zone A
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	A	Low	C	Tanana Health Center
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-02	A	Low	C	TANANA HEALTH CENTER
Airports	X14	X14-01	B	Low	C	TANANA LANDING STRIP

Table 4

*Contaminant Source Inventory and Risk Ranking for  
Tanana Health Center  
Sources of Volatile Organic Chemicals*

PWSID 360395.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Gasoline stations (without repair shop)	C15	C15-01	A	High	C	TANANA GAS COMPANY
Laundromats without dry cleaning	C22	C22-01	A	Low	C	Washeteria and Water Treatment Plant
Motor /motor vehicle repair shops	C31	C31-01	A	Medium	C	City Garage
Motor /motor vehicle repair shops	C31	C31-02	A	Medium	C	Bear Creek RRS Vehicle Maint Shop
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	A	Low	C	Assume 10 or less sewer lines in Zone A
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	A	Low	C	
Domestic wastewater treatment plants	D05	D05-01	A	Low	C	Sewage Lagoon
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	C	FAA - TANANA
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	A	Low	C	FAA - TANANA
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	A	Low	C	TANANA-AK NATIVE HEALTH CLINIC
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-04	A	Low	C	TANANA-VSW
Pit toilets (open hole), nonresidential (one or more)	D16	D16-01	A	Low	C	Assume 100 or less pit toilets/outhouses in Zone A
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-01	A	High	C	Bear Creek RRS Vehicle Maint Shop
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 10 or less septic systems in Zone A
Tanks, heating oil, residential (above ground)	R08	R08-01	A	Medium	C	Assume 30 or less residential heating oil tanks in Zone A
Tanks, diesel (above ground)	T06	T06-01	A	Medium	C	School Backup Generator
Tanks, diesel (underground)	T08	T08-01	A	High	C	TANANA GAS COMPANY
Closed tanks, diesel (underground)	T09	T09-01	A	Medium	C	TANANA HEALTH CENTER

Table 4 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Tanana Health Center  
Sources of Volatile Organic Chemicals*

PWSID 360395.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Closed tanks, diesel (underground)	T09	T09-02	A	Medium	C	TANANA HEALTH CENTER
Tanks, gasoline (underground)	T12	T12-01	A	High	C	TANANA GAS COMPANY
Tanks, gasoline (underground)	T12	T12-02	A	High	C	TANANA GAS COMPANY
Tanks, gasoline (underground)	T12	T12-03	A	High	C	TANANA GAS COMPANY
Closed tanks, gasoline (underground)	T13	T13-01	A	Medium	C	Tanana Commercial
Closed tanks, gasoline (underground)	T13	T13-02	A	Medium	C	ADOTPF - TANANA AIRPORT
Closed tanks, gasoline (underground)	T13	T13-03	A	Medium	C	ADOTPF - TANANA AIRPORT
Closed tanks, gasoline (underground)	T13	T13-04	A	Medium	C	ADOTPF - TANANA AIRPORT
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	A	Low	C	Tanana Power Company
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	A	Low	C	Tanana Health Center
Tanks, heating oil, nonresidential (aboveground)	T14	T14-03	A	Low	C	Dons Video
Tanks, heating oil, nonresidential (aboveground)	T14	T14-04	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-05	A	Low	C	Telephone Company
Tanks, heating oil, nonresidential (aboveground)	T14	T14-06	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-07	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-08	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-09	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-10	A	Low	C	Tanana Volunteer Fire/EMS
Tanks, heating oil, nonresidential (aboveground)	T14	T14-11	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-12	A	Low	C	Tanana City Police

Table 4 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Tanana Health Center  
Sources of Volatile Organic Chemicals*

PWSID 360395.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Tanks, heating oil, nonresidential (aboveground)	T14	T14-13	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-14	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-15	A	Low	C	MAUDREY J SOMMER SCHOOL
Tanks, heating oil, nonresidential (aboveground)	T14	T14-16	A	Low	C	
Tanks, heating oil, nonresidential (underground)	T16	T16-01	A	Low	C	TANANA ZONE HEADQUARTER
Tanks, heating oil, nonresidential (underground)	T16	T16-02	A	Low	C	FAA - TANANA
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-01	A	High	C	Tanana City Drinking Water Well. Reckey: 1996310130501. Status: Active. Increasing concentrations of benzene have been measured in drinking water supply wells beginning in 1992. Benzene concentrations below MCLs.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-02	A	High	C	FAA Tanana Station. Reckey: 1994310134901. Status: Active. Petroleum hydrocarbon contamination present in site soils and groundwater; free product present in wells at various locations at the facility, including wells adjacent to the Yukon River.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-03	A	High	C	Bear Creek RRS White Alice Site
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-04	A	High	C	Bear Creek RRS Vehicle Maint Shop. Reckey: 198931X902546. Status: Active. Contaminants include POL products, metals from waste oils, batteries, and diesel fuel. Soil contamination is extensive.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-05	A	High	C	Tanana Health Center. Reckey: 1982310136302. Status: Active. Fuel spill from AST in 1975. Contaminated well abandoned in 1976. Fuel spill at pumphouse in 1984.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-06	A	High	C	Tanana Health Center. Reckey: 1982310136302. Status: Active. Fuel spill from AST in 1975. Contaminated well abandoned in 1976. Fuel spill at pumphouse in 1984.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-07	A	High	C	FAA Tanana FABL/MAK Fire Serv.F.S. Reckey: 1989310902514. Status: Active. Reported potential contaminants onsite in unknown quantities include petroleum, oil, lubricant waste, PCBs, asbestos, solvents, herbicides, paints, antifreeze.



Table 4 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Tanana Health Center  
Sources of Volatile Organic Chemicals*

PWSID 360395.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-08	A	High	C	Bear Creek RRS POL Storage Area. Reckey: 198931X102544. Status: Active. The POL storage area was operated from 1959 to 1975. Diesel fuel leaks occurred from valves and pipes. The extent of contamination is unknown.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-09	A	High	C	Bear Creek Radio Relay Station. Reckey: 198931X902510. Status: Active. Soil contaminated by PCBs and vandalism of transformers caused oil leakage. Other possible contaminants include petroleum products, and halogenated/non-halogenated solvents.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-10	A	High	C	Bear Creek RRS Landfill. Reckey: 198931X902545. Status: Active. Diesel fuel, waste oil, metals, and PCBs are the contaminants of concern. Soil contamination is extensive.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-11	A	High	C	Bear Creek RRS Vehicle Maint Shop. Reckey: 198931X902546. Status: Active. Contaminants include POL products, metals from waste oils, batteries, and diesel fuel. Soil contamination is extensive.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-12	A	High	C	BLM/AK Fire Service Housing Complex. Reckey: 1993310126601. Status: Inactive. Groundwater impacted and contamination moving towards Yukon river 200 yards from site.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-13	A	High	C	FAA Tanana Station. Reckey: 1994310134901. Status: Active. Petroleum hydrocarbon contamination present in site soils and groundwater; free product present in wells at various locations at the facility, including wells adjacent to the Yukon River.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-14	A	High	C	Tanana Lot 3 Former Tank Farm. Reckey: 2001310105901. Status: Active. Petroleum contamination in the DRO range at 33,200ppm. Drinking water well within 100 feet of contaminated area tested clean of petroleum contaminants.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-15	A	High	C	Tanana Power Company. Reckey: 2002310108501. Status: Active. Surface soils with dark stains and devoid of vegetation. Elevated levels of BTEX, GRO, DRO, RRO, SVOCs, PAHs and trace levels of pesticides (DDT).
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-01	A	High	C	TANANA ZONE HEADQUARTER
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-02	A	High	C	FAA - TANANA
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-03	A	High	C	TANANA GAS COMPANY

Table 4 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Tanana Health Center  
Sources of Volatile Organic Chemicals*

PWSID 360395.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-04	A	High	C	TANANA HEALTH CENTER
Petroleum product bulk station/terminals	X11	X11-01	A	Very High	C	Bulk Fuel Storage-City
Petroleum product bulk station/terminals	X11	X11-02	A	Very High	C	Bulk Fuel Storage-Tanana Power Company
Petroleum product bulk station/terminals	X11	X11-03	A	Very High	C	Bulk Fuel Storage-Tribal Council
Petroleum product bulk station/terminals	X11	X11-04	A	Very High	C	Dons Video
Petroleum product bulk station/terminals	X11	X11-05	A	Very High	C	School Backup Generator
Petroleum product bulk station/terminals	X11	X11-06	A	Very High	C	School-north
Petroleum product bulk station/terminals	X11	X11-07	A	Very High	C	School-USTs
Petroleum product bulk station/terminals	X11	X11-08	A	Very High	C	Waheteria
Boat yards and marinas	X15	X15-01	A	Low	C	Dock
Highways and roads, dirt/gravel	X24	X24-01	A	Low	C	Assume 1-20 roads in Zone A
Pipelines (oil and gas)	X28	X28-01	A	Medium	C	Barge to Bulk Fuel Tanks
Pipelines (oil and gas)	X28	X28-02	A	Medium	C	Barge to Bulk Fuel Tanks
Electric power generation (fossil fuels)	X36	X36-01	A	Medium	C	Tanana Power Company
Firehouses	X38	X38-01	A	Low	C	Tanana Volunteer Fire/EMS
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	A	Low	C	Tanana Health Center
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-02	A	Low	C	TANANA HEALTH CENTER
Airports	X14	X14-01	B	High	C	TANANA LANDING STRIP

Table 5

## Contaminant Source Inventory and Risk Ranking for

PWSID 360395.001

## Tanana Health Center

## Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Gasoline stations (without repair shop)	C15	C15-01	A	Low	C	TANANA GAS COMPANY
Motor /motor vehicle repair shops	C31	C31-01	A	Medium	C	City Garage
Motor /motor vehicle repair shops	C31	C31-02	A	Medium	C	Bear Creek RRS Vehicle Maint Shop
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	A	Low	C	Assume 10 or less sewer lines in Zone A
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	A	Low	C	
Domestic wastewater treatment plants	D05	D05-01	A	Low	C	Sewage Lagoon
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	C	FAA - TANANA
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	A	Low	C	FAA - TANANA
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	A	Low	C	TANANA-AK NATIVE HEALTH CLINIC
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-04	A	Low	C	TANANA-VSW
Pit toilets (open hole), nonresidential (one or more)	D16	D16-01	A	Low	C	Assume 100 or less pit toilets/outhouses in Zone A
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-01	A	High	C	Bear Creek RRS Vehicle Maint Shop
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 10 or less septic systems in Zone A
Tanks, gasoline (underground)	T12	T12-01	A	Medium	C	TANANA GAS COMPANY
Tanks, gasoline (underground)	T12	T12-02	A	Medium	C	TANANA GAS COMPANY
Tanks, gasoline (underground)	T12	T12-03	A	Medium	C	TANANA GAS COMPANY
Tanks, heating oil, nonresidential (aboveground)	T14	T14-01	A	Low	C	Tanana Power Company
Tanks, heating oil, nonresidential (aboveground)	T14	T14-02	A	Low	C	Tanana Health Center

Table 5 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Tanana Health Center*

PWSID 360395.001

*Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals*

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Tanks, heating oil, nonresidential (aboveground)	T14	T14-03	A	Low	C	Dons Video
Tanks, heating oil, nonresidential (aboveground)	T14	T14-04	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-05	A	Low	C	Telephone Company
Tanks, heating oil, nonresidential (aboveground)	T14	T14-06	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-07	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-08	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-09	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-10	A	Low	C	Tanana Volunteer Fire/EMS
Tanks, heating oil, nonresidential (aboveground)	T14	T14-11	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-12	A	Low	C	Tanana City Police
Tanks, heating oil, nonresidential (aboveground)	T14	T14-13	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-14	A	Low	C	
Tanks, heating oil, nonresidential (aboveground)	T14	T14-15	A	Low	C	MAUDREY J SOMMER SCHOOL
Tanks, heating oil, nonresidential (aboveground)	T14	T14-16	A	Low	C	
Tanks, heating oil, nonresidential (underground)	T16	T16-01	A	Low	C	TANANA ZONE HEADQUARTER
Tanks, heating oil, nonresidential (underground)	T16	T16-02	A	Low	C	FAA - TANANA
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-01	A	Low	C	Tanana City Drinking Water Well. Reckey: 1996310130501. Status: Active. Increasing concentrations of benzene have been measured in drinking water supply wells beginning in 1992. Benzene concentrations below MCLs.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-02	A	Low	C	FAA Tanana Station. Reckey: 1994310134901. Status: Active. Petroleum hydrocarbon contamination present in site soils and groundwater; free product present in wells at various locations at the facility, including wells adjacent to the Yukon River.

Table 5 (continued)

## Contaminant Source Inventory and Risk Ranking for

PWSID 360395.001

## Tanana Health Center

## Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

Contaminant Source Type	Contaminant Source ID	CS ID tag	Zone	Risk Ranking for Analysis	Map Number	Comments
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-03	A	Low	C	Bear Creek RRS White Alice Site
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-04	A	Low	C	Bear Creek RRS Vehicle Maint Shop. Reckey: 198931X902546. Status: Active. Contaminants include POL products, metals from waste oils, batteries, and diesel fuel. Soil contamination is extensive.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-05	A	Low	C	Tanana Health Center. Reckey: 1982310136302. Status: Active. Fuel spill from AST in 1975. Contaminated well abandoned in 1976. Fuel spill at pumphouse in 1984.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-06	A	Low	C	Tanana Health Center. Reckey: 1982310136302. Status: Active. Fuel spill from AST in 1975. Contaminated well abandoned in 1976. Fuel spill at pumphouse in 1984.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-07	A	Low	C	FAA Tanana FABLM/AK Fire Serv.F.S. Reckey: 1989310902514. Status: Active. Reported potential contaminants onsite in unknown quantities include petroleum, oil, lubricant waste, PCBs, asbestos, solvents, herbicides, paints, antifreeze.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-08	A	Low	C	Bear Creek RRS POL Storage Area. Reckey: 198931X102544. Status: Active. The POL storage area was operated from 1959 to 1975. Diesel fuel leaks occurred from valves and pipes. The extent of contamination is unknown.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-09	A	Low	C	Bear Creek Radio Relay Station. Reckey: 198931X902510. Status: Active. Soil contaminated by PCBs and vandalism of transformers caused oil leakage. Other possible contaminants include petroleum products, and halogenated/non-halogenated solvents.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-10	A	Low	C	Bear Creek RRS Landfill. Reckey: 198931X902545. Status: Active. Diesel fuel, waste oil, metals, and PCBs are the contaminants of concern. Soil contamination is extensive.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-11	A	Low	C	Bear Creek RRS Vehicle Maint Shop. Reckey: 198931X902546. Status: Active. Contaminants include POL products, metals from waste oils, batteries, and diesel fuel. Soil contamination is extensive.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-12	A	Low	C	BLM/AK Fire Service Housing Complex. Reckey: 1993310126601. Status: Inactive. Groundwater impacted and contamination moving towards Yukon river 200 yards from site.

Table 5 (continued)

## Contaminant Source Inventory and Risk Ranking for

PWSID 360395.001

## Tanana Health Center

## Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-13	A	Low	C	FAA Tanana Station. Reckey: 1994310134901. Status: Active. Petroleum hydrocarbon contamination present in site soils and groundwater; free product present in wells at various locations at the facility, including wells adjacent to the Yukon River.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-14	A	Low	C	Tanana Lot 3 Former Tank Farm. Reckey: 2001310105901. Status: Active. Petroleum contamination in the DRO range at 33,200ppm. Drinking water well within 100 feet of contaminated area tested clean of petroleum contaminants.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-15	A	Low	C	Tanana Power Company. Reckey: 2002310108501. Status: Active. Surface soils with dark stains and devoid of vegetation. Elevated levels of BTEX, GRO, DRO, RRO, SVOCs, PAHs and trace levels of pesticides (DDT).
Cemeteries	X01	X01-01	A	Low	C	
Municipal or city parks (with green areas)	X04	X04-01	A	Low	C	
Petroleum product bulk station/terminals	X11	X11-01	A	Low	C	Bulk Fuel Storage-City
Petroleum product bulk station/terminals	X11	X11-02	A	Low	C	Bulk Fuel Storage-Tanana Power Company
Petroleum product bulk station/terminals	X11	X11-03	A	Low	C	Bulk Fuel Storage-Tribal Council
Petroleum product bulk station/terminals	X11	X11-04	A	Low	C	Dons Video
Petroleum product bulk station/terminals	X11	X11-05	A	Low	C	School Backup Generator
Petroleum product bulk station/terminals	X11	X11-06	A	Low	C	School-north
Petroleum product bulk station/terminals	X11	X11-07	A	Low	C	School-USTs
Petroleum product bulk station/terminals	X11	X11-08	A	Low	C	Waheteria
Boat yards and marinas	X15	X15-01	A	Low	C	Dock
Highways and roads, dirt/gravel	X24	X24-01	A	Low	C	Assume 1-20 roads in Zone A
Pipelines (oil and gas)	X28	X28-01	A	Low	C	Barge to Bulk Fuel Tanks
Pipelines (oil and gas)	X28	X28-02	A	Low	C	Barge to Bulk Fuel Tanks

**Table 5 (continued)**

**Contaminant Source Inventory and Risk Ranking for**

**PWSID 360395.001**

**Tanana Health Center**

**Sources of Heavy Metals, Cyanide and Other Inorganic Chemicals**

<b>Contaminant Source Type</b>	<b>Contaminant Source ID</b>	<b>CS ID tag</b>	<b>Zone</b>	<b>Risk Ranking for Analysis</b>	<b>Map Number</b>	<b>Comments</b>
Electric power generation (fossil fuels)	X36	X36-01	A	Medium	C	Tanana Power Company
Firehouses	X38	X38-01	A	Low	C	Tanana Volunteer Fire/EMS
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	A	Low	C	Tanana Health Center
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-02	A	Low	C	TANANA HEALTH CENTER
Airports	X14	X14-01	B	Low	C	TANANA LANDING STRIP

Table 6

*Contaminant Source Inventory and Risk Ranking for  
Tanana Health Center  
Sources of Synthetic Organic Chemicals*

PWSID 360395.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	A	Low	C	Assume 10 or less sewer lines in Zone A
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	A	Low	C	
Domestic wastewater treatment plants	D05	D05-01	A	Low	C	Sewage Lagoon
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	C	FAA - TANANA
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	A	Low	C	FAA - TANANA
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	A	Low	C	TANANA-AK NATIVE HEALTH CLINIC
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-04	A	Low	C	TANANA-VSW
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-01	A	Low	C	Bear Creek RRS Vehicle Maint Shop
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 10 or less septic systems in Zone A
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-01	A	Low	C	Tanana City Drinking Water Well. Reckey: 1996310130501. Status: Active. Increasing concentrations of benzene have been measured in drinking water supply wells beginning in 1992. Benzene concentrations below MCLs.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-02	A	Low	C	FAA Tanana Station. Reckey: 1994310134901. Status: Active. Petroleum hydrocarbon contamination present in site soils and groundwater; free product present in wells at various locations at the facility, including wells adjacent to the Yukon River.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-03	A	Low	C	Bear Creek RRS White Alice Site
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-04	A	Low	C	Bear Creek RRS Vehicle Maint Shop. Reckey: 198931X902546. Status: Active. Contaminants include POL products, metals from waste oils, batteries, and diesel fuel. Soil contamination is extensive.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-05	A	Low	C	Tanana Health Center. Reckey: 1982310136302. Status: Active. Fuel spill from AST in 1975. Contaminated well abandoned in 1976. Fuel spill at pumphouse in 1984.



Table 6 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Tanana Health Center  
Sources of Synthetic Organic Chemicals*

PWSID 360395.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-06	A	Low	C	Tanana Health Center. Reckey: 1982310136302. Status: Active. Fuel spill from AST in 1975. Contaminated well abandoned in 1976. Fuel spill at pumphouse in 1984.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-07	A	Low	C	FAA Tanana FABLM/AK Fire Serv.F.S. Reckey: 1989310902514. Status: Active. Reported potential contaminants onsite in unknown quantities include petroleum, oil, lubricant waste, PCBs, asbestos, solvents, herbicides, paints, antifreeze.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-08	A	Low	C	Bear Creek RRS POL Storage Area. Reckey: 198931X102544. Status: Active. The POL storage area was operated from 1959 to 1975. Diesel fuel leaks occurred from valves and pipes. The extent of contamination is unknown.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-09	A	Low	C	Bear Creek Radio Relay Station. Reckey: 198931X902510. Status: Active. Soil contaminated by PCBs and vandalism of transformers caused oil leakage. Other possible contaminants include petroleum products, and halogenated/non-halogenated solvents.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-10	A	Low	C	Bear Creek RRS Landfill. Reckey: 198931X902545. Status: Active. Diesel fuel, waste oil, metals, and PCBs are the contaminants of concern. Soil contamination is extensive.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-11	A	Low	C	Bear Creek RRS Vehicle Maint Shop. Reckey: 198931X902546. Status: Active. Contaminants include POL products, metals from waste oils, batteries, and diesel fuel. Soil contamination is extensive.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-12	A	Low	C	BLM/AK Fire Service Housing Complex. Reckey: 1993310126601. Status: Inactive. Groundwater impacted and contamination moving towards Yukon river 200 yards from site.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-13	A	Low	C	FAA Tanana Station. Reckey: 1994310134901. Status: Active. Petroleum hydrocarbon contamination present in site soils and groundwater; free product present in wells at various locations at the facility, including wells adjacent to the Yukon River.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-14	A	Low	C	Tanana Lot 3 Former Tank Farm. Reckey: 2001310105901. Status: Active. Petroleum contamination in the DRO range at 33,200ppm. Drinking water well within 100 feet of contaminated area tested clean of petroleum contaminants.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-15	A	Low	C	Tanana Power Company. Reckey: 2002310108501. Status: Active. Surface soils with dark stains and devoid of vegetation. Elevated levels of BTEX, GRO, DRO, RRO, SVOCs, PAHs and trace levels of pesticides (DDT).

Table 6 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Tanana Health Center  
Sources of Synthetic Organic Chemicals*

PWSID 360395.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-01	A	Low	C	TANANA ZONE HEADQUARTER
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-02	A	Low	C	FAA - TANANA
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-03	A	Low	C	TANANA GAS COMPANY
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-04	A	Low	C	TANANA HEALTH CENTER
Cemeteries	X01	X01-01	A	Medium	C	
Municipal or city parks (with green areas)	X04	X04-01	A	Low	C	
Petroleum product bulk station/terminals	X11	X11-01	A	Low	C	Bulk Fuel Storage-City
Petroleum product bulk station/terminals	X11	X11-02	A	Low	C	Bulk Fuel Storage-Tanana Power Company
Petroleum product bulk station/terminals	X11	X11-03	A	Low	C	Bulk Fuel Storage-Tribal Council
Petroleum product bulk station/terminals	X11	X11-04	A	Low	C	Dons Video
Petroleum product bulk station/terminals	X11	X11-05	A	Low	C	School Backup Generator
Petroleum product bulk station/terminals	X11	X11-06	A	Low	C	School-north
Petroleum product bulk station/terminals	X11	X11-07	A	Low	C	School-USTs
Petroleum product bulk station/terminals	X11	X11-08	A	Low	C	Waheteria
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-01	A	Low	C	Tanana Health Center
Medical/veterinary facilities (doctor or dentist offices, hospitals, nursing homes)	X40	X40-02	A	Low	C	TANANA HEALTH CENTER
Airports	X14	X14-01	B	Medium	C	TANANA LANDING STRIP

Table 7

*Contaminant Source Inventory and Risk Ranking for  
Tanana Health Center  
Sources of Other Organic Chemicals*

PWSID 360395.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Gasoline stations (without repair shop)	C15	C15-01	A	Low	C	TANANA GAS COMPANY
Motor /motor vehicle repair shops	C31	C31-01	A	Medium	C	City Garage
Motor /motor vehicle repair shops	C31	C31-02	A	Medium	C	Bear Creek RRS Vehicle Maint Shop
Domestic wastewater collection systems (sewer lines or lift stations)	D01	D01-01	A	Low	C	Assume 10 or less sewer lines in Zone A
Domestic wastewater treatment plant disposal ponds/lagoons	D02	D02-01	A	Low	C	
Domestic wastewater treatment plants	D05	D05-01	A	Low	C	Sewage Lagoon
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-01	A	Low	C	FAA - TANANA
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-02	A	Low	C	FAA - TANANA
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-03	A	Low	C	TANANA-AK NATIVE HEALTH CLINIC
Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method)	D10	D10-04	A	Low	C	TANANA-VSW
Injection wells (Class V) Motor Vehicle Waste Disposal Well	D42	D42-01	A	Medium	C	Bear Creek RRS Vehicle Maint Shop
Septic systems (serves one single-family home)	R02	R02-01	A	Low	C	Assume 10 or less septic systems in Zone A
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-01	A	Low	C	Tanana City Drinking Water Well. Reckey: 1996310130501. Status: Active. Increasing concentrations of benzene have been measured in drinking water supply wells beginning in 1992. Benzene concentrations below MCLs.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-02	A	Low	C	FAA Tanana Station. Reckey: 1994310134901. Status: Active. Petroleum hydrocarbon contamination present in site soils and groundwater; free product present in wells at various locations at the facility, including wells adjacent to the Yukon River.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-03	A	Low	C	Bear Creek RRS White Alice Site

Table 7 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Tanana Health Center  
Sources of Other Organic Chemicals*

PWSID 360395.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-04	A	Low	C	Bear Creek RRS Vehicle Maint Shop. Reckey: 198931X902546. Status: Active. Contaminants include POL products, metals from waste oils, batteries, and diesel fuel. Soil contamination is extensive.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-05	A	Low	C	Tanana Health Center. Reckey: 1982310136302. Status: Active. Fuel spill from AST in 1975. Contaminated well abandoned in 1976. Fuel spill at pumphouse in 1984.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-06	A	Low	C	Tanana Health Center. Reckey: 1982310136302. Status: Active. Fuel spill from AST in 1975. Contaminated well abandoned in 1976. Fuel spill at pumphouse in 1984.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-07	A	Low	C	FAA Tanana FABLM/AK Fire Serv.F.S. Reckey: 1989310902514. Status: Active. Reported potential contaminants onsite in unknown quantities include petroleum, oil, lubricant waste, PCBs, asbestos, solvents, herbicides, paints, antifreeze.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-08	A	Low	C	Bear Creek RRS POL Storage Area. Reckey: 198931X102544. Status: Active. The POL storage area was operated from 1959 to 1975. Diesel fuel leaks occurred from valves and pipes. The extent of contamination is unknown.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-09	A	Low	C	Bear Creek Radio Relay Station. Reckey: 198931X902510. Status: Active. Soil contaminated by PCBs and vandalism of transformers caused oil leakage. Other possible contaminants include petroleum products, and halogenated/non-halogenated solvents.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-10	A	Low	C	Bear Creek RRS Landfill. Reckey: 198931X902545. Status: Active. Diesel fuel, waste oil, metals, and PCBs are the contaminants of concern. Soil contamination is extensive.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-11	A	Low	C	Bear Creek RRS Vehicle Maint Shop. Reckey: 198931X902546. Status: Active. Contaminants include POL products, metals from waste oils, batteries, and diesel fuel. Soil contamination is extensive.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-12	A	Low	C	BLM/AK Fire Service Housing Complex. Reckey: 1993310126601. Status: Inactive. Groundwater impacted and contamination moving towards Yukon river 200 yards from site.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-13	A	Low	C	FAA Tanana Station. Reckey: 1994310134901. Status: Active. Petroleum hydrocarbon contamination present in site soils and groundwater; free product present in wells at various locations at the facility, including wells adjacent to the Yukon River.

Table 7 (continued)

*Contaminant Source Inventory and Risk Ranking for  
Tanana Health Center  
Sources of Other Organic Chemicals*

PWSID 360395.001

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-14	A	Low	C	Tanana Lot 3 Former Tank Farm. Reckey: 2001310105901. Status: Active. Petroleum contamination in the DRO range at 33,200ppm. Drinking water well within 100 feet of contaminated area tested clean of petroleum contaminants.
Contaminated sites, DEC recognized, non-Superfund, non-RCRA	U04	U04-15	A	Low	C	Tanana Power Company. Reckey: 2002310108501. Status: Active. Surface soils with dark stains and devoid of vegetation. Elevated levels of BTEX, GRO, DRO, RRO, SVOCs, PAHs and trace levels of pesticides (DDT).
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-01	A	Low	C	TANANA ZONE HEADQUARTER
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-02	A	Low	C	FAA - TANANA
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-03	A	Low	C	TANANA GAS COMPANY
Open Leaking Underground Fuel Storage Tank (LUST) Sites	U07	U07-04	A	Low	C	TANANA HEALTH CENTER
Petroleum product bulk station/terminals	X11	X11-01	A	High	C	Bulk Fuel Storage-City
Petroleum product bulk station/terminals	X11	X11-02	A	High	C	Bulk Fuel Storage-Tanana Power Company
Petroleum product bulk station/terminals	X11	X11-03	A	High	C	Bulk Fuel Storage-Tribal Council
Petroleum product bulk station/terminals	X11	X11-04	A	High	C	Dons Video
Petroleum product bulk station/terminals	X11	X11-05	A	High	C	School Backup Generator
Petroleum product bulk station/terminals	X11	X11-06	A	High	C	School-north
Petroleum product bulk station/terminals	X11	X11-07	A	High	C	School-USTs
Petroleum product bulk station/terminals	X11	X11-08	A	High	C	Waheteria
Boat yards and marinas	X15	X15-01	A	Low	C	Dock
Highways and roads, dirt/gravel	X24	X24-01	A	Low	C	Assume 1-20 roads in Zone A
Pipelines (oil and gas)	X28	X28-01	A	High	C	Barge to Bulk Fuel Tanks

**Table 7 (continued)**


*Contaminant Source Inventory and Risk Ranking for  
Tanana Health Center  
Sources of Other Organic Chemicals*

**PWSID 360395.001**

<i>Contaminant Source Type</i>	<i>Contaminant Source ID</i>	<i>CS ID tag</i>	<i>Zone</i>	<i>Risk Ranking for Analysis</i>	<i>Map Number</i>	<i>Comments</i>
Pipelines (oil and gas)	X28	X28-02	A	High	C	Barge to Bulk Fuel Tanks
Electric power generation (fossil fuels)	X36	X36-01	A	High	C	Tanana Power Company
Airports	X14	X14-01	B	Medium	C	TANANA LANDING STRIP



Public Water Well System for PWS # 360395.001 Tanana Health Center  
Showing Potential and Existing Contamination Sources

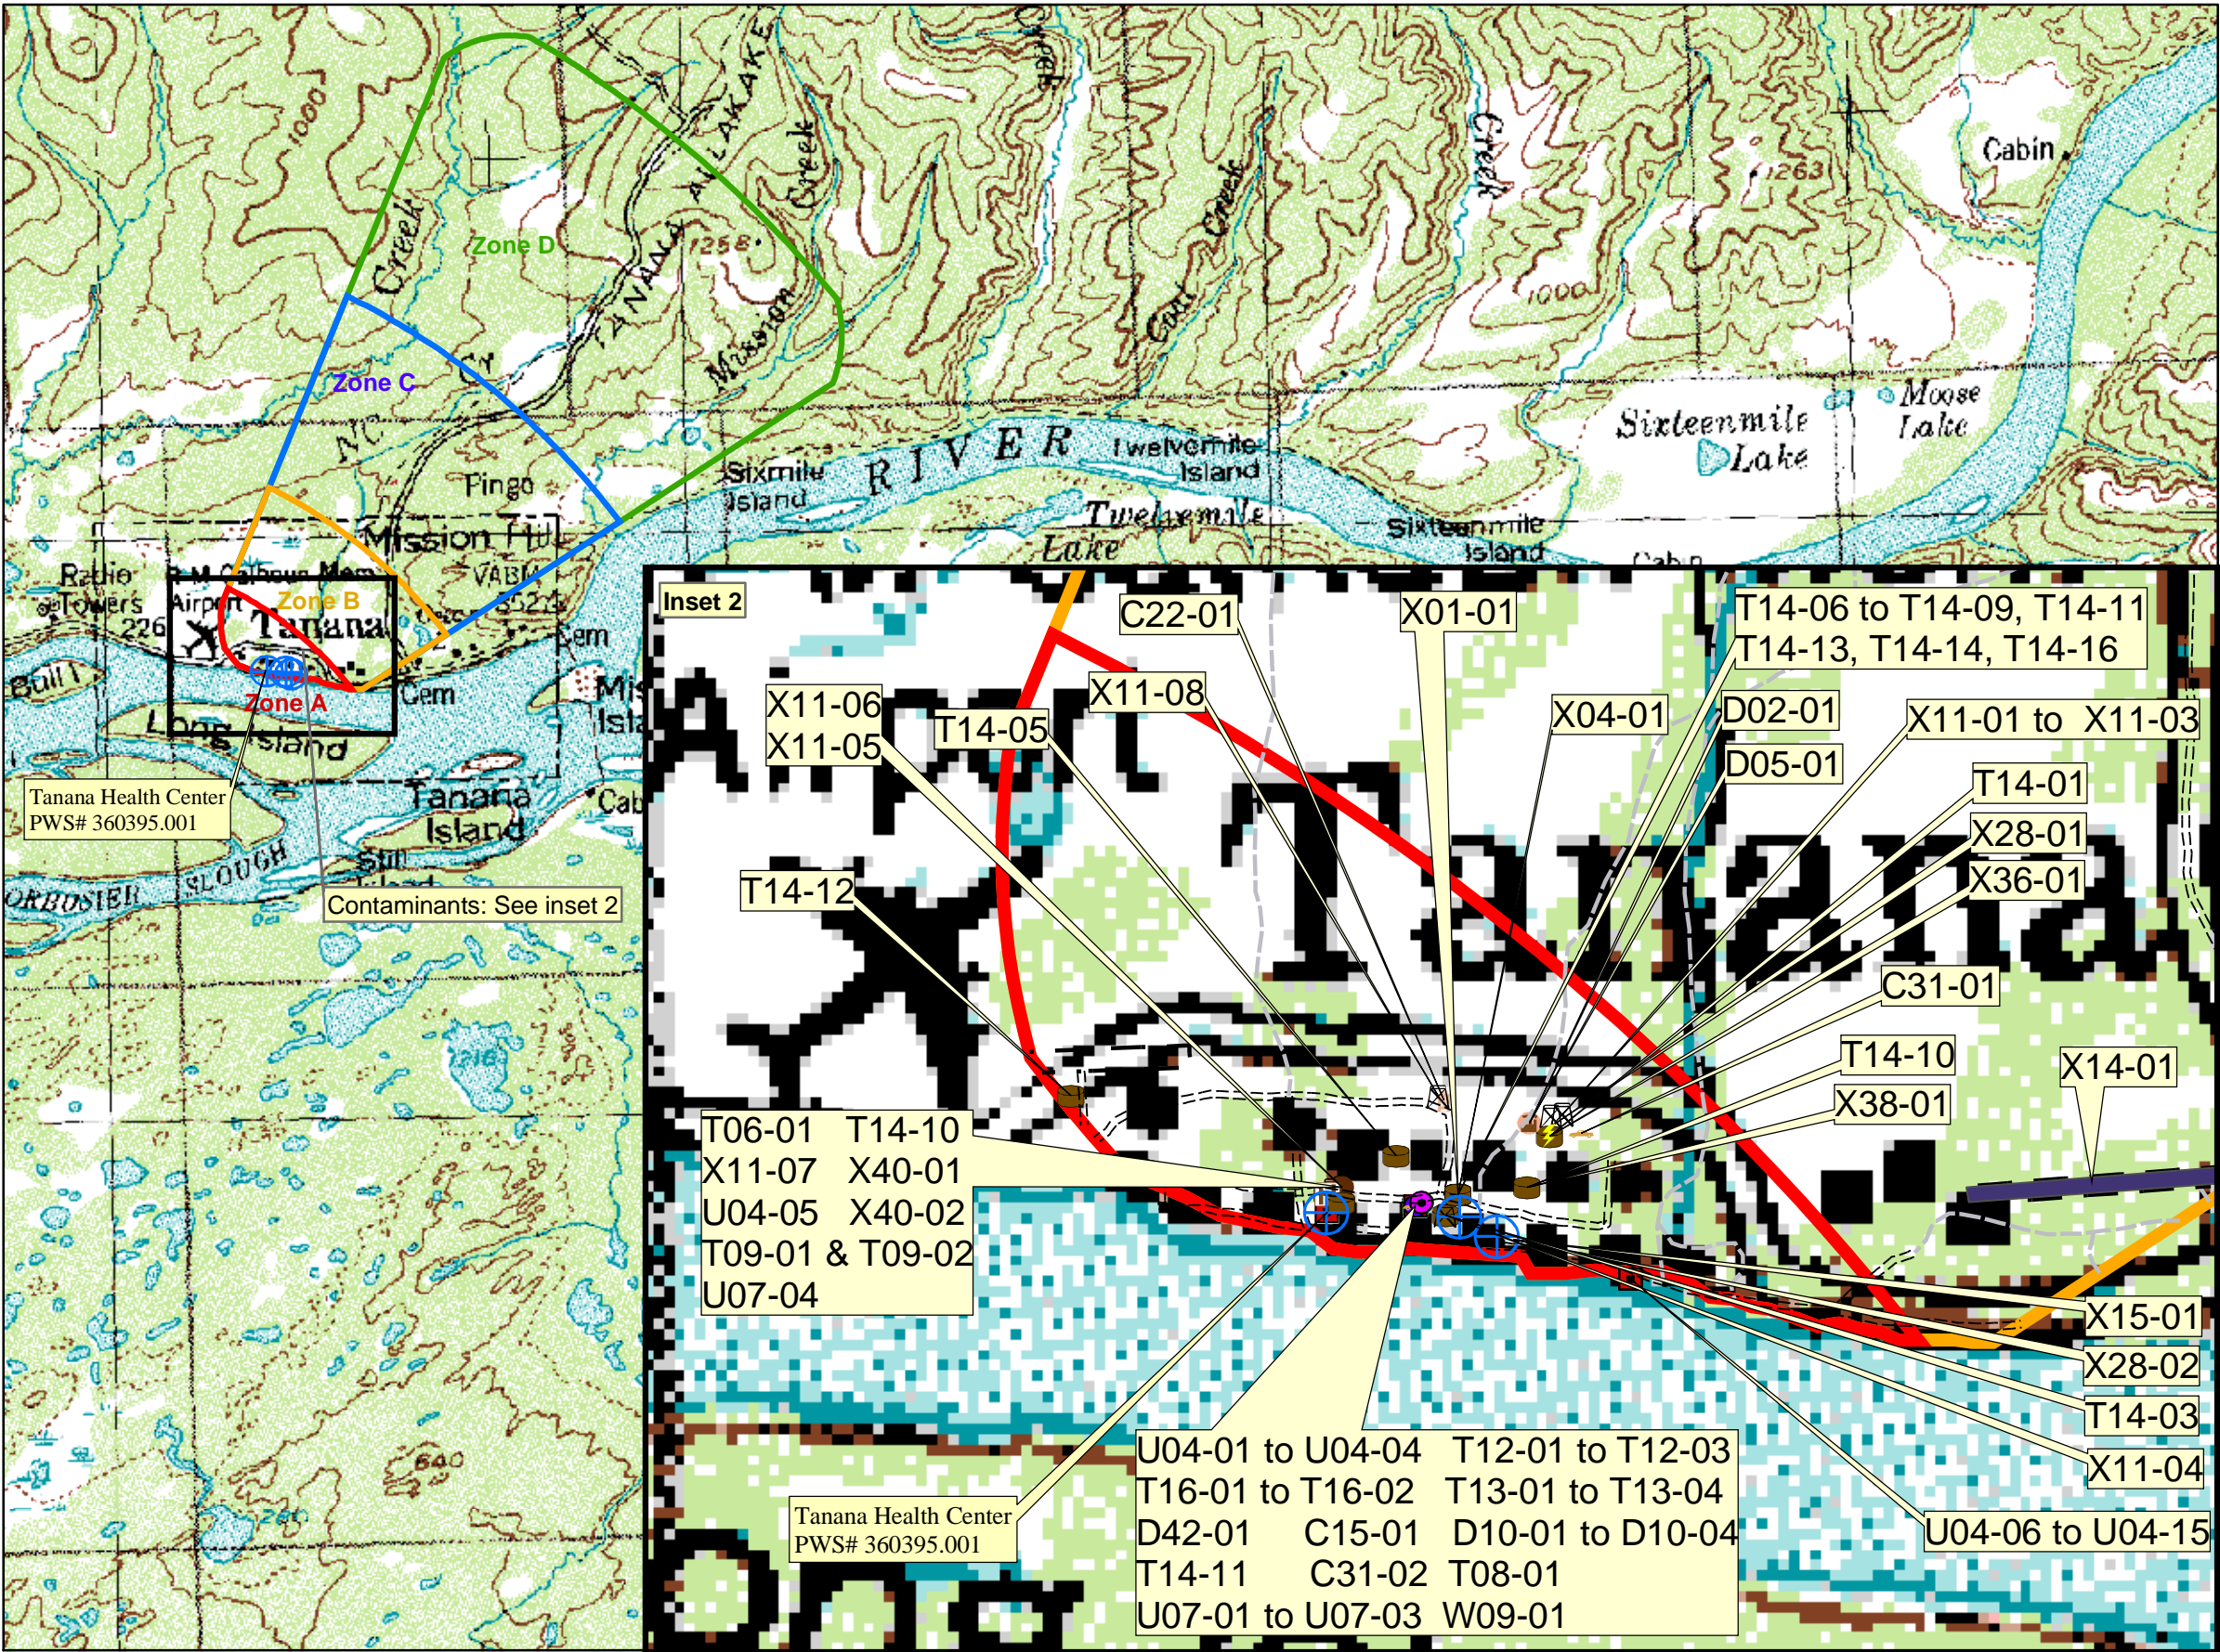


LEGEND

- Public Water System Well
- Hydrography/Physical**
- Parcels
  - Stream
  - Lake or Pond
  - Contours
- Transportation**
- Primary Route (Class 1)
  - Secondary Route (Class 2)
  - Road (Class 3)
  - Road (Class 4)
  - Road (Class 5, Four-wheel drive)

- Groundwater Protection Zones**
- Zone A Protection Area— Several Months Travel Time
  - Zone B Protection Area— 2 Years Travel Time
  - Zone C Protection Area— 5 Years Travel Time
  - Zone D Protection Area— 10 Years Travel Time


- Existing or Potential Contaminant Sources**
- Laundromats without dry cleaning (C22)
  - Motor/motor vehicle repair shops (C31)
  - Domestic wastewater treatment plant disposal ponds/lagoons (D02)
  - Domestic wastewater treatment plants (D05)
  - Injection wells (Class V) Large-Capacity Septic System (Drainfield Disposal Method) (D10)
  - Injection wells (Class V) Motor Vehicle Waste Disposal Well (D42)
  - Tanks, diesel (above ground) (T06)
  - Tanks, diesel (underground) (T08)
  - Tanks, gasoline (above ground) (T09)
  - Tanks, gasoline (underground) (T12)
  - Closed tanks, gasoline (underground) (T13)
  - Nonresidential aboveground heating oil tank (T14)
  - Tanks, heating oil, nonresidential (underground) (T16)
  - Contaminated sites, DEC recognized, non-Superfund, non-RCRA (U04)
  - Open Leaking Underground Fuel Storage Tank (LUST) (lubricants or other petroleum products) (U07)
  - Water supply wells (W09)
  - Cemeteries (X01)
  - Municipal or city parks (X04)
  - Petroleum product bulk station/terminal (X11)
  - Landing strip/airport (X14)
  - Boat yards and marinas (X15)
  - Pipelines (oil and gas) (X28)
  - Electric power generation (fossil fuels) (X36)
  - Firehouses (X38)
  - Medical/veterinary facilities (X40)

Data Sources:  
Contaminant Sources, Public Water System Wells, Contours  
Alaska Department of Environmental Conservation (ADEC)  
All other data:  
United States Geological Survey (USGS)  
Drinking Water Protection Areas based on "Alaska Drinking Water Protection Program - Guidance Manual for Class A Public Water Systems" published by ADEC  
URS Corporation does not guarantee the accuracy or validity of the data provided.

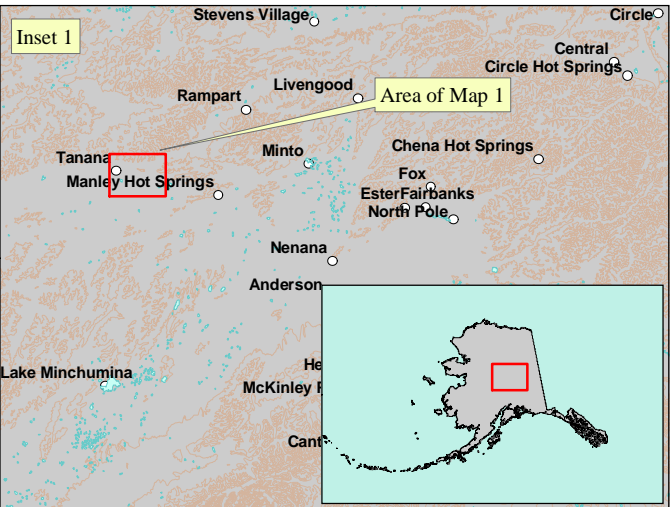



**Chart 1. Susceptibility of the wellhead - Tanana Health Center (PWS No. 360395.001)**

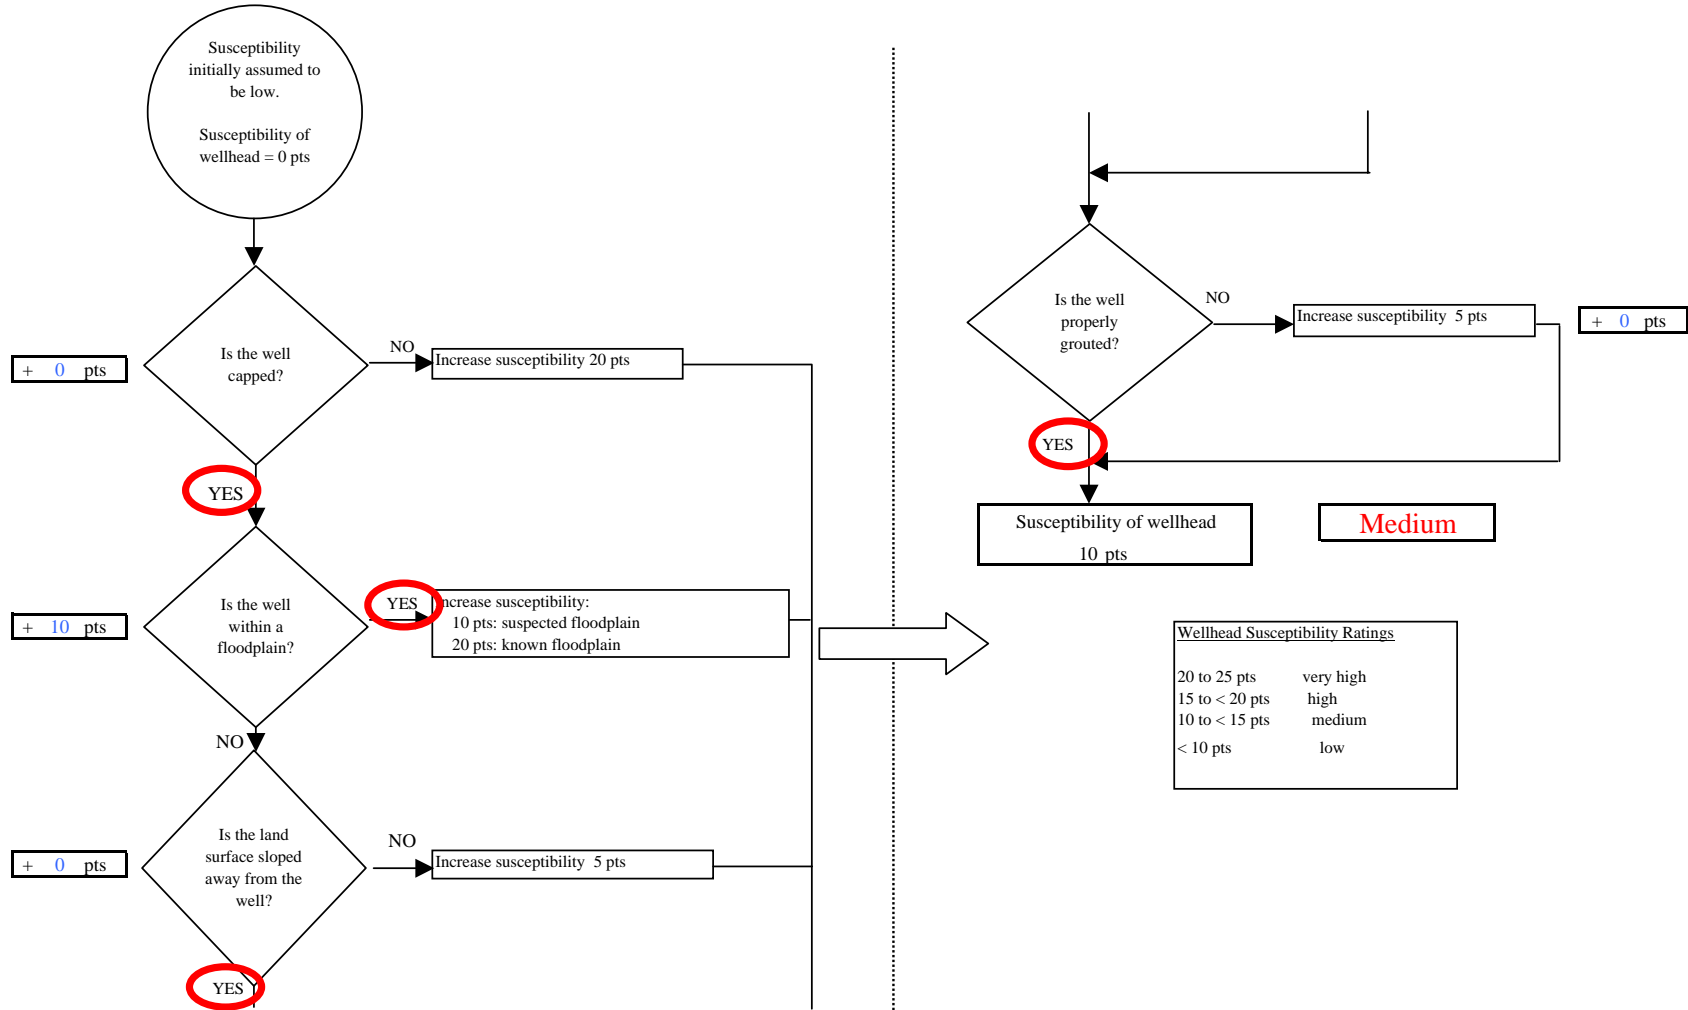



**Chart 2. Susceptibility of the aquifer Tanana Health Center (PWS No. 360395.001)**



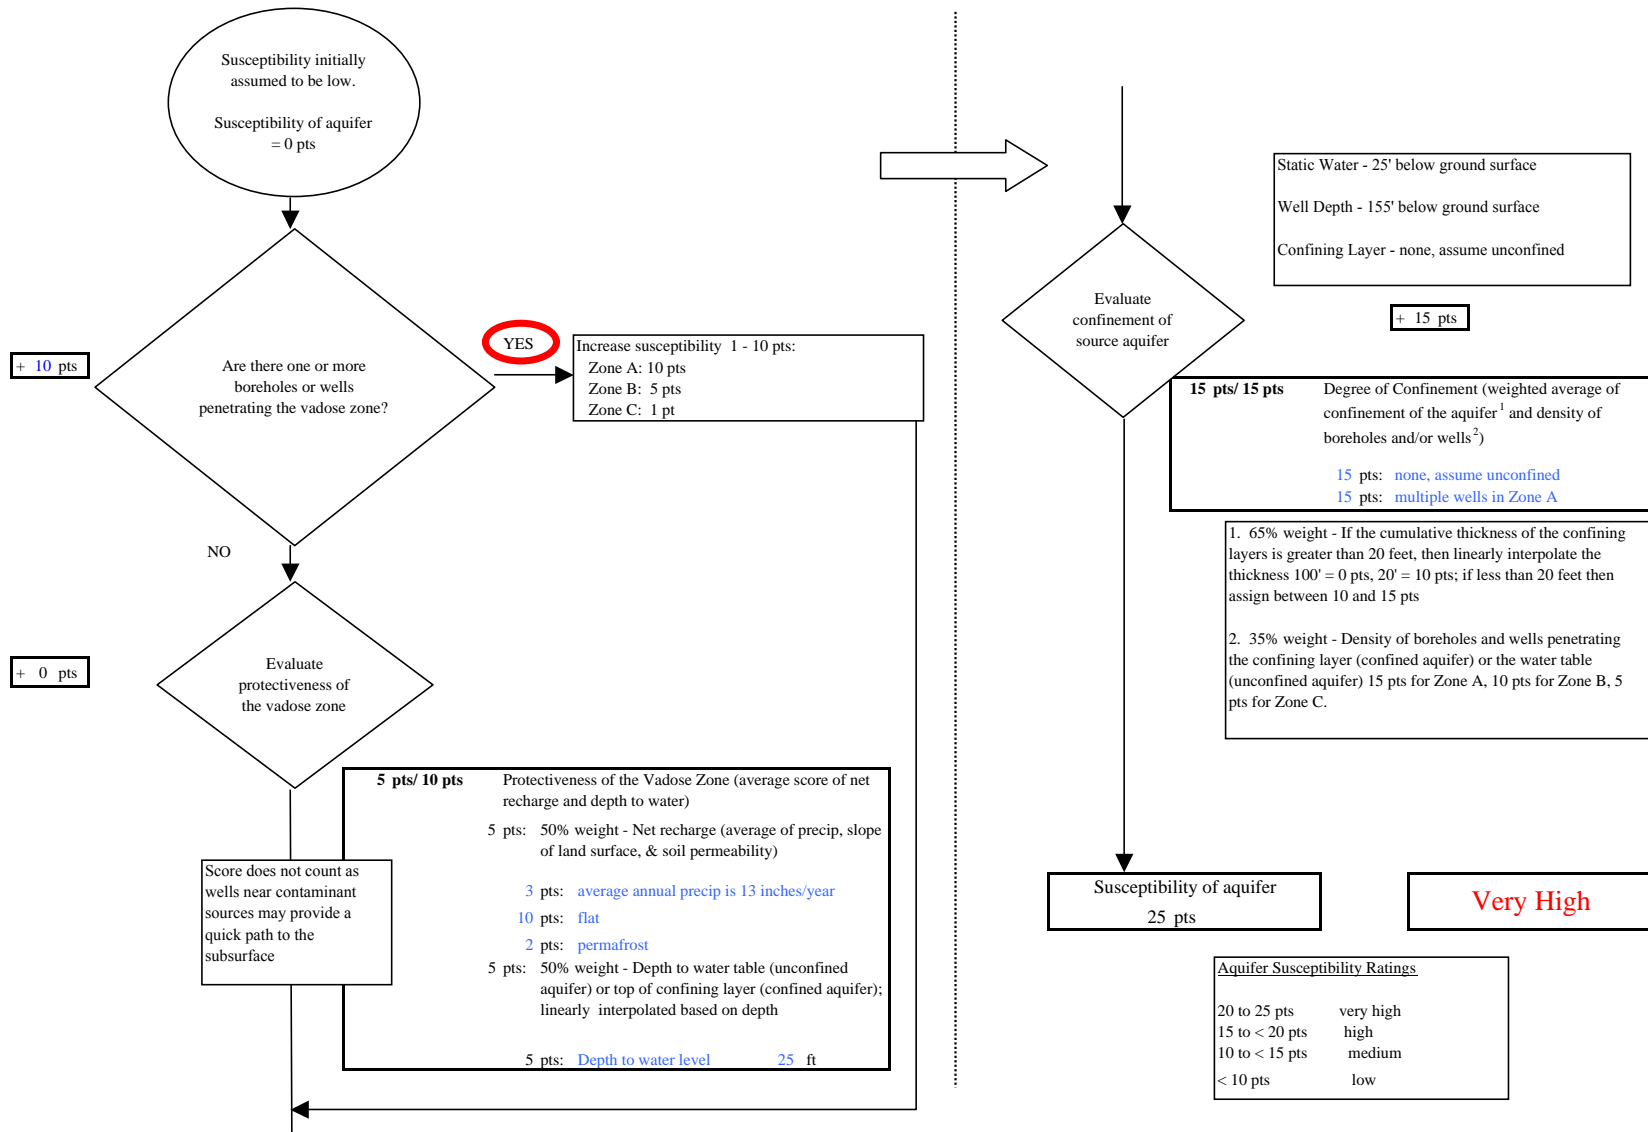



Chart 3. Contaminant risks for Tanana Health Center (PWS No. 360395.001) - Bacteria & Viruses

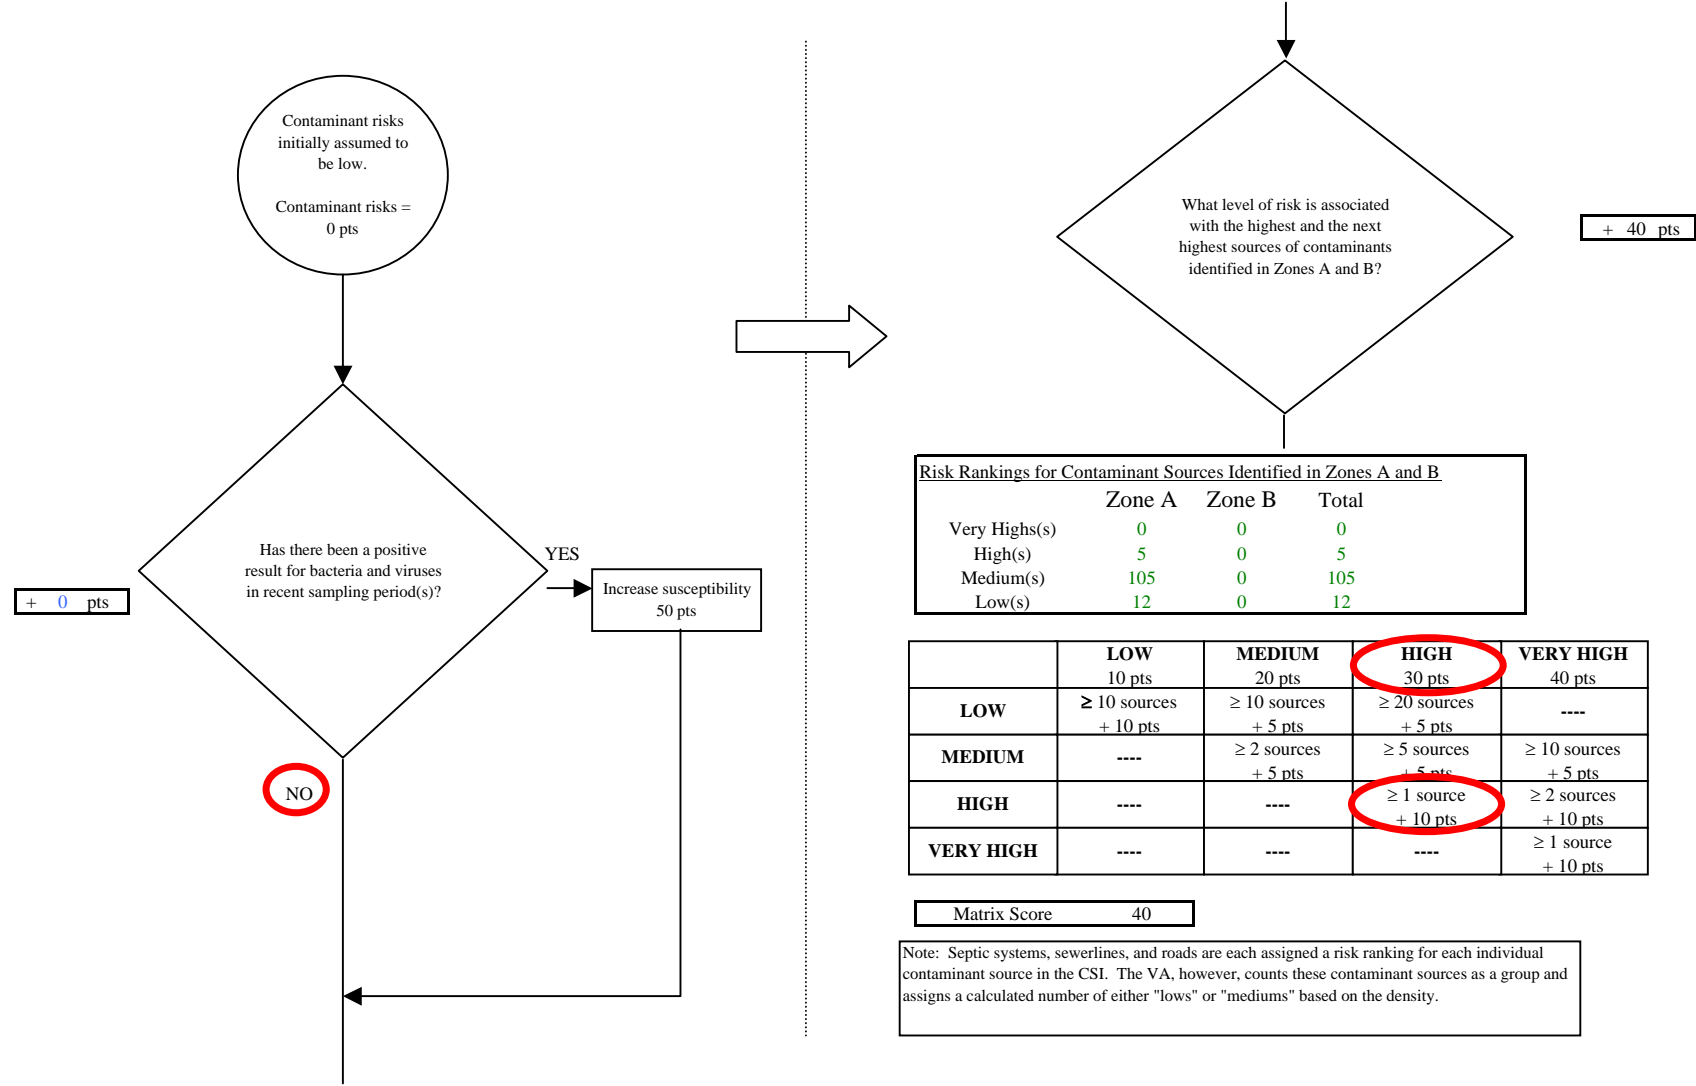

**Chart 3. Contaminant risks for Tanana Health Center (PWS No. 360395.001) - Bacteria & Viruses**

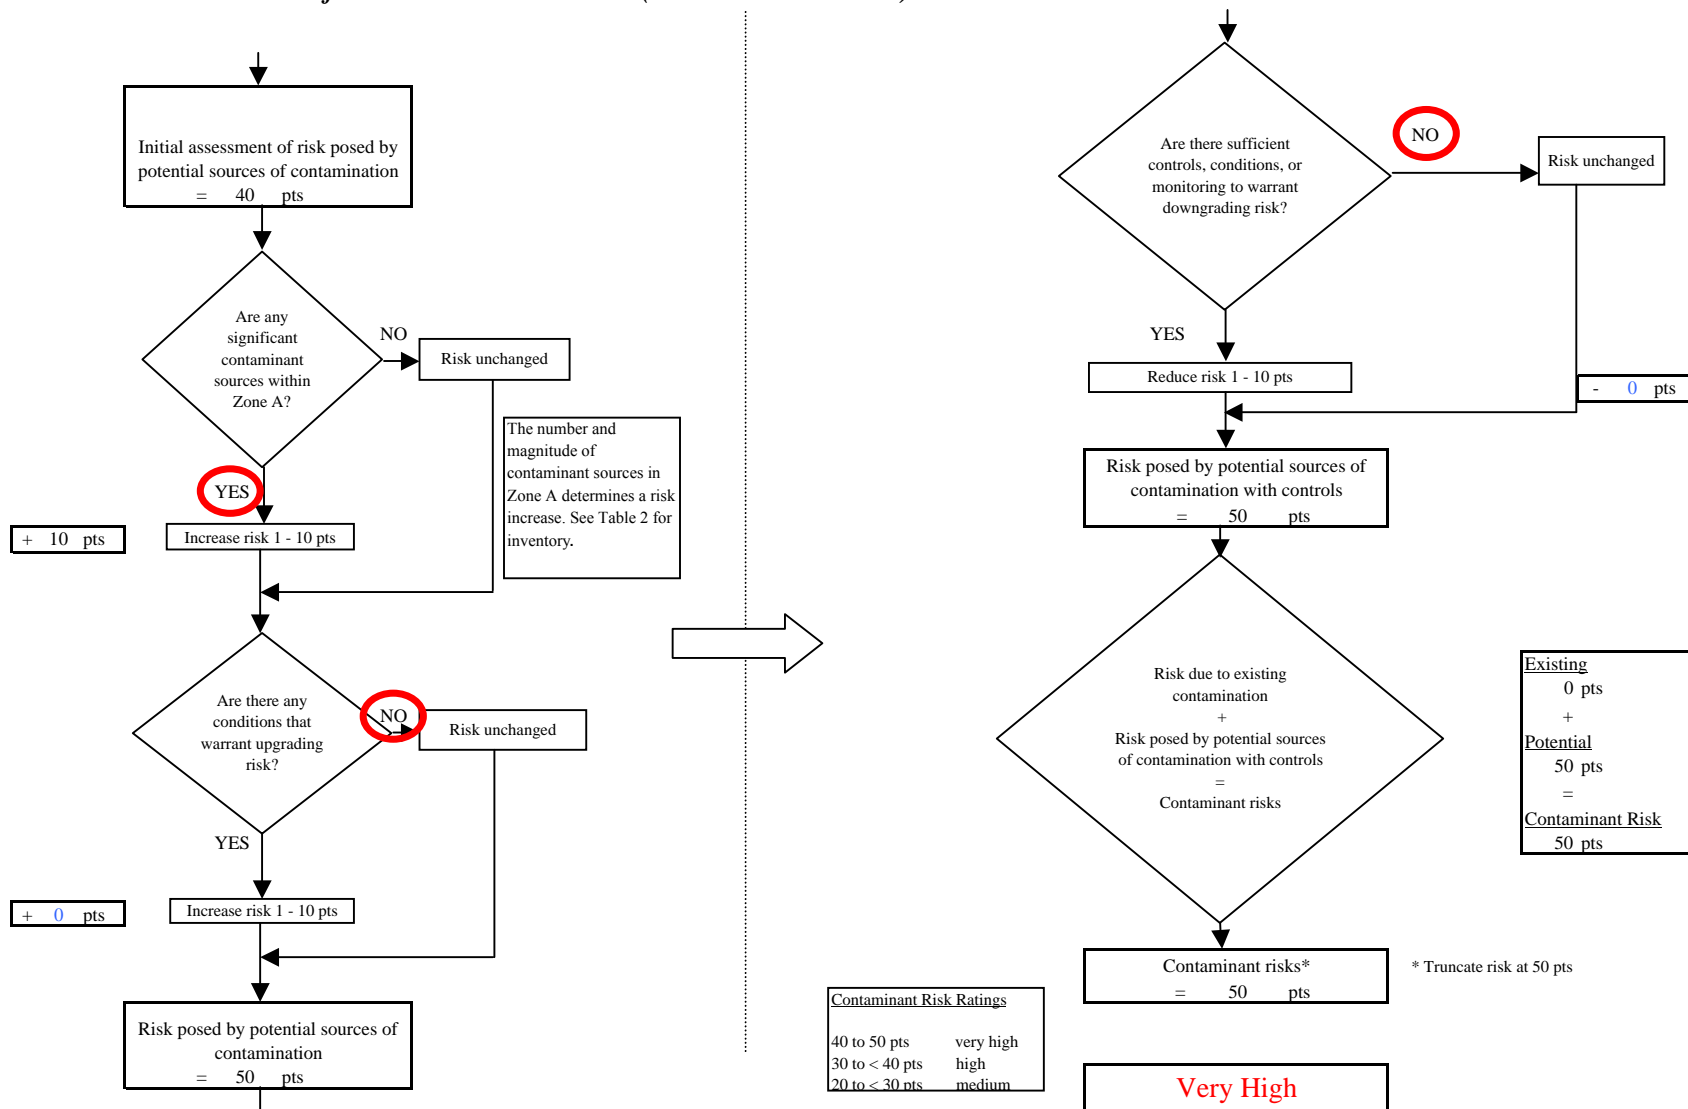

**Chart 4. Vulnerability analysis for Tanana Health Center (PWS No. 360395.001) - Bacteria & Viruses**

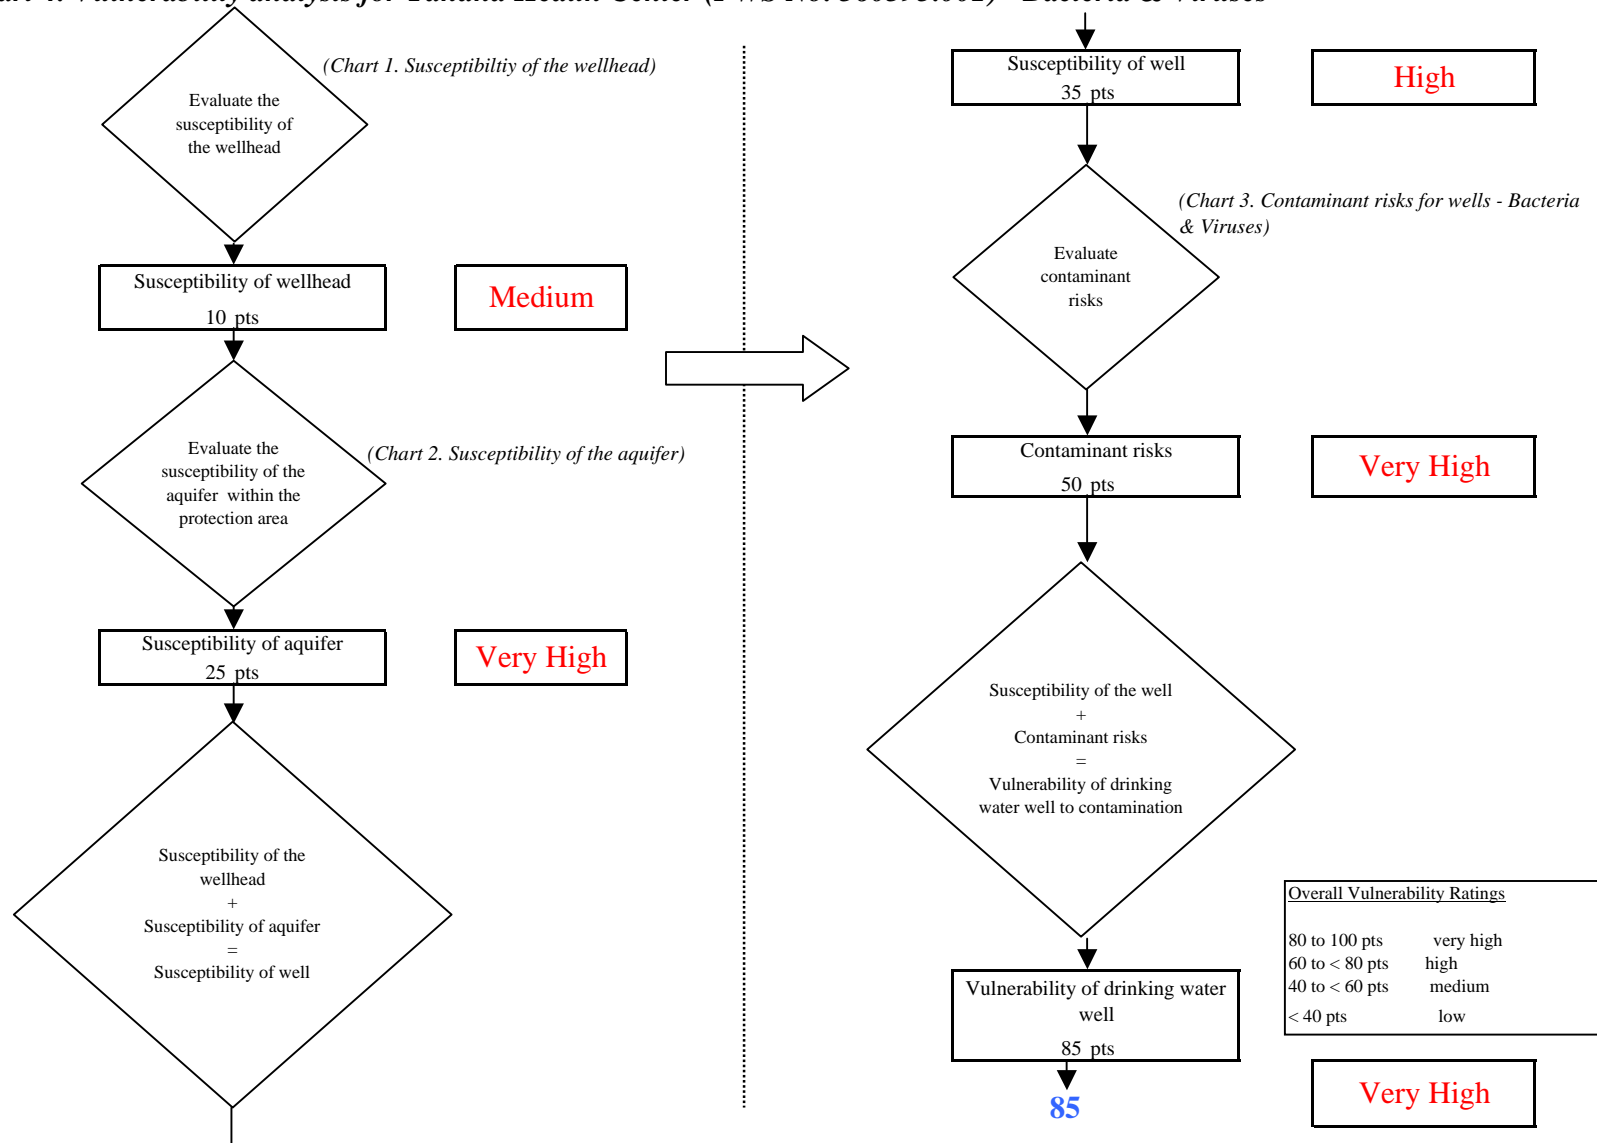

**Chart 5. Contaminant risks for Tanana Health Center (PWS No. 360395.001) - Nitrates and Nitrites**



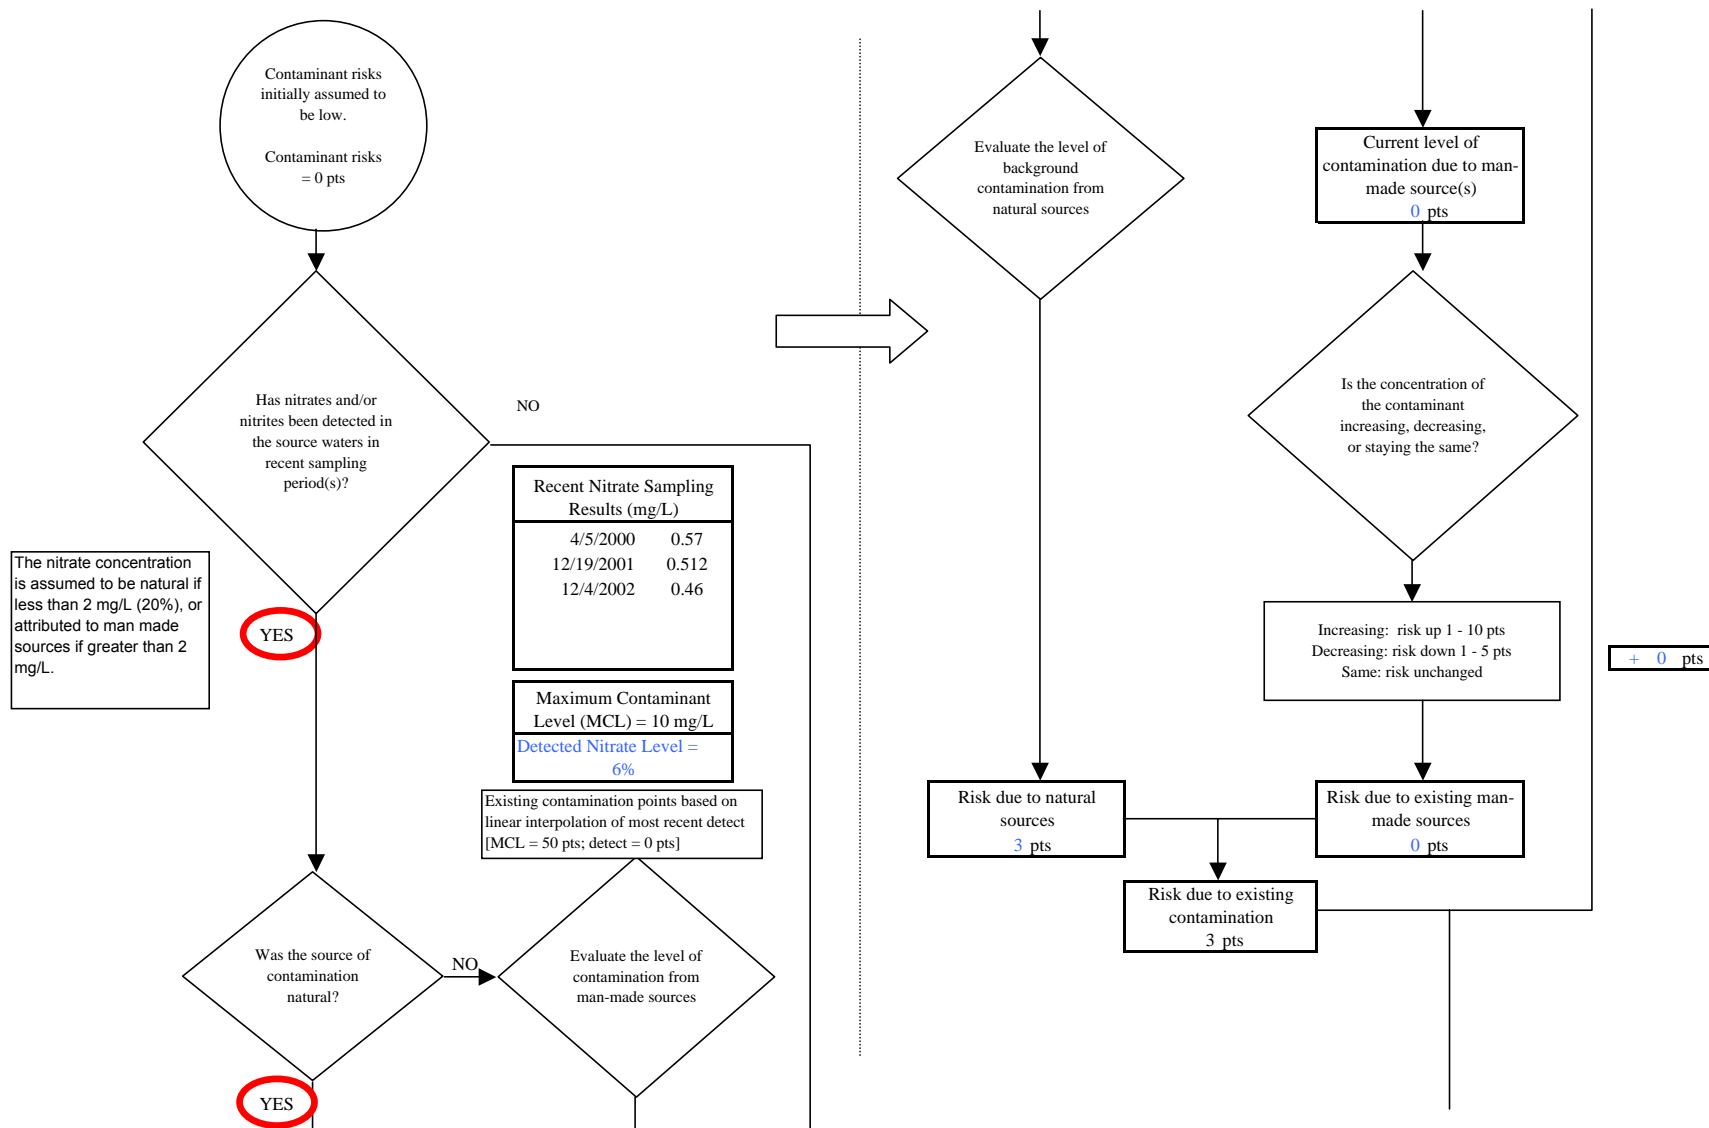



Chart 5. Contaminant risks for Tanana Health Center (PWS No. 360395.001) - Nitrates and Nitrites

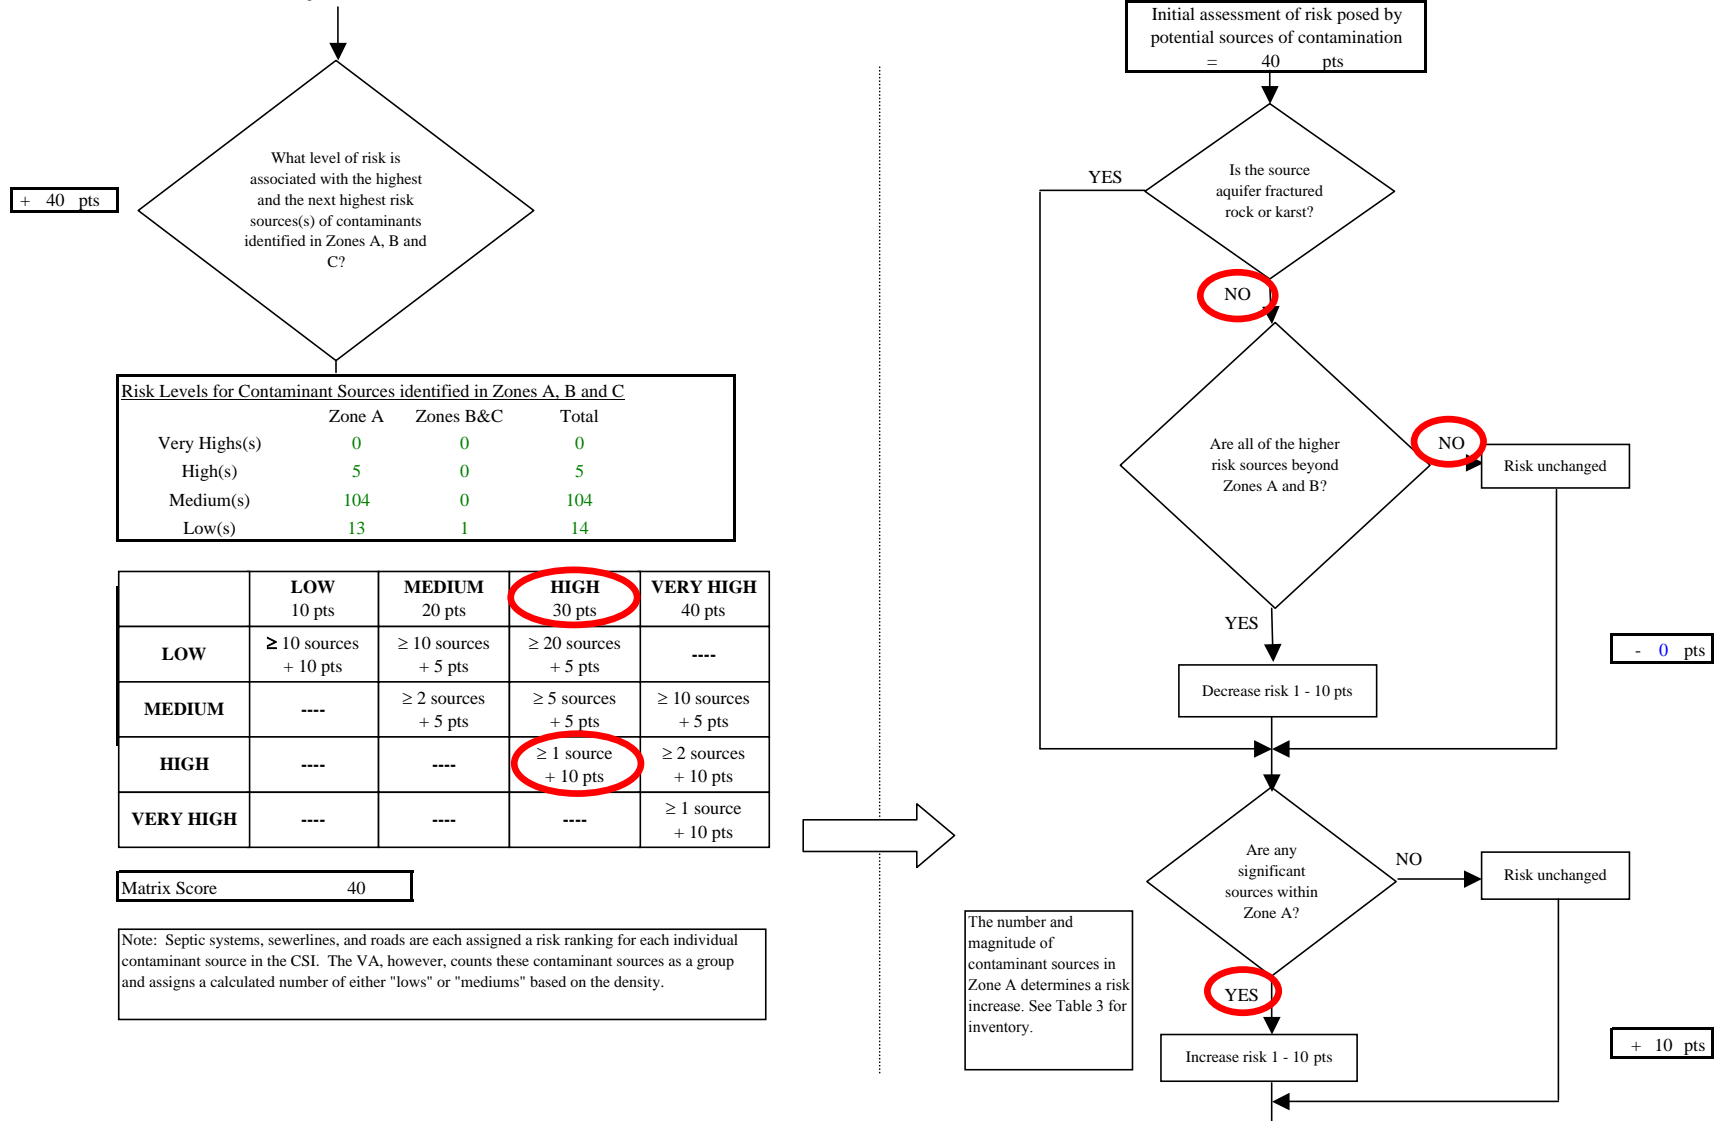

**Chart 5. Contaminant risks for Tanana Health Center (PWS No. 360395.001) - Nitrates and Nitrites**

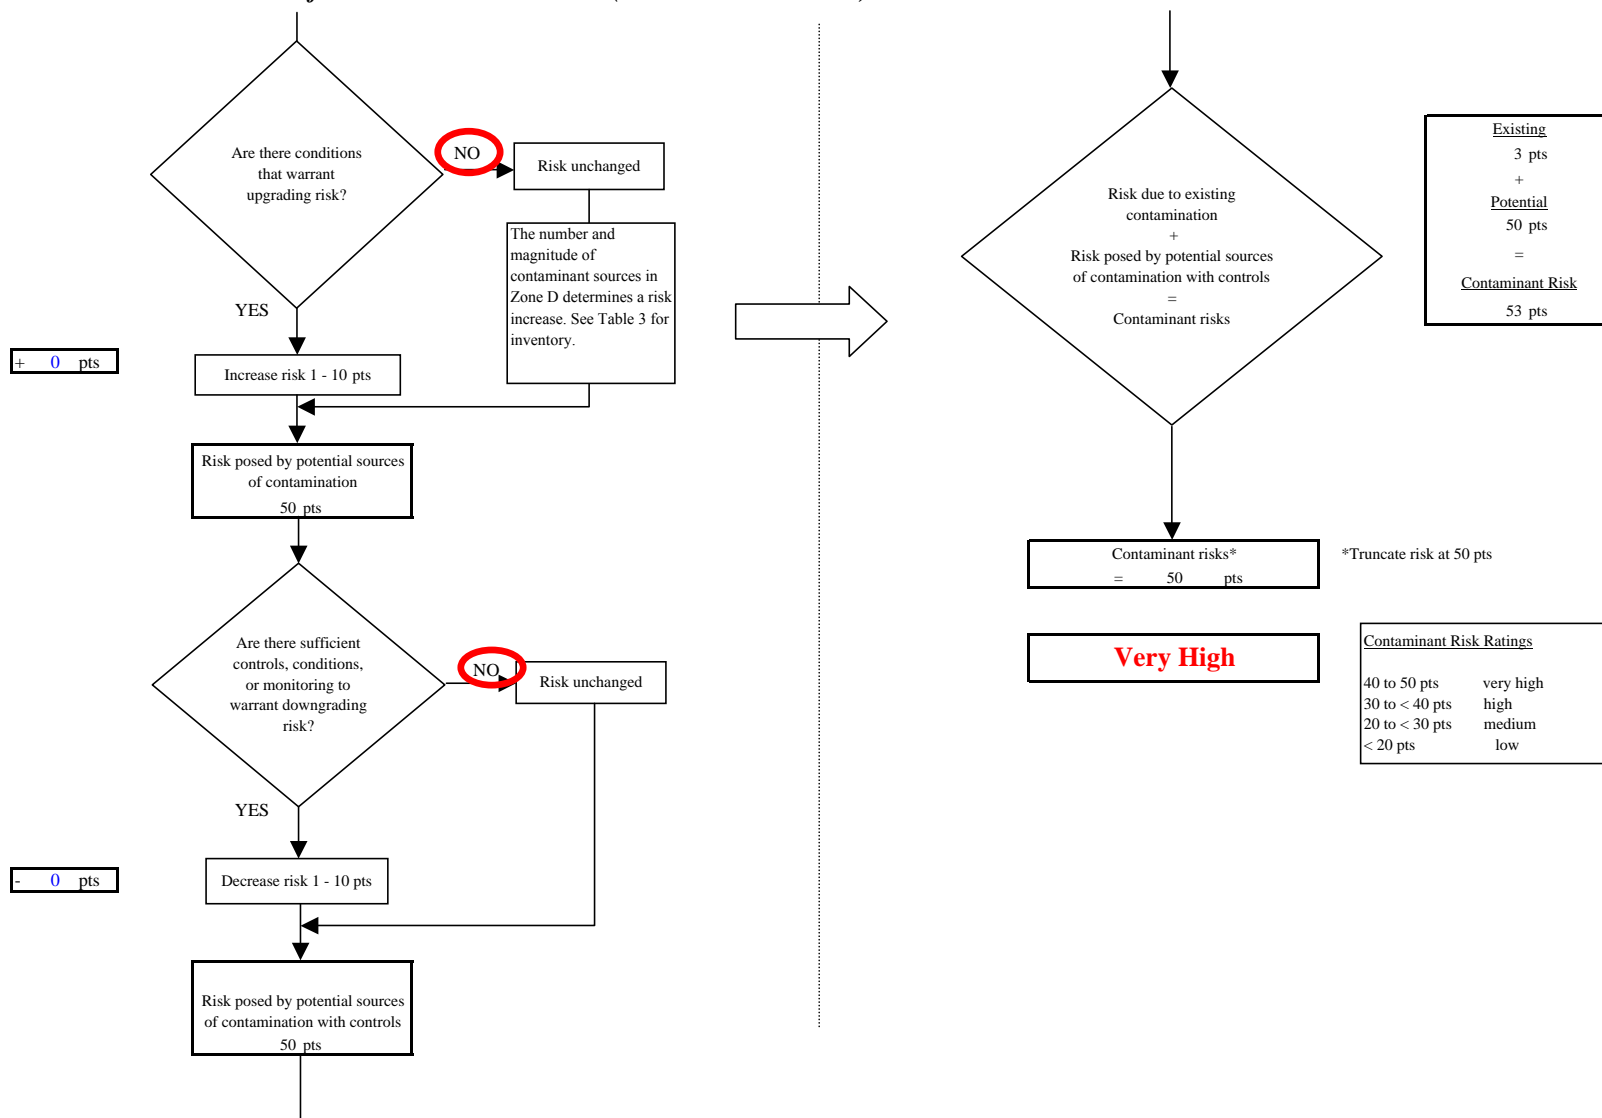

**Chart 6. Vulnerability analysis for Tanana Health Center (PWS No. 360395.001) - Nitrates and Nitrites**

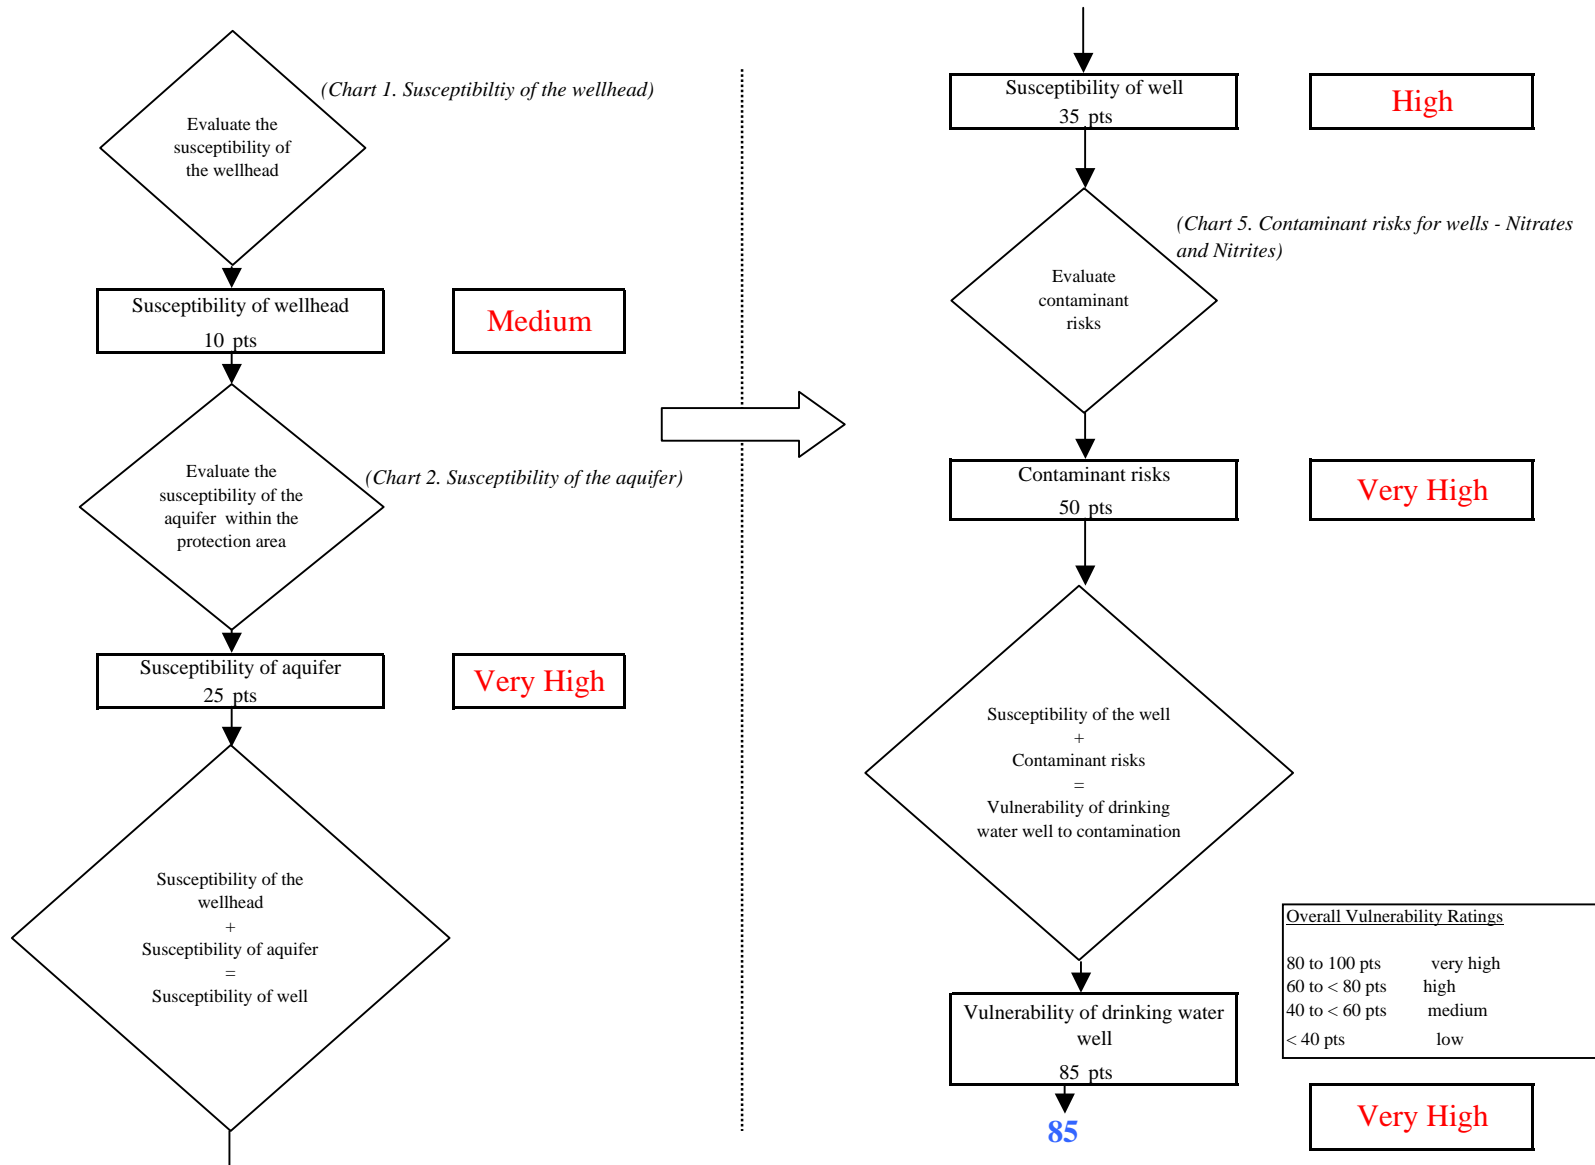



**Chart 7. Contaminant risks for Tanana Health Center (PWS No. 360395.001) - Volatile Organic Chemicals**



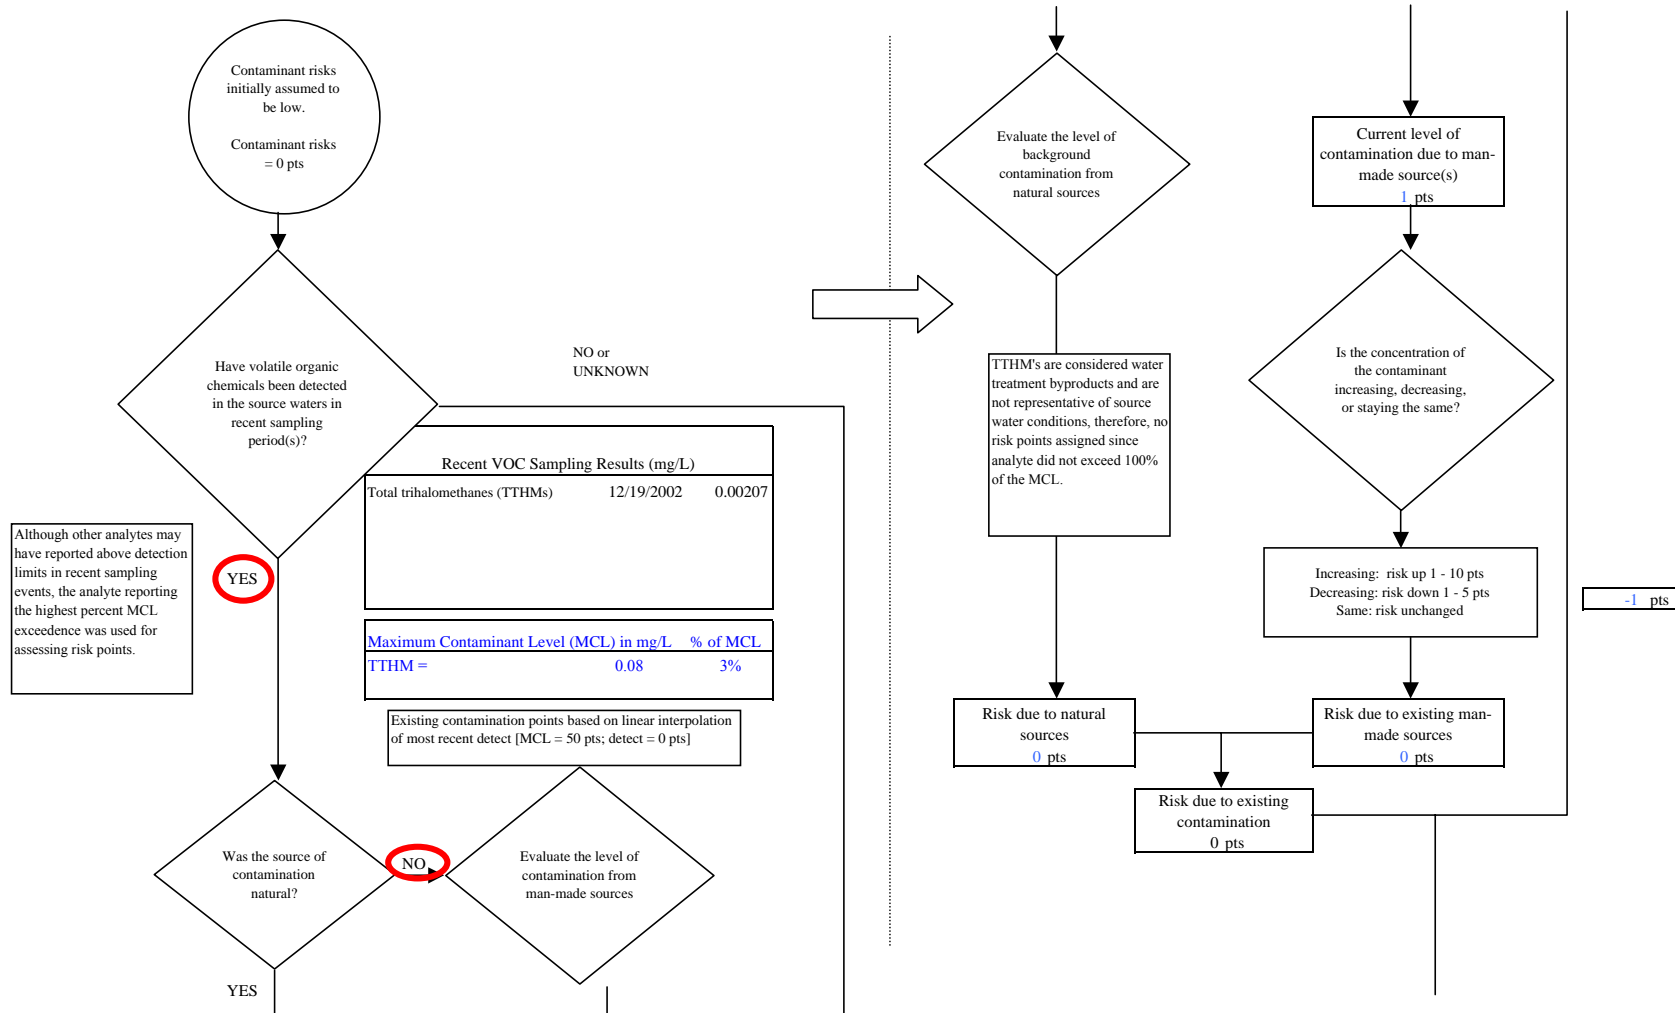


Chart 7. Contaminant risks for Tanapa Health Center (PWS No. 360395.001) - Volatile Organic Chemicals

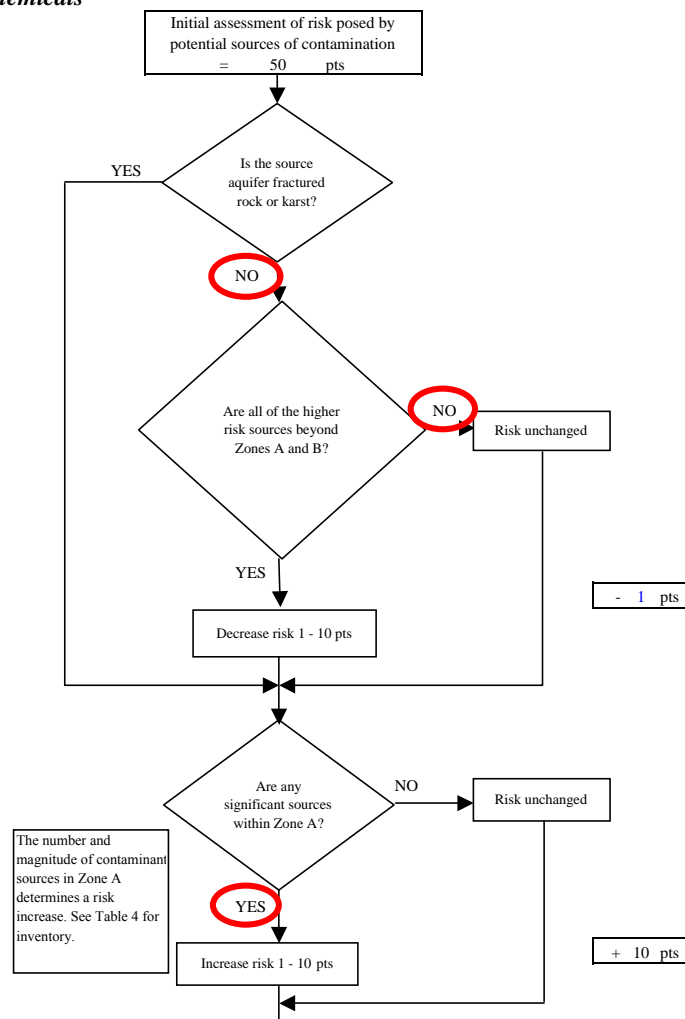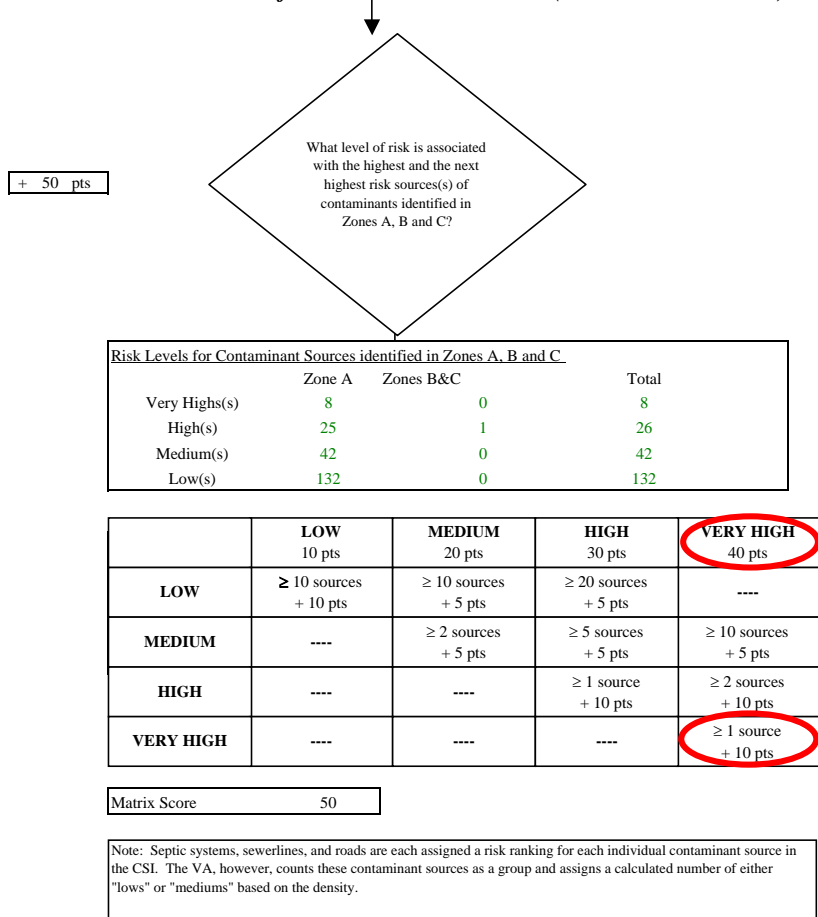

**Chart 7. Contaminant risks for Tanana Health Center (PWS No. 360395.001) - Volatile Organic Chemicals**



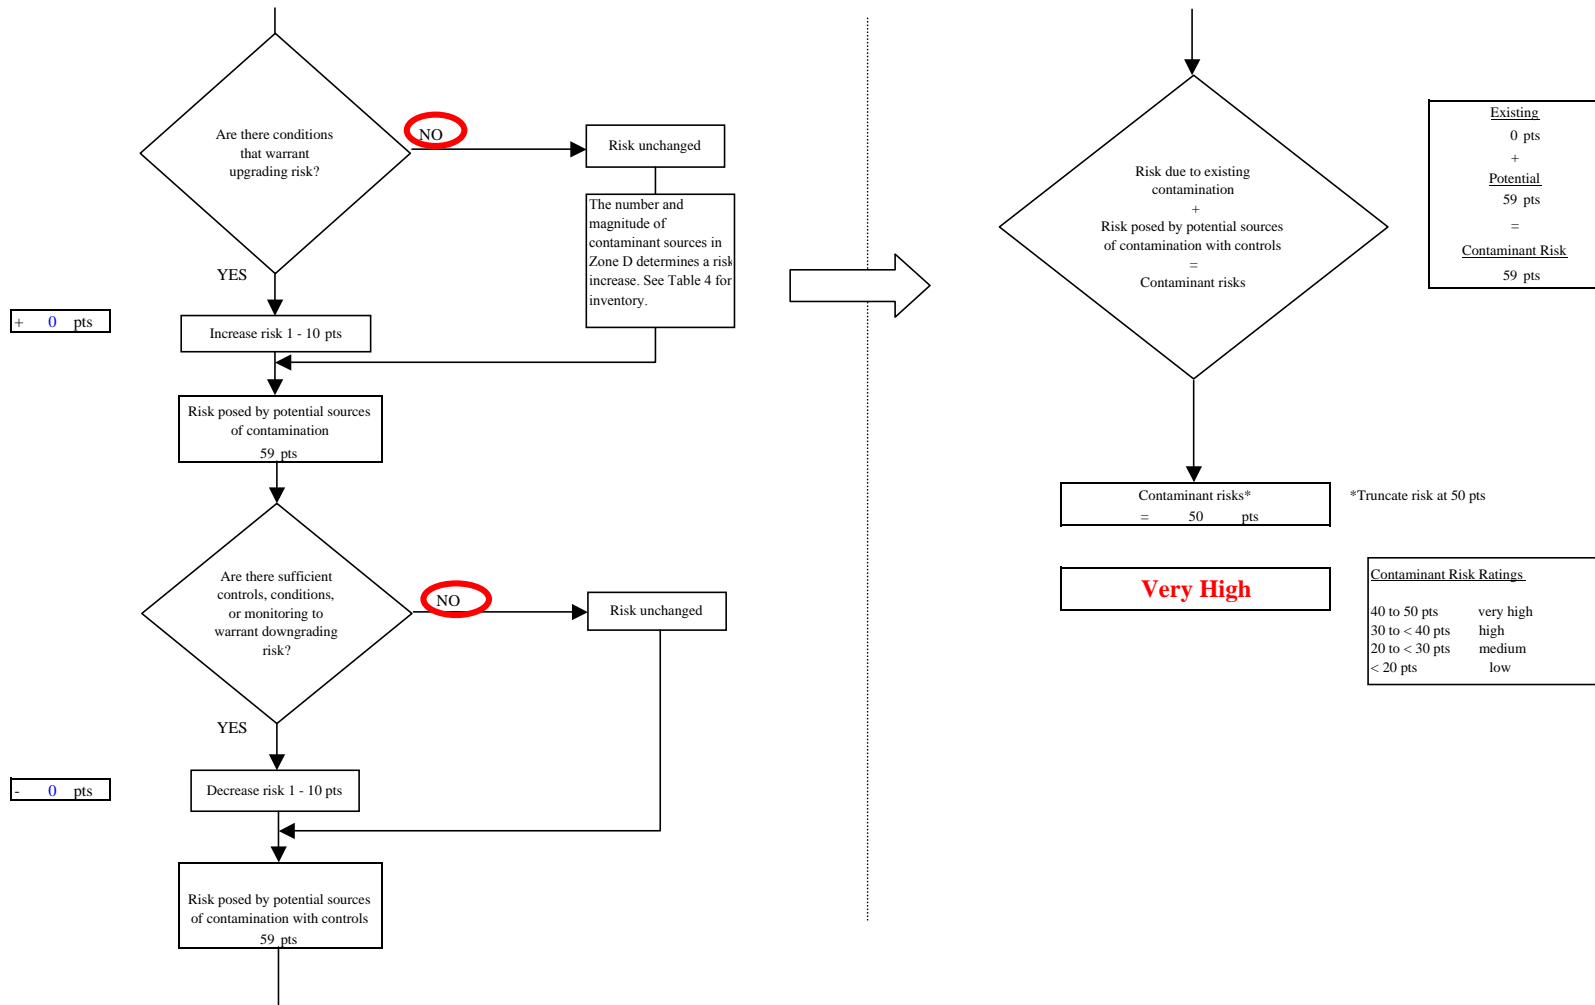



Chart 8. Vulnerability analysis for Tanana Health Center (PWS No. 360395.001) - Volatile Organic Chemicals

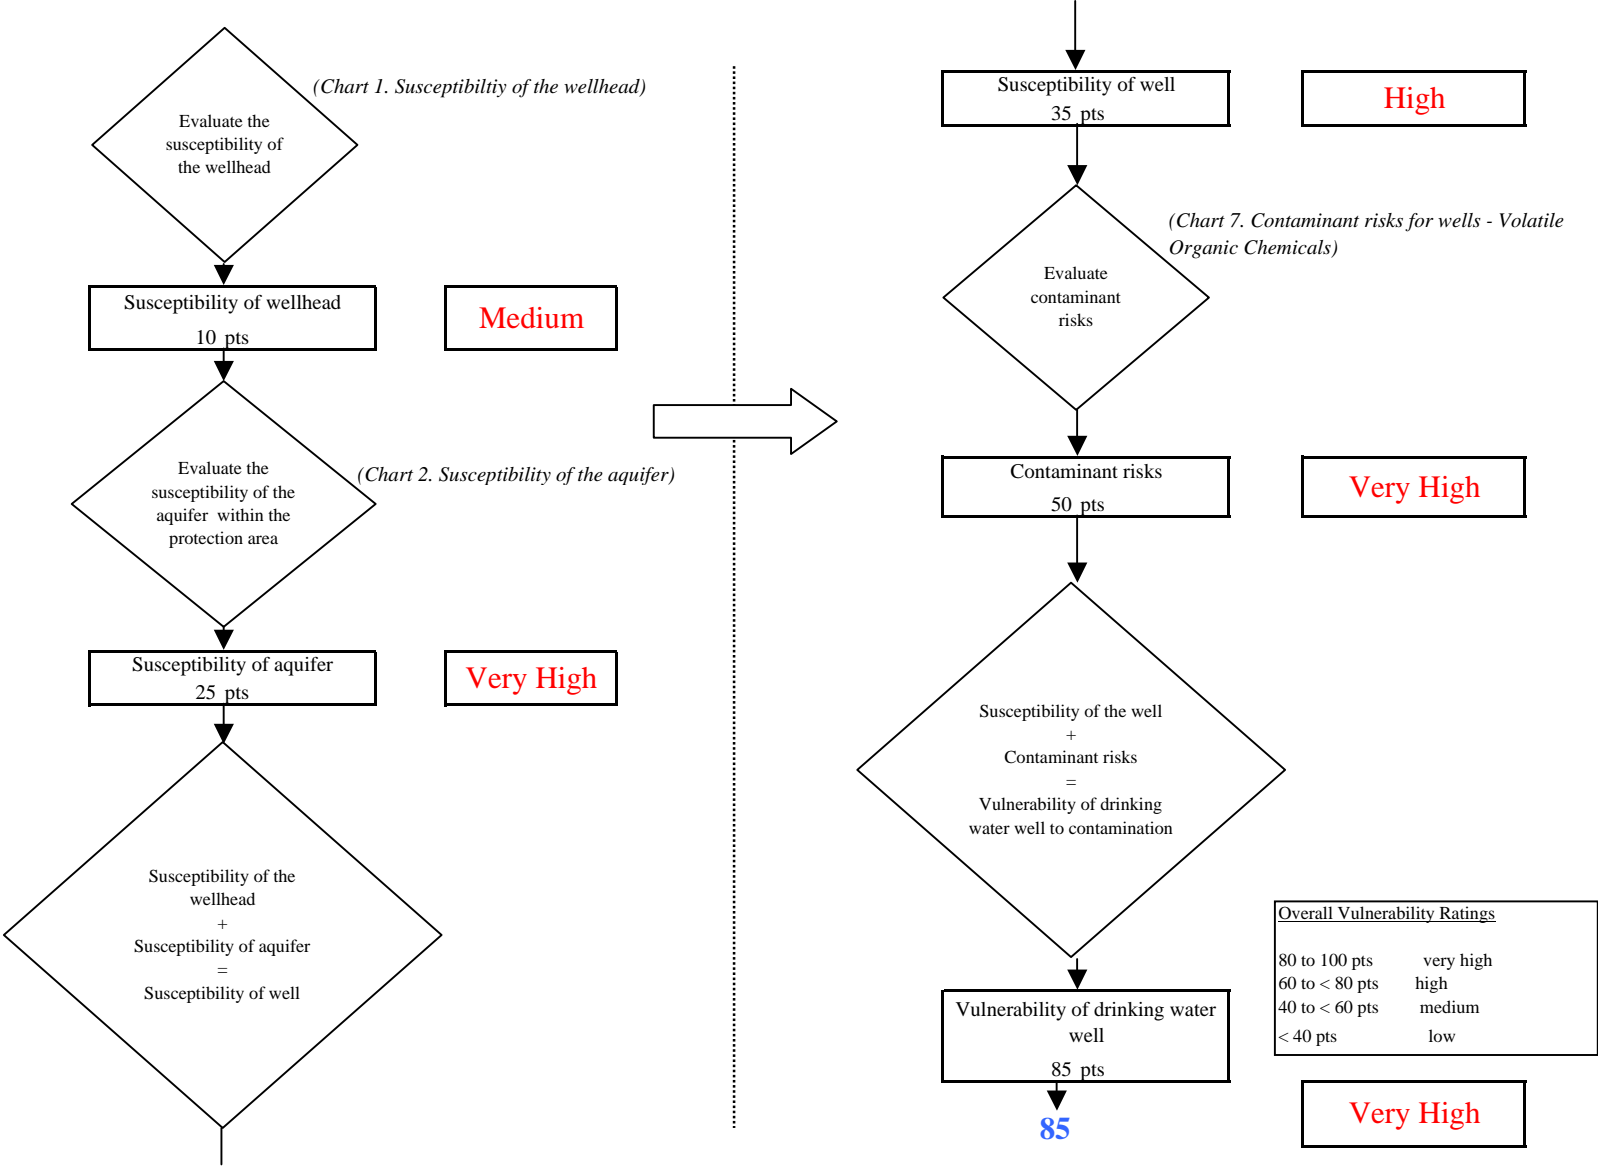


**Chart 9. Contaminant risks for Tanana Health Center (PWS No. 360395.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals**

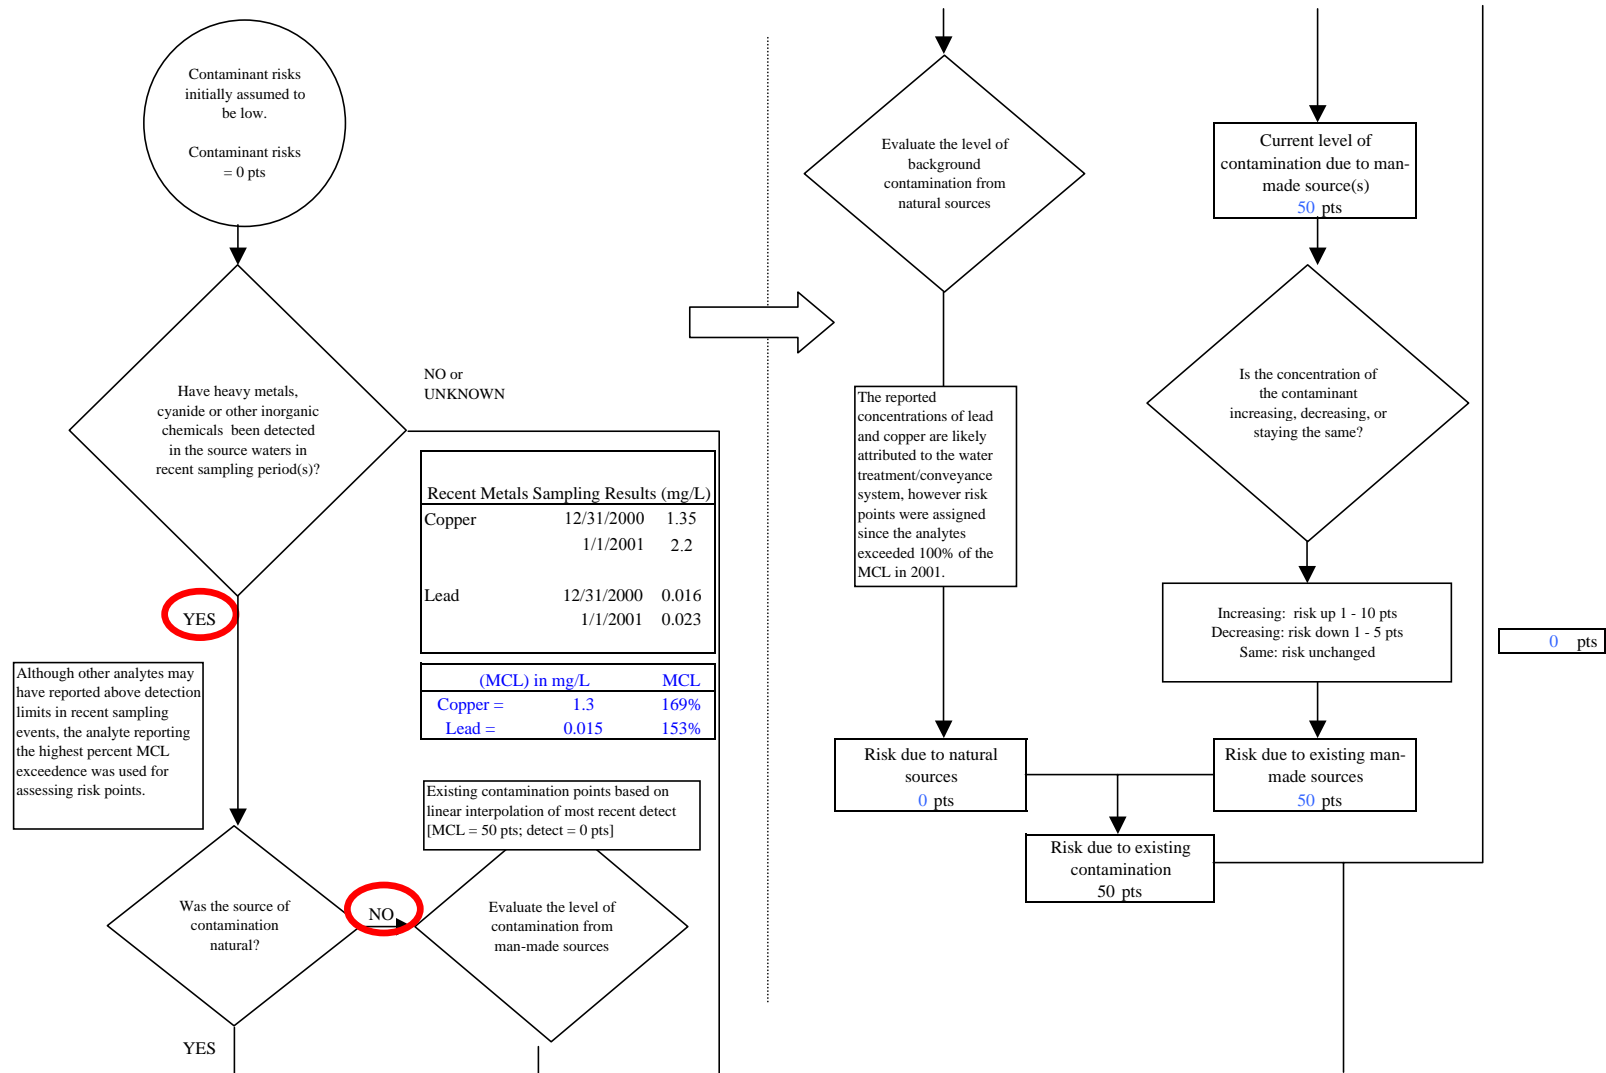


**Chart 9. Contaminant risks for Tanana Health Center (PWS No. 360395.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals**

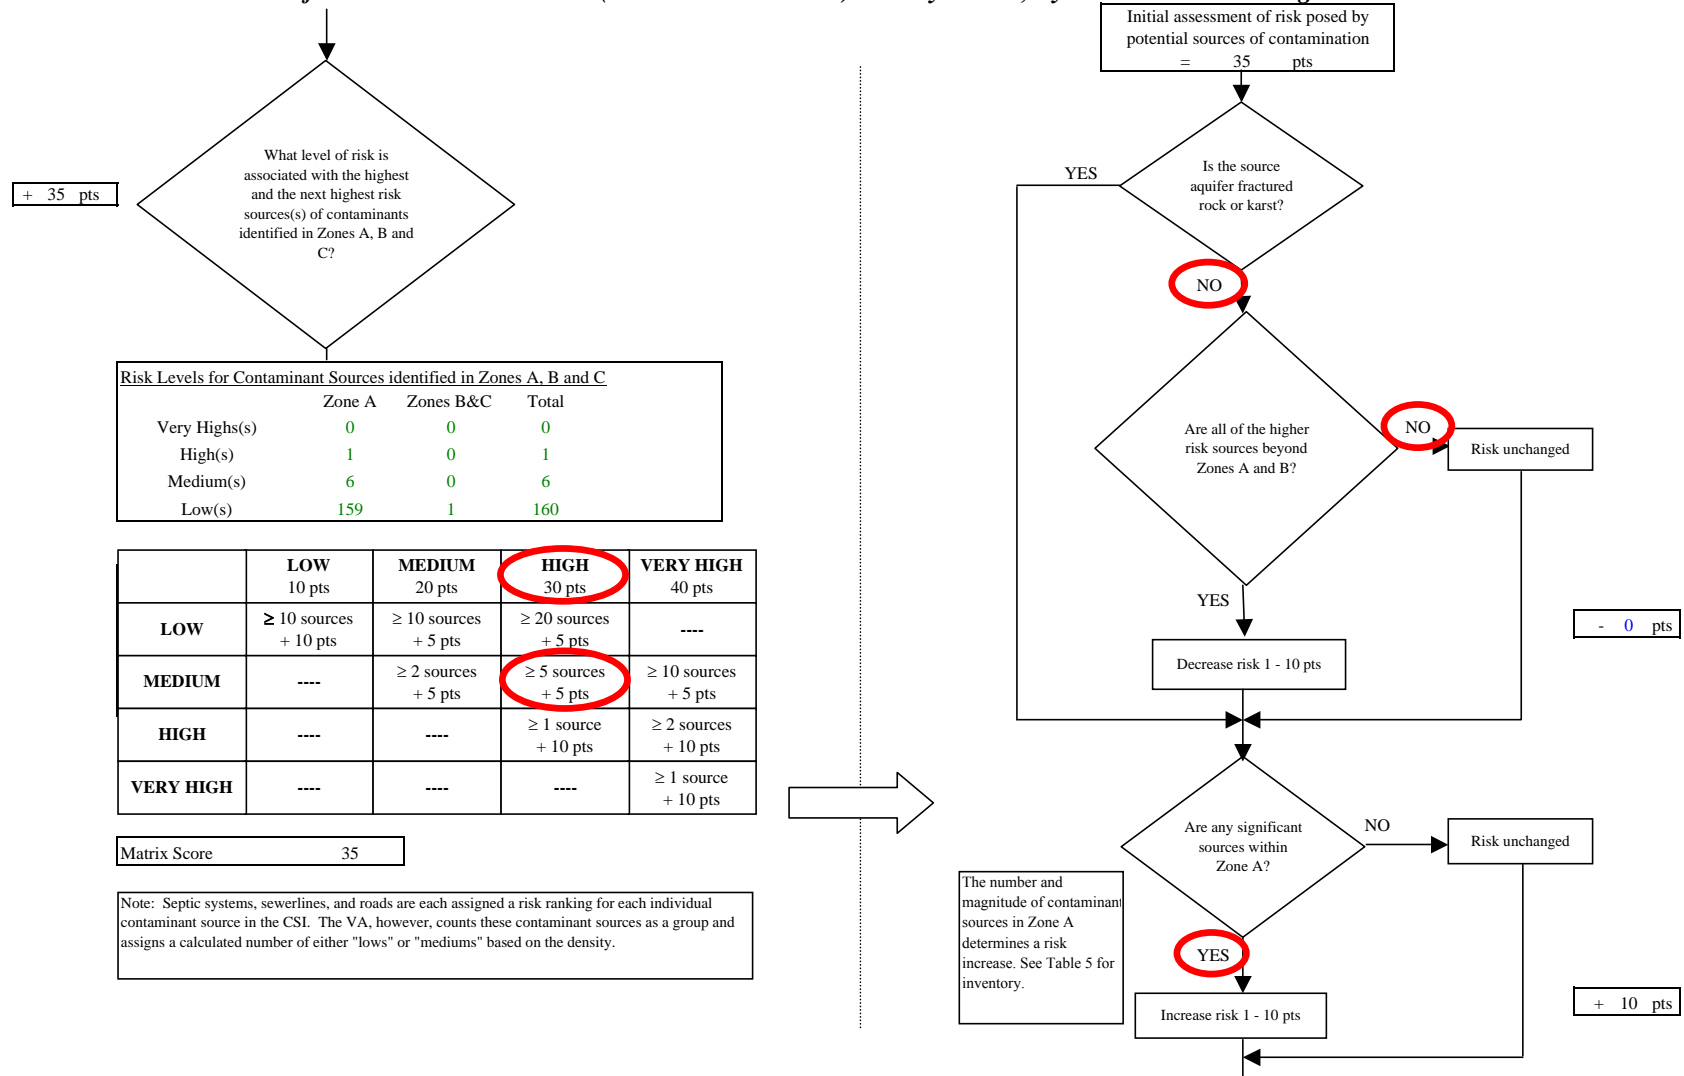

**Chart 9. Contaminant risks for Tanana Health Center (PWS No. 360395.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals**

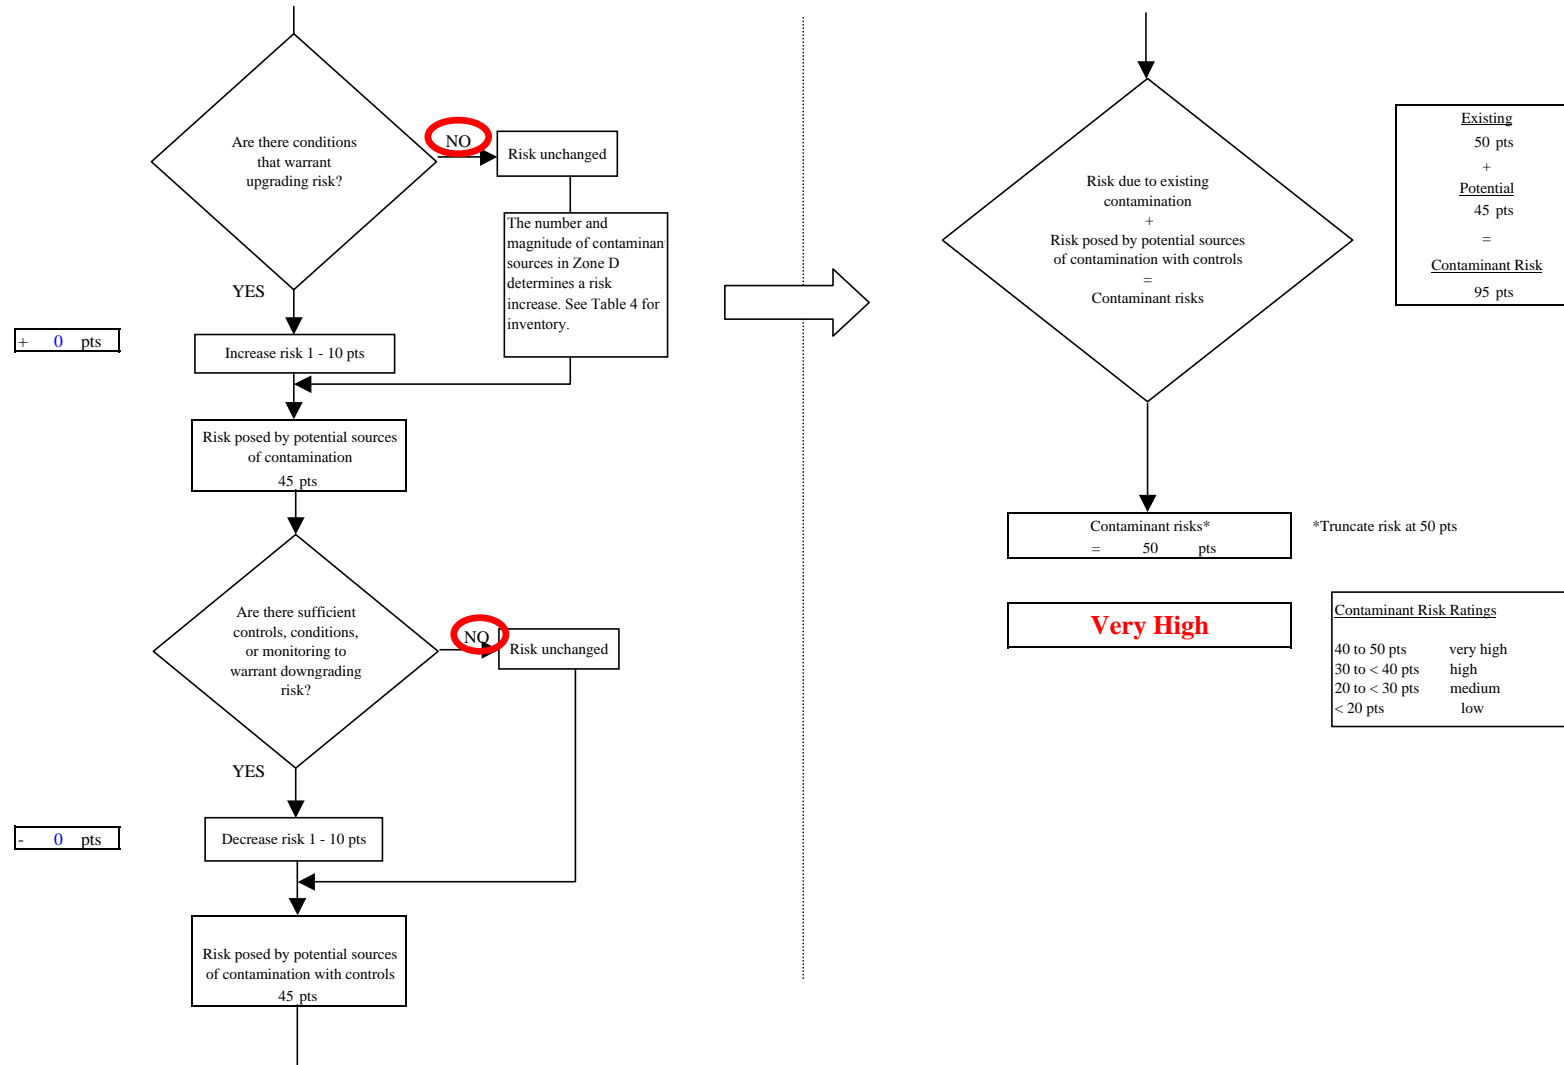


**Chart 10. Vulnerability analysis for Tanana Health Center (PWS No. 360395.001) - Heavy Metals, Cyanide and Other Inorganic Chemicals**

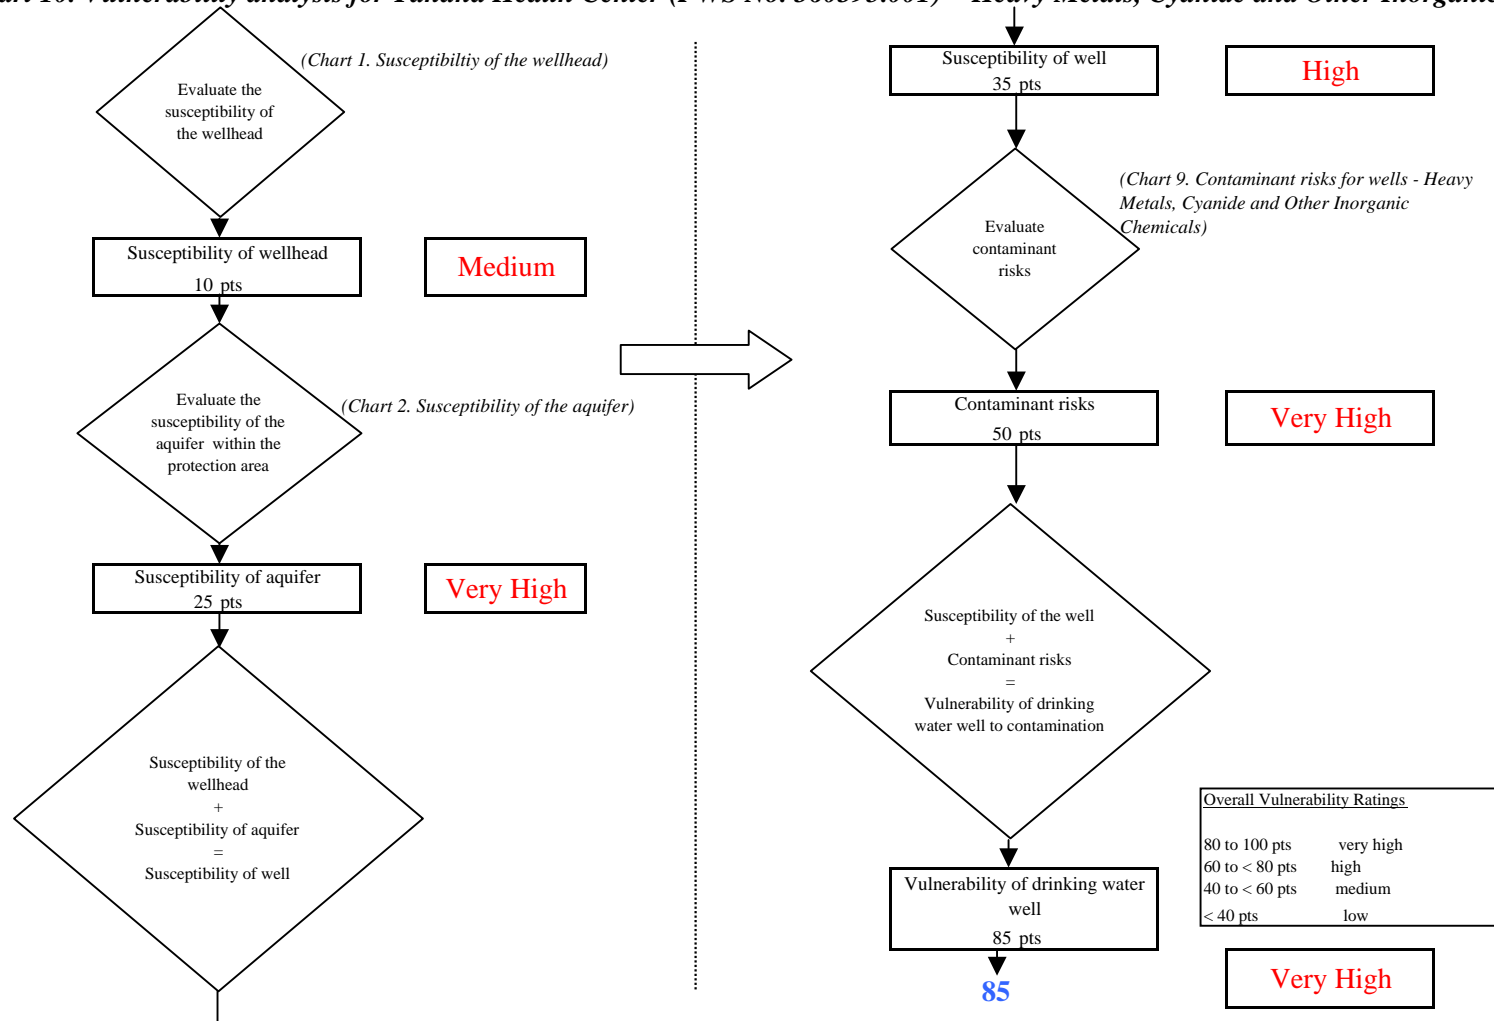



**Chart 11. Contaminant risks for Tanana Health Center (PWS No. 360395.001) - Synthetic Organic Chemicals**

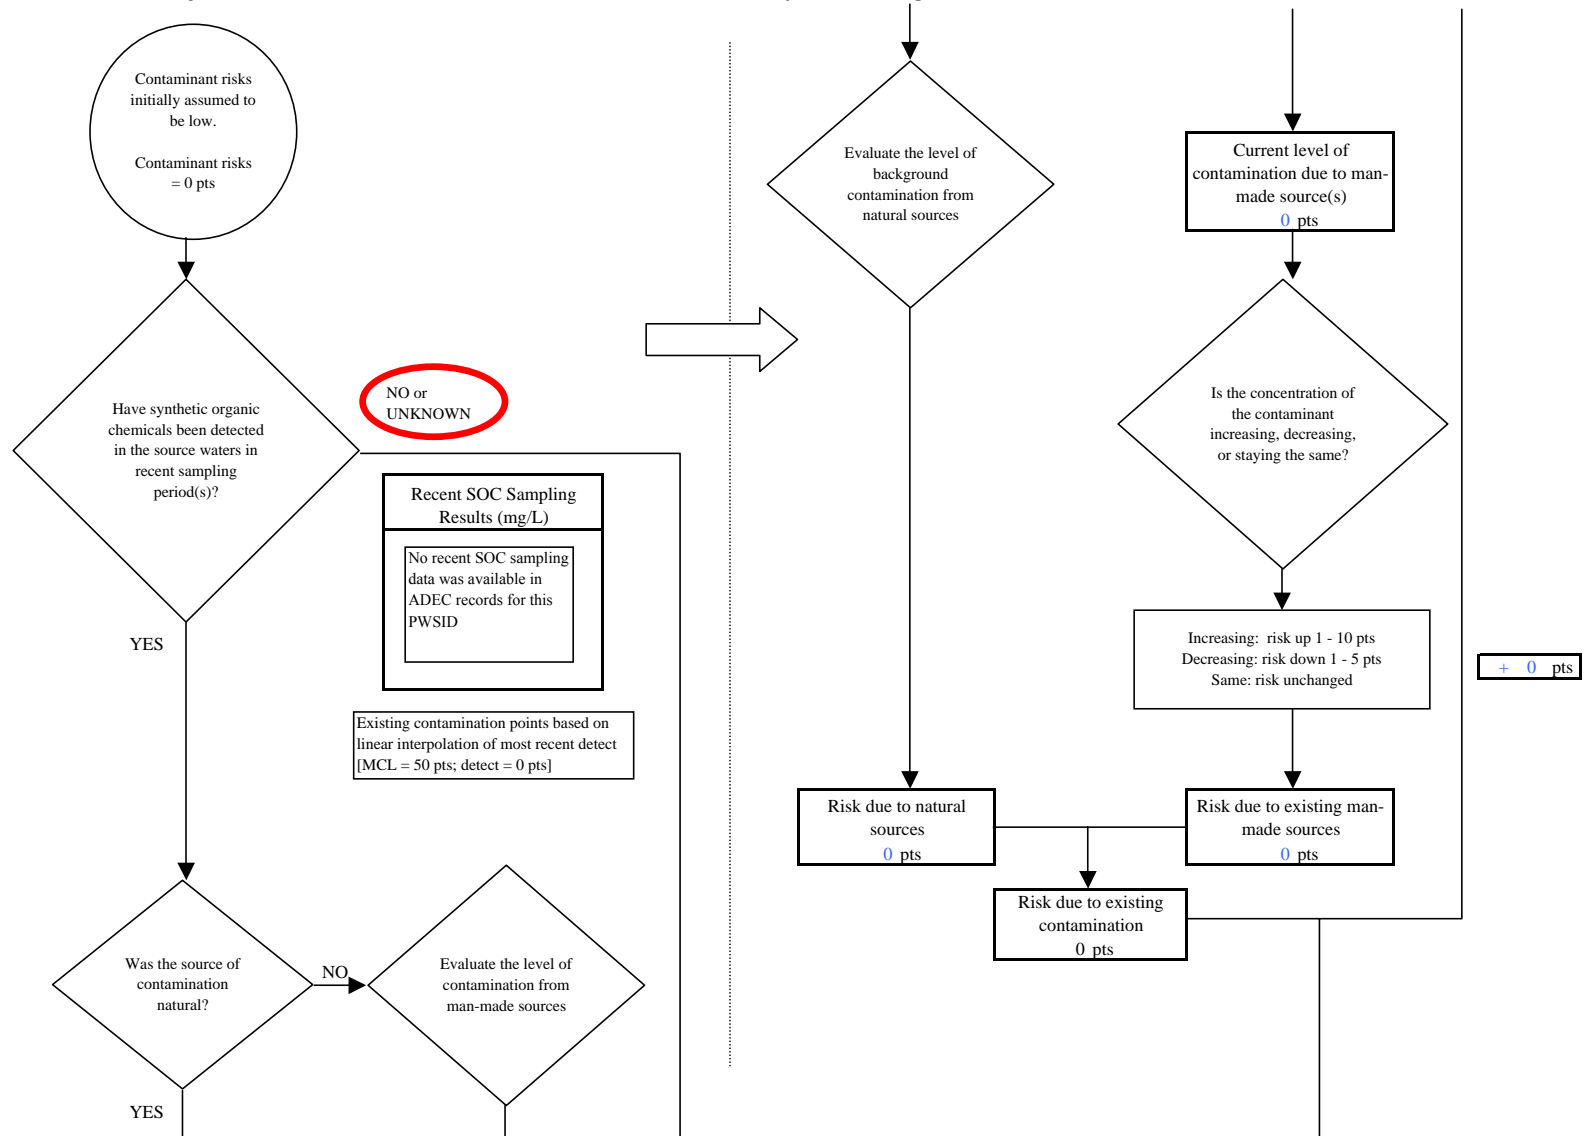

**Chart 11. Contaminant risks for Tanana Health Center (PWS No. 360395.001) - Synthetic Organic Chemicals**



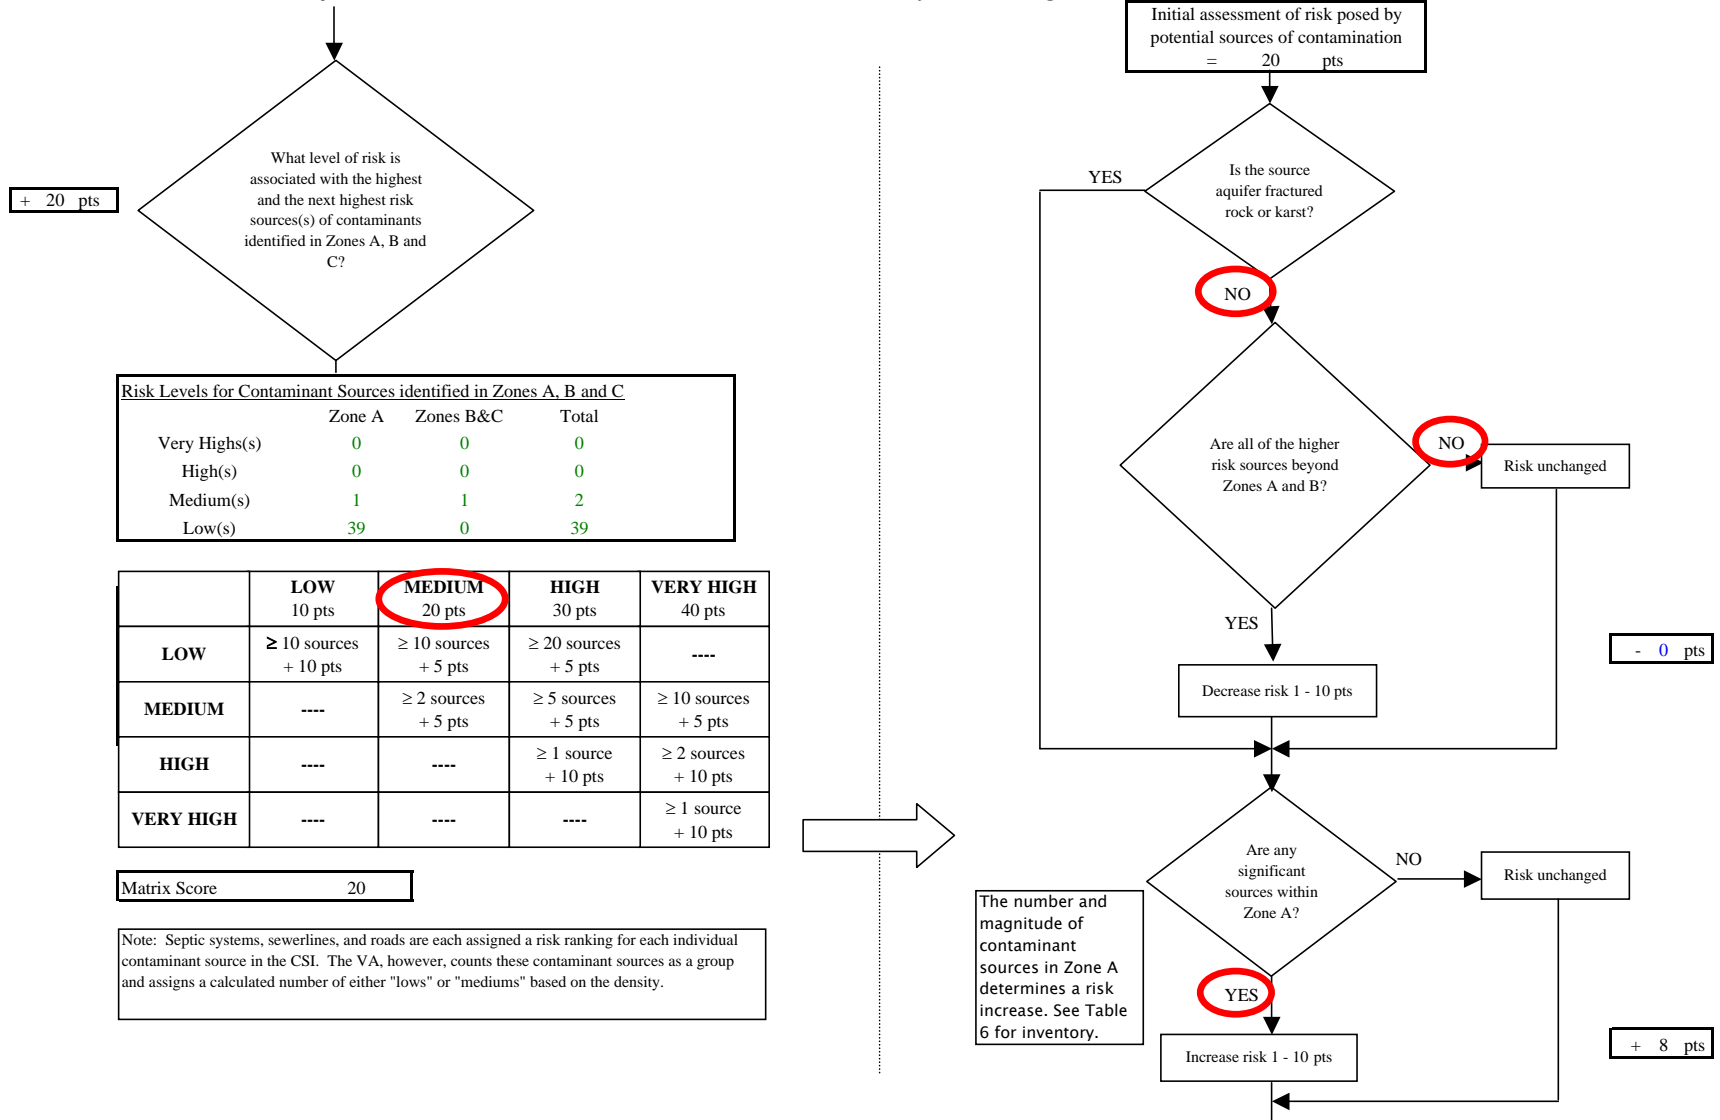


Chart 11. Contaminant risks for Tanana Health Center (PWS No. 360395.001) - Synthetic Organic Chemicals

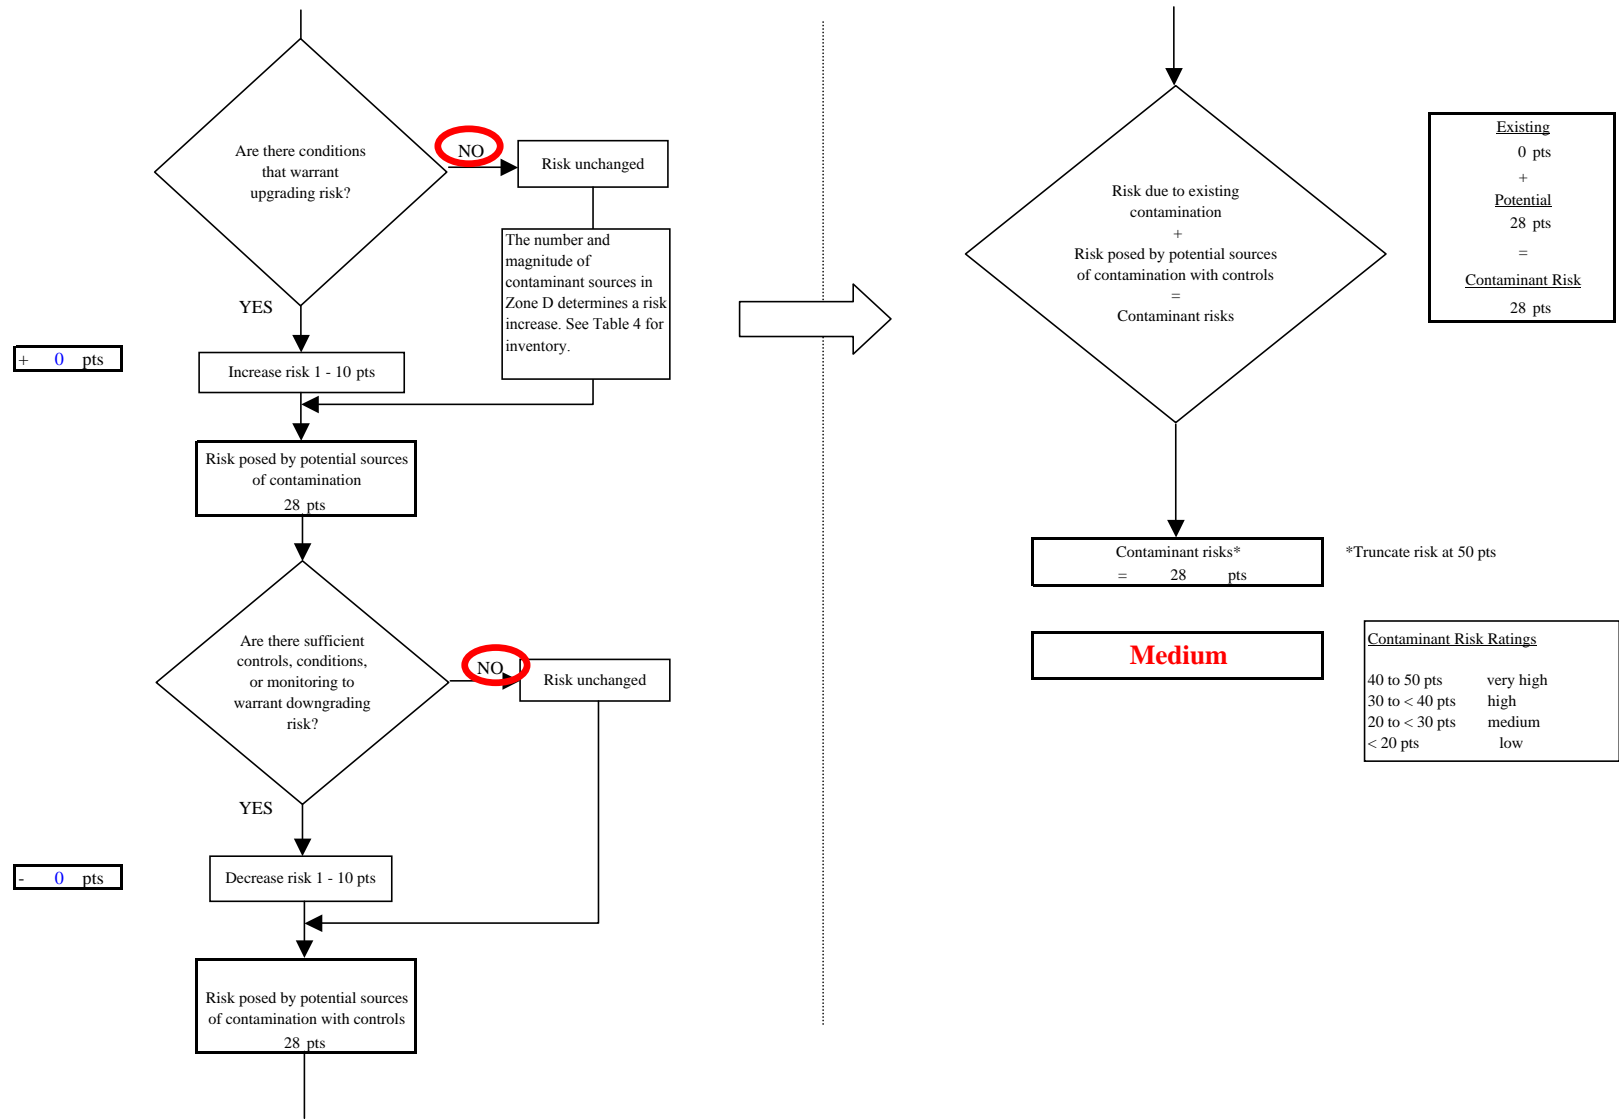

**Chart 12. Vulnerability analysis for Tanana Health Center (PWS No. 360395.001) - Synthetic Organic Chemicals**

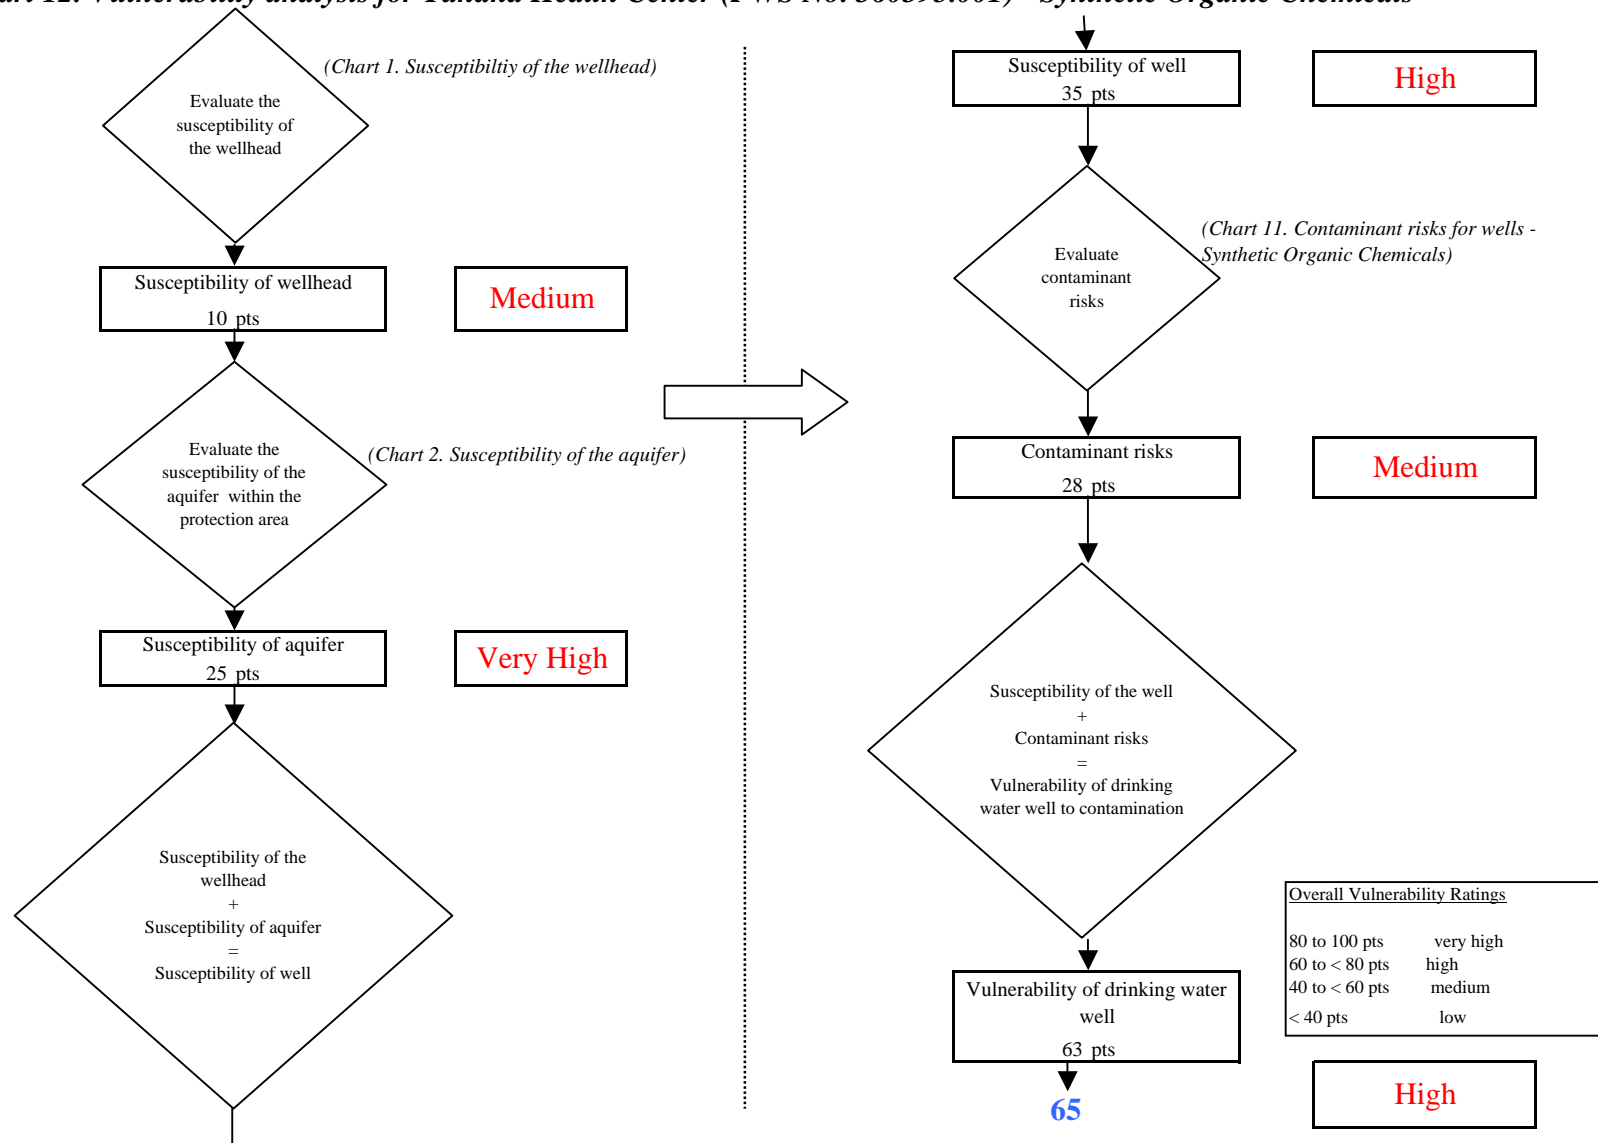

**Chart 13. Contaminant risks for Tanana Health Center (PWS No. 360395.001) - Other Organic Chemicals**



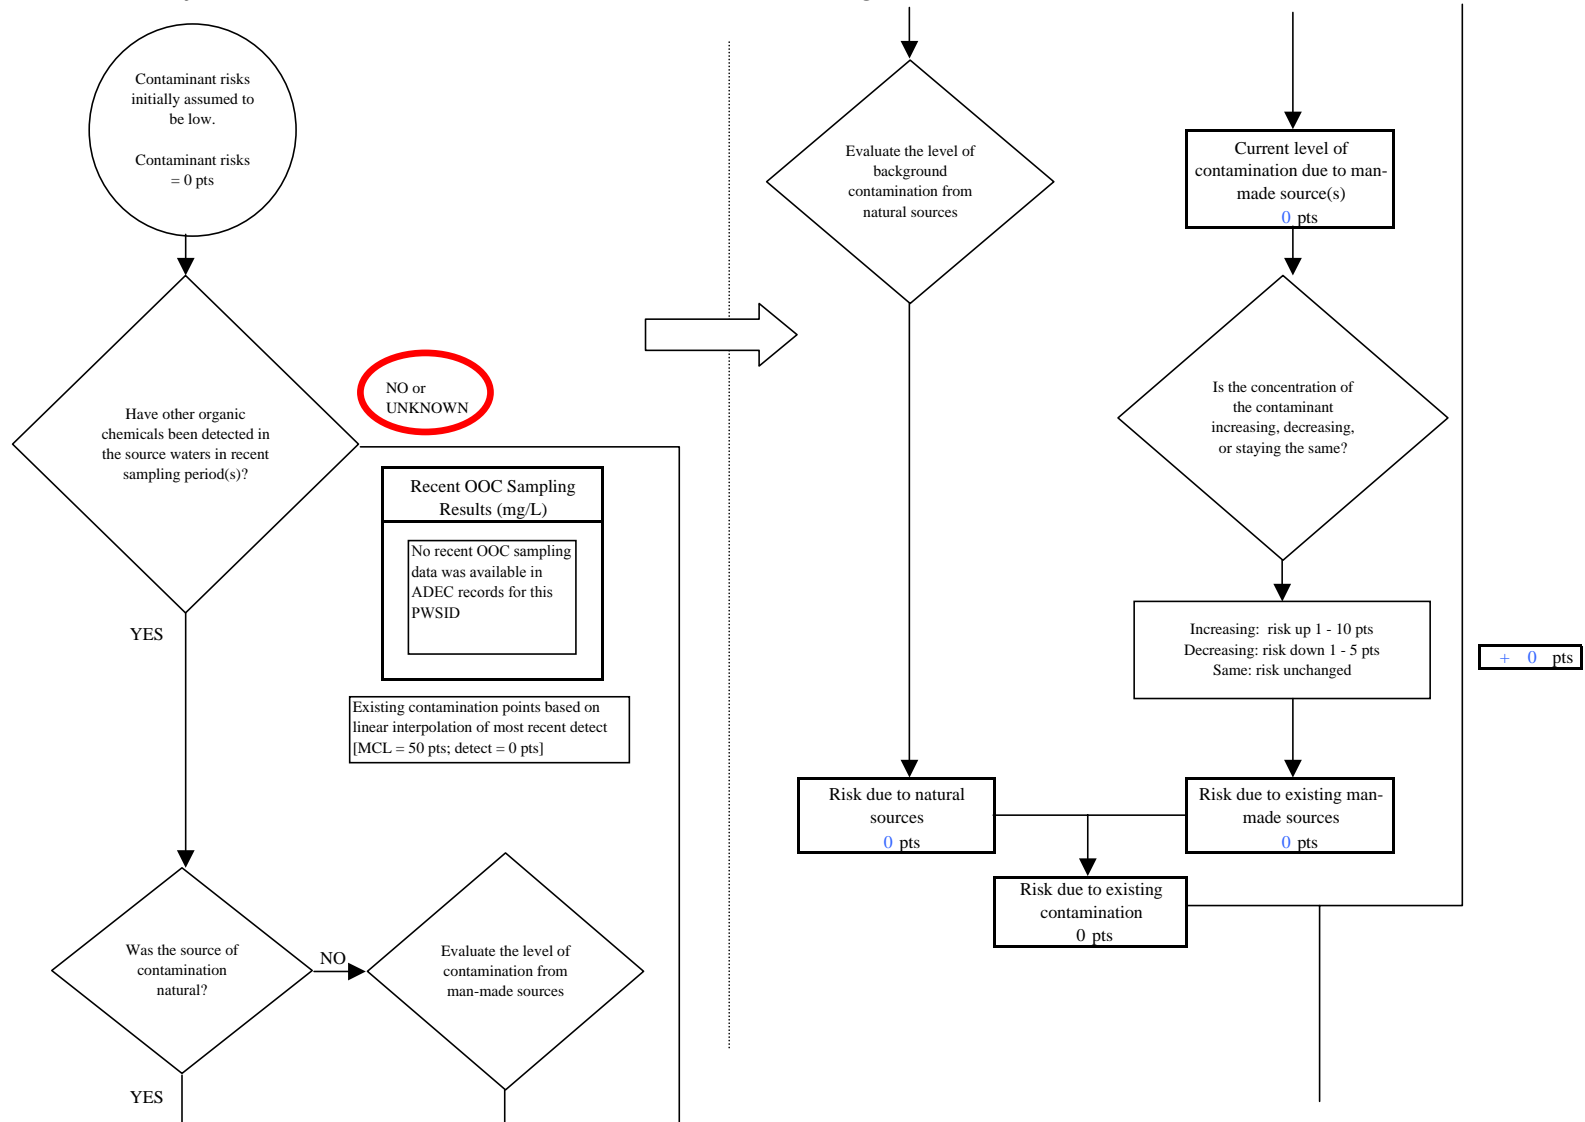


Chart 13. Contaminant risks for Tanana Health Center (PWS No. 360395.001) - Other Organic Chemicals

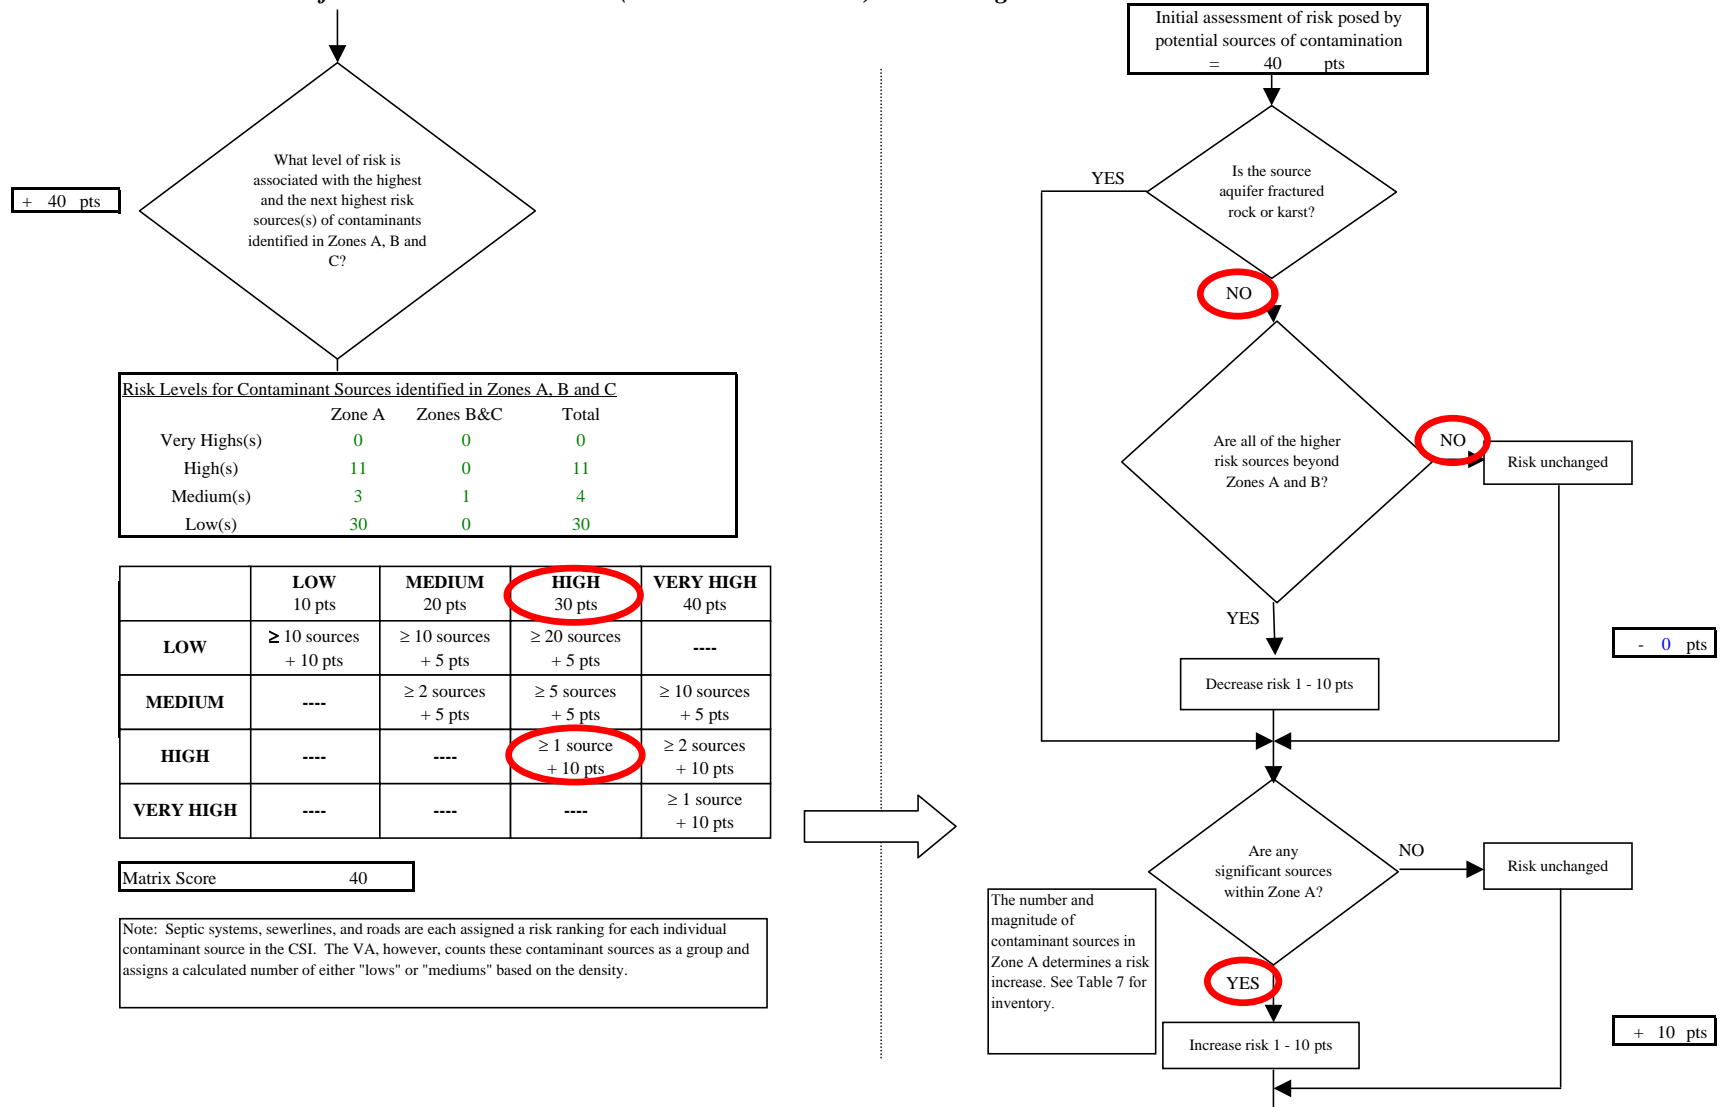

**Chart 13. Contaminant risks for Tanana Health Center (PWS No. 360395.001) - Other Organic Chemicals**

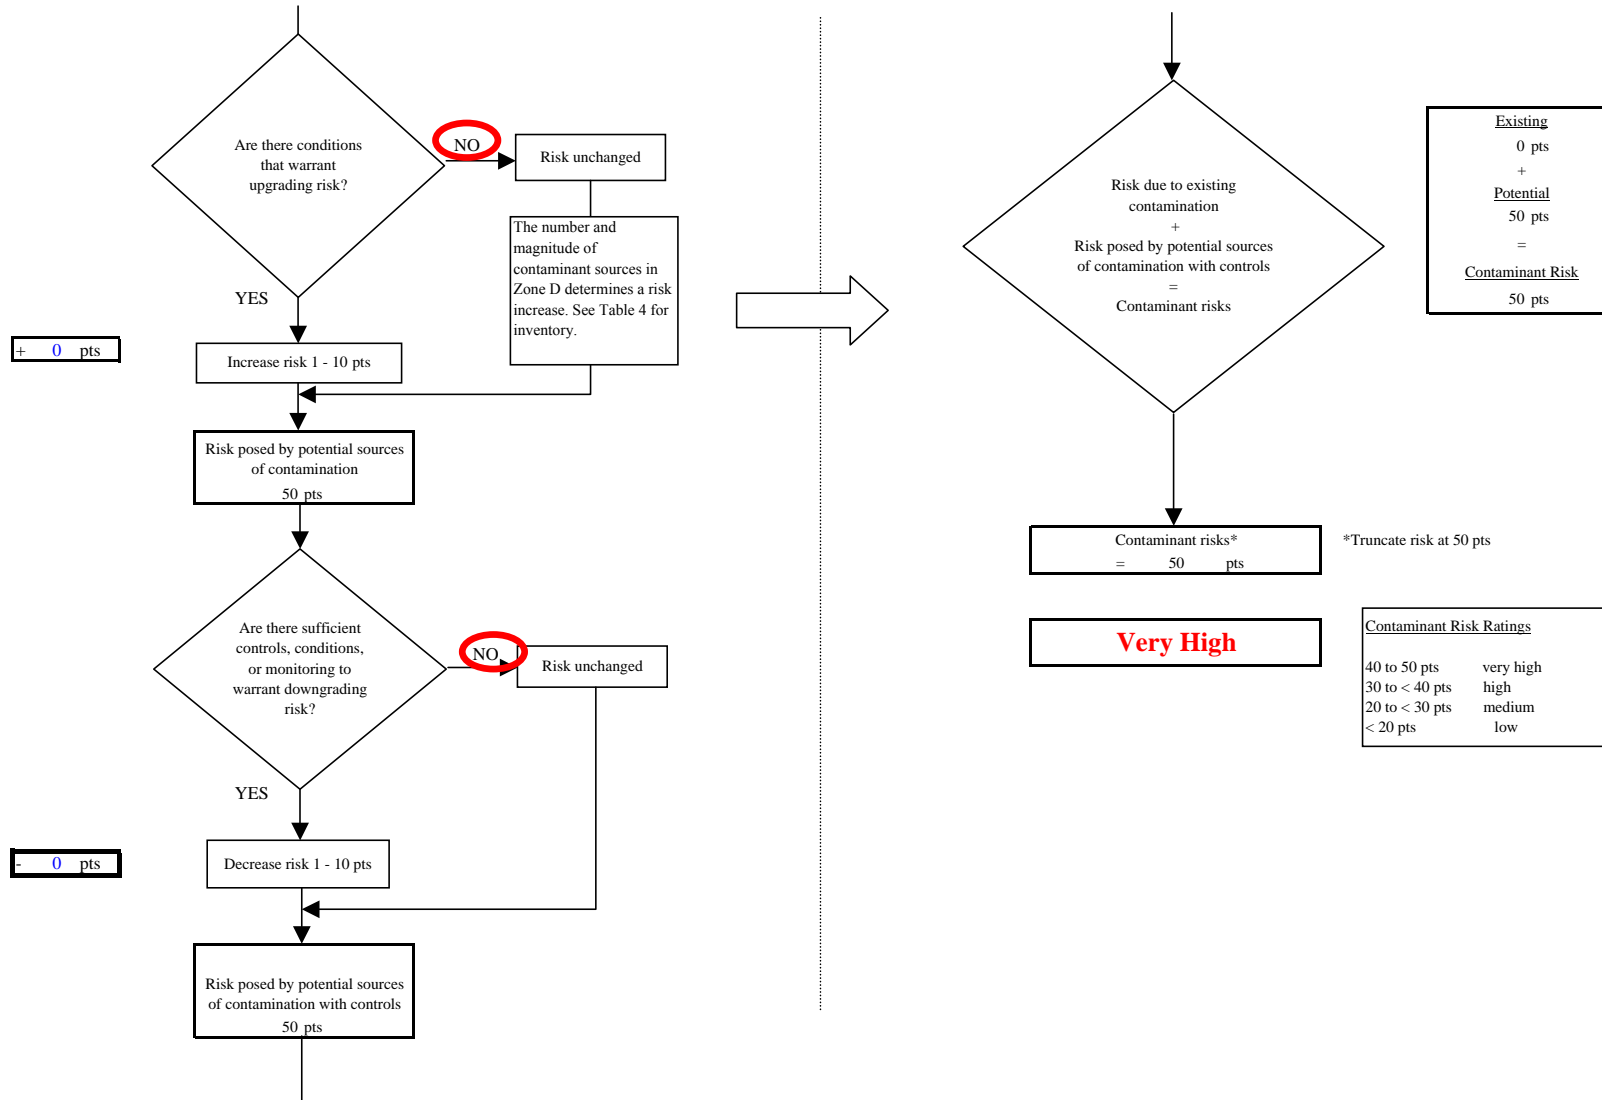

**Chart 14. Vulnerability analysis for Tanana Health Center (PWS No. 360395.001) - Other Organic Chemicals**

