

# **ALASKA POWER AUTHORITY**

## **Anchorage - Fairbanks Transmission Intertie**



### **Economic Feasibility Study Report**


**December 1979**



INTERNATIONAL ENGINEERING COMPANY, INC.



ROBERT W. RETHERFORD ASSOCIATES

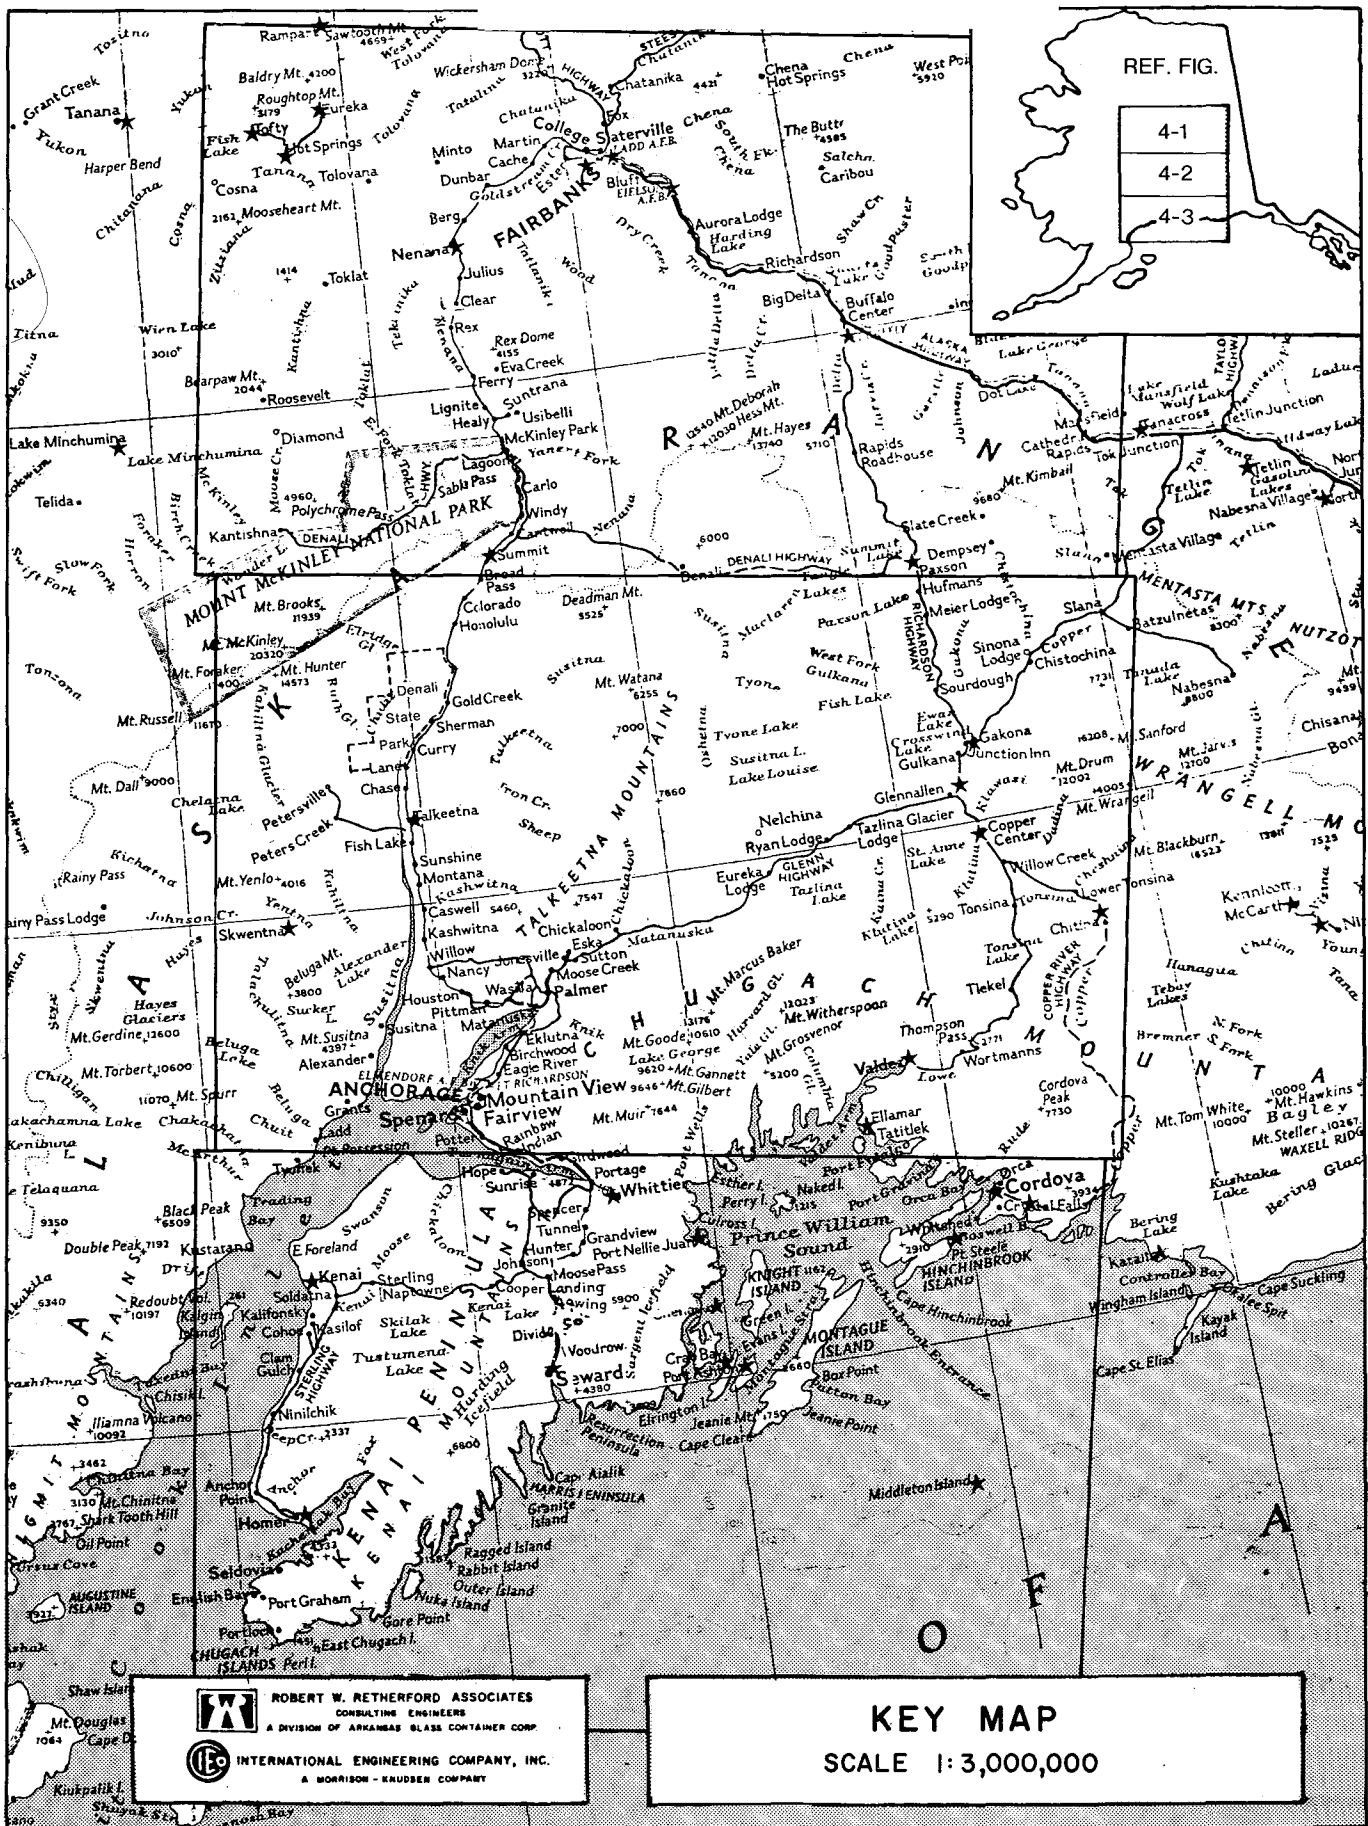

# **A L A S K A P O W E R A U T H O R I T Y**

## **Anchorage - Fairbanks Transmission Intertie Economic Feasibility Study Report**

**December 1979**



**INTERNATIONAL ENGINEERING COMPANY, INC.**



**ROBERT W. RETHERFORD ASSOCIATES**

## CONTENTS

<u>Chapter</u>		<u>Page</u>
	ABBREVIATIONS	x
1	INTRODUCTION	1-1
2	SUMMARY AND CONCLUSIONS	
	2.1 Study Summary	2-1
	2.2 Conclusions	2-4
3	LOAD FORECASTS FOR RAILBELT AREA	
	3.1 Energy and Demand Forecasts Range	3-1
	3.2 Demand Forecasts for Generation Planning	3-8
	3.3 References	3-10
4	SELECTION OF INTERTIE ROUTE	
	4.1 Review of Earlier Studies	4-1
	4.2 Survey of Alternative Corridors	4-1
	4.3 Preferred Route for Transmission Intertie	4-1
	4.4 Field Investigations	4-3
	4.5 Preliminary Environmental Assessment	4-4
	4.6 References	4-11
5	TRANSMISSION LINE DESIGN	
	5.1 Basic Design Requirements	5-1
	5.2 Selection of Tower Type Used in the Study	5-1
	5.3 Design Loading Assumptions	5-2
	5.4 Tower Weight Estimation	5-2

## CONTENTS

<u>Chapter</u>		<u>Page</u>
5	TRANSMISSION LINE DESIGN (Continued)	
	5.5 Conductor Selection	5-3
	5.6 Power Transfer Capabilities	5-4
	5.7 HVDC Transmission System	5-4
	5.8 References	5-5
6	SYSTEM EXPANSION PLANS	
	6.1 Generation Planning Criteria	6-1
	6.2 Multi-Area Reliability Study	6-4
	6.3 System Expansion Plans	6-10
	6.4 References	6-12
7	FACILITY COST ESTIMATES	
	7.1 Transmission Line Costs	7-1
	7.2 Substation Costs	7-4
	7.3 Control and Communications System Costs	7-5
	7.4 Transmission Intertie Facility Costs	7-5
	7.5 Cost of Transmission Losses	7-5
	7.6 Basis for Generating Plant Facility Costs	7-6
	7.7 Generating Plant Fuel Costs	7-7
	7.8 MEA Underlying System Costs	7-8
	7.9 Construction Power Costs for the Upper Susitna Project	7-8
	7.10 References	7-9
8	ECONOMIC FEASIBILITY ANALYSIS	
	8.1 Methodology	8-1
	8.2 Sensitivity Analysis	8-2
	8.3 Economic Analysis	8-3
	8.4 References	8-8

## CONTENTS

<u>Chapter</u>		<u>Page</u>
9	FINANCIAL PLANNING CONCEPTS	
	9.1 Sources of Funds	9-1
	9.2 Proportional Allocations Between Sources	9-5
	9.3 Allocated Financial Responsibility for Participants	9-7
	9.4 Costs for Reserve Sharing and Firm Transfer	9-11
	9.5 Financial Plans for Future Staged Development	9-12
	9.6 References	9-13
10	INSTITUTIONAL CONSIDERATIONS	
	10.1 Present Institutions and Railbelt Utilities	10-1
	10.2 Alaskan Interconnected Utilities	10-3
	10.3 References	10-5

## APPENDIXES

<u>Appendix</u>		
A	NOTES ON FUTURE USE OF ENERGY IN ALASKA	A-1
B	TRANSMISSION LINE COSTS ANALYSIS PROGRAM (TLCAP)	
	B.1 General Description	B-1
	B.2 Computer Program Applications for Optimum Transmission Line Costs	B-2
	B.3 TLCAP Sample Outputs	B-6
C	MULTI-AREA RELIABILITY PROGRAM (MAREL)	C-1

## CONTENTS

<u>Appendix</u>		<u>Page</u>
D	DATA AND COST ESTIMATES FOR TRANSMISSION INTERTIE AND GENERATING PLANTS	D-1
	D.1 Data and Cost Estimates for Trans- mission Intertie	D-1
	D.2 Data and Cost Estimates for Gene- rating Plants	D-13
	D.3 Data and Cost Estimates for Supply of Construction Power to Upper Susitna Project Sites	D-24
	D.4 Alternative Generating Plant Fuel Costs	D-38
E	TRANSMISSION LINE ECONOMIC ANALYSIS PROGRAM	E-1
F	TRANSMISSION LINE FINANCIAL ANALYSIS	F-1

## TABLES

<u>Table</u>		<u>Page</u>
3-1	Anchorage-Cook Inlet Area Utility Forecasts and Extrapolated Projections	3-11
3-2	Fairbanks-Tanana Valley Area Utility Forecasts and Extrapolated Pojections	3-12
3-3	Combined Utility Forecasts for Railbelt Area	3-13
3-4	Load Forecast for Upper Susitna Proj- ect by Alaska Power Administration	3-14
3-5	Load Demand Forecasts for Railbelt Area to Determine Statistical Average Forecast	3-16
3-6	Peak Load Demand Forecasts for Railbelt Area with Range Limits for Sensitivity Analysis	3-17
5-1	Conductor Size Selection Criteria	5-6
6-1	Existing Generation Sources, Anchorage- Cook Inlet Area	6-14
6-2	Existing Generation Sources, Fairbanks- Tanana Valley Area	6-15
6-3	Load Model Data, Anchorage Area, Probable Load Forecast Case	6-16
6-4	Load Model Data, Fairbanks Area, Probable Load Forecast Case	6-17
6-5	Load Model Data, Anchorage Area, Low Load Forecast Case	6-18
6-6	Load Model Data, Fairbanks Area, Low Load Forecast Case	6-19
6-7	Loss of Load Probability Index for Study Cases IA and ID, Probable Load Forecast Case	6-20
6-8	Loss of Load Probability Index for Study Case IB, Probable Load Forecast Case	6-21

# TABLES (Continued)

<u>Table</u>		<u>Page</u>
6-9	Loss of Load Probability Index for Study Case IIA, Probable Load Forecast Case	6-22
6-10	Loss of Load Probability Index for Study Case IA and ID, Low Load Forecast Case	6-23
6-11	Loss of Load Probability Index for Case IB, Low Load Forecast Case	6-24
6-12	Loss of Load Probability Index for Case IC, Probable Load Forecast Case	6-25
7-1	Cost Summary for Intertie Facilities	7-10
7-2	Present Worth of Intertie Line Losses, 1984-1997 Study Period	7-11
7-3	Cost Summary for Generating Facilities	7-12
7-4	Summary of Alternative Generating Plant Fuel Costs	7-13
7-5	Alternative Costs for Construction Power Supply to Watana and Devil Canyon Hydropower Sites during Construction of Upper Susitna Project	7-14
8-1 to 8-6x	Differential Discounted Value of Base Year (1979) Costs	8-9 to 8-21
9-1	Alternative Disbursements of Capital Investment for Generation Expansion	9-14
9-2	Allocation of Total Project Costs Between Participants to Alaskan Intertie Agreement	9-15
9-3A and 9-3B	Allocated Costs for Reserve Capacity Sharing and Firm Power Transfer	9-16 and 9-17
A-1	MEA Statistical Summary - Past, Present and Future	A-4

## FIGURES

<u>Figure</u>		<u>Page</u>
3-1	Comparative Net Energy Generation Forecast for Combined Utilities and Industrial Load - Railbelt Area	3-18
3-2	Projected Range of Net Energy Generation Forecast for Combined Utilities and Industrial Load, Railbelt Area	3-19
3-3	Projected Range of Net Energy Generation Forecasts for Combined Utilities and Industrial Load, Anchorage-Cook Inlet Area and Fairbanks-Tanana Valley Area	3-20
3-4	Comparative Annual Peak Demand Forecasts for Combined Utilities and Industrial Load, Railbelt Area	3-21
3-5	Projected Range of Annual Peak Demand Forecasts for Combined Utilities and Industrial Load, Railbelt Area	3-22
3-6	Annual Peak Demand Forecasts for Combined Utilities and Industrial Load, Anchorage-Cook Inlet Area and Fairbanks-Tanana Valley Area	3-23
3-7	Peak Load Demand Forecast with Range Limits for Sensitivity Analysis, Anchorage-Cook Inlet and Fairbanks-Tanana Valley Area Loads	3-24
3-8	Peak Load Demand Forecast with Range Limits for Sensitivity Analysis, Railbelt Area Loads	3-25
4-1	Nenana-Fairbanks-Tanana Transmission System	4-12
4-2	Anchorage-Matanuska-Susitna-Glenallen-Valdez Transmssion System	4-13
4-3	Cook Inlet-Kenai Peninsula Transmission System	4-14
5-1	230 kV Tangent Tower	5-7
5-2	345 kV Tangent Tower	5-8

## FIGURES (Continued)

<u>Figure</u>		<u>Page</u>
6-1	Non-Coincident 1975 Peak Demands, Anchorage and Fairbanks Areas	6-26
6-2	Independent System Expansion Plans, Anchorage and Fairbanks Areas, Probable Load Forecast Case	6-27
6-3	Interconnected System Expansion Plan, Anchorage-Fairbanks Area without Susitna Project, Probable Load Forecast Case, Case IA and ID	6-28
6-4	Interconnected System Expansion Plan, Anchorage-Fairbanks Area with Firm Power Transfer, Probable Load Forecast Case, Case IB	6-29
6-5	Interconnected System Expansion Plan, Anchorage-Fairbanks Area with Upper Susitna Project, Probable Load Expansion Case, Case II	6-30
6-6	Independent System Expansion Plan, Anchorage- Fairbanks Area, Low Load Forecast Case	6-31
6-7	Interconnected System Expansion Plan, Anchorage-Fairbanks Area, Low Load Forecast Case, Case IA and ID	6-32
6-8	Interconnected System Expansion Plan, Anchorage-Fairbanks Area, Low Load Forecast Case with Firm Power Transfer, Case IB	6-33
6-9	Case I - Alternative A and B	6-34
6-10	Case I - Alternative C	6-35
6-11	Case I - Alternative D	6-36
6-12	Case II	6-37
7-1	Construction Plan for Upper Susitna Project	7-15

## FIGURES (Continued)

<u>Figure</u>		<u>Page</u>
B-1	Transmission Line Cost Analysis Program Methodology	B-4
D-1 and D-2	Nomogram Calculates Economy of Scale in Power Plants	D-45 and D-46
D-3	Estimates of Future National Gas Prices	D-47
D-4	Estimates of Future Coal Prices	D-48

# ABREVIATIONS

ac	alternating current	LNG	liquid nitrate gas
ACF	annual cost of fuel	LOLP	loss of load probability
ACSR	aluminium conductor, steel reinforced	MAREL	Multi-Area Reliability, a computer program developed by PTI
AIA	Alaskan Intertie Agreement	MBTU	Million British thermal unit
AML&P	Anchorage Municipal Light and Power Company	MEA	Matanuska Electrical Association, Inc.
APA	Alaska Power Authority	MVA	megavolt-amperes
A.R.R.	Alaska Railroad	MW	megawatts
AVF	average value factor	NESC	National Electrical Safety Committee
bpd	barrels per day	NOx	nitrous oxide
BTU	British thermal units	O&M	operations and maintenance
CEA	Chugach Electric Association, Inc.	ORV	off-road vehicle
CFC	Cooperative Finance Corporation	PCF	Plant capacity factor
dc	direct current	P.I.	point of intersection
DOE	U.S. Department of Energy	PRS	power requirements studies
EET	Edison Electric Institute	PTI	Power Technology, Inc.
FFB	Federal Finance Bank	REA	Rural Electrification Administration
FGD	flue gas desulphurization	RI	radio interference
FOH	forced outage hours	RWRA	Robert W. Retherford Associates, Inc.
FMUS	Fairbanks Municipal Utility System	S/C	single circuit
ft	feet	SCGT	simple cycle combustion turbine
gal	gallon	SIL	surge impedance loading
GVEA	Golden Valley Electric Association, Inc.	TLCAP	Transmission Line Cost Analysis Program, a computer program developed by IECO
GWh	gigawatt-hours (million kilowatt-hours)	TLEAP	Transmission Line Economic Analysis Program, a computer program developed by IECO
HEA	Homer Electric Association, Inc.	TLFAP	Transmission Line Financial Analysis Program, a computer program developed by IECO
HVDC	high voltage, direct current	tpy	tons per year
IAEAT	Interior Alaska Energy Analysis Team	TVI	television interference
IECO	International Engineering Company, Inc.	USA	United States of America
IEEE	Institute of Electrical and Electronics Engineers	USGS	United States Geological Survey
ISER	Institute for Social and Economic Research	VAR	volt-amperes reactive
kcmil	thousand circular mils		
kV	kilovolts		
kVa	kilovolt-amperes		
kW	kilowatts		
kWh	kilowatt-hours		

CHAPTER 1  
INTRODUCTION

## CHAPTER 1 INTRODUCTION

This report presents a determination of the economic feasibility for a transmission line interconnection between the utility systems of the Anchorage and Fairbanks areas. It includes an objective evaluation of the specific conditions under which the intertie is economically feasible. An interconnection between the two previously independent power systems will reduce total installed generation reserve capacity, provide means for the interchange of energy, reduce spinning reserve requirements, and provide the means for optimum economic dispatch of generating plants on the interconnected system basis. The later integration of the Upper Susitna Hydropower Project into the interconnected Anchorage-Fairbanks power system would serve to increase the benefits already available from early operation of the intertie. The work described in this report was performed under the authority of the 26 October 1978 contract between the Alaska Power Authority and the joint-venture of International Engineering Company, Inc. (IECO) and Robert W. Retherford Associates (RWRA).

Alternative system expansion plans were developed and analyzed during this study for each of the following areas:

- Independent Anchorage area
- Independent Fairbanks area
- Interconnected Anchorage-Fairbanks area  
(generation reserve sharing option)
- Interconnected Anchorage-Fairbanks area  
(generation reserve sharing and firm power transfer option)
- Interconnected Anchorage-Fairbanks area (with inclusion of  
the Upper Susitna Hydropower Project)

This study confirms the economic feasibility of the Anchorage-Fairbanks transmission line interconnection as well as the possibility of an early implementation date for the project, prior to longer-range development of the Upper Susitna Hydropower Project. This study also establishes additional intertie benefits from the supply of construction power to the sites of the Upper Susitna Hydropower Project. It also evaluated potential benefits from firm power supply to Matanuska Electric Association's system at the intermediate Palmer substation of the intertie. Preliminary financial and management plans for the implementation of the project were developed and are presented in the last two chapters of this report.

An Intertie Advisory Committee, composed of managers of Railbelt area utilities with the chairmanship of the Executive Director of the Alaska Power Authority, was formed. During the performance of this study three Intertie Advisory Committee meetings were held (4 December 1978, 8 January 1979, 14 February 1979, and 18 May 1979) to review factors related to the intertie and to discuss preliminary findings of this study. The following Railbelt utilities were represented on the Intertie Advisory Committee:

- Anchorage Municipal Light & Power (AML&P)
- Copper Valley Electric Association (CVEA)
- Chugach Electric Association (CEA)
- Fairbanks Municipal Utility System (FMUS)
- Golden Valley Electric Association (GVEA)
- Homer Electric Association (HEA)
- Matanuska Electric Association (MEA)

The Consultants wish to acknowledge the valuable information, comments, and support received from the managers and engineers of the Railbelt utilities, and the Alaska Power Administration during the performance of this economic feasibility study.

## CHAPTER 2

### SUMMARY AND CONCLUSIONS

## CHAPTER 2

### SUMMARY AND CONCLUSIONS

The purpose of this economic feasibility study is to determine the conditions under which a transmission interconnection between the utility systems of Anchorage and Fairbanks would be economically feasible. Following are the important aspects of work performed and the conclusions of this study.

#### 2.1 STUDY SUMMARY

##### A. Load Forecasts for Railbelt Area

Load forecast is the basis for system expansion planning. The most recent load forecasts for the utility service areas in the Railbelt area were examined to establish the basis for projection of future trends.

The sum of the most recent forecasts made by the individual utilities in the area has been selected as the upper growth limit to the forecast ranges for the Railbelt area. The median forecast prepared by the Alaska Power Administration, as a revision to the Susitna Project Market Study, was selected as the lower limit. The statistical average of these two forecasts was calculated and used in this study as the "probable" forecast.

The long-range "probable" load demand projections in MW for the load areas are:

	<u>Anchorage</u>	<u>Fairbanks</u>	<u>Combined Area</u>
1980	573	153	749
1985	977	231	1194
1990	1581	338	1896
1995	2402	477	2842
2000	3446	663	4054

## B. Selection of Intertie Route

Alternative transmission corridors considered in previous studies were analyzed as to accessibility, cost of right-of-way, transmission line design, and environmental and aesthetic considerations. The preferred corridor described in the Susitna Report, along the Parks Highway from Anchorage to Fairbanks, was selected for the intertie route. It was selected because of its favorable length, accessibility, and environmental considerations. This corridor was further defined by preparing preliminary layouts. Field trips to important sites along this 323-mile line route were made to confirm the suitability at this corridor for the intertie.

## C. Transmission Line Design

To provide a basis for intertie cost estimation, conceptual designs for 230-kV and 345-kV transmission lines and substations were made. The transmission Line Cost Analysis Program (TLCAP), a computer program developed by IECO, was used to select optimum designs. The results favored relatively long spans (1300 feet) and high-strength conductors. Tubular steel, guyed towers and pile-type foundations were selected for both the 230-kV and 345-kV lines as being well suited for Alaska conditions.

## D. System Expansion Plans

To determine the intertie's economic feasibility, alternative system expansion plans were prepared with and without the Anchorage-Fairbanks intertie. System expansion plans were developed to meet both the "probable" and "low" load demand projections.

To assume a nearly constant level of power generation reliability (LOLP Index) for all system expansion plans, a multi-area reliability (MAREL) computer study was performed. Annual load models for both areas were developed. The load models indicate that there is little diversity between the loads in the Anchorage and Fairbanks areas.

The 1984-1997 study period was selected to best suit system requirements. The earliest year when the intertie can be operational is 1984. Based on optimistic assumptions, the last generating unit of Upper Susitna Hydro-power Project will be on-line in January 1997.

#### E. Facility Cost Estimates

Cost estimates were developed for alternative system facilities to allow for economic comparisons. All costs were adjusted to January 1979 levels. Transmission line costs were calculated by using the TLCAP program. The same computer program calculated the line losses.

To provide a means for optimum economic dispatch of generating units on an interconnected system basis, costs for control and communication systems were included in the intertie cost estimates. Cost estimates for new generating plant facilities (gas-turbine units and coal-fired steam plants) were based on cost information in the Power Supply Study - 1978 report to GVEA, prepared by Stanley Consultants. Appropriate Alaskan construction cost location adjustment factors were applied to derive specific site cost estimates.

Construction power costs for the proposed Susitna Project were calculated. The results indicate a clear advantage for utilizing the intertie as a source of construction power.

#### F. Economic Feasibility Analysis

The economic feasibility analysis of the intertie was performed by discounting two cash flows (independent and interconnected systems) to a common year and then measuring the project benefits by the net present worth value. Facility costs for those new generating plants not affected by the introduction of the intertie were excluded from the analysis. The Transmission Line Economic Analysis Program (TLEAP), a computer program, was used to analyze the sensitivity of different escalation and discount rates on the capital costs of various alternatives. For principal investigations to establish definite feasibility analysis a 10% rate was used to discount cash flow in constant 1979 dollars.

#### G. Financial and Institutional Planning

A preliminary financial plan for implementation of the transmission intertie on a progressive basis was developed. The probable composition of institutions and participating utilities for ownership, management, and operating responsibilities is reviewed in this report, and present arrangements and possible future requirements are discussed.

### 2.2 CONCLUSIONS

The study shows that:

- The 230-kV single circuit intertie, having a 130-MW line loading capability (Case IA), is economically feasible in 1984, based only on benefits due to reduction of generation reserve plant capacity (reserve sharing). The net present-worth of the benefits are \$12,475,000. The benefits become marginal (\$945,000) if intertie costs are increased by 25 percent. In the case of "low" load forecast scenario the benefits are \$2,704,000.

- An increase in benefits is obtained if the 230-kV single circuit intertie (double circuit after 1992), in addition to generation reserve sharing, includes firm power transfer capability (Case IB). The benefits are \$24,054,000 or an increase of 93 percent over Case IA. Additional benefits due to supply of construction power to the Upper Susitna Project sites are \$5,579,000.
- The 345-kV single circuit intertie (Case IC) is not economically feasible in 1984 based on the two scenarios developed in this study: generation reserve sharing only and reserve sharing plus firm power transfer capability. In the second scenario the results are negative (\$-426,000). Further studies are recommended to pursue the economic feasibility of the 345-kV intertie because from technical point of view the 345-kV voltage is more appropriate for the transmission distance between Anchorage and Fairbanks.
- The 230-kV single circuit intertie with intermediate substations at Palmer and Healy (Case ID) is economically feasible in 1984. The benefits are \$20,344,000 including the power supplies to MEA system to Palmer and the proposed Upper Susitna Hydropower Project sites. If intertie costs are increased by 25 percent the benefits become \$11,656,000.
- The fully integrated interconnected system operation generates additional benefits which are not quantified in this study. These benefits could be due to:
  - Decrease in spinning reserve requirements by reducing the on-line plant capacity for the combined system.
  - Coordination of maintenance scheduling which would improve combined system security and provide cost savings.
  - Economies from optimum dispatch of generating units on the interconnected system basis. It is definitely recommended that a multi-area production costing simulation study be performed to establish these additional benefits.

- Expansion plans for the interconnected system with the proposed Upper Susitna Project were developed to determine the effect of this project on the interconnected system expansion plans, the displacement of thermal generating units, and intertie transmission requirements with Susitna Project.
- If an early 230-kV transmission intertie is constructed in 1984, due considerations should be given for constructing the Anchorage-Susitna portion of this intertie for 345-kV and operating it temporarily at 230-kV.
- The average value of energy transfer cost (1984-2015) thru the 230-kV intertie is 8 Mills/kWh at 55 percent load factor when financed by 40/60% REA/FFB loan package and municipal bonds issued by Anchorage and Fairbanks.
- This Intertie Feasibility Study is only a part of the overall power system expansion plans for the Railbelt area. Further studies will be required to establish definitive characteristics for this transmission intertie. These studies should be closely coordinated with the future expansion plans of all utilities in the Railbelt area.

CHAPTER 3  
LOAD FORECASTS FOR RAILBELT AREA

CHAPTER 3  
LOAD FORECASTS FOR RAILBELT AREA

3.1 ENERGY AND DEMAND FORECAST RANGE

The basis for establishing a range of future load projections for the Anchorage - Cook Inlet and Fairbanks - Tanana Valley areas, together with a combined forecast for an interconnected system service area in the Railbelt, was obtained from an examination of previous forecasts<sup>1/</sup> compared in the Battelle Report of March 1978 (Ref. 1). These were examined in relation to a combination of the most recent utility forecasts prepared for the REA and an August 1978 revision of previous forecasts for the Upper Susitna Project, issued by the Alaska Power Administration in December 1975 (Ref. 2).

A. Range of Energy Consumption Resulting from Battelle Study

The Battelle study provides a compendium of previous forecasts and an analysis of assumptions intrinsic to their projections. It attempts to eliminate low probability scenarios and select a range of utility and industrial loads for the intertied Railbelt system. The following summary of annual energy consumption, excluding national defense and non-interconnected users, represents the definitive results of the Battelle study:

	<u>1974</u>	<u>1980</u>	<u>1990</u>	<u>2000</u>
Annual Consumption-GWh				
Upper Range Limit	1,600	3,400	10,800	22,500
Interval Growth Rate	13.4%	15.3%	10.2%	
Lower Range Limit	1,600	2,600	8,500	16,000
Interval Growth Rate	8.4%	9.6%	4.0%	

<sup>1/</sup> See Section 3.3 for references used in this chapter.

Battelle selected this energy consumption range after carefully evaluating the methodology used in several previous forecasts and relevant assumptions pertaining to economic factors. Two load studies were deemed most appropriate to future load projections for the Railbelt. They are, in order of preference, the Upper Susitna Project Power Market Study by the Alaska Power Administration, and the report Electric Power in Alaska, 1976-1995 (Ref 3.) by the Institute for Social and Economic Research (ISER) of the University of Alaska.

1. Forecasts for Anchorage - Cook Inlet Area - From the several load forecasts corresponding to various growth scenarios of the ISER study, Battelle selected Forecasts 2 and 4 as most appropriate for the Anchorage and Cook Inlet area. These forecasts assume limited petroleum development, which was considered to be the most likely prospect. The assumptions underlying the scenario for limited petroleum development are:

- Petroleum Production will be 2 million bpd in 1980, and 3.6 million in 1990.
- A natural gas pipeline will be constructed from Prudhoe Bay through Canada.
- An LNG plant for natural gas from the Gulf of Alaska will be constructed.

The assumptions regarding electrical energy consumption are:

Sector	Case 2	Case 4
● Residential	Moderate Electrification	No Growth
● Commercial/Industrial	Growth as Usual	Minimum Electrification

The ISER study did not include new industrial consumption in forecasts, other than expansion of existing loads served by utilities. However, it did relate utility forecasts to economic scenarios, in which future energy consumption was quantitatively projected according to specified assumptions of petroleum development, population, aggregate income, saturation levels, and average usage per customer.

In 1975 the Alaska Power Administration prepared forecasts for the potential power market of the Upper Susitna Project. The forecasts contained projections of industrial load for existing and possible future installations. Battelle modified these projections to include the following assumptions:

- In addition to gradual expansion of existing refinery capacity, a new 150,000-bpd refinery will be built by 1983.
- An aluminum smelter with a capacity of 300,000 tpy will be constructed, to be on-line by 1985.
- A nuclear fuel enrichment plant, included in previous load projections, was deleted from future industrial load.
- Industrial development in the interior region was assumed to be excluded from the load area of an intertied Railbelt system.

A summary of industrial facilities included in the Battelle forecast for the Anchorage and Cook Inlet area is as follows:

<u>Existing Facilities</u>	<u>New Facilities</u>
Chemical Plant	Aluminum Smelter
LNG Plant	LNG Plant
Refinery	Refinery
Timber Mills	Timber Mills
	Coal Gasification Plant
	Mining and Mineral Processing Plants
	New City

2. Forecasts for Fairbanks - Tanana Valley Area - A similar evaluation by Battelle defined the most probable forecasts for the Fairbanks and Tanana Valley area. It assumed that industrial development in the interior region will consist largely of self-supplied mining operations in remote areas. Thus, load growth will be attributable only to utility customers in the service areas of the Fairbanks Municipal Utilities System (FMUS) and the Golden Valley Electric Association, Inc. (GVEA).

In the judgment of Battelle, the most likely consumption range for the Fairbanks area is bounded by the mid-range projections of the Upper Susitna Market Study, with mid-range forecasts prepared by the Interior Alaska Energy Analysis Team (IAEAT) (Ref. 4) as the upper bound and the ISER Case 4 as the lower bound.

3. Combined Forecasts for the Railbelt - The Battelle energy and demand forecast range for the combined utility and industrial load of the Railbelt, encompassing the Anchorage - Cook Inlet and Fairbanks - Tanana Valley areas, is shown graphically on Figures 3-1 and 3-4, respectively. These are intended to serve as background comparisons with combined utility forecasts and the revised projections of the Alaska Power Administration for the potential market of the Upper Susitna Project.

B. Forecasts by Utilities and the Alaska Power Administration

The most recent Power Requirements Studies (PRS) of the REA utilities (Ref. 5) in the Anchorage and Fairbanks areas were obtained, together with the most probable load forecasts, as projected for the Anchorage Municipal Light and Power Company (AML&P) and the Fairbanks Municipal Utilities System (FMUS).

Tables 3-1 and 3-2 provide tabulations of utility forecasts and extrapolated projections to the horizon year 2000, for the Anchorage - Cook Inlet area and the Fairbanks - Tanana Valley area, respectively. The Valdez - Copper Valley area is not included in the forecasts for the

Railbelt, as these load areas are assumed not to be interconnected with the intertied Railbelt system until after the completion of the Upper Susitna Project. As the PRS provided load projections for a base year and at two 5-year intervals, interpolations were made on the basis of assumed compound growth between reported values. On the further assumption that growth rates will decline progressively to the horizon year, extrapolations were made of net energy generation with growth rates declining from reported values at 5-year intervals to 2000. These growth rates were applied on the assumption that there will be no abrupt transition to low growth rates. Rather, growth will diminish in gradual steps as markets are saturated and the effects of conservation and price elasticity reflect in future energy consumption levels. Reported load factors were interpolated for intermediate years and the trend extrapolated to the horizon year to obtain projections of annual peak demand.

The utility forecasts were combined for the Anchorage - Cook Inlet area, the Fairbanks - Tanana Valley area, and the total Railbelt. Table 3-3 provides tabulations of net energy generation, load factor, and annual peak diversified demand. It is obtained by the application of coincidence factors to the sum of individual utility peak demands. These load forecasts are shown on Figures 3-1 through 3-6, in comparison with load projections prepared in August 1978 by the Alaska Power Administration for the Upper Susitna Project, as revisions to previous power market forecasts evaluated as part of the Battelle study. A summary of the Alaska Power Administration load forecasts is given in Table 3-4. These forecasts include only utility and industrial load projections on the assumption that national defense installations will not be supplied as part of the interconnected system load. Since the Battelle forecasts also excluded load forecasts for national defense installations, direct comparisons can be made. The range of Alaska Power Administration load forecasts for peak demand and annual energy was as follows:

		1980	1985	1990	1995	2000
% Differential from median:	High	+ 8	+ 21	+ 31	+ 41	+ 54
	Low	- 8	- 18	- 27	- 33	- 38

The range of load forecasts exhibited this diverging spread from the 1977 base-year load level. The industrial load projected by Battelle was included in the Alaska Power Administration forecast range on a selective basis. The differential between the "high" and "extra high" forecasts is an additional 280 MW of load, representing an aluminum smelter. The "low" forecast excludes the load projected for the New City.

### C. Comparison and Selection of Forecast Range

The forecasts of net energy generation for the Railbelt are shown on Figure 3-1. Curve 1 represents the combination of the most recent forecasts for municipal and REA utilities, as presented in Tables 3-1, 3-2, and 3-3. The forecast aligns closely up to 1990 with the upper bound of the Battelle forecast range. Beyond 1990 the divergence arises from the different assumptions made in regard to growth rates in the 1990-2000 period. The upper bound of the Battelle range exhibits an abrupt change of growth rate, from 15.3% to 10.2%, applied to total energy in the Railbelt, while the combined utilities forecast exhibits a more gradual transition to lower growth rates. Although many economic factors will contribute to lower overall growth rates in energy consumption, a reasonable approach to establishing an upper limit has been taken, in that individual utility forecasts were assumed to decline without abrupt change. This assumption is based on the fairly constant percentage expenditure from disposable income for energy needs, as determined by the study of future consumption patterns in Alaskan service areas (Ref. 6), the results of which are given in an extract from the RWRA report (Ref. 7) presented in Appendix A.

Accordingly, the combined utilities forecast has been selected as the upper limit to the possible range of total energy forecasts for the Railbelt. The median forecast prepared by the Alaska Power Administration, as a revision to the Susitna Project Market Study, has been selected as the lower limit to the forecast range for the Railbelt. This recently prepared forecast exhibits lower growth than the 1975

forecast for the Susitna Project, and represents a prudent choice for a conservative growth scenario.

Figures 3-2 and 3-3 show the relationship between the combined utilities forecast and the range of forecasts prepared by the Alaska Power Administration. The effect of the aluminum smelter load can be observed as the differential between curves 2C and 3C on Figure 3-2, and curves 2A and 3A on Figure 3-3. The median forecast also excludes the aluminum smelter load but provides for a reasonable realization of the industrial potential in the Anchorage area. In setting the lower limit of the forecast range in the context of the considerable industrial growth potential of this area of Alaska, it is thought that the selected forecast range will provide a good test of the economic feasibility of establishing an interconnection in the Railbelt.

A similar comparison of forecast demand can be made by reference to Figures 3-4, 3-5, and 3-6. The combined utilities demand forecast is below the upper bound of the Battelle range until after 1985 and aligns in fairly close proximity until 1990. Beyond 1990 divergence occurs based upon the assumption discussed previously in relation to energy growth. The median demand forecast for the Susitna Project, prepared by the Alaska Power Administration, exhibits a growth characteristic that roughly parallels the lower bound of the Battelle range between 1985 and 2000. As the low growth limit to the range of demand beyond 1981 selected for the interconnection study, it represents a moderately conservative view of overall growth potential.

Prior to 1981, the short-range combined utilities demand forecast is below the median forecast for the Susitna Project, approximately at Battelle mid-range. The demand forecasts for the Susitna Project may be observed in relation to the combined utilities demand forecasts of Figures 3-5 and 3-6. The selected range of demand forecasts represents a moderate to high expectation of a continued growth of the Railbelt economy through the end of the century, this being accentuated by the interconnection of utility systems in the area.

### 3.2 DEMAND FORECASTS FOR GENERATION PLANNING

The range exhibited by load forecasts for the Railbelt Area is considerable. Therefore, it remains to select definitive demand forecasts for generation expansion planning that are a reasonable representation of anticipated load growth under projected economic conditions.

#### A. Selection of Peak Load Demand Forecasts

The combined utilities forecast is appropriate to a high growth scenario that may not be possible under future economic constraints and prevailing trends towards greater conservation. The median forecast by the Alaska Power Administration does not include the entire industrial load potential that could be realized by a steady commitment towards economic growth in the State. It also specifically excludes the possibility of development of the aluminum smelter in the Anchorage area.

The selection of the statistical average forecasts, given in Table 3-5, for peak load demand is consistent with the moderate to high expectation of continued growth in the Railbelt economy. The natural resources of Alaska, particularly oil and gas, will largely determine the extent of future growth possible within the State. A steady pressure for additional domestic oil and gas supplies for the lower forty-eight will be engendered by the continuing energy crisis within the United States. The impact of additional exploitation of the North Slope on the State economy will be reflected in continued growth within the Railbelt. Thus, the conditions are present to ensure the realization of optimistic expectations for moderate to high growth of load demand.

#### B. Forecast Range for Sensitivity Analysis

In order to determine the effect of load growth on the economic feasibility of the Anchorage-Fairbanks Intertie, a suitable range of load growth must be established for sensitivity analysis.

The uncertainty associated with a load forecast increases with time, so the range of demand should also increase with time. The values given in Table 3-6 correspond to a range of load demand that steadily increases through time from a bandwidth of  $\pm 1\%$  in 1979 to  $\pm 21\%$  in 2000.

The long-range load projections for the Anchorage-Cook Inlet and Fairbanks-Tanana Valley areas are shown on Figure 3-7, with their corresponding range limits. The diversified demand for the combined areas of the Rail-belt is given on Figure 3-8, the peak load rising to approximately 4000 MW in the year 2000.

### 3.3 REFERENCES

1. Battelle Pacific Northwest Laboratories, Alaska Electric Power: An Analysis of Future Requirements and Supply Alternatives for the Railbelt Region, March 1978.
2. U.S. Department of the Interior, Alaska Power Administration, Upper Susitna River Hydroelectric Studies, Report on Markets for Project Power, December 1975.
3. University of Alaska, Institute for Social and Economic Research, Electric Power in Alaska, 1976-1995, August 1976.
4. Interior Alaska Energy Analysis Team, Report of Findings and Recommendations, June 1977.
5. Rural Electrification Association, Power Requirements Study for:  
Alaska 2 - Matanuska Electric Association, Inc., May 1978  
Alaska 5 - Kenai-Homer Electric Association, Inc., May 1978  
Alaska 6 - Golden Valley Electric Association, Inc., May 1976  
Alaska 8 - Chugach Electric Association, Inc., May 1976  
Alaska 18 - Copper Valley Electric Association, Inc., May 1977.
6. E. O. Bracken, Alaska Department of Commerce and Economic Development, Power Demand Estimators, Summary and Assumptions for the Alaska Situation, June 1977.
7. Robert W. Retherford Associates, System Planning Report, Matanuska Electric Association, Inc., January 1979.
8. U.S. Department of the Interior, Alaska Power Administration, A Report of the Technical Advisory Committee on Economic Analysis and Load Projections, 1974.
9. Federal Power Commission, The 1976 Alaska Power Survey, Vol. 1, 1976.
10. U.S. Army Corps of Engineers, South-central Railbelt Area, Alaska, Upper Susitna River Basin Interim Feasibility Report, December 1975.
11. U.S. Department of the Interior, Alaska Power Administration, Bradley Lake Project Power Market Analyses, August 1977.
12. Tippet and Gee, Consulting Engineers, 1976 Power System Study, Chugach Electric Association, Inc., Anchorage, Alaska, March 1976.

TABLE 3-1

ANCHORAGE - COOK INLET AREA  
UTILITY FORECASTS AND EXTRAPOLATED PROJECTIONS

Year	Anchorage Municipal Light and Power Company			Alaska 2 - Matanuska Electric Association, Inc.			Alaska 5 - Kenai						Alaska 8 - Chugach Electric Association, Inc.		
	Net Energy (GWh)	Load Factor (%)	Peak Demand (MW)	Net Energy (GWh)	Load Factor (%)	Peak Demand (MW)	Net Energy (GWh)	Load Factor (%)	Peak Demand (MW)	Net Energy (GWh)	Load Factor (%)	Peak Demand (MW)	Net Energy (GWh)	Load Factor (%)	Peak Demand (MW)
1979	633.6	58.1	124.4	280.4	47.5	67.4	275.2	55.0	57.1	34.4	56.0	7.0	1,108.9	53.0	238.8
1980	699.4	58.1	137.5	332.8	47.0	80.8	336.6	55.0	69.9	37.5	56.0	7.6	1,283.0	54.0	271.2
1981	770.6	57.9	151.8	395.1	46.5	97.0	411.6	55.0	85.4	40.8	56.0	8.3	1,467.8	54.0	310.3
1982	847.3	57.8	167.3	468.0	56.0	116.1	502.0	55.0	104.2	44.4	56.0	9.1	1,679.1	54.0	355.0
1983	929.6	57.7	183.9	559.3	45.0	141.9	572.3	55.0	118.8	48.1	56.0	9.8	1,920.9	54.0	406.1
1984	1,017.5	57.6	201.2	668.3	44.5	171.4	652.4	55.0	135.4	52.1	56.0	10.6	2,197.5	54.0	464.5
1985	1,110.8	57.4	220.8	798.6	44.0	207.2	743.7	55.0	154.4	56.4	56.0	11.5	2,509.0	54.0	530.4
1986	1,209.5	57.3	241.1	954.4	43.5	250.5	847.9	55.0	176.0	61.1	56.0	12.5	2,810.1	54.0	594.1
1987	1,313.2	57.1	262.5	1,140.0	43.0	302.6	967.0	55.0	201.0	66.3	56.0	13.5	3,147.3	54.0	665.3
1988	1,421.6	56.9	285.0	1,322.4	44.0	343.1	1,083.0	55.0	224.8	71.5	56.0	14.6	3,525.0	54.0	745.2
1989	1,534.2	56.8	308.5	1,534.0	45.0	389.1	1,213.0	55.0	251.8	77.0	56.0	15.7	3,948.0	54.0	834.6
1990	1,650.5	56.6	333.0	1,779.4	46.0	441.6	1,358.6	55.0	282.0	83.1	56.0	16.9	4,421.7	55.0	934.7
1991	1,769.8	56.4	358.2	2,064.1	47.0	501.3	1,521.6	55.0	315.8	89.5	56.0	18.2	4,863.9	55.0	1,028.2
1992	1,891.3	56.2	384.1	2,394.4	48.0	569.4	1,704.2	55.0	353.7	96.5	56.0	19.7	5,350.3	55.0	1,131.0
1993	2,014.4	56.0	410.5	2,705.7	49.0	630.3	1,874.6	55.0	389.1	103.5	56.0	21.1	5,885.3	55.0	1,244.1
1994	2,138.0	55.8	437.2	3,057.4	50.0	698.0	2,062.1	55.0	428.0	111.1	56.0	22.6	6,473.9	55.0	1,363.6
1995	2,244.9	55.6	460.9	3,454.9	51.0	773.3	2,268.3	55.0	470.8	119.2	56.0	24.3	7,121.2	55.0	1,505.4
1996	2,357.1	55.4	485.7	3,904.0	52.0	857.0	2,495.1	55.0	517.9	127.9	56.0	26.1	7,690.9	55.0	1,625.8
1997	2,475.0	55.2	511.8	4,411.5	53.0	950.2	2,744.6	55.0	559.7	137.3	56.0	28.0	8,306.2	55.0	1,755.9
1998	2,598.8	55.0	539.4	4,852.7	54.0	1,025.9	2,964.2	55.0	615.2	146.9	56.0	29.9	8,970.7	55.0	1,900.6
1999	2,728.7	54.8	568.4	5,337.9	55.0	1,107.9	3,201.3	55.0	664.4	157.2	56.0	32.0	9,688.3	55.0	2,048.1
2000	2,865.0	54.6	599.0	5,871.7	56.0	1,196.9	3,457.4	55.0	717.6	168.2	56.0	34.3	10,463.4	55.0	2,211.9

## Growth Rates:

Reported	Logistic Curve 3	18.7% (1977-1982)	22.3% (1977-1982)	8.8% (1977-1982)	15.7% (1977-1980)
		19.5% (1983-1987)	14.0% (1983-1987)	8.3% (1983-1987)	14.4% (1981-1985)
Projected	5.0% (1995-2000)	16.0% (1983-1992)	12.0% (1988-1992)	7.8% (1988-1992)	12.6% (1986-1990)
		13.0% (1993-1997)	10.0% (1993-1997)	7.3% (1993-1997)	10.0% (1991-1995)
		10.0% (1998-2000)	8.0% (1998-2000)	7.0% (1998-2000)	8.0% (1996-2000)

TABLE 3-2  
FAIRBANKS - TANANA VALLEY AREA  
UTILITY FORECASTS AND EXTRAPOLATED PROJECTIONS

Year	Fairbanks Municipal Utilities System			Alaska 6 - Golden Valley Electric Association, Inc.		
	Net Energy (GWh)	Load Factor (%)	Peak Demand (MW)	Net Energy (GWh)	Load Factor (%)	Peak Demand (MW)
1979	144.3	50.0	32.9	450.0	46.3	111.0
1980	153.0	50.0	34.9	501.8	46.6	122.9
1981	162.2	50.0	37.0	559.5	46.9	136.2
1982	171.9	50.0	39.2	624.6	47.2	150.9
1983	182.2	50.0	41.6	692.6	47.3	167.1
1984	193.2	50.0	44.1	768.8	47.3	185.5
1985	204.7	50.0	46.7	853.4	47.4	205.5
1986	217.0	50.0	49.5	947.3	47.4	228.1
1987	230.0	50.0	52.5	1,050.0	47.5	252.3
1988	243.9	50.0	55.7	1,155.0	47.5	277.6
1989	258.5	50.0	59.0	1,270.5	47.6	304.7
1990	274.0	50.0	62.6	1,397.6	47.6	335.2
1991	287.7	50.0	65.7	1,537.3	47.7	367.9
1992	302.1	50.0	69.0	1,691.0	47.7	404.7
1993	317.2	50.0	72.4	1,843.2	47.8	440.2
1994	333.0	50.0	76.0	2,009.1	47.8	479.8
1995	349.7	50.0	79.8	2,189.9	47.9	521.0
1996	367.2	50.0	83.8	2,387.0	47.9	568.9
1997	385.5	50.0	88.0	2,601.8	48.0	618.8
1998	404.8	50.0	92.4	2,809.9	48.0	668.3
1999	425.1	50.0	97.1	3,034.7	48.0	721.7
2000	446.3	50.0	101.9	3,277.5	48.0	779.5

Growth Rates:

Reported	6.0% (1978-1990)	11.5% (1977-1982)
		11.0% (1983-1987)
<hr/>		
Projected	5.0% (1991-2000)	10.0% (1988-1992)
		9.0% (1993-1997)
		8.0% (1998-2000)

TABLE 3-3

## COMBINED UTILITY FORECASTS FOR RAILBELT AREA

Year	Anchorage Cook - Inlet			Fairbanks - Tanana Valley			Combined Load Areas		
	Net Energy (GWh)	Load Factor (%)	Peak <sup>1/</sup> Demand (MW)	Net Energy (GWh)	Load Factor (%)	Peak <sup>2/</sup> Demand (MW)	Net Energy (GWh)	Load Factor (%)	Peak <sup>3/</sup> Demand (MW)
1979	2,332.5	56.1	475	594.3	47.6	142	2,926.8	55.3	605
1980	2,689.3	56.4	544	654.8	47.9	156	3,344.1	55.6	686
1981	3,085.9	56.2	627	721.7	48.0	171	3,807.6	55.6	782
1982	3,540.8	56.0	722	795.9	48.3	188	4,336.7	55.5	892
1983	4,030.2	55.7	826	874.8	48.3	207	4,905.0	55.3	1,012
1984	4,587.8	55.5	944	962.0	48.3	227	5,549.8	55.2	1,148
1985	5,218.5	55.2	1,079	1,058.1	48.4	250	6,276.6	55.0	1,302
1986	5,883.0	54.9	1,223	1,164.3	48.4	275	7,047.3	54.8	1,468
1987	6,633.8	54.6	1,387	1,280.0	48.4	302	7,913.8	54.6	1,655
1988	7,423.5	54.7	1,548	1,398.9	48.4	330	8,822.4	54.7	1,840
1989	8,306.2	54.9	1,728	1,529.0	48.5	360	9,835.2	54.9	2,046
1990	9,293.3	55.0	1,928	1,671.6	48.5	394	10,964.9	55.0	2,276
1991	10,308.9	55.2	2,133	1,825.0	48.5	429	12,133.9	55.2	2,511
1992	11,436.7	55.3	2,360	1,993.1	48.5	469	13,429.8	55.3	2,772
1993	12,583.5	55.5	2,587	2,160.4	48.6	507	14,743.9	55.5	3,032
1994	13,842.5	55.7	2,836	2,342.1	48.6	550	16,184.6	55.7	3,318
1995	15,208.5	55.9	3,105	2,539.6	48.6	596	17,748.1	55.9	3,627
1996	16,575.0	56.1	3,372	2,754.2	48.7	646	19,329.2	56.0	3,938
1997	18,074.6	56.3	3,663	2,987.3	48.7	700	21,061.9	56.2	4,276
1998	19,533.3	56.5	3,947	3,214.7	48.7	753	22,748.0	56.4	4,606
1999	21,113.4	56.8	4,244	3,459.8	48.7	811	24,573.2	56.6	4,954
2000	22,825.7	57.0	4,569	3,723.8	48.7	873	265,49.5	56.8	5,333

Diversified Demand  
for Coincidence Factor:

1/ 0.96

2/ 0.99

3/ 0.98

TABLE 3-4  
Sheet 1 of 2

LOAD FORECAST FOR UPPER SUSITNA PROJECT  
BY  
ALASKA POWER ADMINISTRATION

	<u>1977</u>	<u>1980</u>	<u>1985</u>	<u>1990</u>	<u>1995</u>	<u>2000</u>
<b>1. <u>ANCHORAGE-COOK INLET AREA POWER DEMAND AND ENERGY REQUIREMENTS</u></b>						
<b>(Excluding National Defense)</b>						
<u>Peak Demand (MW)</u>						
Utility Loads						
High		620	1,000	2,150	3,180	7,240
Median	424	570	810	1,500	2,045	3,370
Low		525	650	1,040	1,320	1,520
Industrial Loads						
Extra high		32	344	399	541	683
High		32	64	119	261	403
Median	25	32	64	119	199	278
Low		27	59	70	87	104
Total						
Extra high		652	1,344	1,914	2,691	3,863
High		652	1,064	1,634	2,411	3,583
Median	449	602	874	1,234	1,699	2,323
Low		552	709	890	1,127	1,424
<u>Annual Energy (GWh)</u>						
Utility Loads						
High		2,720	4,390	6,630	9,430	13,920
Median	1,790	2,500	3,530	4,880	6,570	8,960
Low		2,300	2,840	3,590	4,560	5,770
Industrial Loads						
Extra high		170	1,810	2,100	2,840	3,590
High		170	340	625	1,370	2,120
Median	70	170	340	630	1,050	1,460
Low		141	312	370	460	550
Total						
Extra high		2,890	6,200	8,730	12,270	17,510
High		2,890	4,730	7,255	10,800	16,040
Median	1,860	2,670	3,870	5,510	7,620	10,420
Low		2,441	3,152	3,960	5,020	6,320

TABLE 3-4  
Sheet 2 of 2

LOAD FORECAST FOR UPPER SUSITNA PROJECT  
BY  
ALASKA POWER ADMINISTRATION

	<u>1977</u>	<u>1980</u>	<u>1985</u>	<u>1990</u>	<u>1995</u>	<u>2000</u>
<b>2. FAIRBANKS-TANANA VALLEY AREA POWER DEMAND AND ENERGY REQUIREMENTS</b>						
(Excluding National Defense)						
<u>Peak Demand (MW)</u>						
Utility Loads						
High		158	244	358	495	685
Median	119	150	211	281	358	452
Low		142	180	219	258	297
<u>Annual Energy (GWh)</u>						
Utility Loads						
High		690	1,070	1,570	2,170	3,000
Median	483	655	925	1,230	1,570	1,980
Low		620	790	960	1,130	1,300
<b>3. COMBINED ANCHORAGE-COOK INLET AND FAIRBANKS-TANANA VALLEY AREAS</b>						
<u>Peak Demand (MW)</u>						
Extra high		810	1,588	2,272	3,186	4,548
High		810	1,308	1,992	2,906	4,268
Median	568	752	1,085	1,515	2,057	2,775
Low		694	889	1,109	1,385	1,721
<u>Annual Energy (GWh)</u>						
Extra high		3,580	7,270	10,300	14,440	20,510
High		3,580	5,800	8,825	12,970	19,040
Median	2,343	3,325	4,795	6,740	9,190	12,400
Low		3,061	3,942	4,920	6,150	7,620

TABLE 3 - 5

LOAD DEMAND FORECASTS FOR RAILBELT AREA  
TO  
DETERMINE STATISTICAL AVERAGE FORECAST

Year	Anchorage - Cook Inlet			Fairbanks - Tanana Valley			Combined Load Areas		
	Combined Utilities Forecast (MW)	Alaska Power Administration Median Forecast (MW)	Statistical Average Forecast (MW)	Combined Utilities Forecast (MW)	Alaska Power Administration Median Forecast (MW)	Statistical Average Forecast (MW)	Combined Utilities Forecast (MW)	Alaska Power Administration Median Forecast (MW)	Statistical Average Forecast (MW)
1979	475	546	511	142	139	141	605	685	645
1980	544	602	573	156	150	153	686	752	719
1981	627	648	638	171	161	166	782	809	796
1982	722	698	710	188	172	180	892	870	881
1983	826	752	789	207	184	196	1012	936	974
1984	944	810	877	227	197	212	1148	1007	1078
1985	1079	874	977	250	211	231	1302	1085	1194
1986	1223	937	1080	275	223	249	1468	1160	1314
1987	1387	1004	1196	302	237	270	1655	1241	1448
1988	1548	1077	1313	330	251	291	1840	1328	1584
1989	1728	1154	1441	360	265	313	2046	1419	1733
1990	1928	1234	1581	394	281	338	2276	1515	1896
1991	2133	1315	1724	429	295	362	2511	1610	2061
1992	2360	1402	1881	469	310	390	2772	1712	2242
1993	2587	1495	2041	507	325	416	3032	1820	2426
1994	2834	1593	2215	550	342	446	3318	1935	2627
1995	3105	1699	2402	596	358	477	3627	2057	2842
1996	3372	1809	2591	646	375	511	3938	2184	3061
1997	3663	1925	2794	700	393	547	4276	2318	3297
1998	3947	2049	2998	753	412	583	4606	2461	3534
1999	4244	2182	3213	811	432	622	4954	2614	3784
2000	4569	2323	3446	873	452	663	5333	2755	4054

TABLE 3-6  
PEAK LOAD DEMAND FORECASTS FOR RAILBELT AREA  
WITH  
RANGE LIMITS FOR SENSITIVITY ANALYSIS

Year	Anchorage - Cook Inlet			Fairbanks - Tanana Valley			Combined Load Areas		
	Lower Range Limit*	Peak Load Demand Forecast**	Upper Range Limit	Lower Range Limit*	Peak Load Demand Forecast**	Upper Range Limit	Lower Range Limit*	Peak Load Demand Forecast**	Upper Range Limit
	(MW)	(MW)	(MW)	(MW)	(MW)	(MW)	(MW)	(MW)	(MW)
1979	508	511	514	140	141	142	641	645	649
1980	570	573	576	151	153	155	744	749	754
1981	635	638	641	163	166	169	790	796	802
1982	702	710	718	175	180	185	874	881	888
1983	765	789	813	188	196	204	949	974	999
1984	832	877	922	202	212	222	1031	1078	1125
1985	908	977	1046	218	231	244	1121	1194	1267
1986	985	1080	1175	232	249	266	1212	1314	1416
1987	1068	1196	1324	248	270	292	1310	1448	1586
1988	1156	1313	1470	264	291	318	1413	1584	1755
1989	1250	1441	1632	281	313	345	1523	1733	1943
1990	1350	1581	1812	300	338	376	1642	1896	2150
1991	1451	1724	1997	317	362	407	1760	2061	2362
1992	1562	1881	2200	337	390	443	1888	2242	2596
1993	1677	2041	2405	355	416	477	2021	2426	2831
1994	1800	2215	2630	377	446	515	2167	2627	3087
1995	1933	2402	2871	398	477	556	2319	2842	3365
1996	2070	2591	3112	420	511	602	2476	3061	3646
1997	2215	2794	3373	444	547	650	2644	3297	3950
1998	2365	2998	3631	469	583	697	2820	3534	4248
1999	2526	3213	3900	495	622	749	3004	3784	4564
2000	2697	3446	4195	522	663	804	3203	4054	4905

\* Low load forecast case in this study.

\*\* Probable load forecast case in this study.

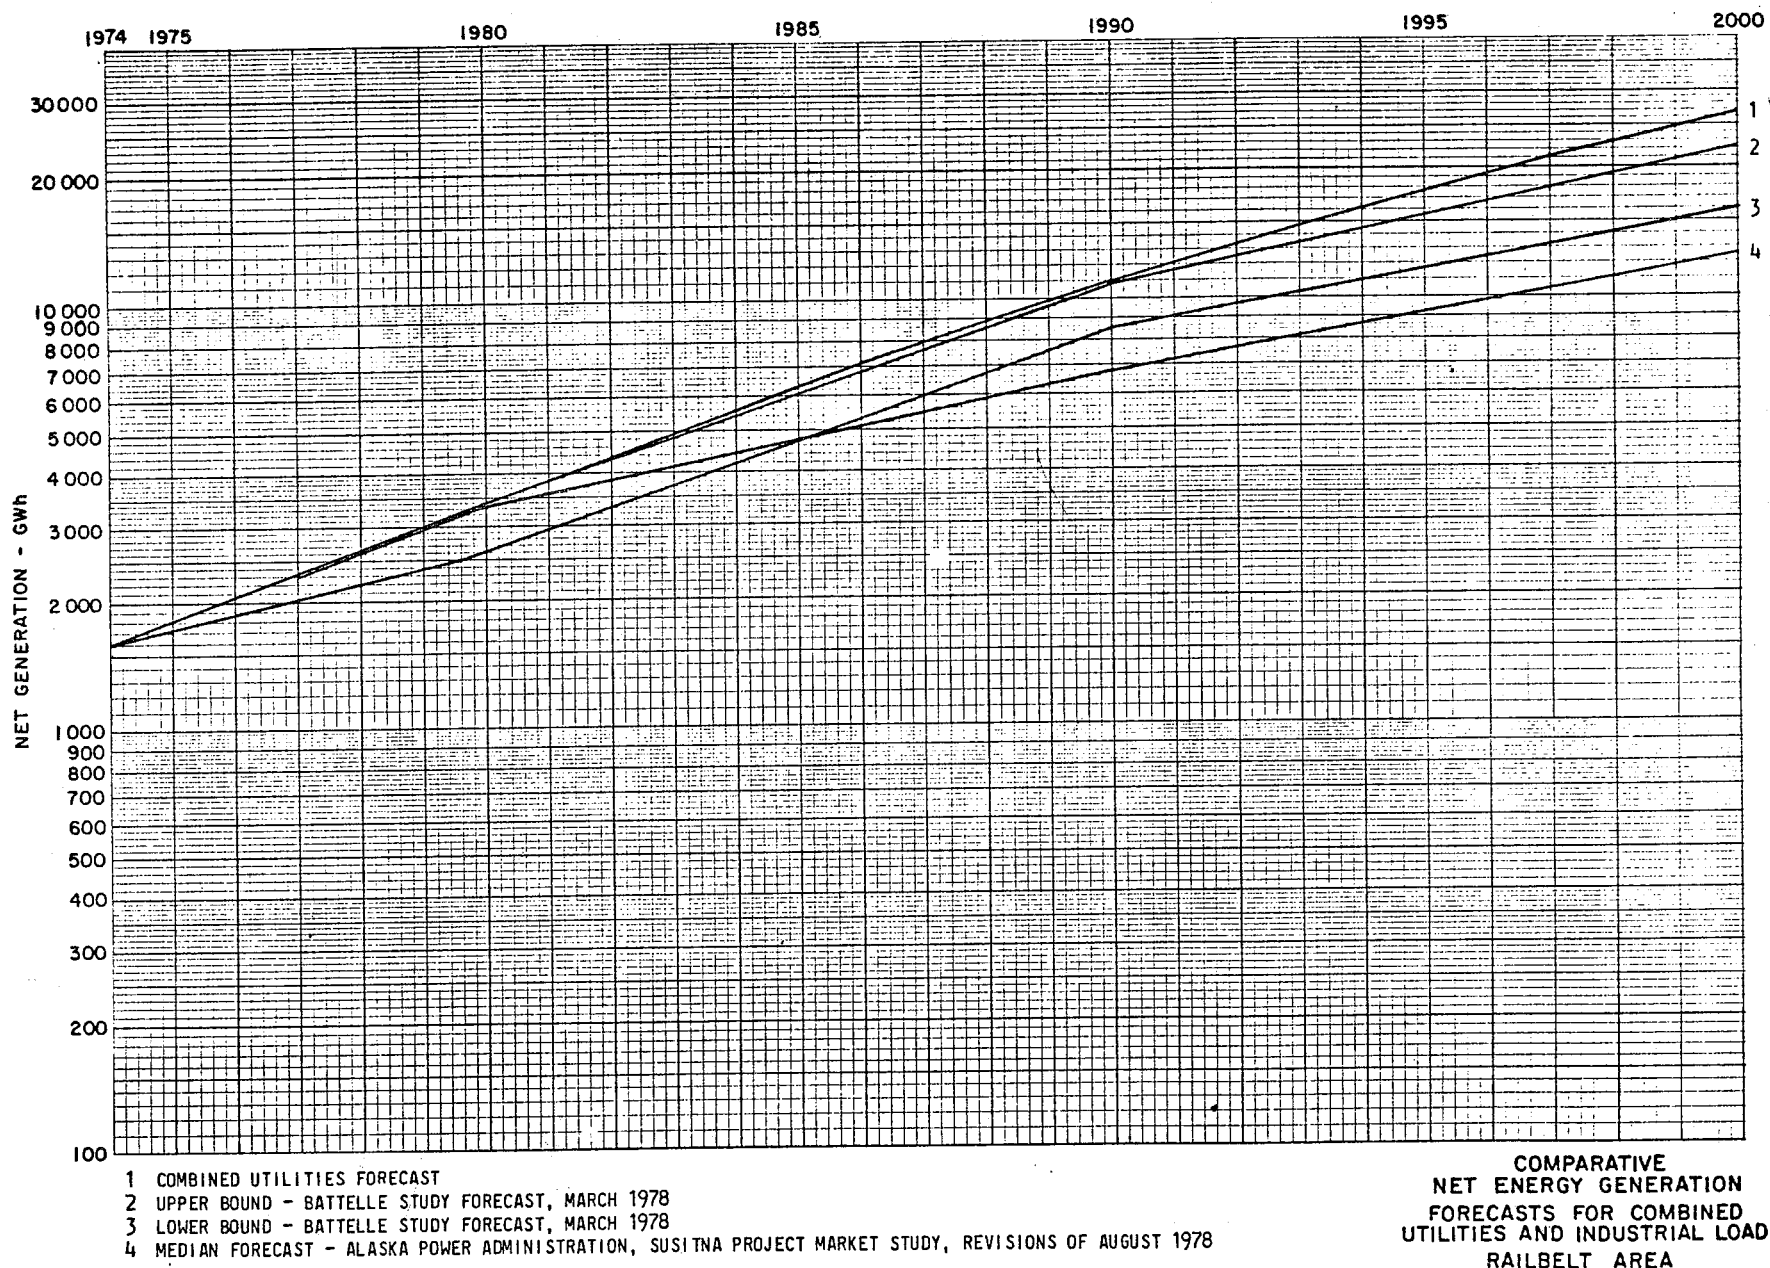


FIGURE 3-1

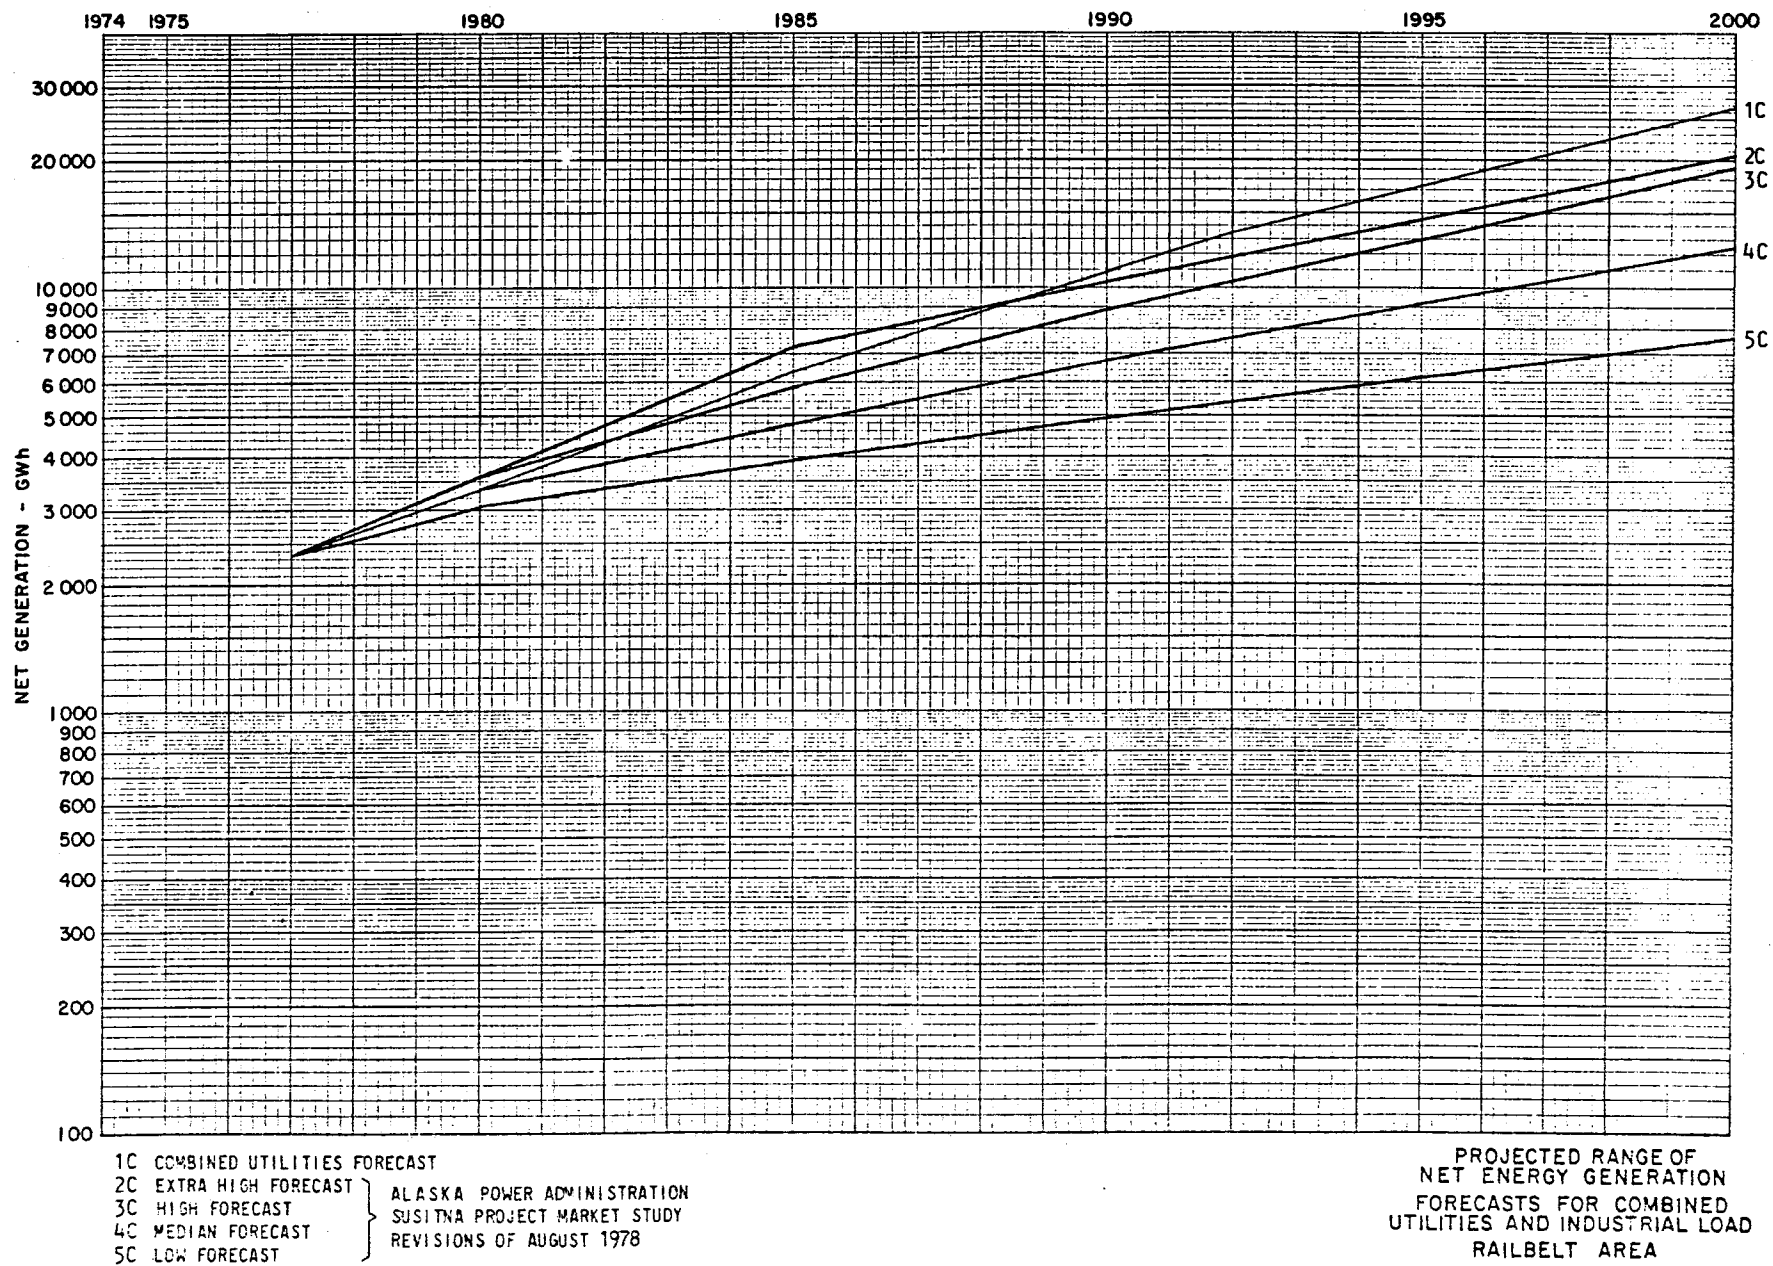


FIGURE 3-2

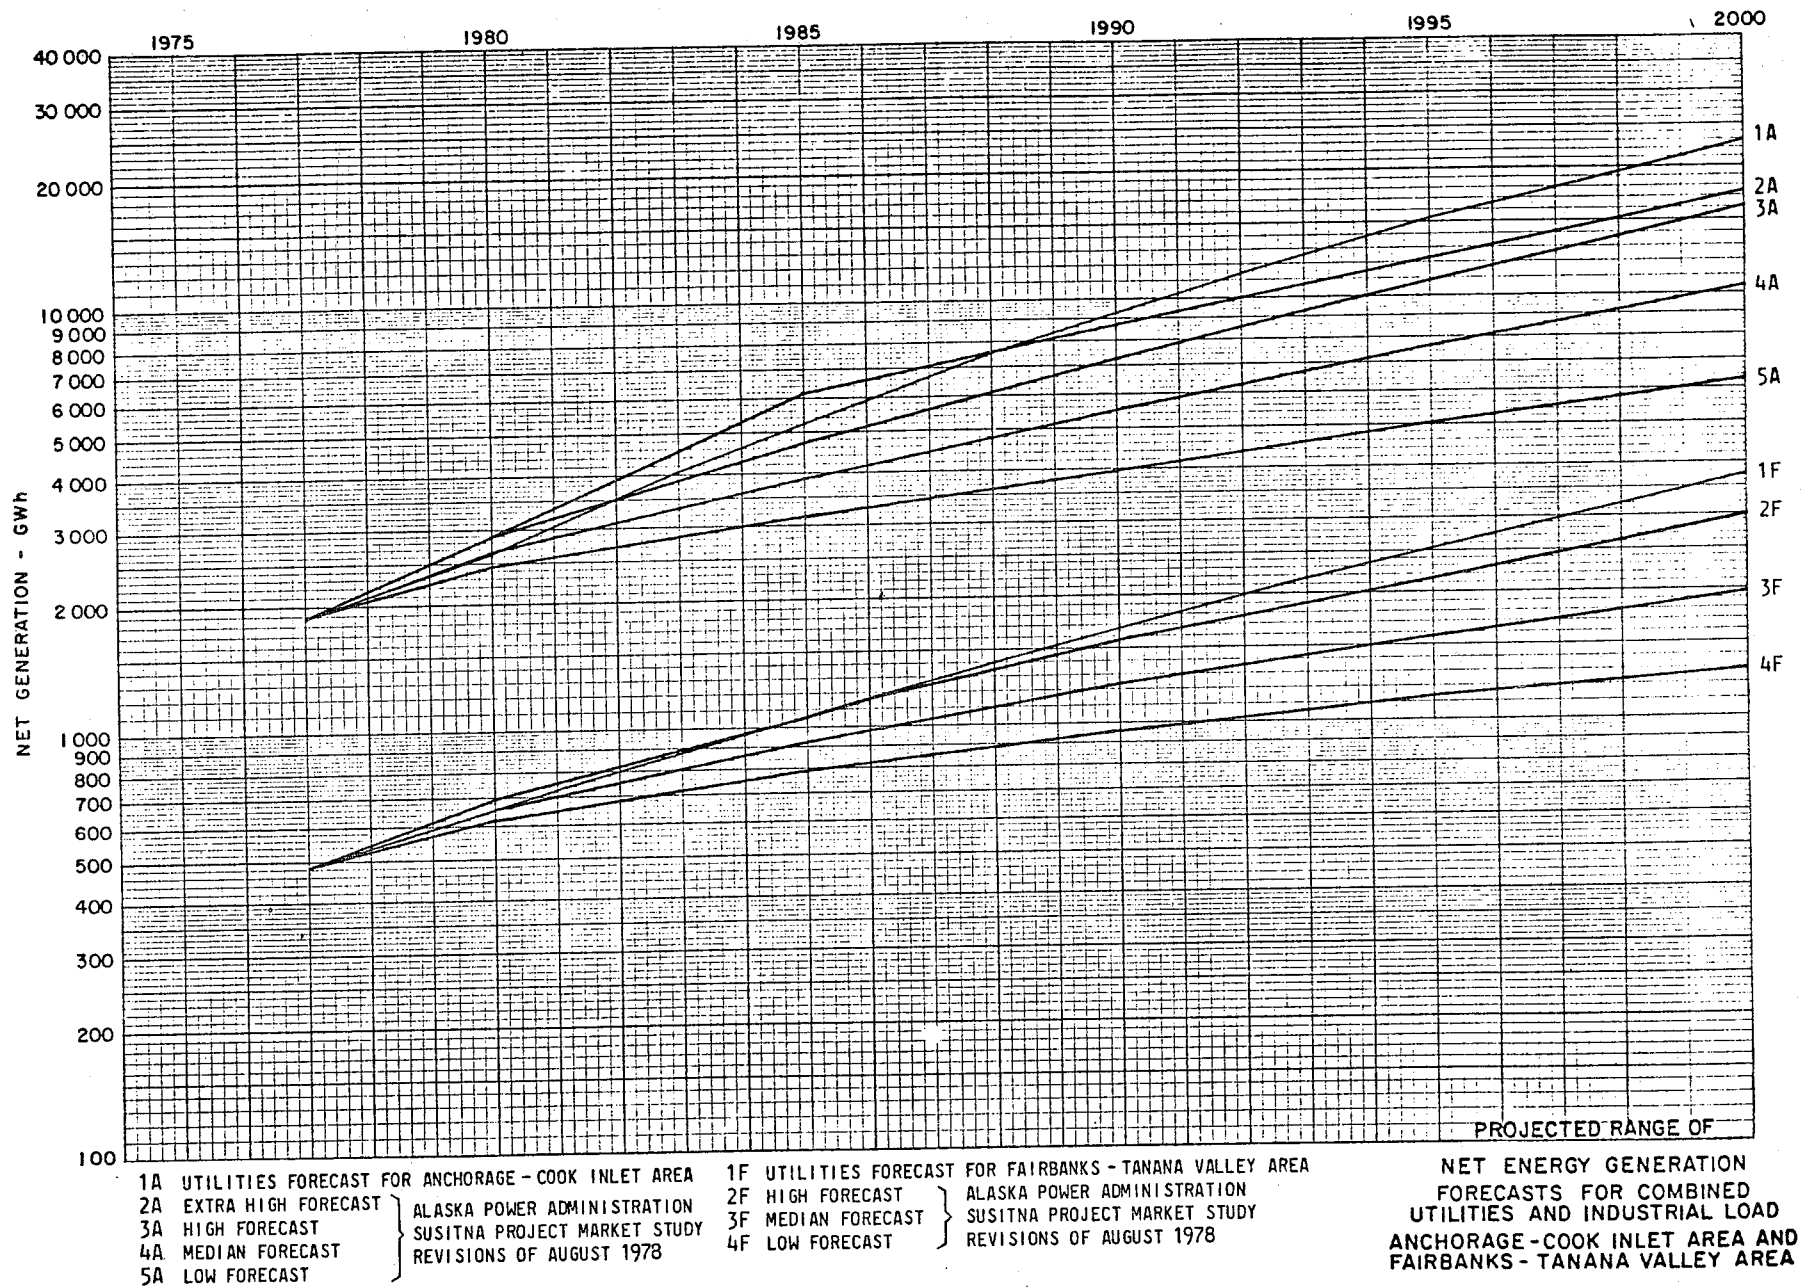


FIGURE 3-3

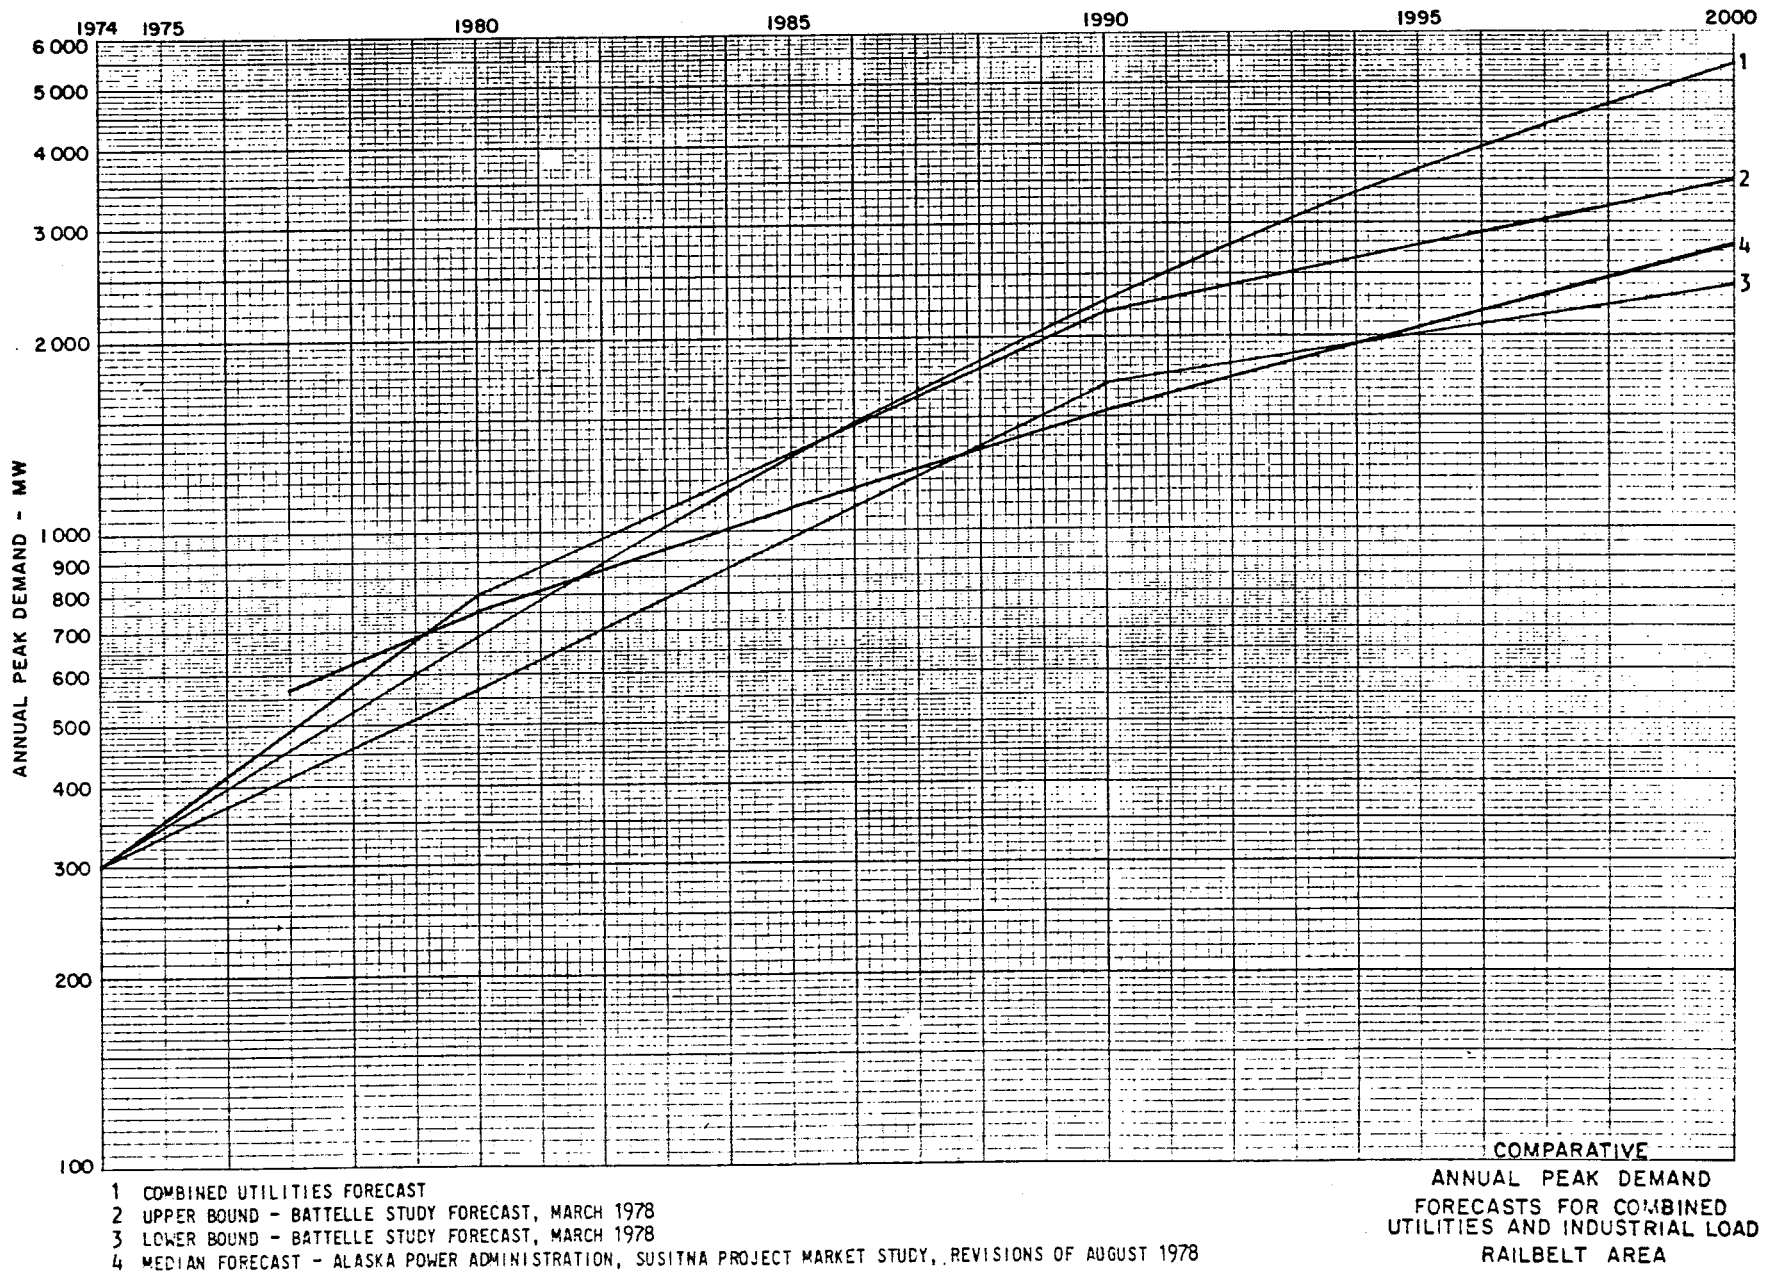


FIGURE 3-4


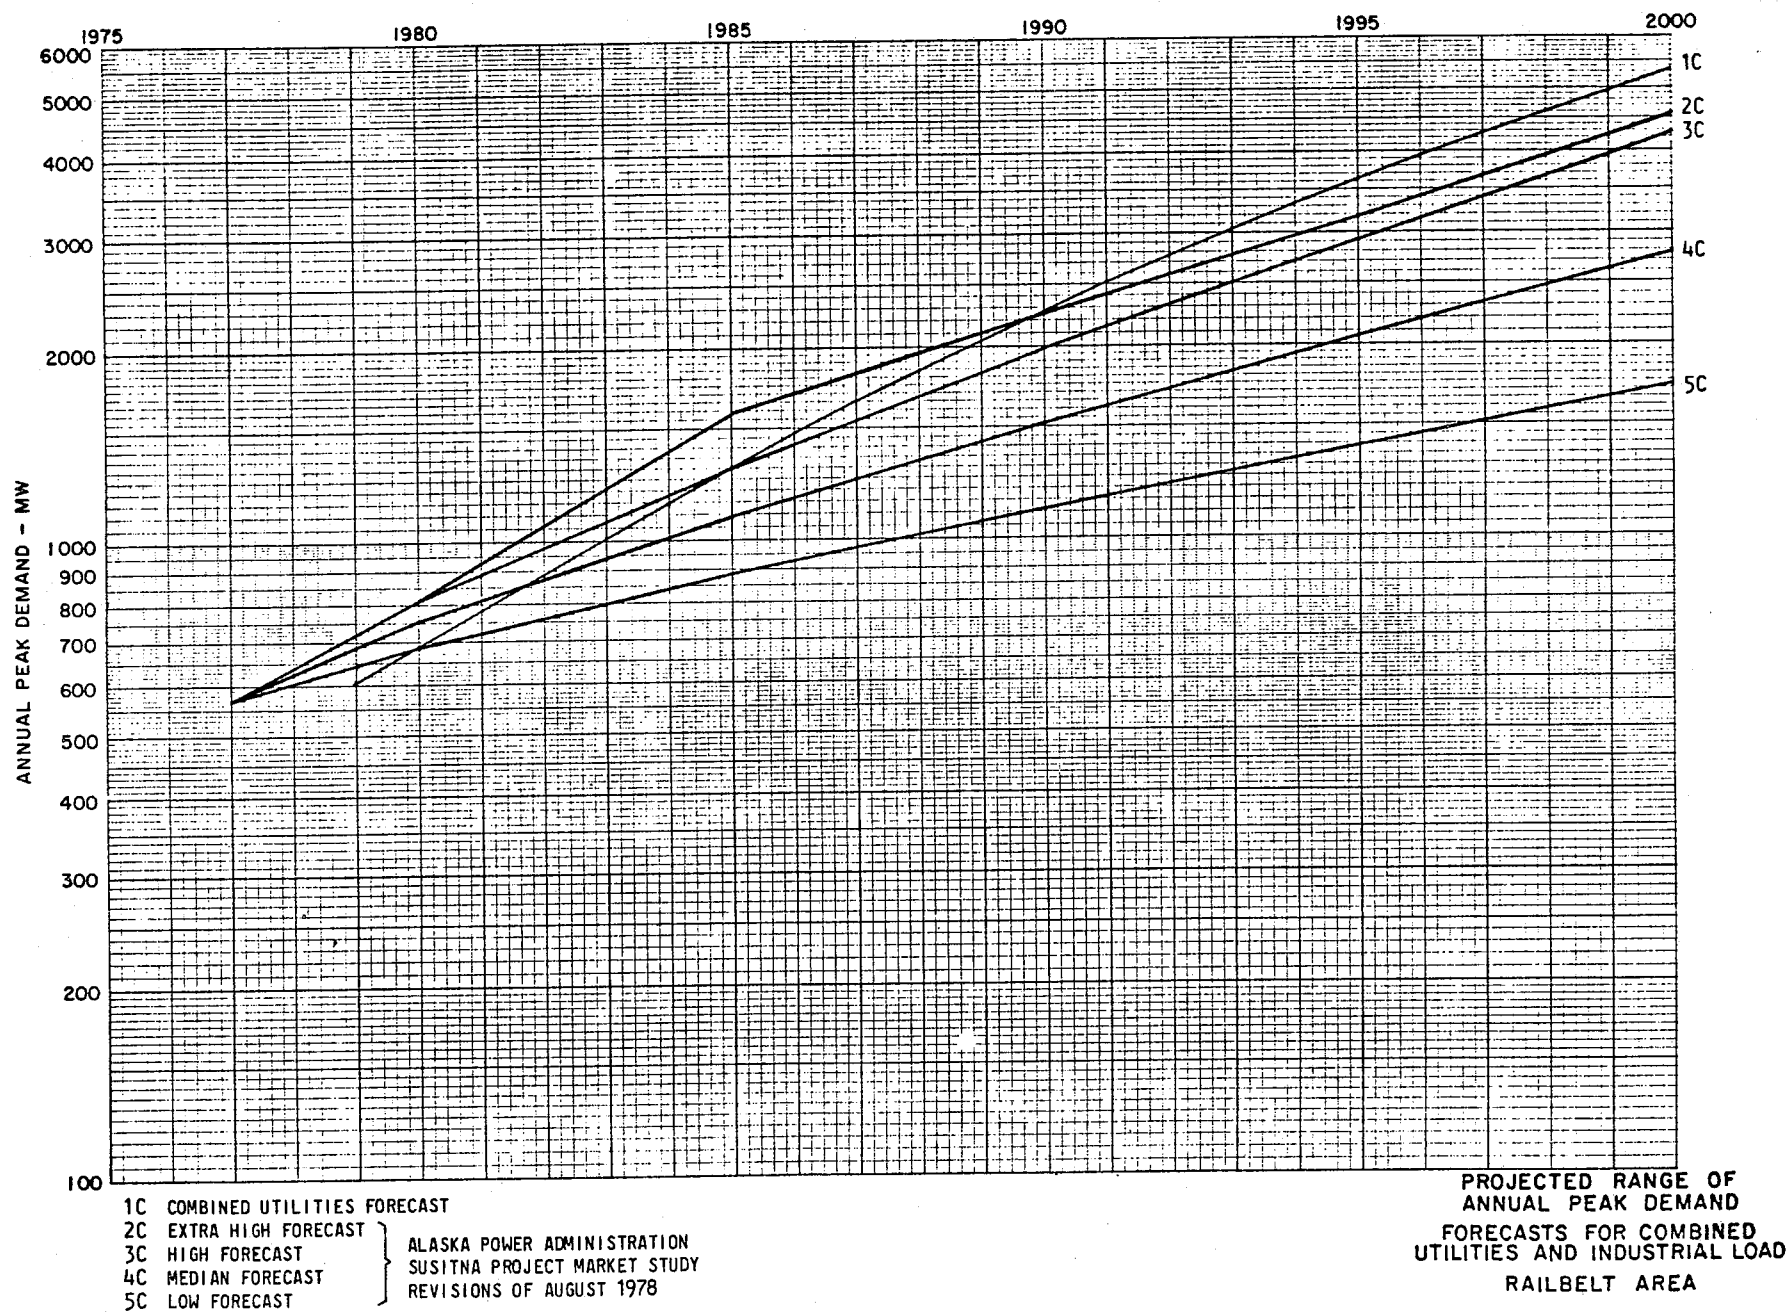


FIGURE 3-5

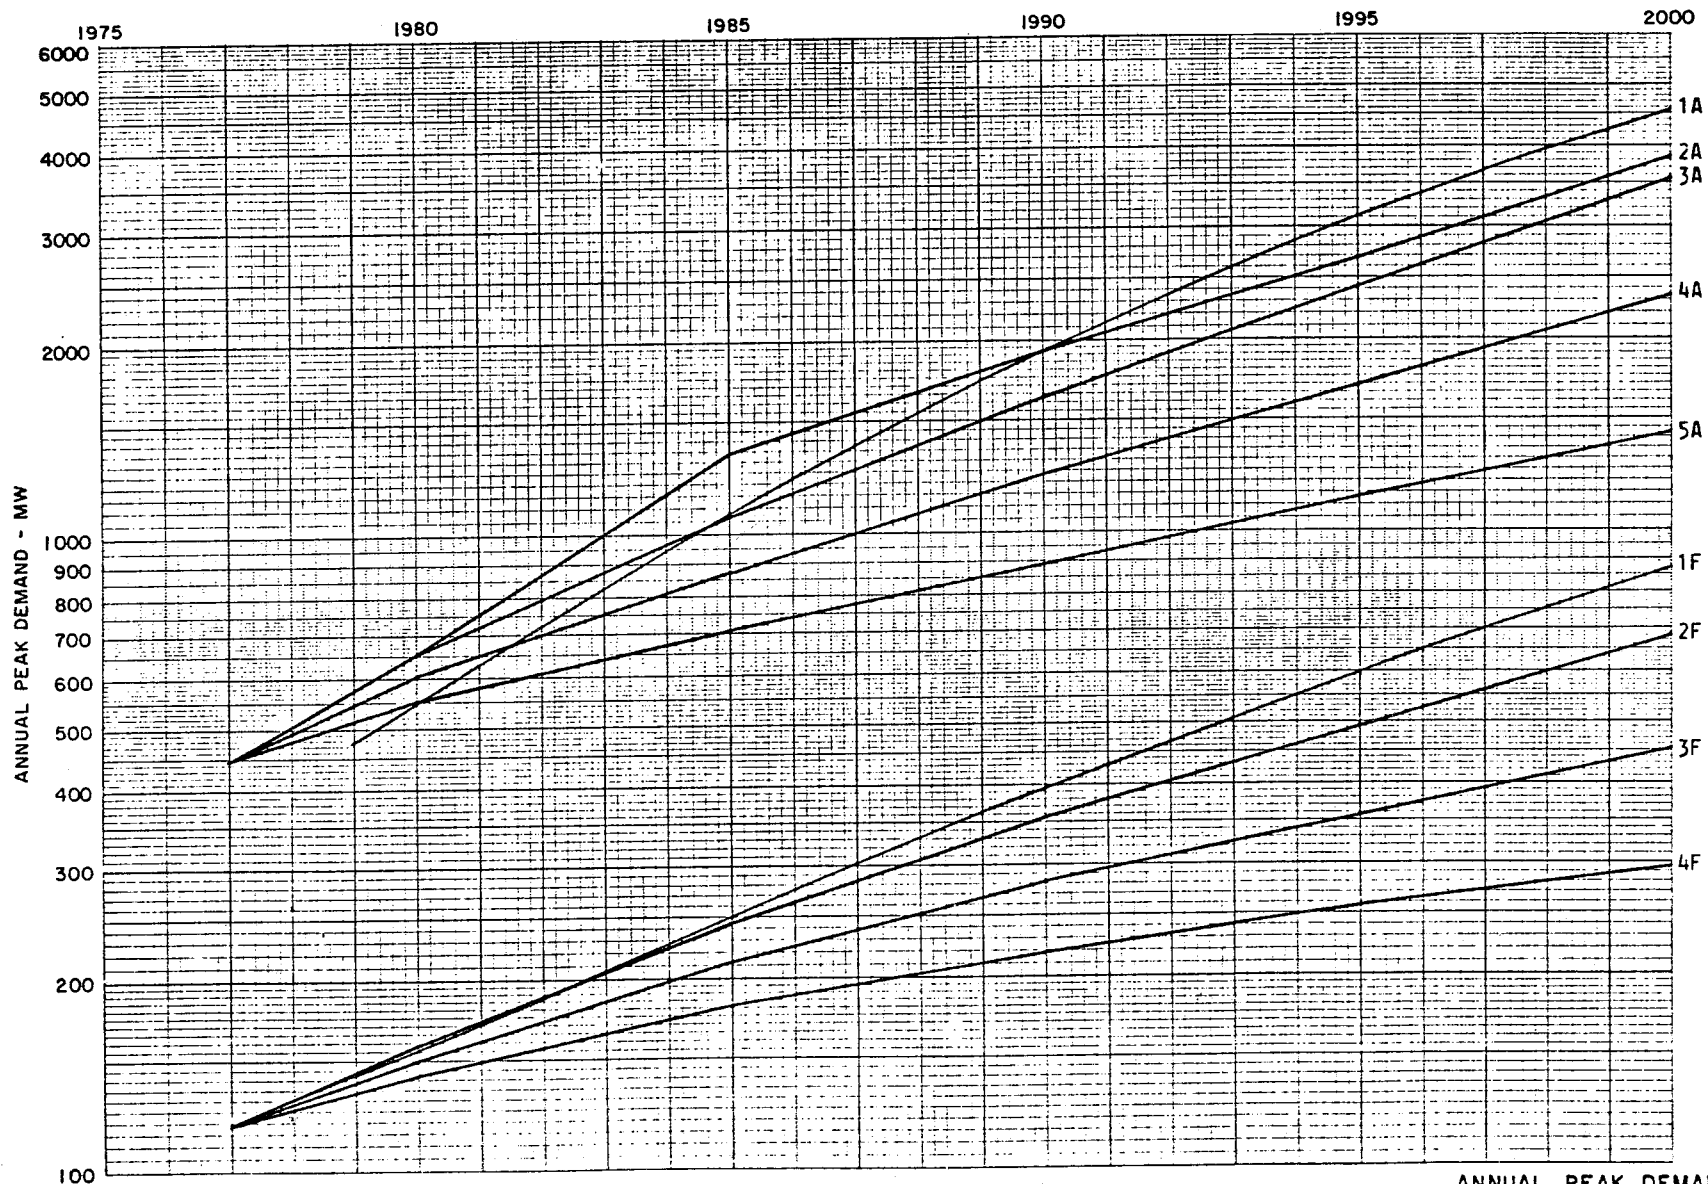


1A UTILITIES FORECAST FOR ANCHORAGE - COOK INLET AREA  
 2A EXTRA HIGH FORECAST } ALASKA POWER ADMINISTRATION  
 3A HIGH FORECAST } SUSITNA PROJECT MARKET STUDY  
 4A MEDIAN FORECAST } REVISIONS OF AUGUST 1978  
 5A LOW FORECAST

1F UTILITIES FORECAST FOR FAIRBANKS - TANANA VALLEY AREA  
 2A HIGH FORECAST } ALASKA POWER ADMINISTRATION  
 3F MEDIAN FORECAST } SUSITNA PROJECT MARKET STUDY  
 4F LOW FORECAST } REVISIONS OF AUGUST 1978

ANNUAL PEAK DEMAND  
 FORECASTS FOR COMBINED  
 UTILITIES AND INDUSTRIAL LOAD  
 ANCHORAGE-COOK INLET AREA AND  
 FAIRBANKS-TANANA VALLEY AREA

FIGURE 3-6

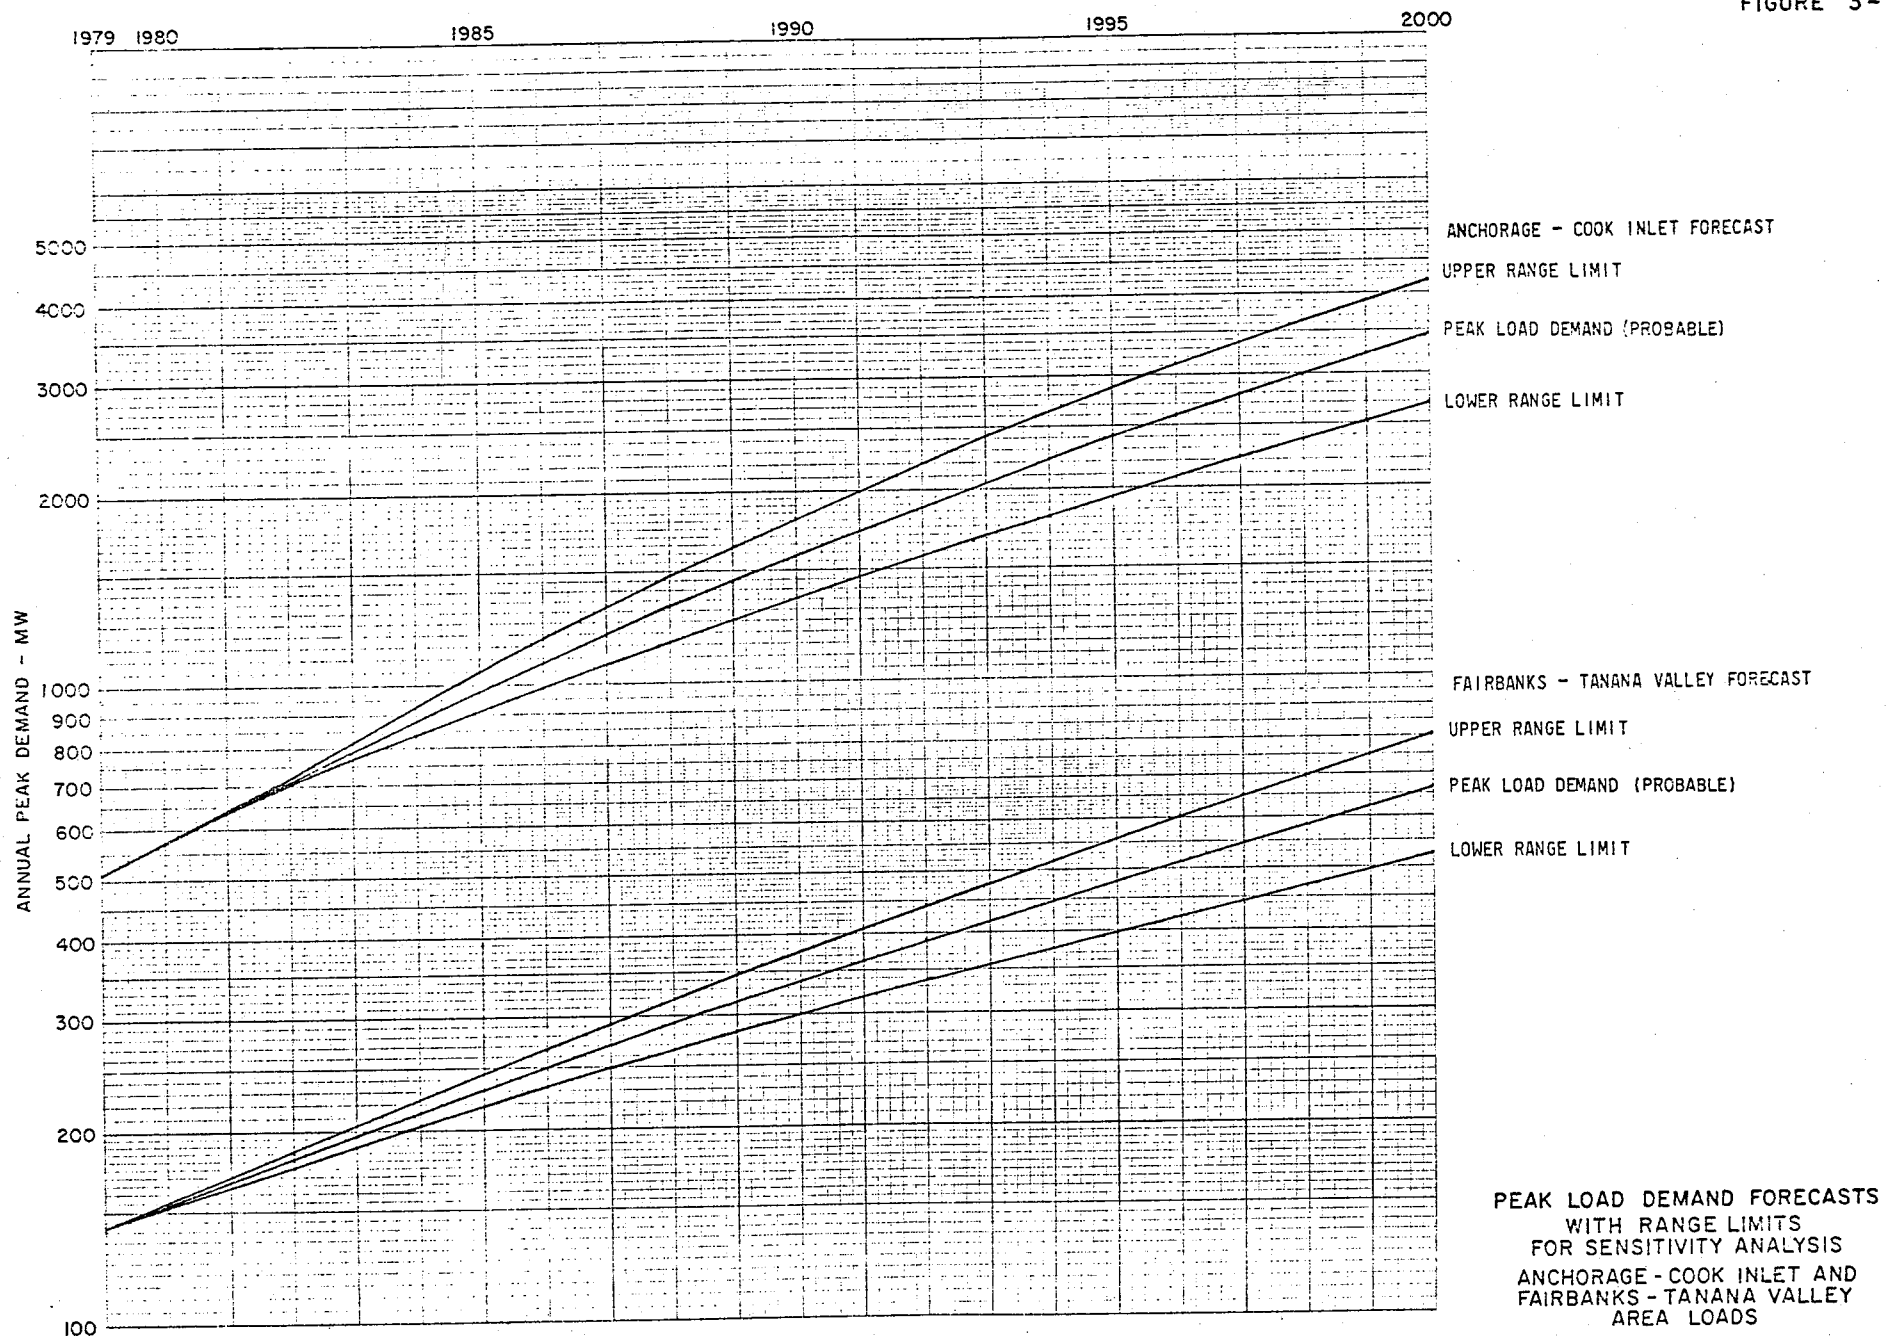

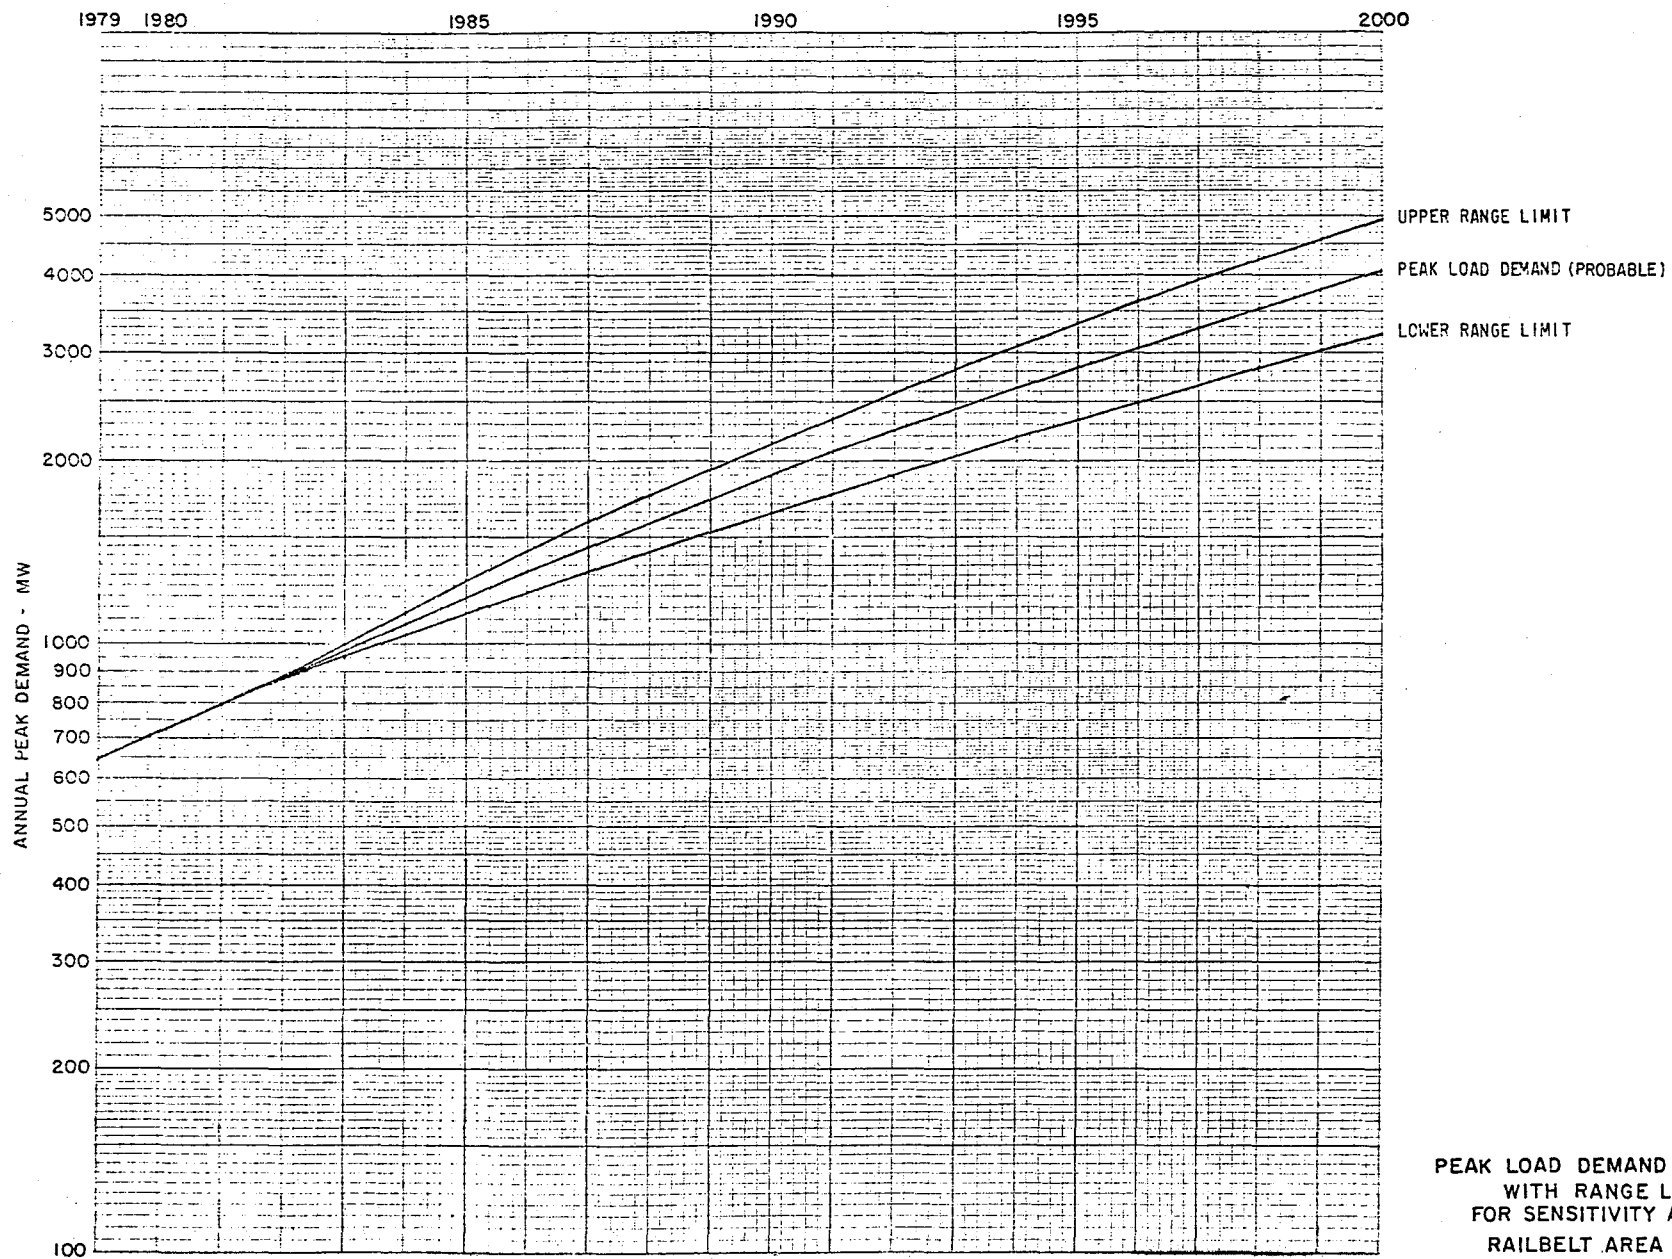


FIGURE 3 - 8

FIGURE 3-8

CHAPTER 4  
SELECTION OF INTERTIE ROUTE

## CHAPTER 4

### SELECTION OF INTERTIE ROUTE

#### 4.1 REVIEW OF EARLIER STUDIES

A number of studies have considered the electrical interconnection of the Fairbanks, South Central, and Anchorage areas (Refs. 1-8). The Susitna Hydroelectric Project Interim Feasibility Report (Ref. 2), hereafter called Susitna Report, reviewed a number of alternative transmission corridors in considerable depth. None of the studies included a specific route for a transmission line. The Susitna Report provides an excellent inventory of topography, geology, soils, vegetation, wildlife, climate, existing development, land ownership status, existing rights-of-way, and scenic quality and recreation values by corridor segments of about 5-mile widths.

#### 4.2 SURVEY OF ALTERNATIVE CORRIDORS

Alternative corridors reviewed for this report were those along or near the Railbelt region between the Anchorage and Fairbanks areas. A reconnaissance (by USGS Quad's and local knowledge) of routes connecting the Railbelt area to Glennallen was also made to provide a basis for estimating the cost of such a connection at a later date.

#### 4.3 PREFERRED ROUTE FOR TRANSMISSION INTERTIE

The preferred corridor described in the Susitna Report was further defined by making an actual preliminary layout of a definitive route (with some alternatives) using engineering techniques. This preliminary routing provides a basis for refining cost estimates, displaying a definitive location for use in studying potential environmental impacts, and providing a specific engineering recommendation for use in right-of-way negotiations.

The preliminary line routing is shown on the accompanying maps, Figures 4-1, 4-2, and 4-3, these being spatially related to the key map on the inside of the front cover of this report. These routes come from a working strip map of 1" = 1 mile (USGS Quad's.) on which these preliminary routes are drawn. The route was plotted by an engineer with nearly 30 years of experience with Alaskan transmission systems. It was also visually inspected throughout much of its length over the Parks Highway from Anchorage to Fairbanks.

The definitive line route was established within the preferred corridor, with due regard to the following restraints, insofar as they could be identified in this preliminary review:

- Avoidance of highway rights-of-way, which are better locations for distribution lines that will be required to serve homes and enterprises served by the highway.
- Avoidance of telephone lines, because of electrical interference problems. (An open-wire telephone circuit exists on the entire length of the Alaska Railroad right-of-way.)
- Avoidance of aircraft landing and takeoff corridors, including all lakes of sufficient size to accommodate small floatplanes. Where lines may cross landing patterns, at least 1/2 mile is allowed from the end of runways or lakes, so that special designs are not required.
- Avoidance of highly subdivided land areas and dwellings.
- Avoidance of crossings over developed agricultural lands.
- Selection of routings that provide for minimum visibility from highways and homes.

- Avoidance of heavily timbered lands.
- Selection of routes that provide for minimum changes in grade as the terrain will allow.
- Parallel alignments with property lines are favored, if not precluded by other considerations.
- Avoidance of sensitive wildlife areas, if practicable, and cooperation in regard to construction and operating restraints where lines pass through such areas.
- Alignments located in reasonable proximity to transportation corridors (roads, railroads, navigable waterways) so that construction, operation, and maintenance routines are not inordinately difficult.

#### 4.4 FIELD INVESTIGATIONS

Principal engineers of the IECO-RWRA team made field trips by helicopter and surface transportation to important sites and typical structures of existing transmission lines in both the Anchorage and Fairbanks areas. Particular attention was given to lines using designs developed especially for Alaskan conditions of muskeg swamp, permafrost, and flood plain. These designs have had more than ten years of successful service, and are the basis for more recent tubular steel structure designs now being installed on Alaska projects.

Actual field records of Resident Engineers and Inspectors on Alaska transmission line construction projects were analyzed along with contractor bids for these projects to provide authoritative basic data on the actual man-hours, materials use, and dollar costs of completed transmission lines.

#### 4.5 PRELIMINARY ENVIRONMENTAL ASSESSMENT

##### A. Description of the Environment

1. Point MacKenzie to Talkeetna - The corridor travels north along the east flank of the Susitna River Valley, an extremely wide and poorly drained plain. Heavy forests of bottomland spruce and poplar, interspersed with muskeg and black spruce, are typical. The soils vary from deep, very poorly drained peat to well-drained gravels and loams, with the well-drained soils being more abundant. Although permafrost is almost absent in this lower part of the Susitna Valley, the poorly drained areas are subject to freezing and heaving in the winter.

A sizeable concentration of moose inhabits the lower Susitna River Valley. This valley also supports black and brown bear and a moderate density of water fowl.

The proposed transmission line route generally follows a "tractor trail" (USGS designation) to three miles northeast of Middle Lake. Here, at the approach to the Nancy Lake area, an alternate route (A) may be used to avoid this area. The proposed route (B) is located in marshes and wetlands, between Papoose Twins and Finger Lakes, across the Little Susitna River. The corridor then travels northward along the east side of Lynx Lake, Rainbow Lake, and Long Lake where it crosses the Willow River. Here alternate routes (A) and (B) rejoin and intersect an existing 115-kV MEA transmission corridor at the Little Willow Junction and a proposed corridor to Anchorage on the east side of Knik Arm. Travelling north, the corridor crosses several major tributaries of the Susitna River including Sheep Creek and the Kashwitna River. In this area the terrain becomes more rolling, and the relative proportion of well-drained soils supporting thick poplar-spruce forests is considerably greater than to the south. The corridor then travels some five miles east of Talkeetna to the Bartlett Hills P.I. (point of intersection).

2. Talkeetna to Gold Creek - From Bartlett Hills P.I. the corridor crosses the Talkeetna River near the confluence of the Talkeetna and Chulitna Rivers, where it follows the west bank of the Chulitna River at a mean elevation of 600 feet. Where the Chulitna River curves eastward, the corridor travels northward, along the Susitna River Valley, through forested uplands, gradually rising to an elevation of 1000 feet. The uplands above the valley support sparser forests, and increasing amounts of permafrost soils are encountered. At the 1000-foot elevation, one to three miles east of the Susitna River, the corridor crosses Lane Creek, MacKenzie Creek, Portage Creek, Deadhorse Creek, and numerous other small tributaries of the Susitna River. It then crosses Gold Creek and the Susitna River, 1-1/2 miles east of A.R.R. Mile 265, to the Susitna Junction, one mile east of A.R.R. Mile 266. At the Susitna Junction, the proposed Devil Canyon-Watana-Glennallen line meets the corridor.

3. Gold Creek to Glennallen - The corridor parallels the Susitna River to the proposed Devil Canyon damsite and then travels east to the proposed Watana damsite. The vegetation in the canyons varies from upland spruce-hardwood to alpine tundra. Soils vary from poorly drained river bottoms to unstable talus. Permafrost occurs in this portion of the corridor. Some localized moose populations are crossed. The corridor passes through low lake areas west of Lake Louise until it intersects the Richardson Highway at Tazlina. From Tazlina the route follows the Richardson Highway into Glennallen.

4. Gold Creek to Cantwell - The transmission corridor travels north some 1 to 3 miles east of the Alaska Railroad between elevation 1500 and 2000 feet. The timber density becomes successively less in this area. This portion of the corridor is a good bear and moose habitat. Shallow permafrost occurs in this portion. The corridor crosses several major and minor tributaries to the Chulitna River including Honolulu Creek, Antimony Creek, Hardage Creek, the East Fork of the Chulitna River, and the Middle Fork of the Chulitna River. The corridor area is of medium scenic quality and is not readily accessible, except at the Denali Highway Crossing.

5. Cantwell to Healy - The corridor rises to the 3200 foot level along the west side of Reindeer Hills and then descends into the Nenana River Valley. It follows the east flank of the Nenana River northward at the 2200 foot level, through sparsely timbered country. This is an area of high scenic quality especially in the canyons. The terrain varies from rolling hills and valleys to high passes and sharp ridges. Habitats of moose, bear, and Dall sheep are traversed. Bedrock is exposed in the canyons. The corridor crosses several tributaries to the Nenana River including Slime Creek, Carlo Creek, Yanert Fork, and Montana Creek, and the Nenana River itself. It also crosses the Alaska Railroad at the Moody Tunnel, near A.R.R. Mile 354 and the Healy River. The boundary of Mt. McKinley National Park is on the west flank of the Nenana River.

6. Healy to Ester - The corridor leaves Healy and crosses the Parks Highway near Dry Creek. It then roughly parallels the west side of the highway at elevation 1500 feet, crossing several tributaries to the Nenana River. It crosses the GVEA line 1-1/2 miles north of Bear Creek, the Alaska Railroad and the Nenana River at A.R.R. Mile 383, and the Parks Highway. The route then parallels the GVEA line. The corridor crosses the Tanana River at the Tanana P.I. and follows the Tanana River flood plain for several miles until the route again crosses the highway where it travels on the west side of the Bonanza Creek Experimental Forest. The route parallels the GVEA right-of-way the rest of the way to Ester. The Healy to Ester portion of the route passes through some private lands (mining claims, homesteads, etc.), as well as near the towns of Healy, Lignite, and Nenana. An archeological site exists near Dry Creek. Portions of the corridor are heavily forested and provide habitat for moose, caribou, and bear. Poorly drained areas in this corridor are subject to potential permafrost degradation and frost heaving.

## B. Environmental Impacts

Construction and maintenance of other Alaskan transmission systems has shown that most negative environmental impacts caused by a transmission system can be minimized. Golden Valley Electric Association, Matanuska Electric Association, and Chugach Electric Association have constructed and are operating several lines on poor soils and under harsh climatic conditions. Except for anticipated slight visual impacts, most environmental impacts caused by a transmission system would be far less than those of many transportation and communication systems. Specific areas to be impacted are discussed below.

1. Ecosystems - The major positive impact will be on human environment, while adverse effects to the other ecosystems will be minimal. The route has been selected to avoid adverse impacts on these ecosystems wherever possible. The human environment will be benefited by the provision of energy, vital to the growing state of Alaska. The development of many potential renewable energy resources will be made feasible by the Anchorage-Fairbanks intertie. The project will contribute to the reduction in costs of electrical energy, improvement in reliability of electrical service, and enhancement of opportunities for renewable energy resources (such as hydro and wind) to displace non-renewable energy resources (such as gas and oil) for the generation of electricity.

Alteration of vegetation patterns will affect wildlife. This corridor traverses many areas of moose concentrations, and moose should benefit from the introduction of brush resulting from regrowth on the clearing. Since the clearing must be maintained, this brush area will last for the lifetime of the project. Animals such as squirrels will suffer loss and displacement. However, their faster reproductive rates will allow their populations to adjust rapidly.

Construction itself will affect wildlife. Larger mammals may temporarily leave the area to return after the construction activity. Smaller animals will suffer individual losses, but should recuperate rapidly once construction is completed. The density of forest in portions of the corridor will allow animals to move only a short distance to avoid contact with construction activities.

Vegetation suppression, by whatever method, will periodically remove cover from along the right-of-way. However, due to the surrounding cover of the uncleared forests, this impact will be insignificant.

2. Recreation - The corridor will approach several recreational and wayside areas in the lower Susitna Valley. The largest of these is the Nancy Lake Recreational Area. The corridor will also approach the Denali State Park, but will be separated from the Park by the Susitna River.

This corridor will provide access to areas previously difficult to reach. The largest such area is that south of Nancy Lake to Point MacKenzie. Dense forest and muskeg limit travel.

Further north the corridor parallels the east border of Mt. McKinley National Park, being separated by the Parks Highway, the Nenana River, and the Alaska Railroad.

3. Cultural Resources - The National Register of Historical and Archaeological Sites lists the following sites which will be approached by the transmission corridor: Knik Village, Dry Creek, and the Tangle Lake Archaeological District. The line will be routed to bypass these areas.

During construction and preconstruction surveys, other archaeological sites may be discovered which may be eligible for nomination to the National Register. This is a positive benefit of the corridor, as archaeological and other cultural resources are often difficult to find in the great Alaska wilderness.

4. Scenic Resources - The southern portion of the corridor does not traverse any areas of good or high quality scenic values. The northern portion is, however, more scenic than the southern portion. In the northern portion the fairly continuous, moderately dense forest will provide ample screening from transportation routes. Further south, the forests are more intermingled with open muskeg. Glimpses of the transmission line will be seen from the highway or railroad through these muskeg areas. South of Nancy Lake the transmission corridor and the transportation corridors diverge, and although cover becomes more sporadic, the line will no longer be visible from the transportation routes. The transmission line will not be visible from most of the Nancy Lake Recreation Area.

As the Alaska Railroad and the transmission corridor approach Gold Creek, the valley becomes more confined, and screening becomes more difficult. However, it appears that the line can be concealed through most of this portion.

The corridor passes through an area recognized as being of good to high scenic quality from Devil Canyon to Healy. The possibility of screening throughout this area varies from moderate in the southern portion around Chulitna, to minimal in the Broad Pass and the upper and lower canyons of the Nenana River. Scenic quality will be impacted, the impact being a function of existing scenic quality and the opportunity for screening. The proposed line design will incorporate weathering tubular steel towers which blend well into the environment. Non-specular conductors might be used where light reflection from the line would cause unacceptable adverse visual impact. Impact in the Nenana Canyon will be high; impact on Broad Pass will be moderate to high; impact elsewhere will be moderate. Two favorable factors mitigate the impact somewhat: 1) the corridor is not visually intact as the Alaska Railroad and the Anchorage-Fairbanks Highway have already reduced scenic quality somewhat; and 2) the major views south of the canyons are to the west, toward the Mt. McKinley massif, whereas the transmission line corridor lies to the east of the transportation routes.

5. Social - Some economic impact can be expected, as flying services, motels, restaurants, and entertainment facilities receive business, not only from the transmission line workers, but from related personnel. Due to the high cost of a low-load tap on a high voltage line, the likelihood of use of the energy by small communities along the corridor is remote. However, in places where the demand could justify such a tap, it would provide a reliable source of electrical energy for growing communities.

C. Special Impact Mitigation Efforts During Construction

Right-of-way clearing will be accomplished by approved methods such as the hydro axe, and chips will be spread along the right-of-way. The line will be screened wherever possible. The towers will be designed to blend into the environment, thereby reducing visual impact.

Movement of men and equipment during construction will be scheduled to avoid excessive damage to the ground cover. This is generally accomplished by winter construction. The tower design will allow movement of men and equipment along the right-of-way centerline, thereby eliminating the need for an access road in addition to the transmission line clearing.

Major river crossings will be required over the Talkeetna River, Tanana River, Healy Creek, and the Susitna River. Minor stream crossings may be made either by fording or ice crossings. Special efforts will be made to avoid siltation of fish streams. Oil will be carefully handled to avoid spillage. Where larger quantities of oil are to be stockpiled, dikes will be constructed to protect against spills.

Since most of the construction will occur far from communities, noise is not anticipated to be a problem. Suitable muffling devices will be used to protect men and wildlife from excessive noise.

Prior to and during construction, special efforts will be made to consult with State historical and archaeological authorities, the Soil Conservation Service, the Bureau of Land Management, the Alaska Department of Fish and Game, and the U.S. Forest and Wildlife Service, and any other agencies having jurisdiction over the construction area, in an effort to ensure sound environmental practices.

#### 4.6 REFERENCES

1. Robert W. Retherford Associates, North Slope Natural Gas Transport Systems and Their Potential Impact on Electric Power Supply and Uses in Alaska, March 1977.
2. U.S. Army Corps of Engineers, Southcentral Railbelt Area, Alaska, Upper Susitna River Basin Interim Feasibility Report, (Appendix I, Part II (G) Marketability Analysis, (H) Transmission System, (I) Environmental Assessment for Transmission Systems, December 1975.
3. Kozak, Edwin, under the direction of J. R. Eaton, Performance Characteristics of a 350-Mile Electric Power Transmission Line (Fairbanks to Anchorage), A project in EE 494, Department of Electrical Engineering, University of Alaska, June 1973.
4. Ch2M-Hill, Electric Generation and Transmission Intertie System for Interior and Southcentral Alaska, 1972.
5. Federal Power Commission, Alaska Power Survey, 1969.
6. Alaska Power Administration, Alaska Railbelt Transmission System, working paper, December 1967.
7. The Ralph M. Parsons Company, Central Alaska Power Study, undated.
8. The Ralph M. Parsons Company, Alaska Power Feasibility Study, 1962.


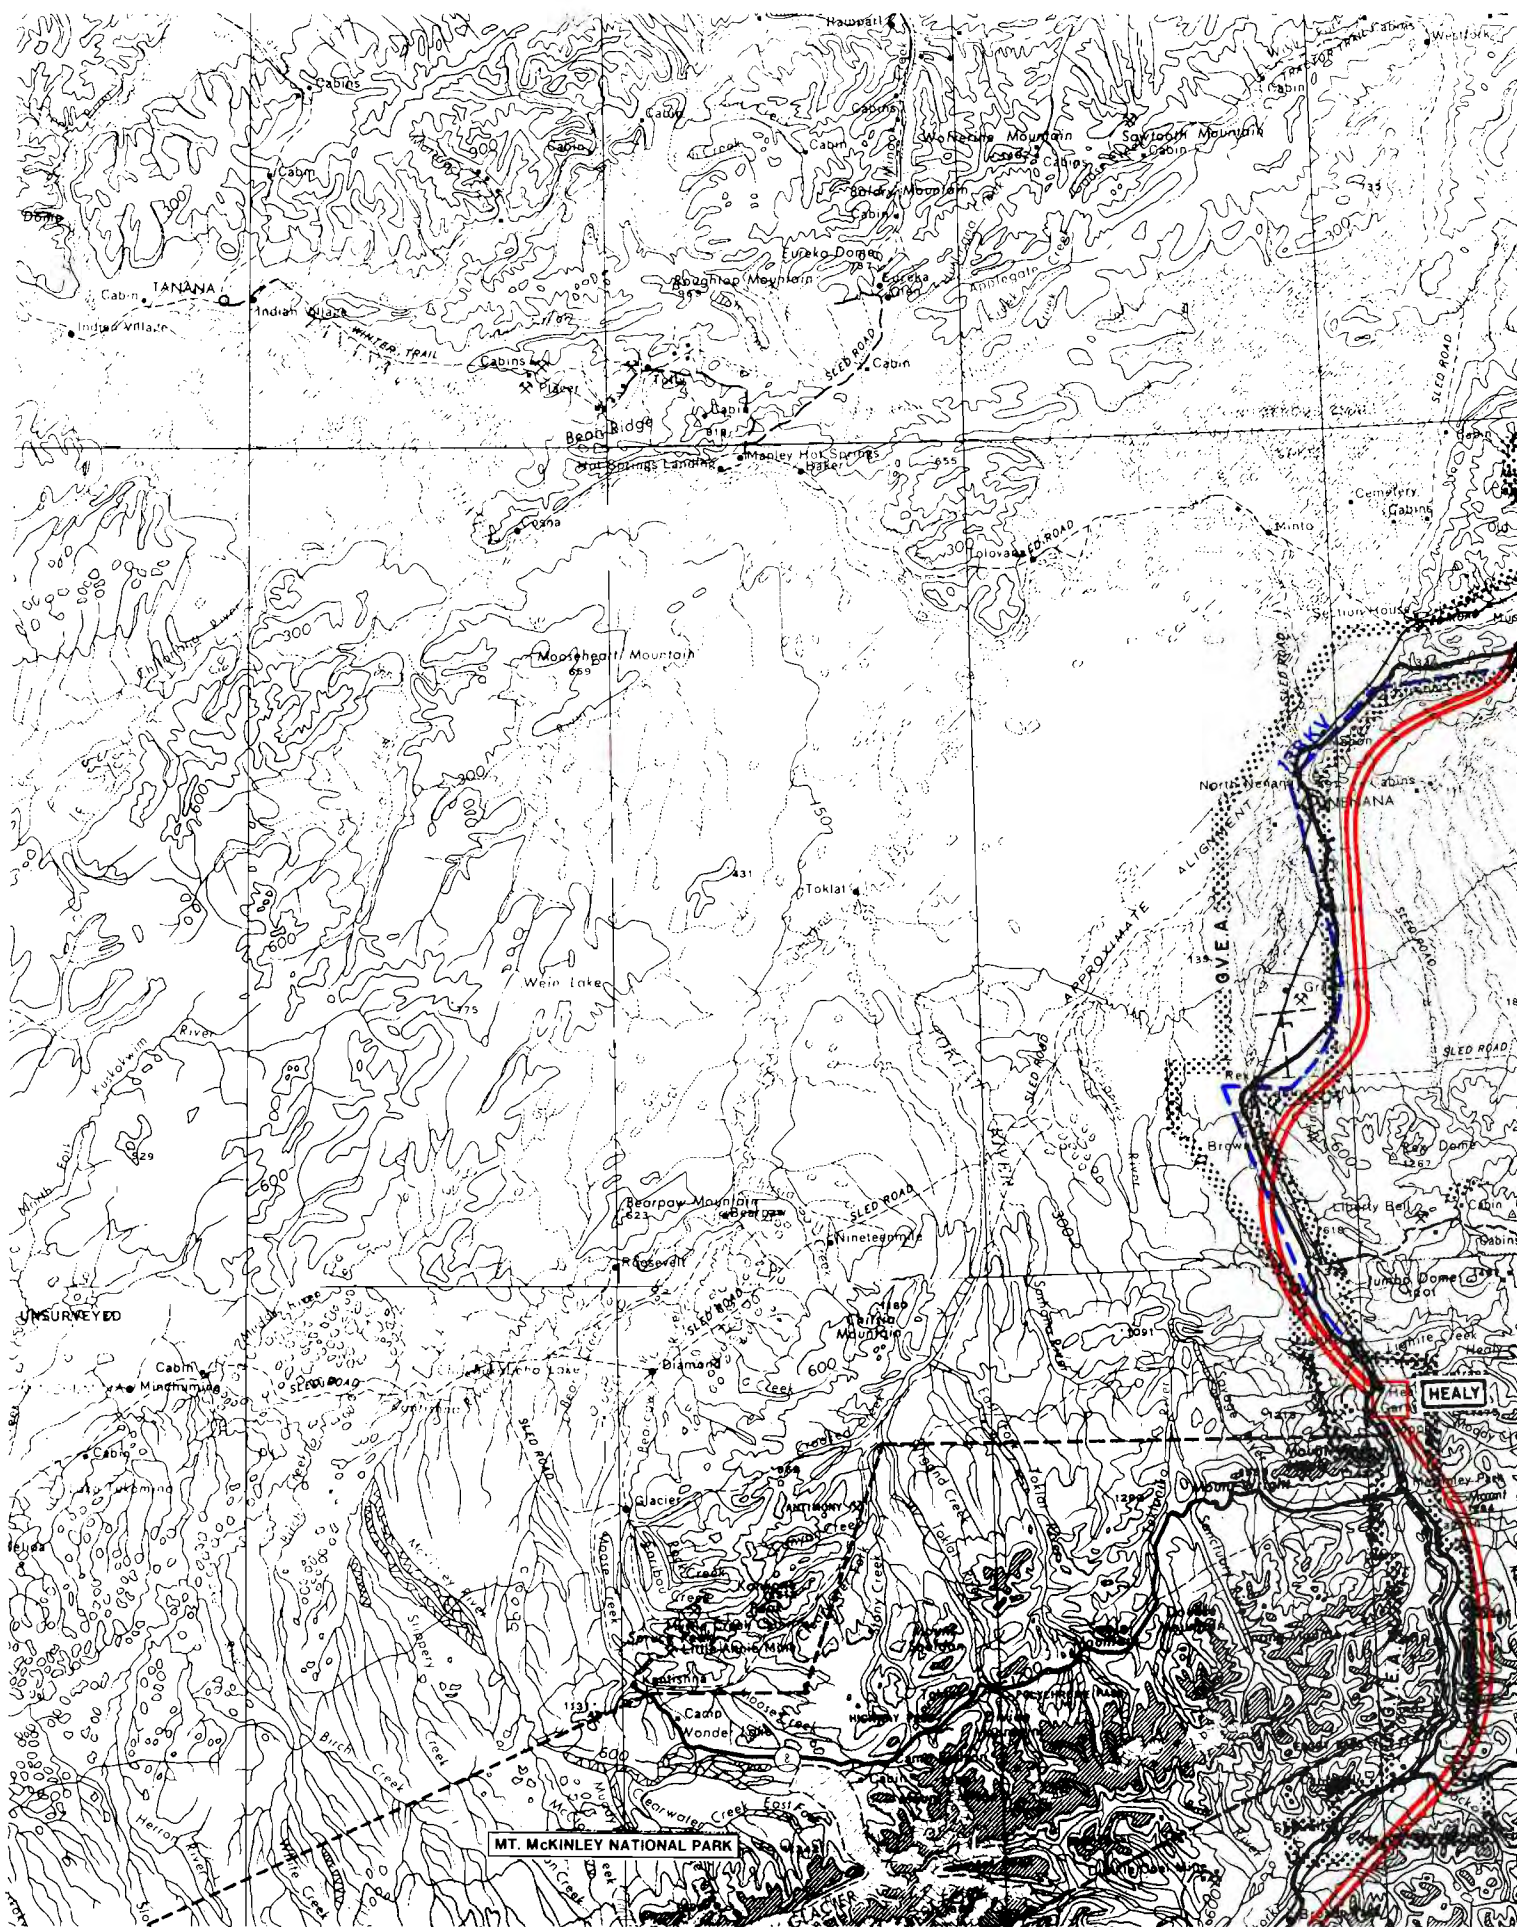


FIGURE 4-1



INTERNATIONAL ENGINEERING COMPANY, INC.  
A MORRISON - KNUDSEN COMPANY

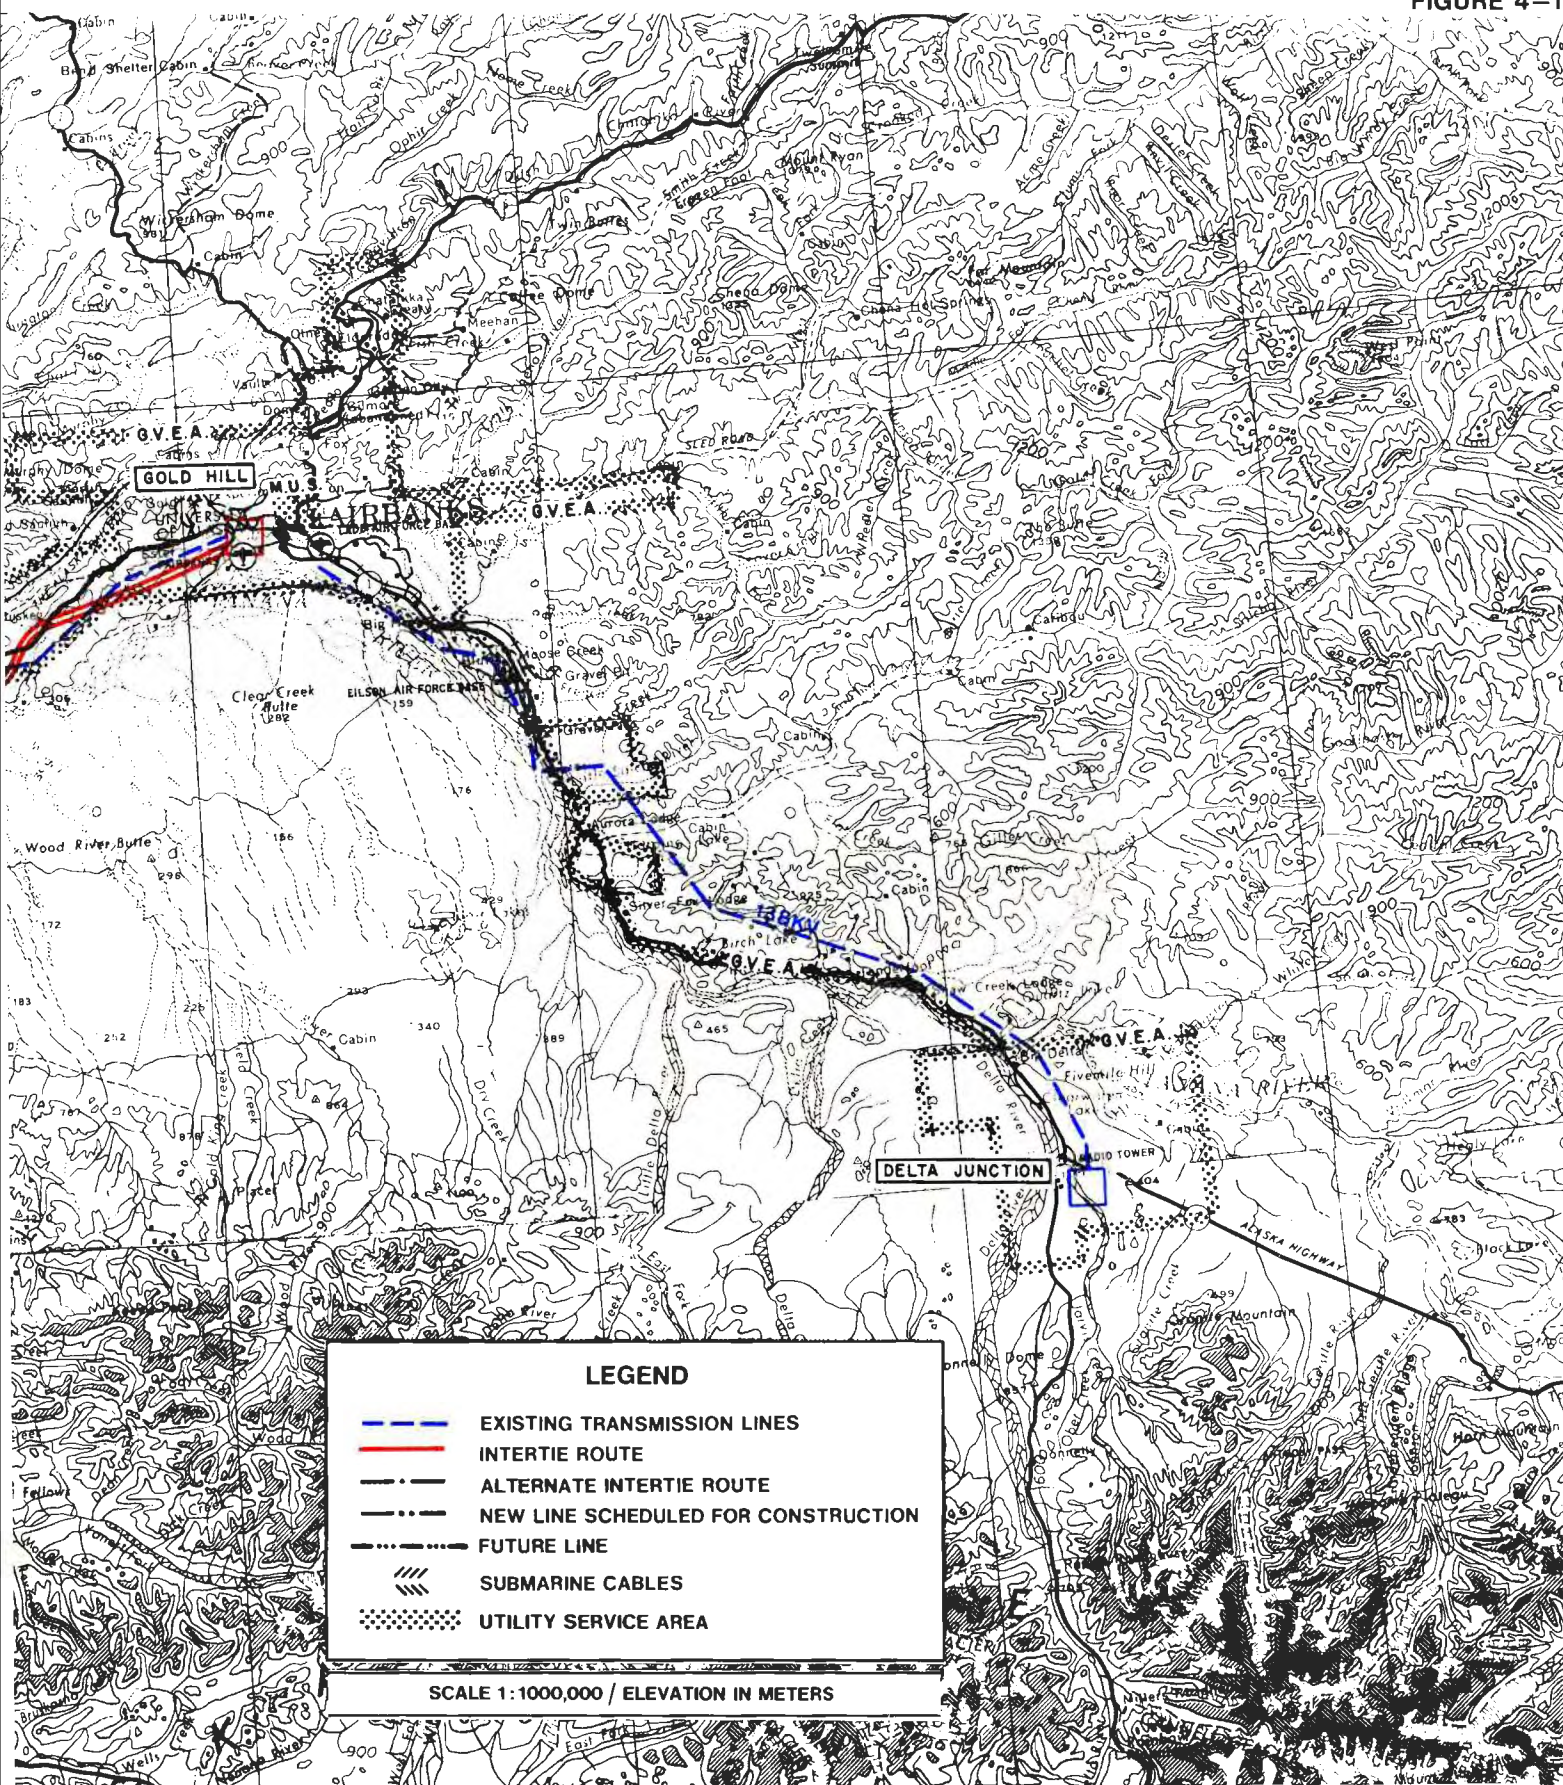

ROBERT W. RETHERFORD ASSOCIATES  
CONSULTING ENGINEERS  
A DIVISION OF ARKANSAS GLASS CONTAINER CORP.


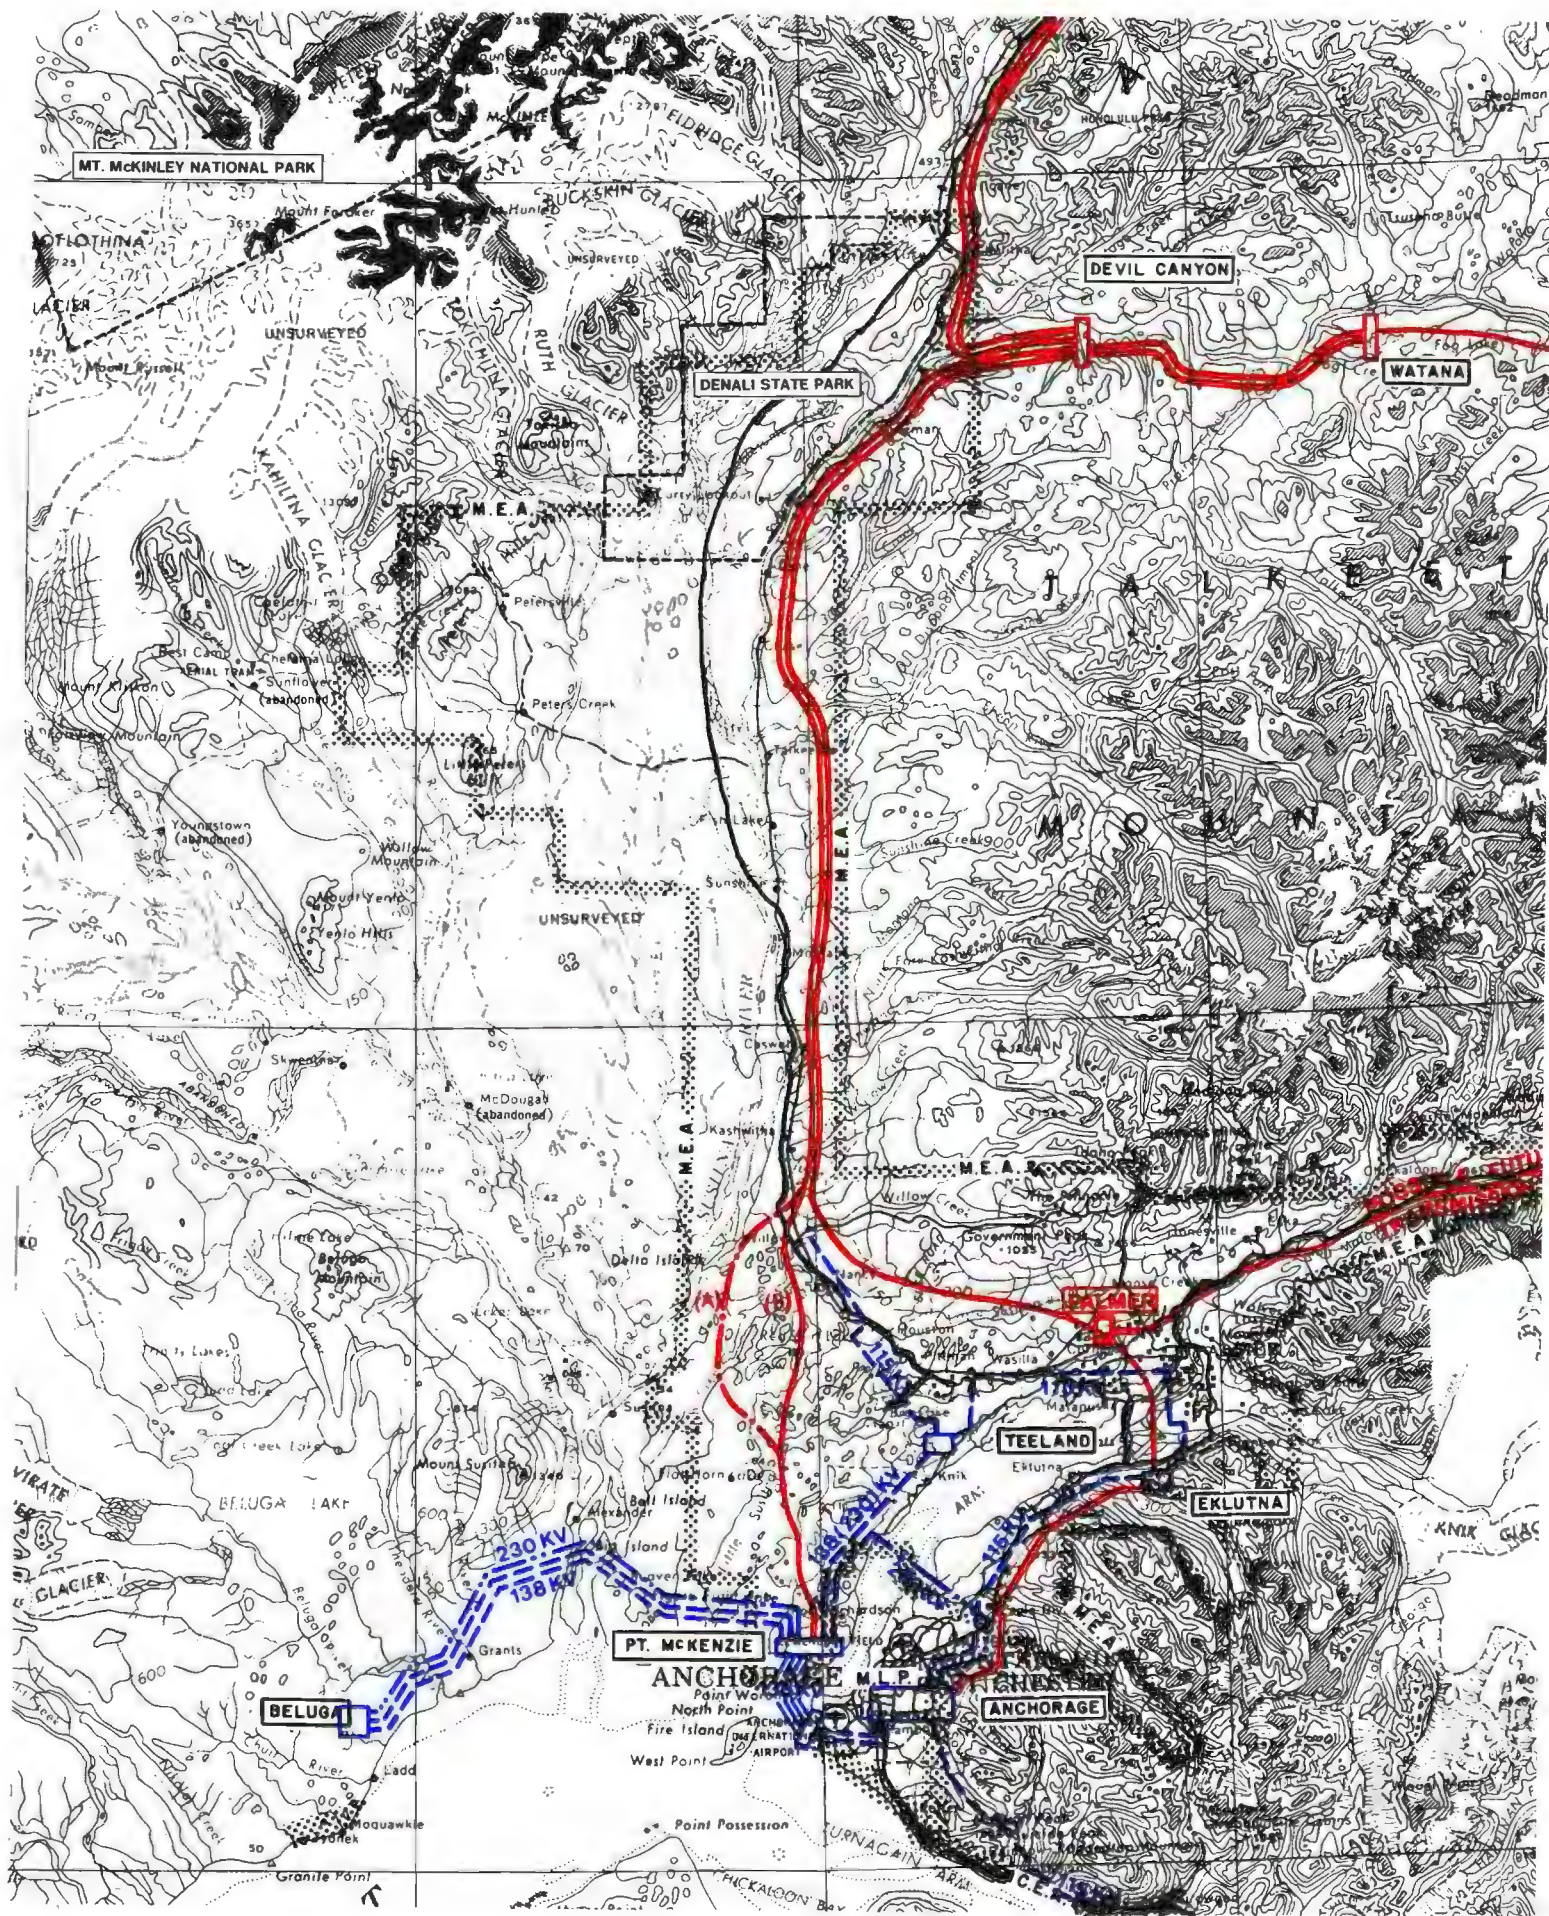


FIGURE 4-2




INTERNATIONAL ENGINEERING COMPANY, INC.  
A MORRISON - KNUDSEN COMPANY

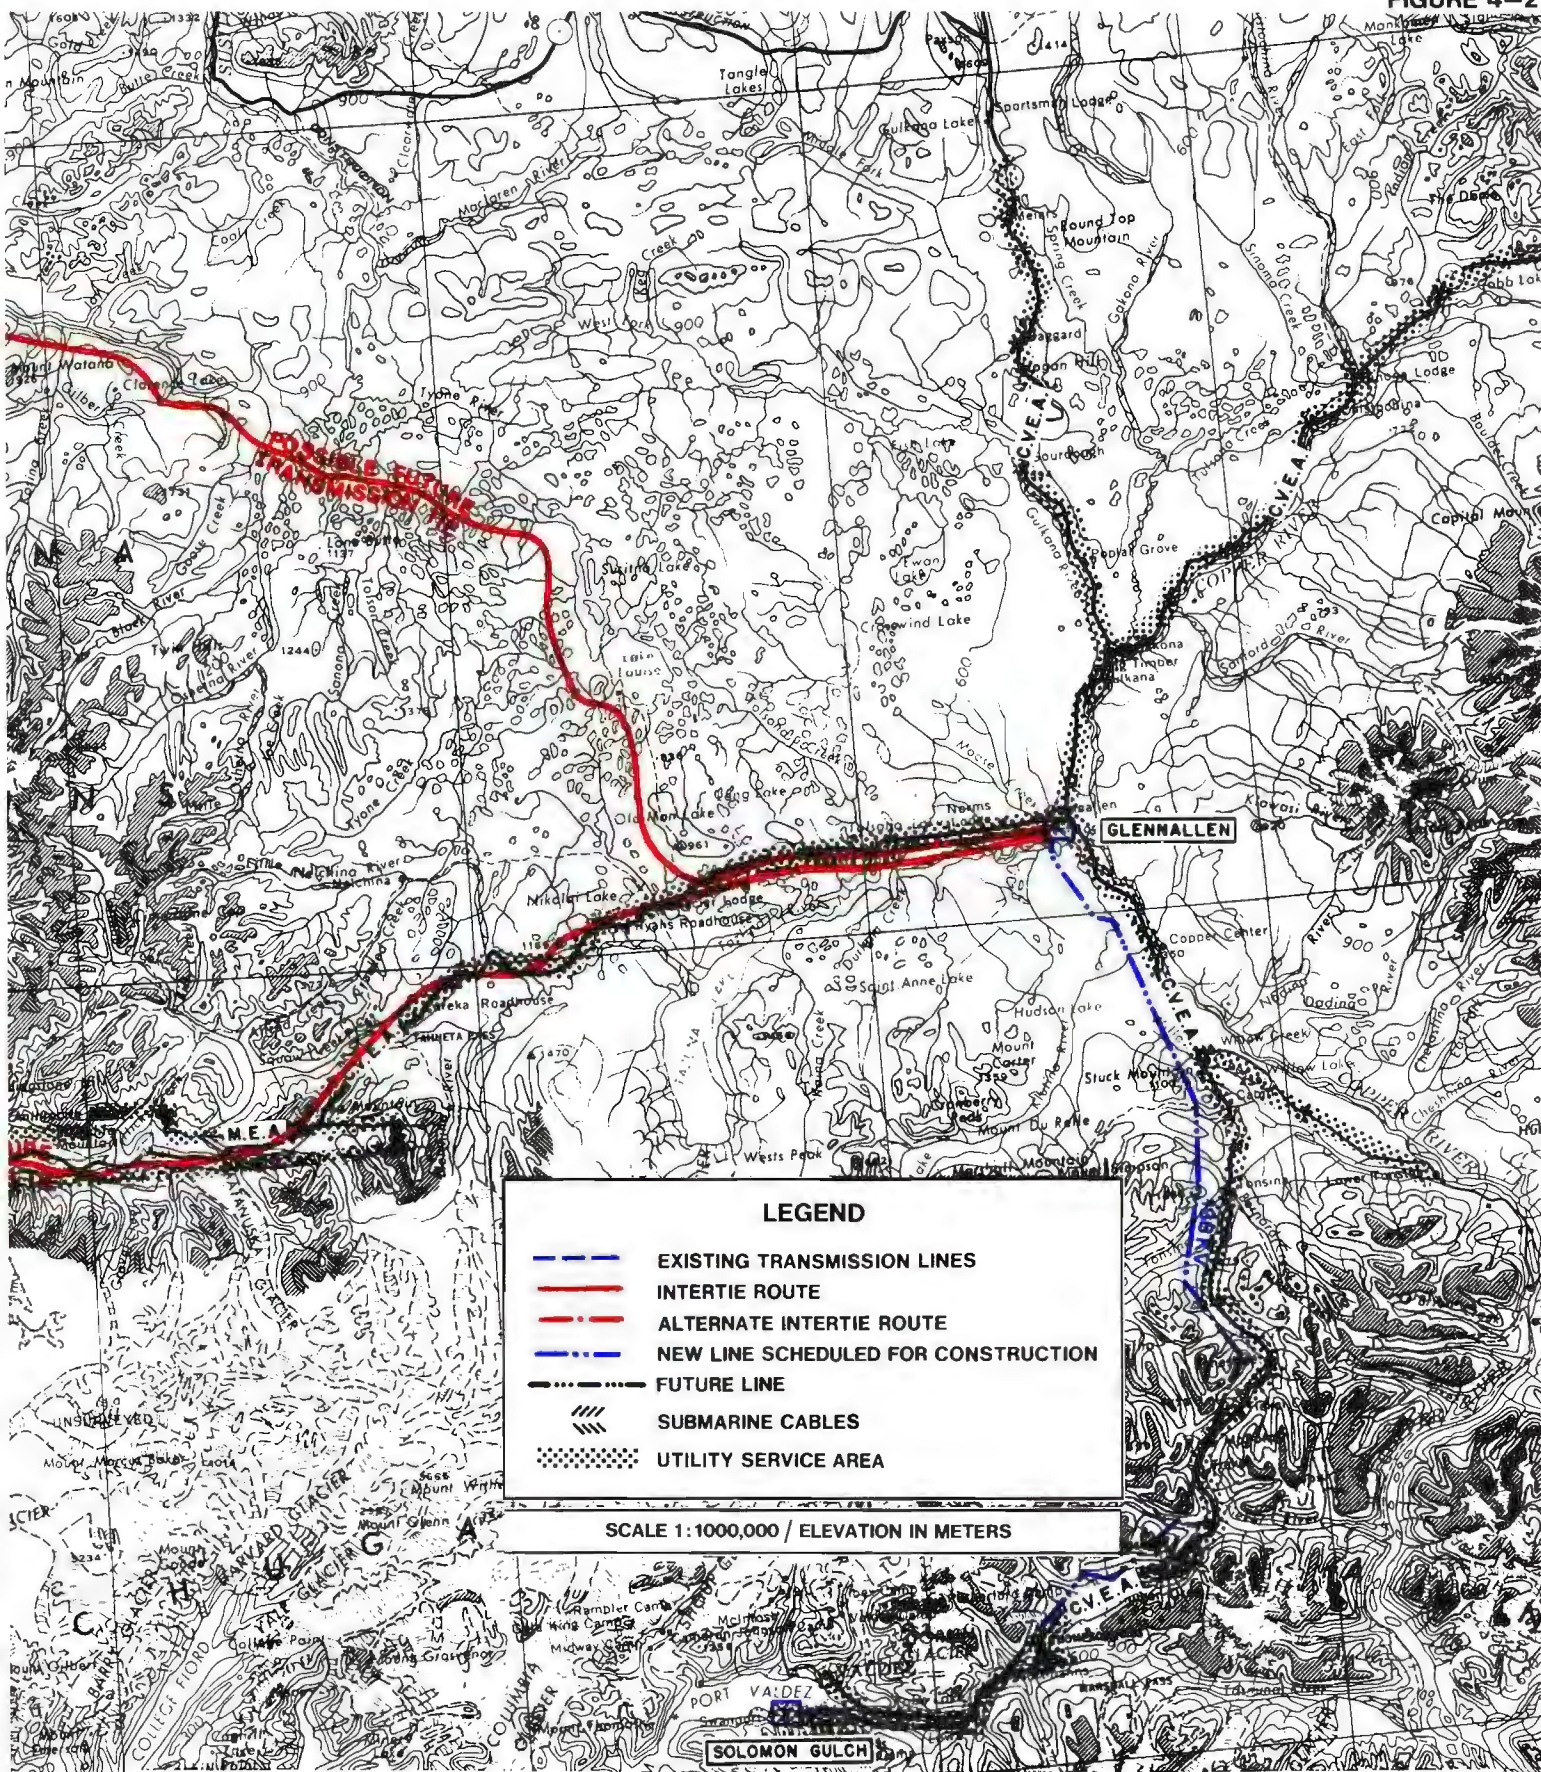

ROBERT W. RETHERFORD ASSOCIATES  
CONSULTING ENGINEERS  
A DIVISION OF ARKANSAS GLASS CONTAINER CORP.

ANCHORAGE-MATANUSKA-SUSITNA-GLENNALLEN-VALDEZ TRANSMISSION SYSTEM

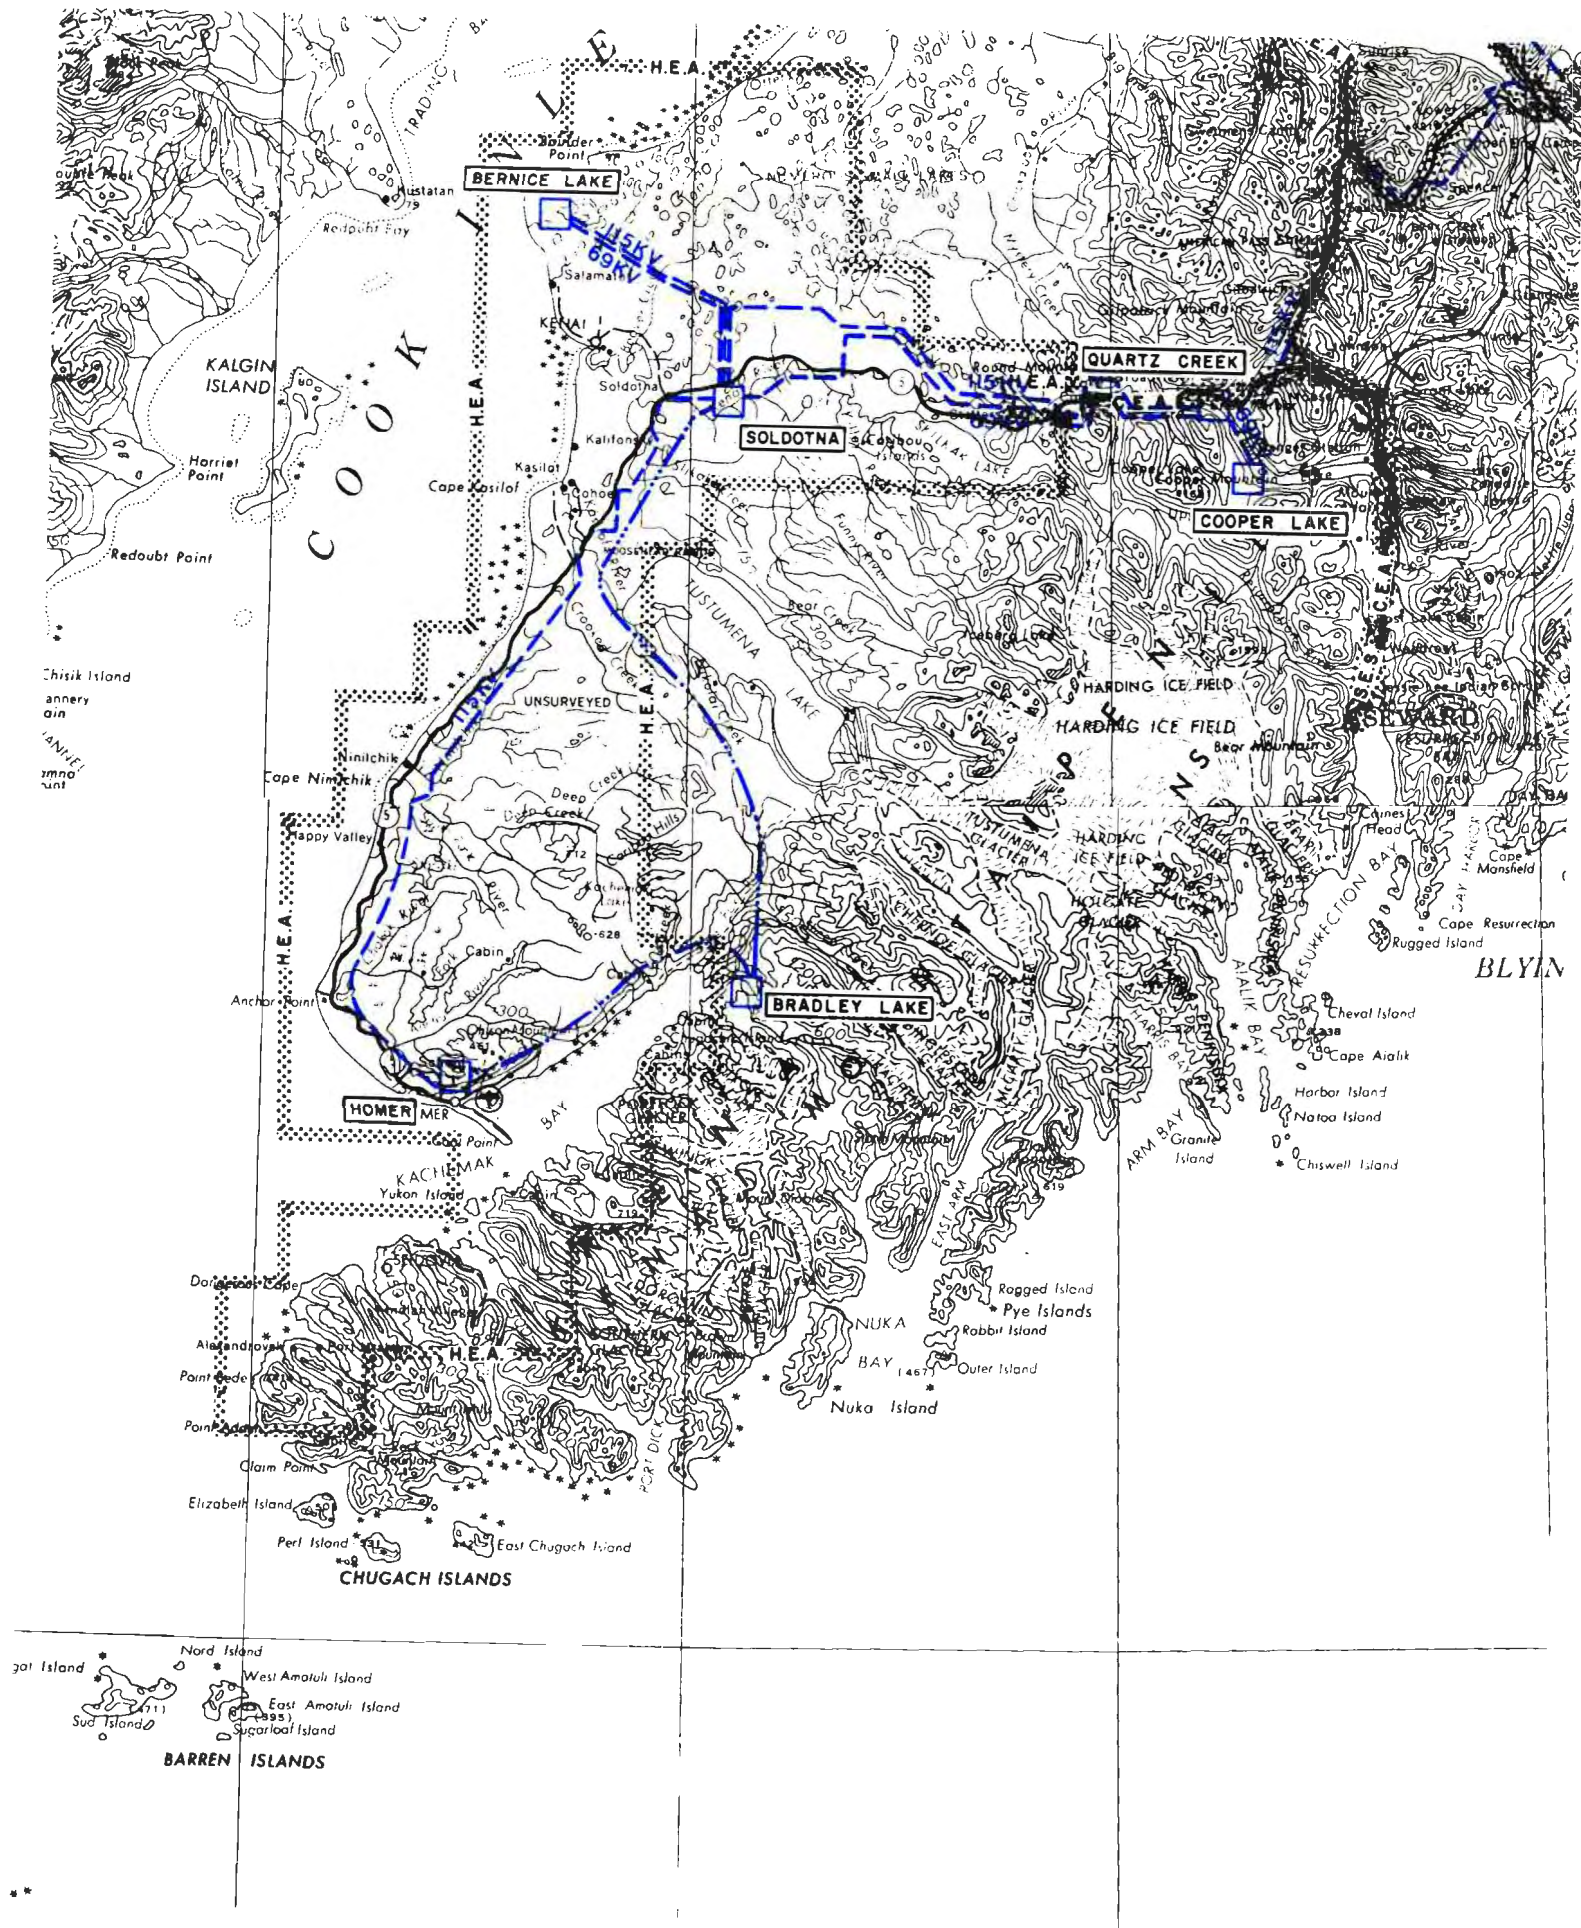

**PRINCE WILLIAM SOUND**

**LEGEND**

- EXISTING TRANSMISSION LINES
- INTERTIE ROUTE
- ALTERNATE INTERTIE ROUTE
- NEW LINE SCHEDULED FOR CONSTRUCTION
- FUTURE LINE
- SUBMARINE CABLES
- UTILITY SERVICE AREA

SCALE 1:1,000,000 / ELEVATION IN METERS



## COOK INLET — KENAI PENINSULA TRANSMISSION SYSTEM

CHAPTER 5  
TRANSMISSION LINE DESIGN

## CHAPTER 5 TRANSMISSION LINE DESIGN

### 5.1 BASIC DESIGN REQUIREMENTS

Experience in Alaska with both wood-pole H-frame, aluminum lattice guyed-X towers, and tubular steel guyed-X towers with high-strength conductors (such as Drake 795 kcmil ACSR) has demonstrated the excellent performance of lines designed with relatively long spans and flexible structures. This general philosophy has been followed in establishing the input parameters for the Transmission Line Cost Analysis Program (TLCAP) used to optimize line designs for the Anchorage-Fairbanks Intertie study. Sample outputs of TLCAP and descriptions of the program methodology are found in Appendix B.

The results of this computer analysis for 230-kV lines favor relatively long spans (1300 ft) and high-strength conductors (such as Cardinal 954 kcmil ACSR). This confirms the previous Alaskan experience and contributes substantially to a more economical design, as Chapter 7 will illustrate.

### 5.2 SELECTION OF TOWER TYPE USED IN THE STUDY

Due to rather unique soil conditions in Alaska, with extensive regions of muskeg and permafrost, conventional self-supporting or rigid towers will not provide a satisfactory performance or solution for the proposed intertie. Permafrost and seasonal changes in the soil are known to cause large earth movements at some locations, requiring towers with a high degree of flexibility and capability for handling relatively large foundation movements without appreciable loss of structural integrity.

The guyed tower is exceptionally well suited for these type of conditions. Therefore, the final choice of tower for this study was the hinged-guyed X-type design, which has been considered for both the 230-kV and 345-kV

alternatives. These towers are essentially identical in design to towers presently used on some lines in Alaska, which have proven themselves during more than ten years of service. The design features include hinged connections between the leg members and the foundations which, together with the longitudinal guy system, provides for large flexibility combined with excellent stability in the direction of the line. Transverse stability is provided by the wide leg base which also accounts for relatively small and manageable footing reactions.

The foundations are pile-type, consisting of heavy H-pile beams driven to an expected depth of 20 to 30 feet depending upon the soil conditions.

Tower outlines with general dimensions for the two voltage levels are shown on Figures 5-1 and 5-2.

### 5.3 DESIGN LOADING ASSUMPTIONS

According to available information and experience on existing lines, heavy icing is not a serious problem in most parts of Alaska. NESC Heavy Loading is presently used for all line designs throughout the Rail-belt region. However, there are locations where Light Loading probably could be used. Some line failures have occurred due to exceptionally heavy wind combined with very little or no ice. Such locations should be identified and carefully investigated prior to the final line design.

In this study, NESC Heavy Loading or heavy wind on bare conductor (corresponding to NESC Light Loading) was used, whichever is more severe.

### 5.4 TOWER WEIGHT ESTIMATION

In order to arrive at realistic tower weights and material costs for the study, actual tower designs for both the 230-kV and the 345-kV

alternatives were obtained from Meyer Industries of Red Wing, Minnesota (Ref. 1). This company has designed similar towers for other lines in Alaska.

Based on these reference designs and additional manual calculations, tower weight formulas were developed to account for variations in tower weight due to changes in tower height and load as a function of the type of conductor used.

### 5.5 CONDUCTOR SELECTION

Conductor size (see Table 5-1) was selected by the use of the Transmission Line Cost Analysis Program (TLCAP) which was specially developed by IECO for this type of study. Given an appropriate range of conductor types and sizes, span lengths, and other pertinent data, TLCAP determines the most economical conductor-span combination.

The program includes a sag-tension routine which calculates the conductor sag and tension for a given set of criteria. Using this information, the tower height and loads are then determined for each discrete span length. These values are then applied to the tower weight formula with the pertinent overload factors included.

In the process of this analysis, the program also evaluated the effect of the cost of the power losses over a specified number of years. The power losses were minimized by varying the sending and receiving end voltages by  $\pm 10\%$  and by providing required shunt compensation at both line terminals. Applicable material and labor costs, together with projected escalation rates, were included to enable the program to calculate the total installed cost of the line. A discount rate of 7% per annum was used for the determination of the present worth of transmission line losses.

For this particular study, material and labor costs were obtained from "as built" cost information realized on recently completed (138-kV and 230-kV) lines in Alaska.

## 5.6 POWER TRANSFER CAPABILITIES

Preliminary transmission line capabilities, based on surge impedance loading (SIL) criteria, were obtained from the National Power Survey Report (Ref. 2). Additional investigations indicate that for the 230-kV alternatives (Cases IA, IB, and ID), the calculated intertie power angle is near 30 degrees. To improve the 230-kV intertie's steady state and transient transmission capability, series capacitors will be necessary. Interconnected power system studies should be performed to determine the final series and shunt compensation requirements. Such studies are outside the scope of this work.

## 5.7 HVDC TRANSMISSION SYSTEM

Because of its asynchronous nature, the interconnection of two isolated alternating current (ac) systems by a point-to-point HVDC transmission link provides the desired power exchange without being prone to inherent stability problems. Furthermore, HVDC transmission can provide stabilizing power, and be very effective in damping system oscillations. While the state-of-the-art in HVDC technology is advancing, the resulting developments are keeping pace with inflation.

Preliminary investigations have shown that HVDC transmission, using 180-kV mono-polar transmission and ground return, is competitive with single-circuit 230-kV ac transmission in the transfer 130 MW of power over 323 miles. However, if the point-to-point transmission link is required to supply intermediate locations with power (either initially or in the future) then it is unlikely that dc transmission can be competitive with an ac alternative.

#### 5.8 REFERENCES

1. Letter from ITT Meyer Industries to Robert W. Retherford Associates, Anchorage, Alaska, January 15, 1979.
2. FPC Advisory Committee Report No. 6, National Power Survey, Vol. II, p. IV2-12, 1964.

TABLE 5-1  
CONDUCTOR SIZE SELECTION CRITERIA


<u>Case and Alternative<sup>1/</sup></u>	<u>Interconnection</u>	<u>Voltage (kV + 10%)</u>	<u>Line Length (miles)</u>	<u>Optimum ACSR Conductor (kcmil)</u>	<u>Load<sup>2/</sup> Per Circuit (MW)</u>
I A & B	Anchorage-Ester	230 s/c	323	1/c - 954	130
I C	Anchorage-Ester	345 s/c	323	2/c - 795	380
I D	Anchorage-Palmer Healy-Ester	230 s/c	323	2/c - 954	130
II A	Anchorage-Devil Canyon	345 s/c <sup>3/</sup>	155	2/c - 954	600
	Devil Canyon-Ester	230 s/c <sup>3/</sup>	189	1/c - 1510	185
	Watana-Devil Canyon	230 s/c <sup>3/</sup>	27	1/c - 2156	488

<sup>1/</sup> Case I Alternatives exclude the proposed Susitna Project; Case II Alternative A includes the Susitna Project.

<sup>2/</sup> 100% voltage support at both ends.


<sup>3/</sup> Two single-circuit lines on the same right-of-way.

Note: s/c = single circuit; 1/c = single conductor; 2/c = two conductor bundle.

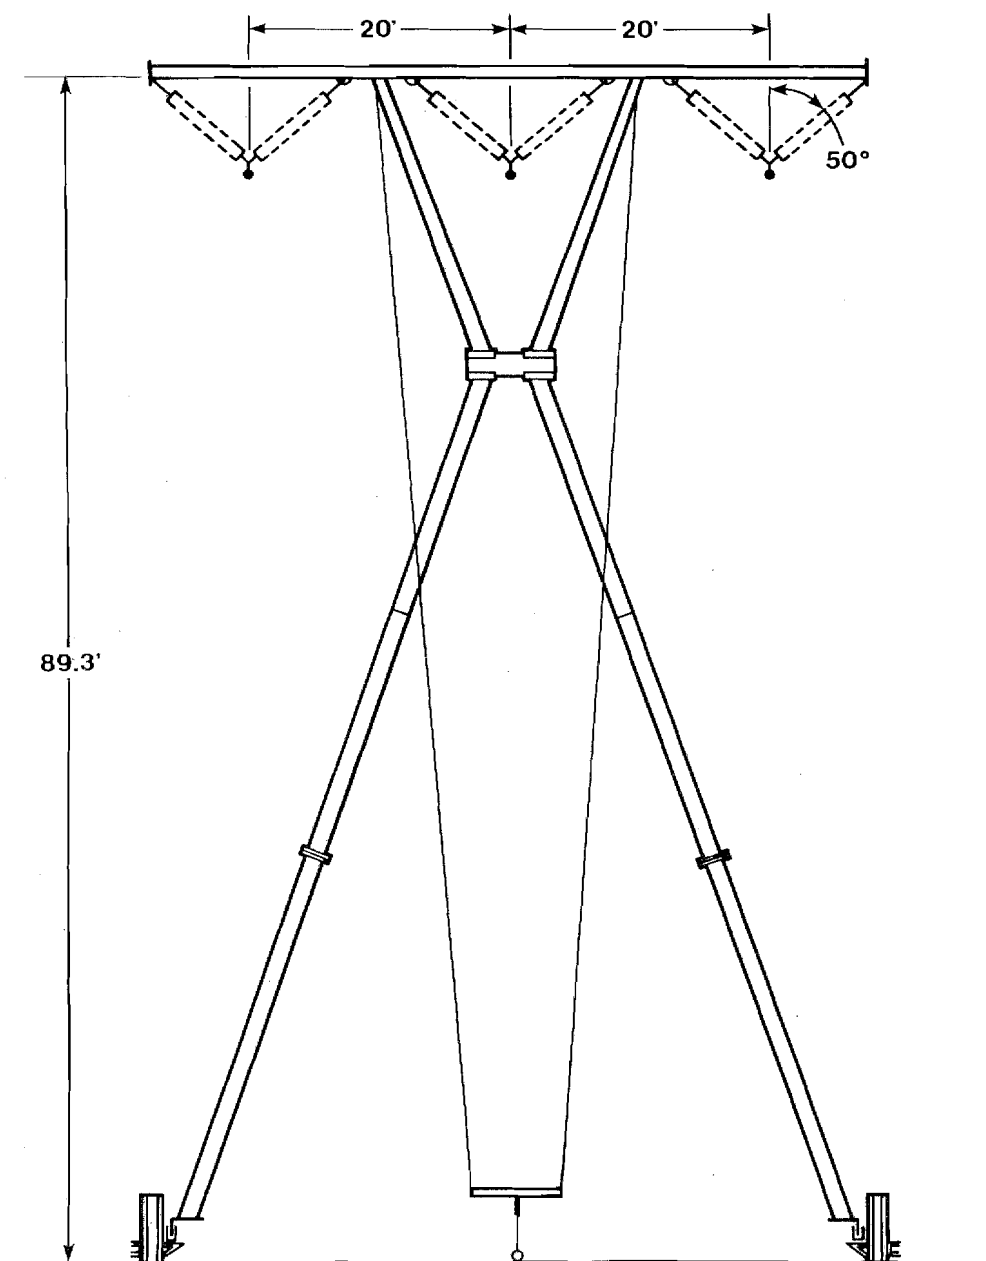

230KV TANGENT TOWER

FIGURE 5-2

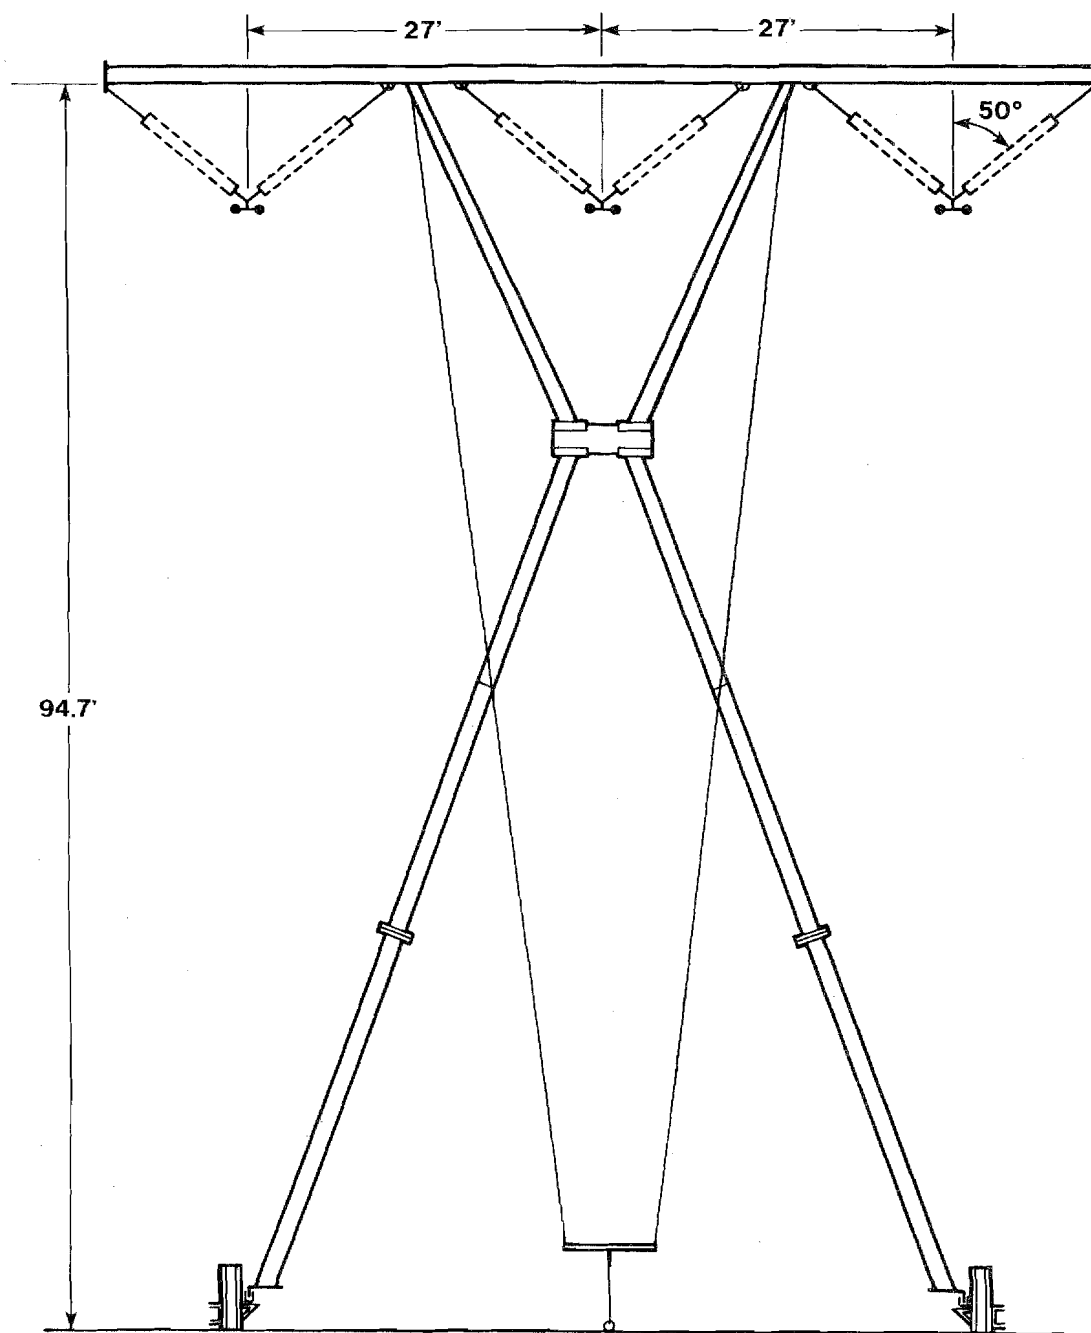

345KV TANGENT TOWER

CHAPTER 6  
SYSTEM EXPANSION PLANS

## CHAPTER 6

### SYSTEM EXPANSION PLANS

One benefit of transmission interconnection between two independent power systems is the reduction in the installed generating capacity that is possible, while maintaining the same electric power supply (generation) reliability level for both the independent and interconnected power systems. To calculate this reduction in installed generating plant capacity (megawatts), generation expansion plans had to be developed for both the independent and the interconnected power systems.

This chapter describes the actual process used in the generation expansion planning for the independent power systems of the Anchorage and Fairbanks areas, and for an interconnected Anchorage - Fairbanks power system. Generation expansion planning is a rather complex process. A brief description of the somewhat simplified method used in this Economic Feasibility Study is described below.

#### 6.1 GENERATION PLANNING CRITERIA

##### A. Generating Unit Data

Existing generating unit data were obtained from the Battelle (Ref. 1) and University of Alaska, August 1976 (Ref. 2) reports. These available data were reviewed and updated using new information obtained by IECO-RWRA engineers during interviews with the managers of the Railbelt utilities. The updated existing generation unit data is presented in Tables 6-1 and 6-2.

Preliminary information on near future (1979-1986) generation expansion planning, including probable generation capacity requirements, for the AML&P and CEA systems was obtained directly from the two utilities. More

detailed information on GVEA generation expansion plans was available in the review copy of the report Power Supply Study - 1978 (Ref. 3) and the Report on FMUS/GVEA Net Study (Ref. 4).

#### B. Installed Reserve Capacity

At the present time, there is apparently no uniform policy as to the required installed generation reserve margins for Alaskan electric power utilities. By definition, the installed generation reserve capacity includes spinning reserve, "hot" and "cold" standby reserves, and generating units on maintenance and overhaul work. No effort is made in this study to separate the installed reserve capacity into spinning and other types of reserves. Utilities in Alaska currently keep spinning reserves to the very minimum, mainly because of the no-load fuel cost incurred by the spinning reserves, and because most generating units in Alaska's Railbelt area are quick starting, combustion turbine-type units. This situation may change in the future when new larger, slow starting, thermal power plants are constructed, exceptions being hydro plant units which can be started rather rapidly.

To develop alternative generation expansion plans for this study, guidelines for installed reserve generation capacity had to be established. A minimum of 20% reserve margin on the largest single unit at the time of peak system load was decided on as the installed generation reserve guideline. In general, the 20% value is close to the actual installed reserve margin of most U.S.A. utilities. Recently, the Department of Energy's Economic Regulatory Administration reported the following for the 1978 winter peak load of the lower 48 states:

"According to the forecast, total available power resources for the lower 48 states will total nearly 500,000 MW. Peak demand is anticipated at 380,000 MW, for a reserve of nearly 120,000 MW or 31.5 percent. The lowest reserve - the 21.1 percent - will occur for the southeastern Electric Reliability Council, the DOE said, with the Mid-Atlantic Council experiencing the highest reserve margin at 45.1 percent" (Ref. 5).

### C. Unit Retirement

Except for the Knik Arm Power Plant (CEA), no other generating units were reported for retirement by the Railbelt utilities during the 1980-1992 period. Later, to include the effect of the proposed Susitna Hydroelectric Project and to obtain a better economic analysis, this study period was extended through 1997. An assumption was made that the generating units available from 1980-1992 will also be available from 1993 through 1997. Many of them, however, will serve as system standby reserve units.

### D. Generation Expansion Planning

To program the economic feasibility study and to establish transmission line interconnection benefits, generation expansion plans for the 1980-1997 period were developed for:

- Independent Anchorage area system.
- Independent Fairbanks area system.
- Interconnected Anchorage-Fairbanks system (intertie for reserve sharing only).
- Interconnected Anchorage-Fairbanks system (intertie for reserve sharing and power transfer).
- Interconnected Anchorage-Fairbanks system (with Susitna Hydroelectric Project).

Basically, generation planning includes three aspects: forecasting future loads (previously described in Chapter 3); developing generation reserve and reliability criteria (discussed later in this chapter); and determining when, how much, and what type of generation capacity is needed (which is discussed below).

Generation timing and capacity were determined by the most probable load forecasts for the Anchorage, Fairbanks, and combined Anchorage-Fairbanks areas, as described in Chapter 3.

Unit sizes for the alternative system expansion plans were determined by the ability of the power system to withstand the loss of a generating unit (or units) and still maintain reasonable system generation reliability. In determining unit sizes, due consideration was given to the valuable generation expansion planning data for the 1979-1986 period which was obtained by IECO-RWRA engineers from the Railbelt area utilities, and as the power system grows the economy of larger unit sizes.

IECO-RWRA engineers determined the type of generation mix for the expansion plans based on:

- Preliminary planning information obtained through interviews with Railbelt utilities.
- Information available in the Battelle Report and Alaska Power Administration's January 1979 report draft (Ref. 6).
- The judgment of IECO-RWRA power system planners.

Most of the planned generation additions are baseload-type thermal steam power plants burning coal, gas, or oil as fuel. They are mixed with a few additional peaking-type combustion turbine generating units using natural gas or oil as fuel. It is assumed that in the later years of this study many existing combustion turbine generating units, presently used as baseload or intermediate units, will become peaking or standby units.

## 6.2 MULTI-AREA RELIABILITY STUDY

### A. Purpose

The PTI Multi-Area Reliability (MAREL) Computer Program is used for alternative generation expansion planning, mainly for its ability to maintain a nearly constant level of generation supply reliability in all cases. This approach provides a nearly equal reliability level as far as generation ability to meet the load is concerned. The MAREL program

gives reliability equivalence to both individual area and interconnected system generation planning alternatives. The MAREL program manual (Ref. 7) introduces this program with the following:

"The PTI Multi-Area Reliability Program MAREL determines the reliability of multi-area power systems. It has been written in FORTRAN IV for use on a PRIME 400 time-sharing computer. Reliability indices computed by the program include system loss of load probability (LOLP), LOLP values for the individual areas, probability of various failure conditions and probability that each transmission (intertie) link is limiting in the transfer of generation reserves from one area to another."

MAREL program results helped determine the effectiveness of a transmission line intertie between the Anchorage and Fairbanks areas, and established the amount of generating capacity needed to give the individual areas approximately the same LOLP as for the interconnected system. MAREL study results are also applicable to the alternative which includes the Upper Susitna Project. In this instance the study became a three area reliability study with the Susitna area having only net generation and no load.

#### B. Reliability Index

To perform individual and interconnected system reliability studies (MAREL), it was necessary to select a reference system generation reliability index. As described above, the MAREL program uses LOLP calculation techniques for each study case. For each load condition the program user adjusts input data, specifically generator unit sizes, generator types, location of generating plants, and intertie capacities, to obtain generation expansion plans of near equal reliability for various alternatives. The LOLP method is very much the adapted method used by U.S.A. utilities during the last 30 years. According to the IEEE/PES Working Group on

Performance Records for Optimizing System Design, Power System Engineering Committee (Ref. 8):

"This (LOLP reliability ) index is defined as the long run average number of days in a period of time that load exceeds the available installed capacity. The index may be expressed in any time units for the period under consideration and, in general, can be considered as the expected number of days that the system experiences a generating capacity deficiency in the period. This index is commonly, but mistakenly, termed the "loss of load probability, (LOLP)". A year is generally used as the period of consideration. In this case, the LOLP index is the long-run number of days/year that the hourly integrated daily peak load exceeds the available installed capacity."

There is no standard value of LOLP which is used throughout the electric power industry. However, one day in ten years is a very much accepted value by the lower 48 utilities. Since to the authors' knowledge, LOLP index has not previously been used in Alaska, it was decided to use one day in ten years as reference LOLP index in this study. The use of this LOLP index may imply larger generation reserve margins than are presently used in Alaska, but an equal or even lower LOLP index is justifiable for Alaska for at least the following reasons:

- In very cold climatic zones the loss of electric power may be more critical than in more temperate climates.
- There is very little information on existing generation and transmission outage rates in Alaska. Therefore, there is more uncertainty about the study input data.
- At present, most of the power systems in Alaska are independently operated. In case of emergency, utilities cannot rely on help from neighboring utilities or power pools as can most of utilities

in the lower 48. Therefore, a lower LOLP reliability index is justifiable.

- Higher planned generation reserves may be needed to provide protection against possible unplanned delays in construction of new larger thermal units.

#### C. Program Methodology

A general description of the MAREL computer program methodology is contained in Appendix C. The particular program application to this study is "Planning of interconnections to achieve regional integration and more widespread sharing of generation reserves" (Ref. 7). Briefly, the program models each area as a one-bus system to which all generators and loads are connected. Transmission interties between areas are modeled as having limited power transfer capabilities and specified line outage rates. The method assumes that each area takes care of its own internal transmission needs.

#### D. Load Model

Annual load models were developed for the Anchorage and Fairbanks areas. Daily peak load data for 1975 were obtained from AML&P, CEA, FMUS, and GVEA. The Railbelt utility representatives agreed that 1975 was a typical year with normal weather conditions. The 1975 load models were converted into per unit system for the MAREL program. The computer program multiplied this 1975 load model (input) by the respective study year peak loads to obtain annual load models for each year of the study. Forecasted annual peak loads and the per unit annual load models for the Anchorage and Fairbanks areas are shown in Tables 6-3 through 6-6. Annual demand curves indicating biweekly non-coincident peaks are shown on Figure 6-1. Figure 6-1 also indicates that there is very little diversity between the loads of the Anchorage and Fairbanks areas.

## E. Generating Unit Data

Information on existing generating unit data, as indicated in Tables 6-1 and 6-2, was used in the study. Unit base ratings were rounded off to the nearest megawatt in the study. Sizes for new generating units used in the expansion plans are indicated on Figures 6-2 through 6-8.

Generating unit outage rates, which are required for calculating LOLP indexes, were obtained from the most recent Edison Electric Institute (EEI) report on equipment availability (Ref. 9). The rates for combustion turbines were obtained from the actual operating experience of CEA and GVEA at the Beluga and Zehnder Power Plants. The EEI publication defines the forced outage rate as:

$$\text{Forced Outage Rate} = \text{FOH} / (\text{SH} + \text{FOH}) \times 100$$

Where FOH represents forced outage hours and SH represents service hours. Generating unit outage rates used in the MAREL study are indicated below:

<u>Unit Designation</u>	<u>Forced Outage Rate (%)</u>
Combustion Turbine*	5.5
Hydroelectric Plant	1.6
Thermal Steam Plant (small units)	5.9
Thermal Steam Plant (100-200 MW)	5.7
Thermal Steam Plant (300 MW)	7.9

\* The Forced Outage Rate for combustion turbines was based on the following information:

- CEA experience at Beluga during 1977-1978 period, six units base loaded.

Unit availability	87% of the time
Scheduled maintenance	8% of the time
Forced outage	5% of the time

Therefore, the calculated Forced Outage Rate equals 5.4%.

- In 1975 GVEA experience at Zehnder Station, Units No. 1 and 2 provides calculated Forced Outage Rates of 4.2% and 4%, respectively; however, these units were basically standby units.

#### F. Generating Unit Maintenance

The MAREL program automatically schedules generating unit maintenance within the specified restrictions. For the purpose of this study, it was assumed that no unit maintenance will be scheduled during the November-March winter season.

#### G. Intertie Data

The MAREL program models the transmission intertie by limiting intertie transfer capabilities and considering intertie outage rates. No load loss sharing method was used. This means that one area will share its generating reserves only up to the limit of intertie transfer capability or available reserves in the other area, whichever is limiting. The forced outage rates (on a per year basis) used in the study for transmission and line terminal equipment are indicated below:

<u>Line Voltage (kV)</u>	<u>Forced Outage Rate (per unit/100 miles)</u>
230	0.00113
345	0.00225

Note: The following outage rate was used for both 230-kV and 345-kV line terminals: 36 hours/10 years.

### 6.3 SYSTEM EXPANSION PLANS

#### A. Planning Study Period

Based on generation planning criteria and the results of the MAREL reliability study (previously described in this chapter), alternative generation expansion plans were developed. The 1984-1997 period was selected for the alternative expansion plans for the following reasons:

- 1984 is the earliest year when the interconnected system can be operational.
- The 1992-1997 period includes the Upper Susitna Hydroelectric Project, based on the optimistic assumption that Watana Unit No. 1 will be on-line in January 1992.
- The study period is long enough for the present worth economic analysis method, and includes most of the costs and benefits obtainable by the introduction of an intertie in 1984.

To close the gap between the existing generation systems and the first study year (1984) of the intertie economic feasibility study, generation expansion plans for the independent Anchorage and Fairbanks areas for 1980 through 1983 were developed. Information on planned generation additions supplied by the generating utilities in the Railbelt area was used for this purpose.

#### B. Independent System Expansion Plans

Generation expansion plans for the independent Anchorage and Fairbanks systems were also needed to calculate economic benefits of the interconnection. The planned generation additions consist of thermal base load and peaking units. They do not include the Upper Susitna Project (Watana and Devil Canyon Hydro Plants), which are only included in the

interconnected system expansion plans. The independent Anchorage and Fairbanks generation expansion plans are indicated on Figure 6-2 for the probable load forecast case and Figure 6-6 for the low load forecast case.

### C. Interconnected System Expansion Plans

Two cases of system interconnection were studied - Case I, direct interconnection between Anchorage and Fairbanks (Ester), and Case II, interconnection between Watana-Devil Canyon with Anchorage and Fairbanks systems. Under Case I the alternatives were developed as follows:

- Case IA includes a single-circuit 230-kV transmission line having 130-MW power transfer capability allocated for reserve sharing only. This plan is shown on Figures 6-3 and 6-9 for the probable load forecast case and on Figures 6-7 and 6-9 for the low load forecast case.
- Case IB includes one single-circuit 230-kV transmission line (1984-1991) and two single-circuit 230-kV transmission lines (1992-1997) having the following generation reserve sharing capabilities: 100 MW (1984-1987), 130 MW (1989-1991) and 190 MW (1992-1997). In addition, this alternative has a firm power transfer capability of 30 MW (1984-1987), supplying 14% of peak load in Fairbanks area in 1984, and 70 MW (1992-1997) supplying 18% of peak load in Fairbanks area in 1992. This plan is shown on Figures 6-4 and 6-9 for the probable load forecast case and on Figures 6-8 and 6-9 for the low load forecast case.
- Case IC includes one single-circuit 345-kV transmission line having a total of 380 MW power transfer capability allocated for generation reserve sharing and for firm power transfer. The case is similar to Case IB (230 kV) except that only one 345 kV line is required during the 1992-1997 period. This plan is shown on Figures 6-4 (similar) and 6-10.

- Case ID is the same as Case IA, except with intermediate switching stations at Palmer and Healy. This plan is shown on Figures 6-3 and 6-11 for the probable load forecast case and on Figures 6-7 and 6-11 for the low load forecast case.

Under Case II, only one solution was studied: two single-circuit 230-kV transmission lines from Watana to Devil Canyon; two single-circuit 230-kV lines from Devil Canyon to Ester (Fairbanks); and two single-circuit 345-kV lines from Devil Canyon to Anchorage.

#### D. Reliability Indexes

The results of the MAREL study show loss of load probability (LOLP) indexes for independent system expansion plans and plans for an interconnected system (with and without the Upper Susitna Project), and are indicated in Tables 6-7 through 6-12. As previously discussed in Subsection 6.2B, the LOLP index of one day in ten years (0.1 day/year) was used as a reference standard throughout the study for comparing different alternatives. During the performance of the MAREL study the LOLP index was kept as close to the standard as reasonably possible.

#### 6.4 REFERENCES

1. Battelle Pacific Northwest Laboratories, Alaskan Electric Power, An Analysis of Future Requirements and Supply Alternatives for the Railbelt Region, Vol. I, March 1978.
2. University of Alaska, Institute for Social and Economic Research, Electric Power in Alaska, 1976 - 1995, August 1976.
3. Stanley Consultants, Power Supply Study - 1978 for Golden Valley Electric Association, Inc.
4. Alaska Resource Sciences Corporation, Report FMUS/GVEA Net Study, Vol. 1, May 1978.

5. Electric Light and Power, Capacity Can Meet Winter Peaks - DOE, November 1978.
6. Alaska Power Administration, Upper Susitna River Project, POWER MARKET ANALYSES, Draft, January 1979.
7. Power Technologies, Inc. PTI Multi-Area Reliability Program (MAREL), Computer Program Manual, September 1978.
8. "Reliability Indices for Use in Bulk Power Supply Adequacy Evaluation", IEEE Transactions on Power Apparatus and Systems, Vol. PAS-97, No. 4, July/August 1978.
9. Edison Electric Institute, Report on Equipment Availability for the Ten-Year Period 1967-1976, December 1977.

TABLE 6-1

EXISTING GENERATION SOURCES  
ANCHORAGE - COOK INLET AREA

Name/Location	Unit Reference	Year of Installation	Type	Unit Rating		Dependable Capacity (kw)	Remarks
				Base (kw)	Peak (kw)		
<u>ANCHORAGE MUNICIPAL LIGHT AND POWER (AML&amp;P)</u>							
Anchorage			Diesel	2,200			Black start unit
Anchorage	Unit 1		SCGT	15,130	18,000		
Anchorage	Unit 2		SCGT	15,130	18,000		
Anchorage	Unit 3	1968	SCGT	18,650	21,000		
Anchorage	Unit 4	1972	SCGT	31,700	35,000		
Anchorage	Unit 5	1975	SCGT	36,800	40,000	} Combined cycle installation	
Anchorage	Unit 6	1979	HRST	12,000			
<u>CHUGACH ELECTRIC ASSOCIATION (CEA)</u>							
Beluga	Unit 1		SCGT	15,150	18,700		
Beluga	Unit 2		SCGT	15,150	18,700		
Beluga	Unit 3		RCGT	53,500	67,000		
Beluga	Unit 4		SCGT	9,300	10,000		
Beluga	Unit 5		RCGT	53,500	67,000		
Beluga	Unit 6		SCGT	67,810	72,900		
Beluga	Unit 7	1978	SCGT	67,810	72,900		
Bernice Lake	Unit 1		SCGT	8,200	16,500		
Bernice Lake	Unit 2		SCGT	19,600	20,500		
Bernice Lake	Unit 3	1978	SCGT	24,000			
International	Unit 1		SCGT	14,530	16,500		
International	Unit 2		SCGT	14,530	16,500		
International	Unit 3		SCGT	18,600	21,500		
Cooper Lake	Unit 1		Hydro	7,500	9,600		
Cooper Lake	Unit 2		Hydro	7,500	9,600	16,500	
Knik Arm	Several (1,2,3,4 & 5)		ST	14,500	17,700		To be retired in 1985
<u>MATANUSKA ELECTRIC ASSOCIATION (MEA)</u>							
Talkeetna			Diesel	600			Standby
<u>HOMER ELECTRIC ASSOCIATION (HEA)</u>							
English Bay			Diesel	100			
Homer-Kenai			Diesel	300			
Homer (2 x 3500)			SCGT	7,000			Leased to CEA
Port Graham			Diesel	200			Leased from GVEA (1977-1979)
Seldovia			Diesel	1,648		1,500	
<u>SEWARD ELECTRIC SYSTEM (SES)</u>							
Seward	Unit 1		Diesel	1,500		} 5,500	
	Unit 2		Diesel	1,500	1,500		
	Unit 3		Diesel	2,500	3,000		Standby
<u>ALASKA POWER ADMINISTRATION (APA)</u>							
Eklutna	Unit 1 & 2		Hydro	30,000	35,000	30,000	Two 15,000 kW units

TABLE 6-2  
EXISTING GENERATION SOURCES  
FAIRBANKS - TANANA VALLEY AREA

Name/Location	Unit Reference	Year of Installation	Type	Unit Rating		Dependable Capacity (kW)	Remarks
				Base (kW)	Peak (kW)		
<u>FAIRBANKS MUNICIPAL UTILITIES SYSTEM (FMUS)</u>							
Fairbanks	Chena 1	1954	ST	5,000			
Fairbanks	Chena 2	1952	ST	2,000			
Fairbanks	Chena 3	1952	ST	1,500			
Fairbanks	Chena 4	1963	ST	20,000			
Fairbanks	Chena 5	1970	SCGT	5,350	7,000		
Fairbanks	Chena 6	1976	SCGT	23,500			
Fairbanks	Diesel 1	1967	Diesel	2,665			
Fairbanks	Diesel 2	1968	Diesel	2,665			
Fairbanks	Diesel 3	1968	Diesel	2,665			
<u>GOLDEN VALLEY ELECTRIC ASSOCIATION (GVEA)</u>							
Zehnder Sub.	Unit 1	1971	SCGT	17,553	20,000	17,400	Peaking Service
Zehnder Sub.	Unit 2	1972	SCGT	17,553	20,000	17,400	
Zehnder Sub.	Unit 3	1975	SCGT			3,500	Leased to HEA (1977-1979)
Zehnder Sub.	Unit 4	1975	SCGT			3,500	
Zehnder Sub.	Units 1-7	1970	Diesel			12,900	
Healy	Unit-1	1967	ST			26,200	
Healy			Diesel	2,500			
Northpole	Unit 1	1976	SCGT	64,800	70,000		
Northpole	Unit 2	1977	SCGT	64,800	70,000		
U. of Alaska	Units 7&8		Diesel			5,100	
Delta			Diesel			500	Mobile Unit

TABLE 6-3

LOAD MODEL DATA  
ANCHORAGE AREA  
PROBABLE LOAD FORECAST CASE

ANNUAL PEAK LOAD IN MW  
(1983 - 1997)

789. 877. 977. 1080. 1196. 1313. 1441. 1581. 1724. 1881.  
2041. 2215. 2402. 2591. 2794.

INTERVAL PEAK LOADS IN P.U. OF ANNUAL PEAK LOAD  
(26 INTERVALS / YEAR)

.8333 .6667 .7404 .7500 .6571 .6346 .6122 .5865 .5481 .5353 .5224 .5160 .5064  
.4904 .5032 .4968 .5160 .5737 .5769 .6154 .6827 .8429 .8526 .9135 1.0000 .8301

DAILY PEAK LOADS IN P.U. OF INTERVAL PEAK LOAD  
(260 WEEK DAYS / YEAR)

1.0000	.9769	.9731	.9538	.9500	.9462	.8962	.8731	.8577	.8423
1.0000	.9808	.9663	.9663	.9615	.9615	.9519	.9519	.9423	.9375
1.0000	.9913	.9784	.9827	.9697	.9654	.9437	.9307	.9221	.8918
1.0000	.9829	.9487	.9359	.9017	.8889	.8889	.8846	.8333	.8034
1.0000	.9512	.9317	.9171	.9171	.9073	.9073	.9024	.9024	.8976
1.0000	.9848	.9798	.9747	.9646	.9495	.9444	.9343	.9293	.9141
1.0000	.9686	.9634	.9529	.9529	.9476	.9424	.9372	.9058	.9058
1.0000	.9781	.9727	.9617	.9563	.9563	.9344	.9344	.9071	.9071
1.0000	.9883	.9883	.9825	.9825	.9708	.9708	.9649	.9591	.9415
1.0000	.9940	.9820	.9701	.9581	.9461	.9401	.9341	.9281	.9162
1.0000	.9939	.9877	.9571	.9571	.9509	.9509	.9448	.9202	.8589
1.0000	.9938	.9814	.9689	.9565	.9379	.9379	.9379	.9255	.9255
1.0000	.9810	.9684	.9620	.9494	.9494	.9430	.9367	.9304	.9177
1.0000	.9804	.9739	.9739	.9673	.9608	.9542	.9542	.9477	.8824
1.0000	.9873	.9745	.9554	.9490	.9490	.9427	.9427	.9299	.9299
1.0000	1.0000	.9935	.9871	.9806	.9742	.9677	.9613	.9548	.9484
1.0000	.9938	.9814	.9689	.9627	.9565	.9565	.9441	.9441	.9379
1.0000	.9777	.9609	.9441	.9274	.9106	.8883	.8715	.8715	.8045
1.0000	.9944	.9944	.9722	.9722	.9722	.9611	.9278	.9222	.9222
1.0000	.9948	.9896	.9896	.9687	.9583	.9531	.9375	.9323	.8802
1.0000	.9859	.9484	.9437	.9390	.9296	.9249	.9202	.9155	.9014
1.0000	.9962	.9658	.9468	.9468	.9087	.7985	.7757	.7719	.8555
1.0000	1.0000	.9887	.9662	.9549	.9511	.9474	.9398	.9361	.9323
1.0000	.9754	.8632	.8596	.8421	.8386	.8386	.8386	.8386	.8175
1.0000	.9840	.9679	.9519	.9359	.9327	.9327	.9135	.8654	.8045
1.0000	.9730	.9730	.9614	.9614	.9575	.9575	.9537	.9421	.8340

TABLE 6-4

## LOAD MODEL DATA

## FAIRBANKS AREA

## PROBABLE LOAD FORECAST CASE

ANNUAL PEAK LOAD IN MW  
(1983 - 1997)

196. 212. 231. 249. 270. 291. 313. 338. 362. 390.  
416. 446. 477. 511. 547.

INTERVAL PEAK LOADS IN P.U. OF ANNUAL PEAK LOAD  
(26 INTERVALS / YEAR)

0.87590.69900.73710.76040.57490.59710.56630.51110.43240.41150.38330.37470.3587  
0.35380.38080.41770.42010.43730.46190.53190.57490.89190.93370.93491.00000.7690

DAILY PEAK LOADS IN P.U. OF INTERVAL PEAK LOAD  
(260 WEEK DAYS / YEAR)

1.00000.97480.94670.94670.94530.93130.89480.86540.84290.8177  
1.00000.93670.92790.92790.90510.89980.88050.85940.82790.7891  
1.00000.99330.96670.94830.94000.92330.90330.88000.86670.8267  
1.00000.97580.96120.94510.86910.83200.82390.81100.79000.6769  
1.00000.98500.98290.95940.95300.94660.91880.90810.90170.8825  
1.00000.99790.99590.98770.97940.95880.93620.90530.89300.8827  
1.00000.98480.95010.93710.91970.89370.88070.87200.86120.8091  
1.00000.96870.96150.95190.93510.91590.88700.88220.87980.8558  
1.00000.99150.99150.99150.97160.96870.93180.89200.88920.8693  
1.00001.00000.96120.93130.92840.92840.92240.90750.90450.8955  
1.00000.99040.99040.94550.92310.91990.91670.91350.87820.8558  
1.00000.96720.95410.92790.92460.90490.89840.89510.87870.8721  
1.00000.96920.96920.95890.95890.94520.94520.93150.92120.9041  
1.00000.98960.97220.96870.95830.94790.93400.92360.92010.8507  
1.00000.96770.93870.93230.91290.90320.90320.90320.87100.8677  
1.00000.87350.87060.86760.86460.85880.84710.84410.83820.8059  
1.00000.94440.90640.90640.89470.82750.82750.82460.81870.8012  
1.00000.99720.97750.96350.96350.94940.93820.93820.91010.8904  
1.00000.99470.96810.93090.92820.90960.90690.90160.88830.8856  
1.00000.98850.93300.91450.90990.89610.88910.88450.86370.8568  
1.00000.99150.98080.97650.94020.92950.92740.91880.91450.9017  
1.00000.96690.91180.89260.88840.79890.73970.64460.61020.6088  
1.00000.97710.91050.90790.90790.89340.88950.88550.86320.8434  
1.00000.97110.86330.83050.81870.79630.79240.74510.73320.7201  
1.00000.99510.98160.97300.97170.95580.91650.88450.82430.6818  
1.00000.99840.93930.92010.89940.88980.88500.84820.81310.7971

TABLE 6-5

LOAD MODEL DATA  
ANCHORAGE AREA  
LOW LOAD FORECAST CASE

ANNUAL PEAK LOAD IN MW  
(1983 - 1997)

765. 832. 908. 985. 1068. 1156. 1250. 1350. 1451. 1562.  
1677. 1800. 1933. 2070. 2215.

INTERVAL PEAK LOADS IN P.U. OF ANNUAL PEAK LOAD  
(26 INTERVALS / YEAR)

.8333 .6667 .7404 .7500 .6571 .6346 .6122 .5865 .5481 .5353 .5224 .5160 .5064  
.4904 .5032 .4968 .5160 .5737 .5769 .6154 .6827 .8429 .8526 .9135 1.0000 .8301

DAILY PEAK LOADS IN P.U. OF INTERVAL PEAK LOAD  
(260 WEEK DAYS / YEAR)

1.0000	.9769	.9731	.9538	.9500	.9462	.8962	.8731	.8577	.8423
1.0000	.9808	.9663	.9663	.9615	.9615	.9519	.9519	.9423	.9375
1.0000	.9913	.9784	.9827	.9697	.9654	.9437	.9307	.9221	.8918
1.0000	.9829	.9487	.9359	.9017	.8889	.8889	.8846	.8333	.8034
1.0000	.9512	.9317	.9171	.9171	.9073	.9073	.9024	.9024	.8976
1.0000	.9848	.9798	.9747	.9646	.9495	.9444	.9343	.9293	.9141
1.0000	.9686	.9634	.9529	.9529	.9476	.9424	.9372	.9058	.9058
1.0000	.9781	.9727	.9617	.9563	.9563	.9344	.9344	.9071	.9071
1.0000	.9883	.9883	.9825	.9825	.9708	.9708	.9649	.9591	.9415
1.0000	.9940	.9820	.9701	.9581	.9461	.9401	.9341	.9281	.9162
1.0000	.9939	.9877	.9571	.9571	.9509	.9509	.9448	.9202	.8589
1.0000	.9938	.9814	.9689	.9565	.9379	.9379	.9379	.9255	.9255
1.0000	.9810	.9684	.9620	.9494	.9494	.9430	.9367	.9304	.9177
1.0000	.9804	.9739	.9739	.9673	.9608	.9542	.9542	.9477	.8824
1.0000	.9873	.9745	.9554	.9490	.9490	.9427	.9427	.9299	.9299
1.0000	1.0000	.9935	.9871	.9806	.9742	.9677	.9613	.9548	.9484
1.0000	.9938	.9814	.9689	.9627	.9565	.9565	.9441	.9441	.9379
1.0000	.9777	.9609	.9441	.9274	.9106	.8883	.8715	.8715	.8045
1.0000	.9944	.9944	.9722	.9722	.9722	.9611	.9278	.9222	.9222
1.0000	.9948	.9896	.9896	.9687	.9583	.9531	.9375	.9323	.8802
1.0000	.9859	.9484	.9437	.9390	.9296	.9249	.9202	.9155	.9014
1.0000	.9962	.9658	.9468	.9468	.9087	.7985	.7757	.7719	.8555
1.0000	1.0000	.9887	.9662	.9549	.9511	.9474	.9398	.9361	.9323
1.0000	.9754	.8632	.8596	.8421	.8386	.8386	.8386	.8386	.8175
1.0000	.9840	.9679	.9519	.9359	.9327	.9327	.9135	.8654	.8045
1.0000	.9730	.9730	.9614	.9614	.9575	.9575	.9537	.9421	.8340

TABLE 6-6

LOAD MODEL DATA  
FAIRBANKS AREA  
LOW LOAD FORECAST CASE

ANNUAL PEAK LOAD IN MW  
(1983 - 1997)

188. 202. 218. 232. 248. 264. 281. 300. 317. 337.  
355. 377. 398. 420. 444.

INTERVAL PEAK LOADS IN P.U. OF ANNUAL PEAK LOAD  
(26 INTERVALS / YEAR)

0.87590.69900.73710.76040.57490.59710.56630.51110.43240.41150.38330.37470.3587  
0.35380.38080.41770.42010.43730.46190.53190.57490.89190.93370.93491.00000.7690

DAILY PEAK LOADS IN P.U. OF INTERVAL PEAK LOAD  
(260 WEEK DAYS / YEAR)

1.00000.97480.94670.94670.94530.93130.89480.86540.84290.8177  
1.00000.93670.92790.92790.90510.89980.88050.85940.82790.7891  
1.00000.99330.96670.94830.94000.92330.90330.88000.86670.8267  
1.00000.97580.96120.94510.86910.83200.82390.81100.79000.6769  
1.00000.98500.98290.95940.95300.94660.91880.90810.90170.8825  
1.00000.99790.99590.98770.97940.95880.93620.90530.89300.8827  
1.00000.98480.95010.93710.91970.89370.88070.87200.86120.8091  
1.00000.96870.96150.95190.93510.91590.88700.88220.87980.8558  
1.00000.99150.99150.99150.97160.96870.93180.89200.88920.8693  
1.00001.00000.96120.93130.92840.92840.92240.90750.90450.8955  
1.00000.99040.99040.94550.92310.91990.91670.91350.87820.8558  
1.00000.96720.95410.92790.92460.90490.89840.89510.87870.8721  
1.00000.96920.96920.95890.95890.94520.94520.93150.92120.9041  
1.00000.98960.97220.96870.95830.94790.93400.92360.92010.8507  
1.00000.96770.93870.93230.91290.90320.90320.90320.87100.8677  
1.00000.87350.87060.86760.86460.85880.84710.84410.83820.8059  
1.00000.94440.90640.90640.89470.82750.82750.82460.81870.8012  
1.00000.99720.97750.96350.96350.94940.93820.93820.91010.8904  
1.00000.99470.96810.93090.92820.90960.90690.90160.88830.8856  
1.00000.98850.93300.91450.90990.89610.88910.88450.86370.8568  
1.00000.99150.98080.97650.94020.92950.92740.91880.91450.9017  
1.00000.96690.91180.89260.88840.79890.73970.64460.61020.6088  
1.00000.97710.91050.90790.90790.89340.88950.88550.86320.8434  
1.00000.97110.86330.83050.81870.79630.79240.74510.73320.7201  
1.00000.99510.98160.97300.97170.95580.91650.88450.82430.6818  
1.00000.99840.93930.92010.89940.88980.88500.84820.81310.7971

TABLE 6-7

LOSS OF LOAD PROBABILITY INDEX (LOLP)<sup>1/</sup>

FOR

STUDY CASES IA & ID<sup>2/</sup>

PROBABLE LOAD FORECAST CASE

Study Year	Anchorage		Fairbanks	
	Independent Expansion <sup>3/</sup>	Interconnected Expansion <sup>4/</sup>	Independent Expansion <sup>3/</sup>	Interconnected Expansion <sup>4/</sup>
1984	0.0262	0.0063	0.8193	0.0066
1985	0.0123	0.0275	0.1446	0.0242
1986 <sup>5/</sup>	0.0199	0.0113	0.2868	0.0236
1987	0.0247	0.0208	0.6795	0.0546
1988	0.0408	0.0698	0.1140	0.0278
1989	0.0290	0.0613	0.2318	0.0376
1990	0.0242	0.0625	0.0593	0.0652
1991	0.0184	0.0595	0.1550	0.1276
1992	0.0168	0.0259	0.0276	0.0269
1993	0.0539	0.0297	0.0586	0.0598
1994	0.0393	0.0296	0.1583	0.1358
1995	0.0307	0.0622	0.0373	0.0426
1996	0.0901	0.0568	0.0899	0.1014
1997	0.0676	0.0367	0.0441	0.0419

<sup>1/</sup> LOLP in days per year.<sup>2/</sup> 230 kV s/c, 130 MW reserve sharing only.<sup>3/</sup> See Figure 6-2.<sup>4/</sup> See Figure 6-3.<sup>5/</sup> Starting in 1986 includes Bradley Lake Hydro Project.

TABLE 6-8  
LOSS OF LOAD PROBABILITY INDEX (LOLP)<sup>1/</sup>  
FOR  
CASE IB<sup>2/</sup>  
PROBABLE LOAD FORECAST CASE

Study Year	Anchorage		Fairbanks	
	Independent Expansion <sup>3/</sup>	Interconnected Expansion <sup>4/</sup>	Independent Expansion <sup>3/</sup>	Interconnected Expansion <sup>4/</sup>
1984	0.0262	0.0077	0.8193	0.0018
1985	0.0123	0.0329	0.1446	0.0096
1986	0.0293	0.0220	0.2868	0.0152
1987	0.0288	0.0306	0.6766	0.0299
1988	0.0482	0.0799	0.1140	0.0300
1989	0.0330	0.0677	0.2318	0.0394
1990	0.0265	0.0680	0.0593	0.0670
1991	0.0193	0.0633	0.1550	0.0130
1992	0.0189	0.0644	0.0276	0.0227
1993	0.0546	0.0703	0.0586	0.0354
1994	0.0427	0.0550	0.1583	0.0654
1995	0.0326	0.0991	0.0373	0.0369
1996	0.0931	0.0838	0.0899	0.0506
1997	0.0676	0.0520	0.0441	0.0244

<sup>1/</sup> LOLP in days per year.

<sup>2/</sup> 230-kV transmission system with reserve sharing and firm power transfer capability.

<sup>3/</sup> See Figure 6-2.

<sup>4/</sup> See Figure 6-4.

TABLE 6-9

LOSS OF LOAD PROBABILITY INDEX (LOLP)<sup>1/</sup>  
 FOR  
 CASE IIA<sup>2/</sup>  
 PROBABLE LOAD FORECAST CASE

Study Year	Anchorage		Fairbanks	
	Independent Expansion <sup>4/</sup>	Interconnected Expansion <sup>3/</sup>	Independent Expansion <sup>4/</sup>	Interconnected Expansion <sup>3/</sup>
1992	0.0189	0.0476	0.0276	0.0972
1993	0.0546	0.0418	0.0586	0.0299
1994	0.0427	0.0235	0.1583	0.0244
1995	0.0326	0.0070	0.0373	0.0089
1996	0.0931	0.0226	0.0899	0.0207
1997	0.0676	0.1240	0.0441	0.0461

<sup>1/</sup> LOLP in days per year.

<sup>2/</sup> Includes interconnections between Devil Canyon-Anchorage (345 kV), Devil Canyon-Watana (230 kV), and Devil Canyon-Ester (230 kV).

<sup>3/</sup> Interconnected expansion for three area system: Anchorage, Fairbanks, and Upper Susitna (generation only). See also Figure 6-5.

<sup>4/</sup> See Figure 6-2.

TABLE 6-10

LOSS OF LOAD PROBABILITY INDEX (LOLP)<sup>1/</sup>

FOR

STUDY CASES IA & ID<sup>2/</sup>

LOW LOAD FORECAST CASE

Study Year	Anchorage		Fairbanks	
	Independent Expansion <sup>3/</sup>	Interconnected Expansion <sup>4/</sup>	Independent Expansion <sup>3/</sup>	Interconnected Expansion <sup>4/</sup>
1984	0.0262	0.0063	0.8193	0.0066
1985	0.0123	0.0275	0.1446	0.0242
1986	0.0199	0.0113	0.2868	0.0236
1987 <sup>5/</sup>	0.0134	0.0527	0.2697	0.0501
1988	0.0095	0.0068	0.0329	0.0035
1989	0.0724	0.0701	0.0741	0.0222
1990	0.0309	0.0376	0.1511	0.0207
1991	0.0350	0.0533	0.0061	0.0387
1992	0.0182	0.0334	0.0591	0.0502
1993	0.0359	0.0351	0.1207	0.0173
1994	0.0190	0.0264	0.2499	0.0264
1995	0.0129	0.0211	0.0340	0.0463
1996	0.0075	0.0601	0.0711	0.0152
1997	0.0393	0.0393	0.0207	0.0225

<sup>1/</sup> LOLP in days per year.<sup>2/</sup> 230 kV s/c, 130 MW reserve sharing only.<sup>3/</sup> See Figure 6-6.<sup>4/</sup> See Figure 6-7.<sup>5/</sup> From 1987, figures include Bradley Lake Hydro Project.

TABLE 6-11  
LOSS OF LOAD PROBABILITY INDEX (LOLP)<sup>1/</sup>  
FOR  
CASE IB<sup>2/</sup>  
LOW LOAD FORECAST CASE

Study Year	Anchorage		Fairbanks	
	Independent Expansion <sup>3/</sup>	Interconnected Expansion <sup>4/</sup>	Independent Expansion <sup>3/</sup>	Interconnected Expansion <sup>4/</sup>
1984	0.0064	0.0012	0.4650	0.0006
1985	0.0105	0.0225	0.0807	0.0044
1986	0.0232	0.0745	0.1515	0.0176
1987	0.0217	0.0918	0.2697	0.0393
1988	0.0121	0.0090	0.0329	0.0037
1989	0.0869	0.0822	0.0740	0.0238
1990	0.0344	0.0428	0.1511	0.0219
1991	0.0393	0.0602	0.2557	0.0413
1992	0.0189	0.0366	0.0591	0.0515
1993	0.0366	0.0393	0.1207	0.0180
1994	0.0209	0.0288	0.2499	0.0271
1995	0.0133	0.0207	0.0340	0.0024
1996	0.0078	0.0126	0.0711	0.0195
1997	0.0427	0.0692	0.0207	0.0029

<sup>1/</sup> LOLP in days per year.

<sup>2/</sup> 230-kV transmission system with reserve sharing and firm power transfer capability.

<sup>3/</sup> See Figure 6-6.

<sup>4/</sup> See Figure 6-8.

TABLE 6-12

LOSS OF LOAD PROBABILITY INDEX (LOLP)<sup>1/</sup>  
 FOR  
 CASE IC<sup>2/</sup>  
 PROBABLE LOAD FORECAST CASE

Study Year	Anchorage		Fairbanks	
	Independent Expansion <sup>3/</sup>	Interconnected Expansion <sup>4/</sup>	Independent Expansion <sup>3/</sup>	Interconnected Expansion <sup>4/</sup>
1984	0.0262	0.0063	0.8193	0.0066
1985	0.0123	0.0275	0.1446	0.0242
1986 <sup>5/</sup>	0.0199	0.0113	0.2868	0.0236
1987	0.0247	0.0208	0.6795	0.0546
1988	0.0408	0.0698	0.1140	0.0278
1989	0.0290	0.0613	0.2318	0.0376
1990	0.0242	0.0625	0.0593	0.0652
1991	0.0184	0.0595	0.1550	0.1276
1992	0.0168	0.0616	0.0276	0.0388
1993	0.0539	0.0666	0.0586	0.0620
1994	0.0393	0.0511	0.1583	0.1198
1995	0.0307	0.0971	0.0373	0.0486
1996	0.0901	0.0830	0.0899	0.0699
1997	0.0676	0.0516	0.0441	0.0354

<sup>1/</sup> LOLP in days per year.

<sup>2/</sup> 345-kV transmission system with reserve sharing and firm power transfer capability.

<sup>3/</sup> See Figure 6-2.

<sup>4/</sup> See Figure 6-4. The 345 kV (Case IC) is similar to 230 kV (Case IB) except that only one 345-kV line is required during the 1992-1997 period, instead of two 230-kV lines.

<sup>5/</sup> Starting in 1986 includes Bradley Lake Hydro Project.

# NON-COINCIDENT 1975 PEAK DEMANDS ANCHORAGE AND FAIRBANKS AREAS


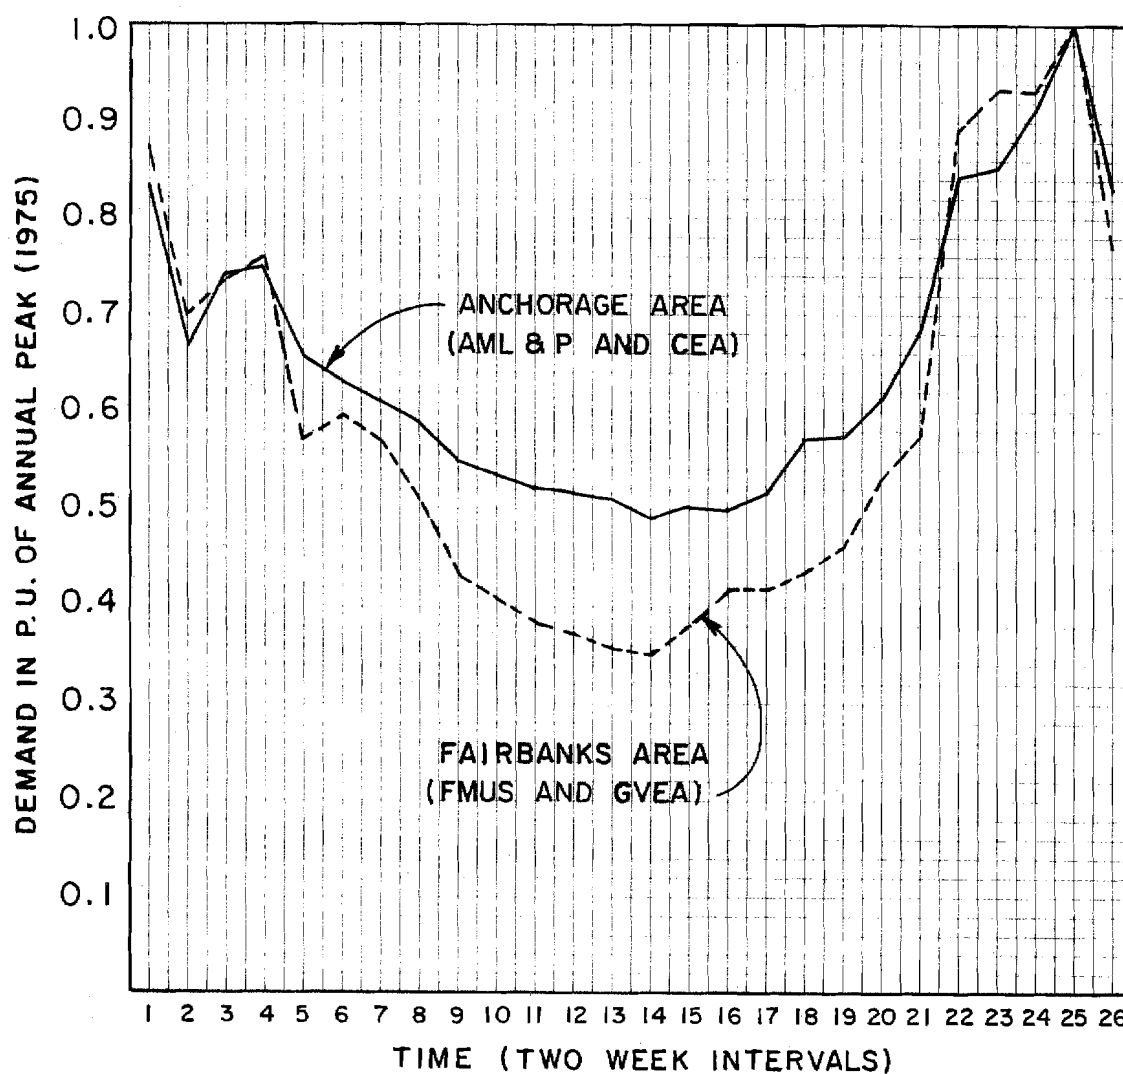


FIGURE 6-2

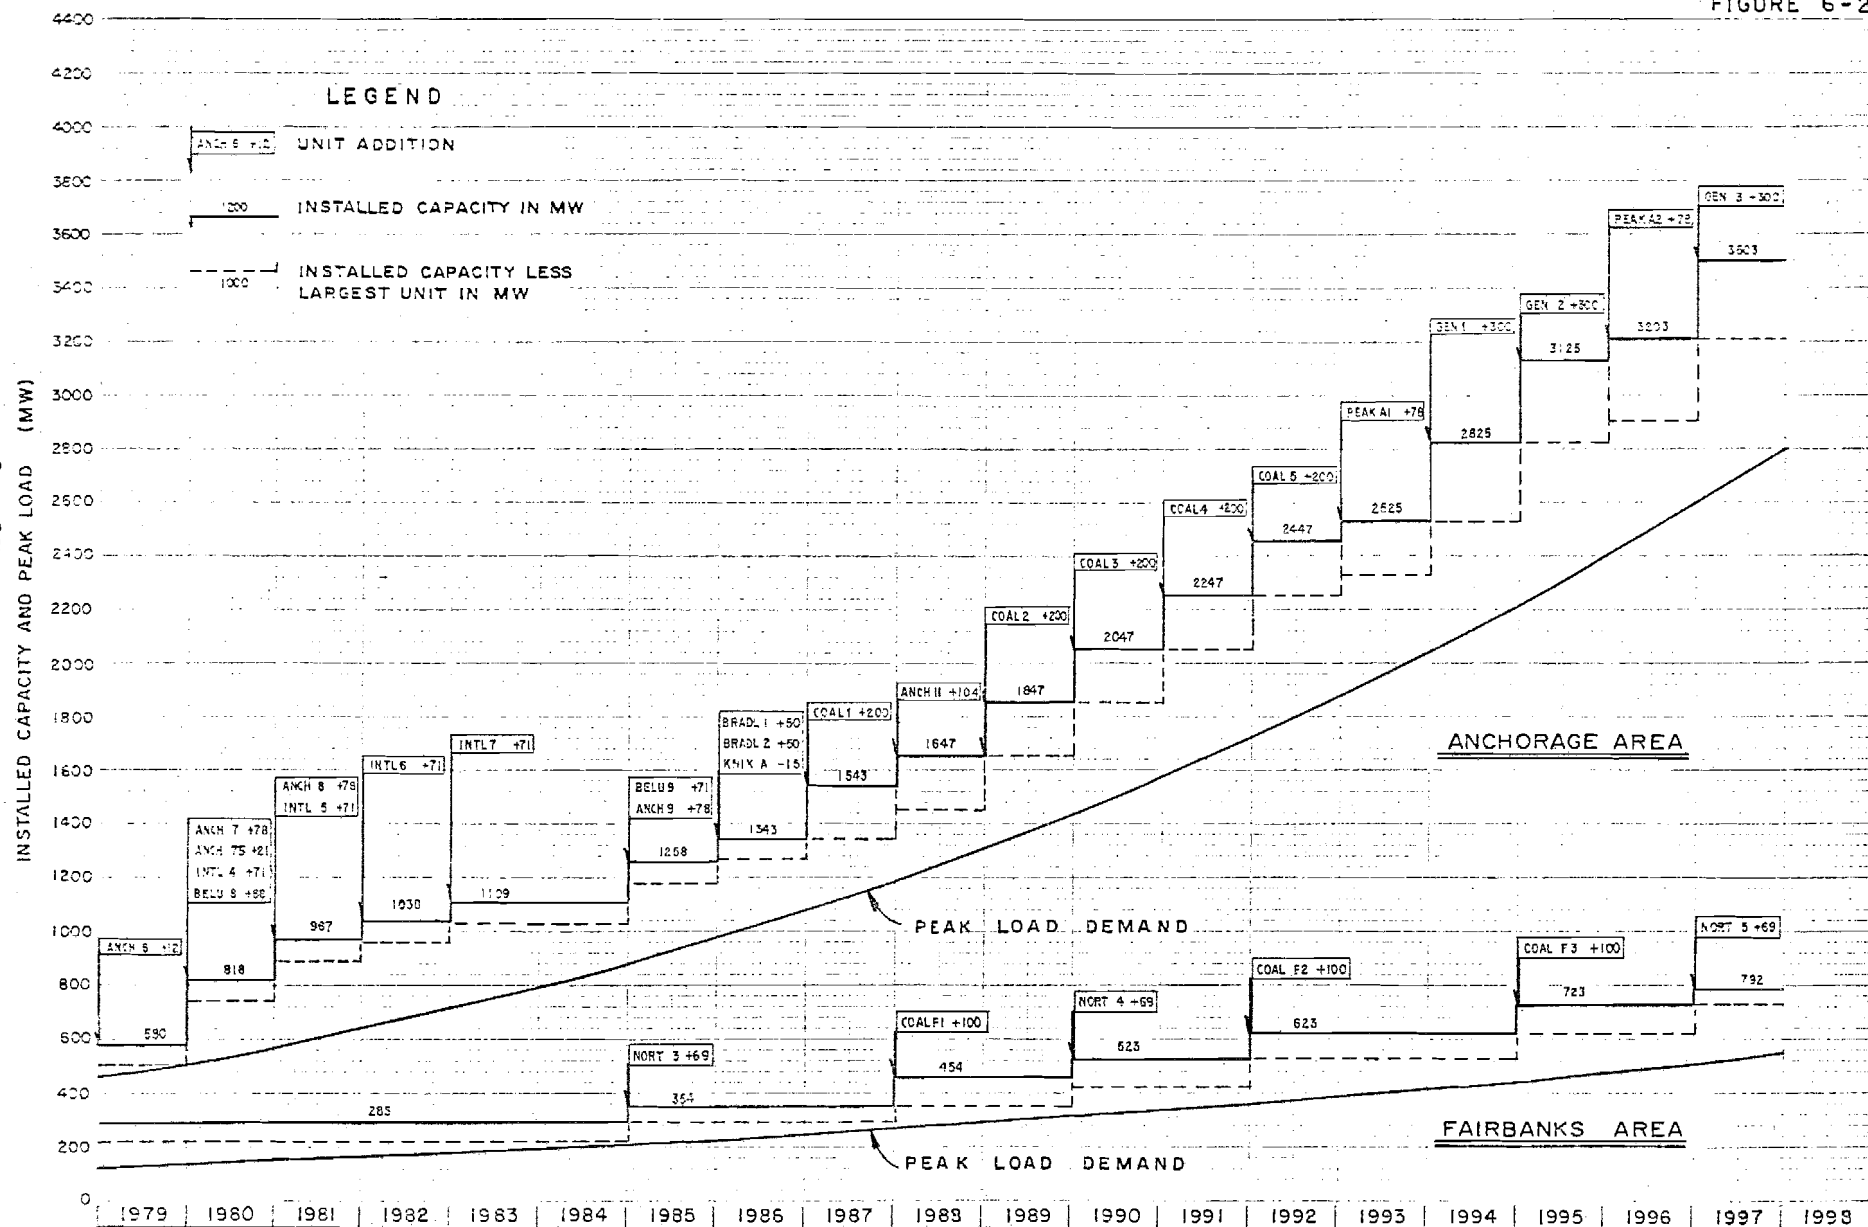

INDEPENDENT SYSTEM EXPANSION PLANS  
ANCHORAGE AND FAIRBANKS AREAS  
PROBABLE LOAD FORECAST CASE 8/79

FIGURE 6-3


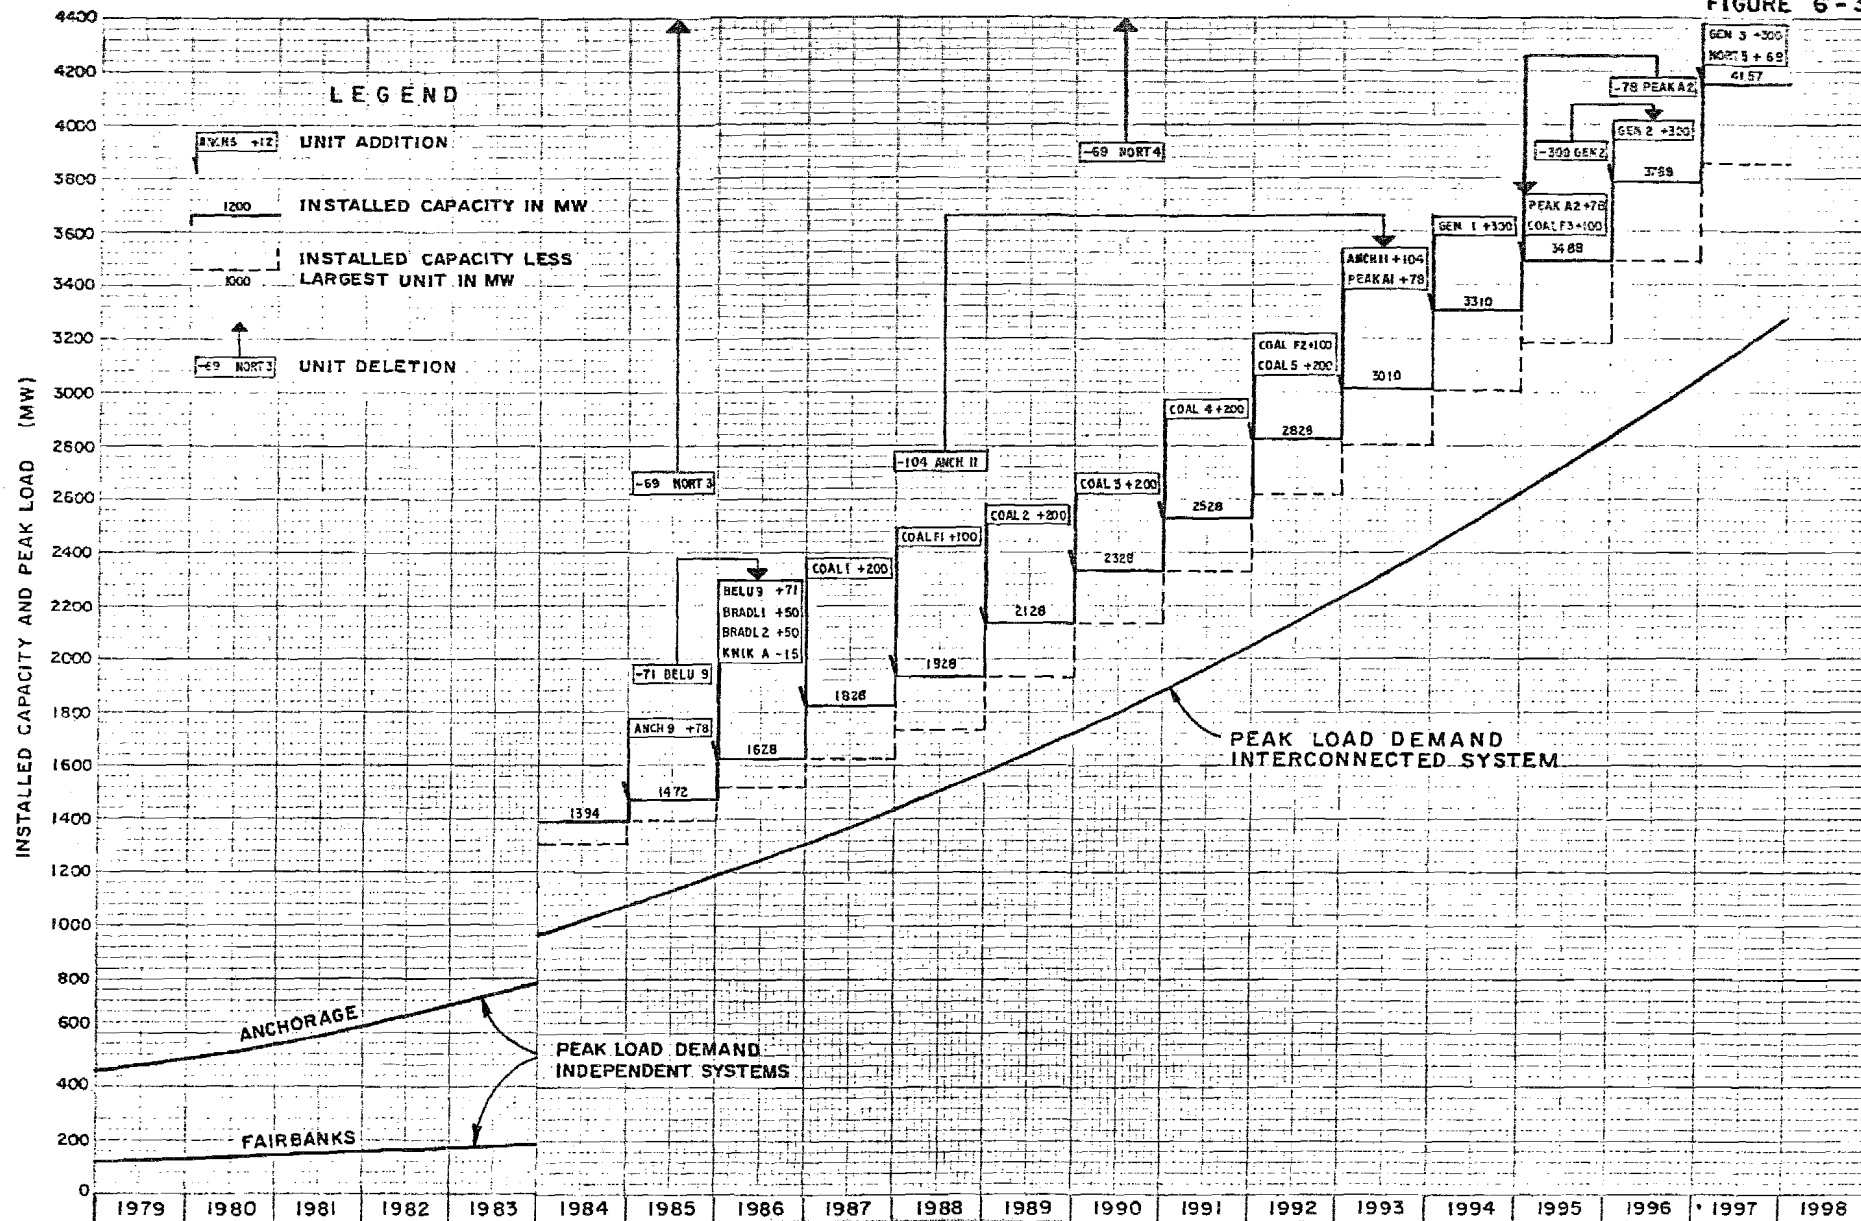


FIGURE 6-3  
CASE 1A & 1D

INTERCONNECTED SYSTEM EXPANSION PLAN  
ANCHORAGE - FAIRBANKS AREA  
WITHOUT SUSITNA PROJECT  
PROBABLE LOAD FORECAST CASE 8/79

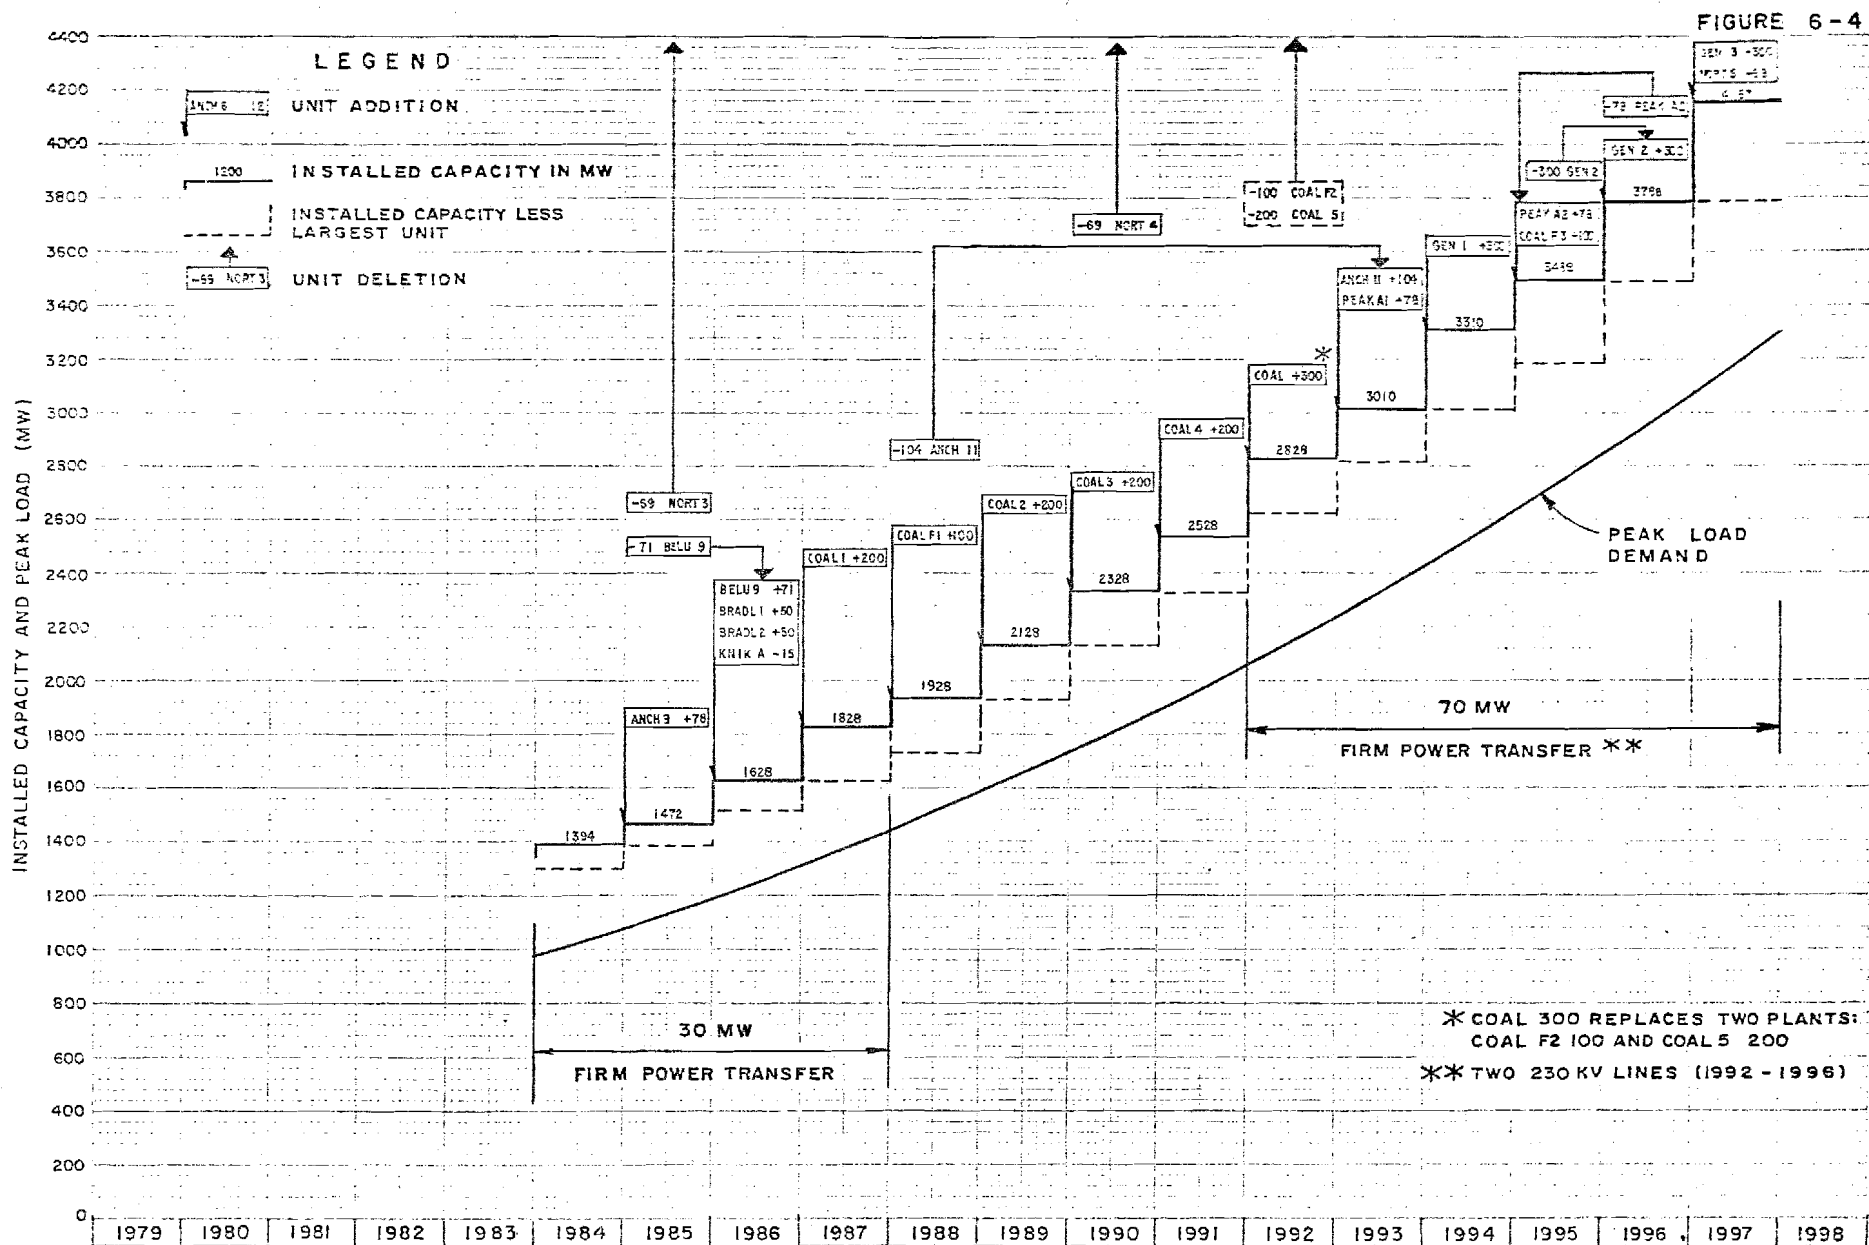

INTERCONNECTED SYSTEM EXPANSION PLAN  
ANCHORAGE - FAIRBANKS AREA  
WITH FIRM POWER TRANSFER  
PROBABLE LOAD FORECAST CASE 8/79


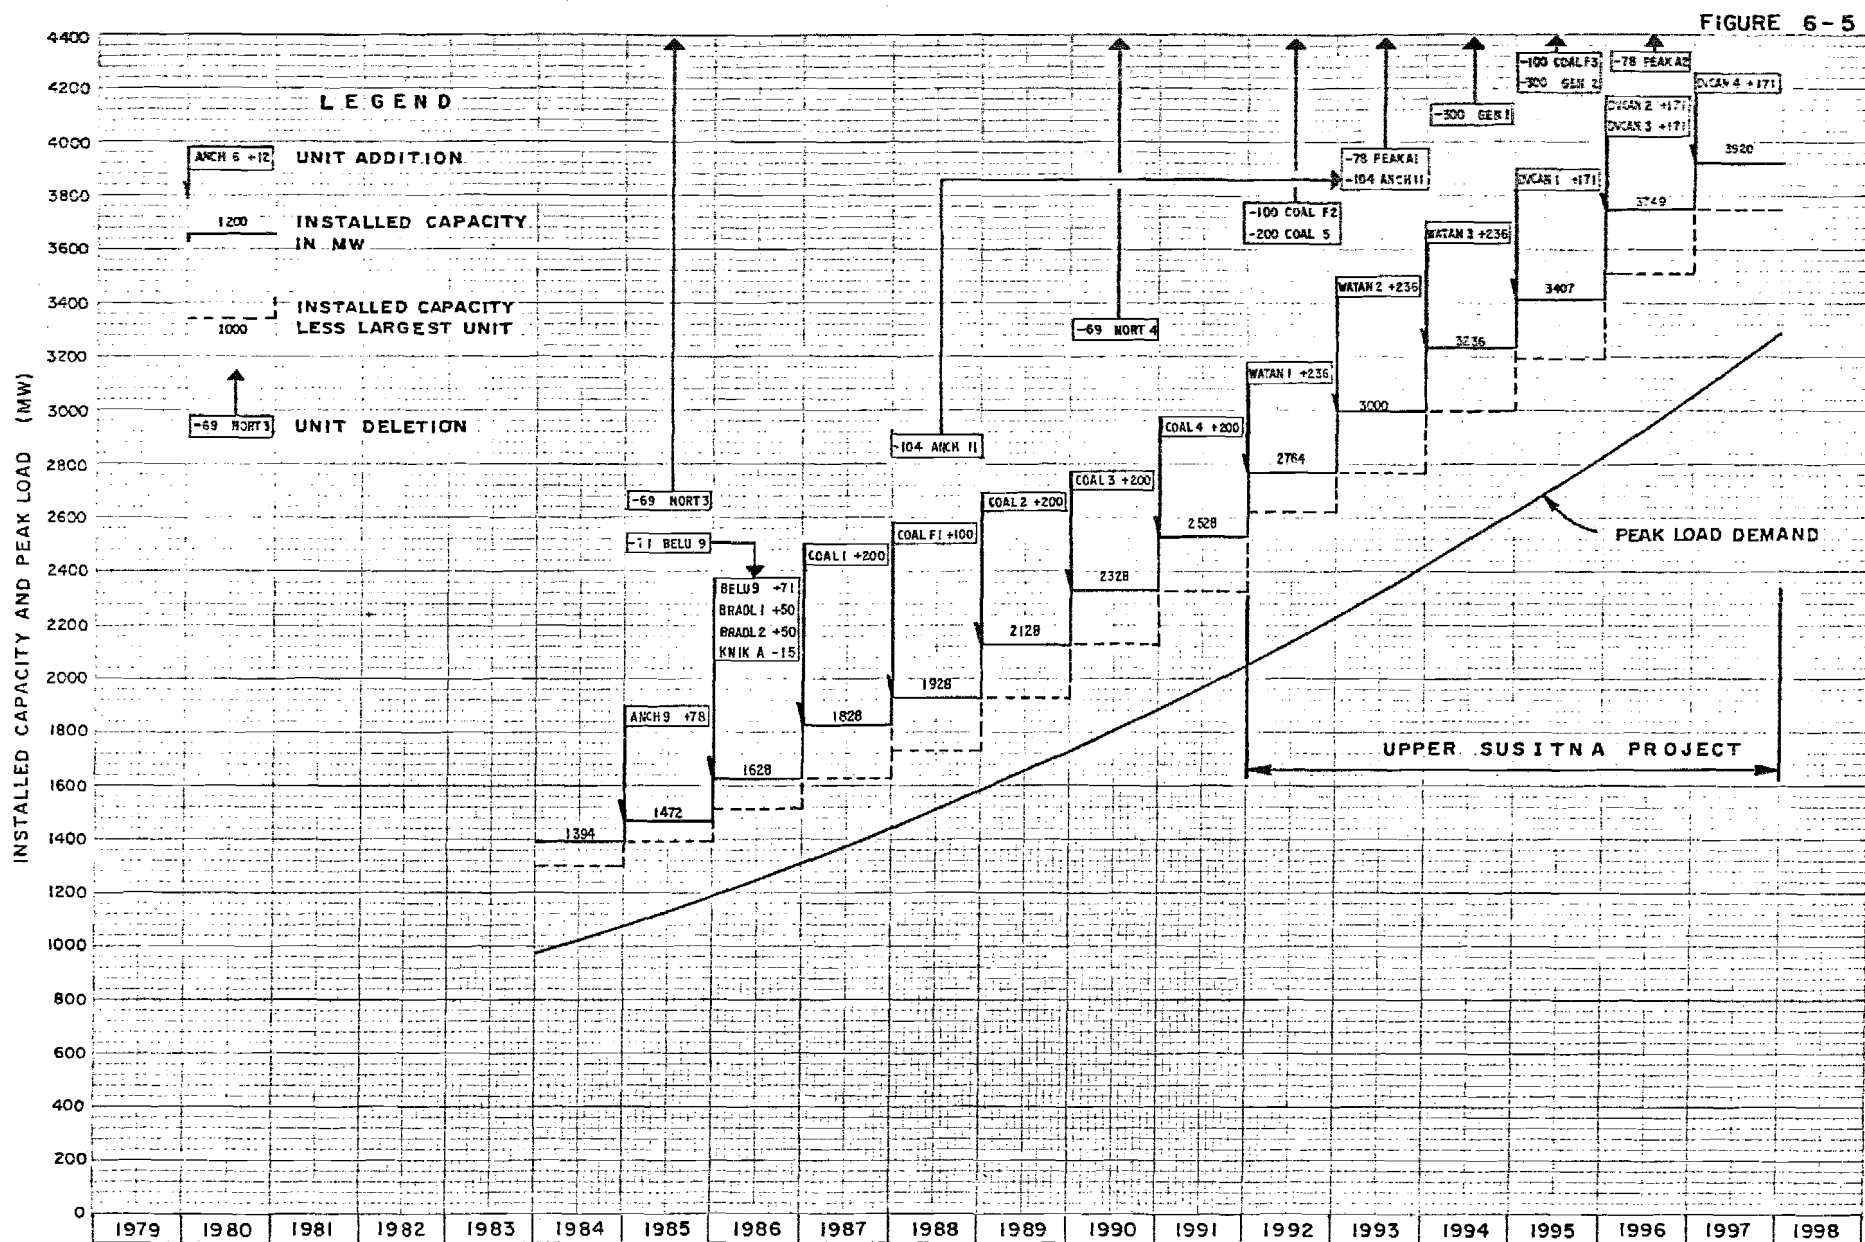


FIGURE 6-5  
CASE 11


INTERCONNECTED SYSTEM EXPANSION PLAN  
ANCHORAGE - FAIRBANKS AREA  
WITH UPPER SUSITNA PROJECT  
PROBABLE LOAD FORECAST CASE 8/79

FIGURE 6-6

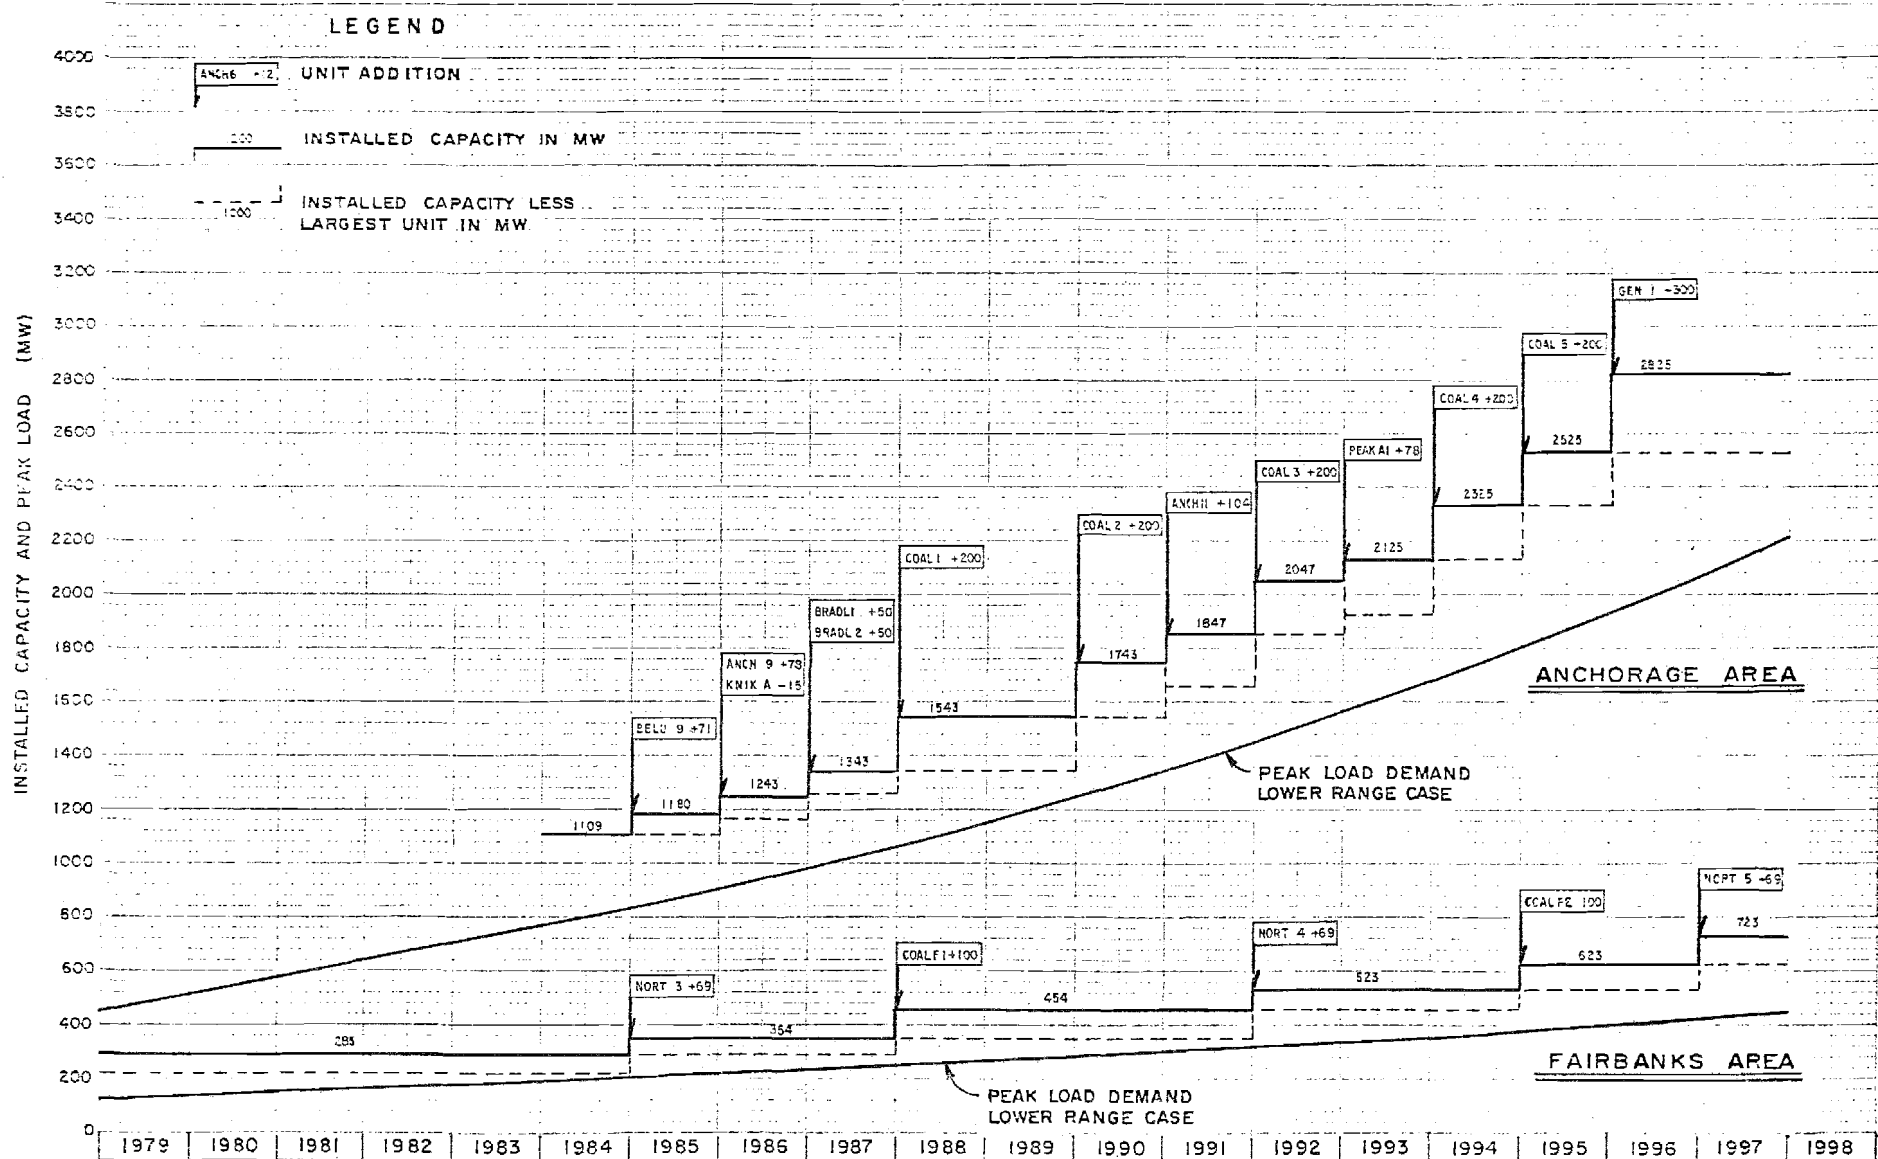

INDEPENDENT SYSTEM EXPANSION PLAN  
ANCHORAGE - FAIRBANKS AREA  
LOW LOAD FORECAST CASE


FIGURE 6-6

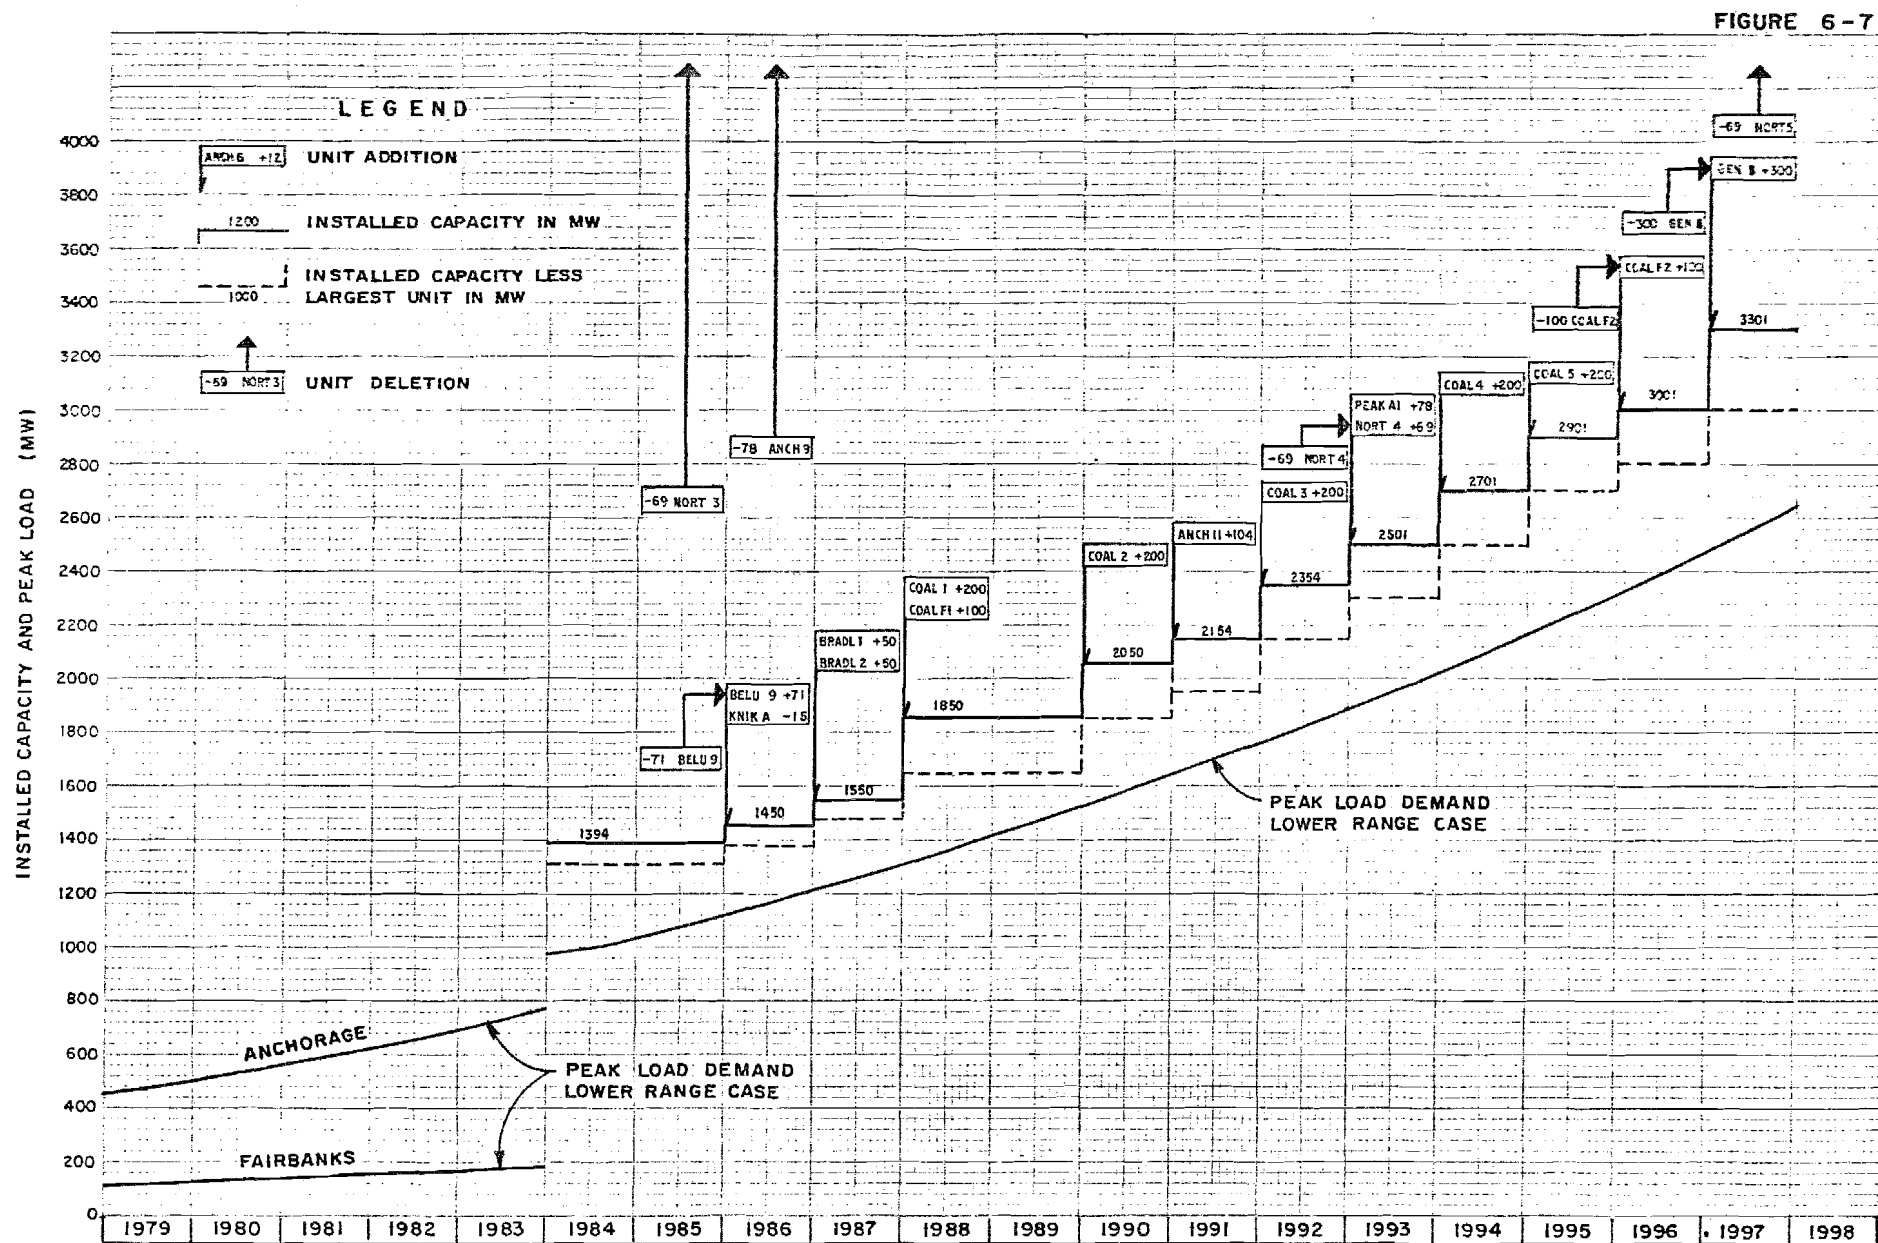

INTERCONNECTED SYSTEM EXPANSION PLAN  
ANCHORAGE - FAIRBANKS AREA  
LOW LOAD FORECAST CASE


FIGURE 6-7  
CASE 1A & 1D

FIGURE 6-8

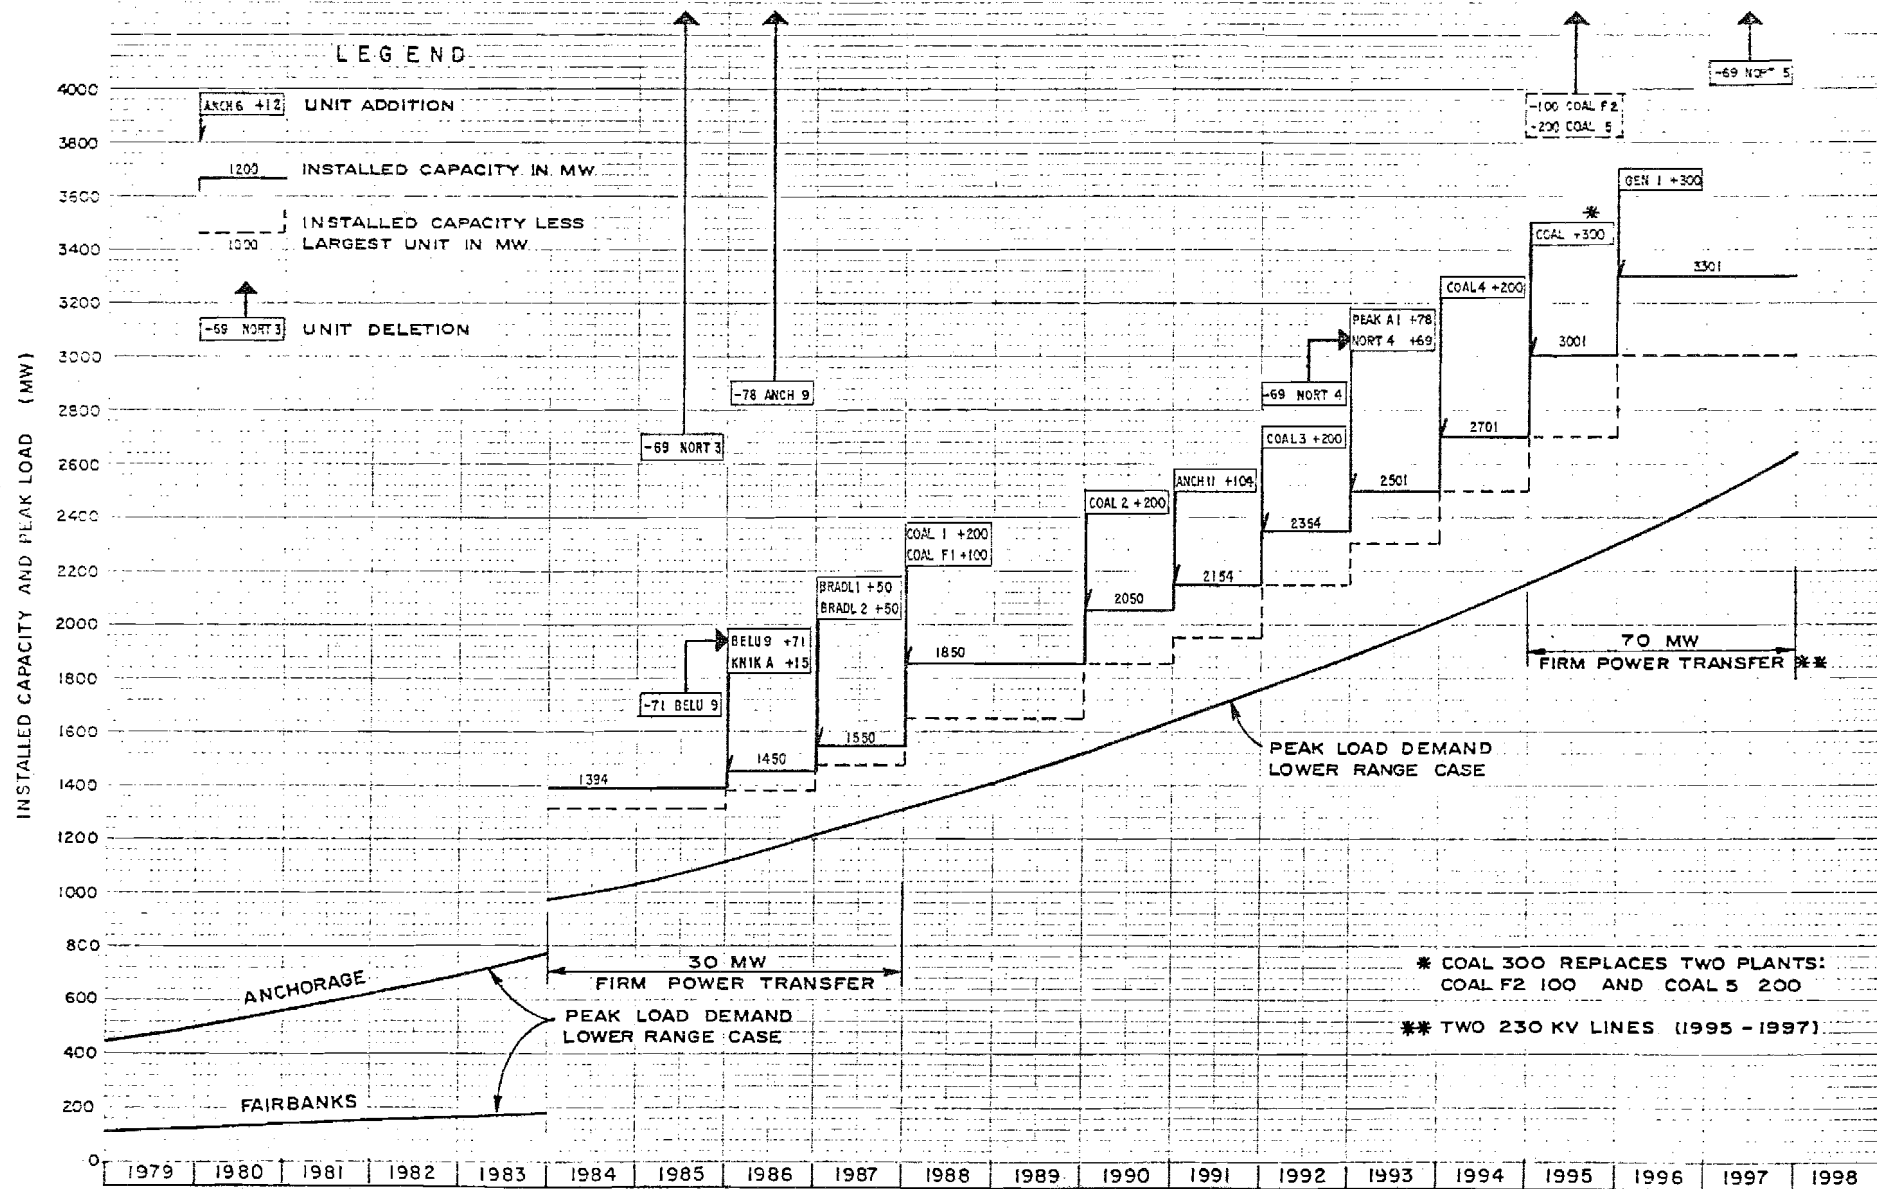

INTERCONNECTED SYSTEM EXPANSION PLAN  
ANCHORAGE-FAIRBANKS AREA  
LOW LOAD FORECAST CASE  
WITH FIRM POWER TRANSFER

FIGURE 6-8  
CASE 1B

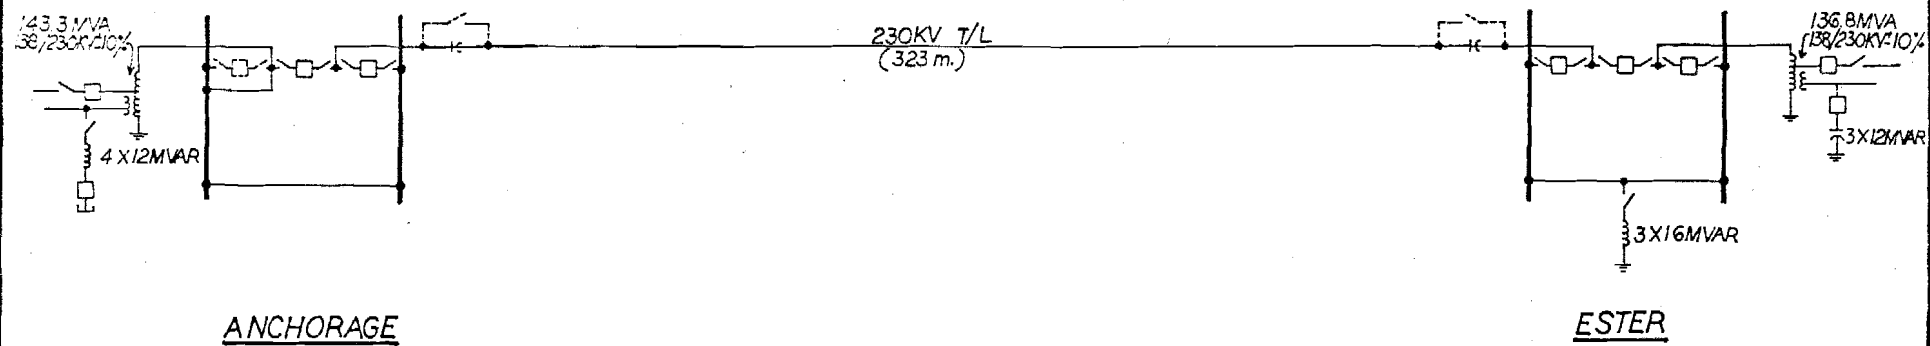

CASE I  
Alternatives A & B

FIGURE 6-9

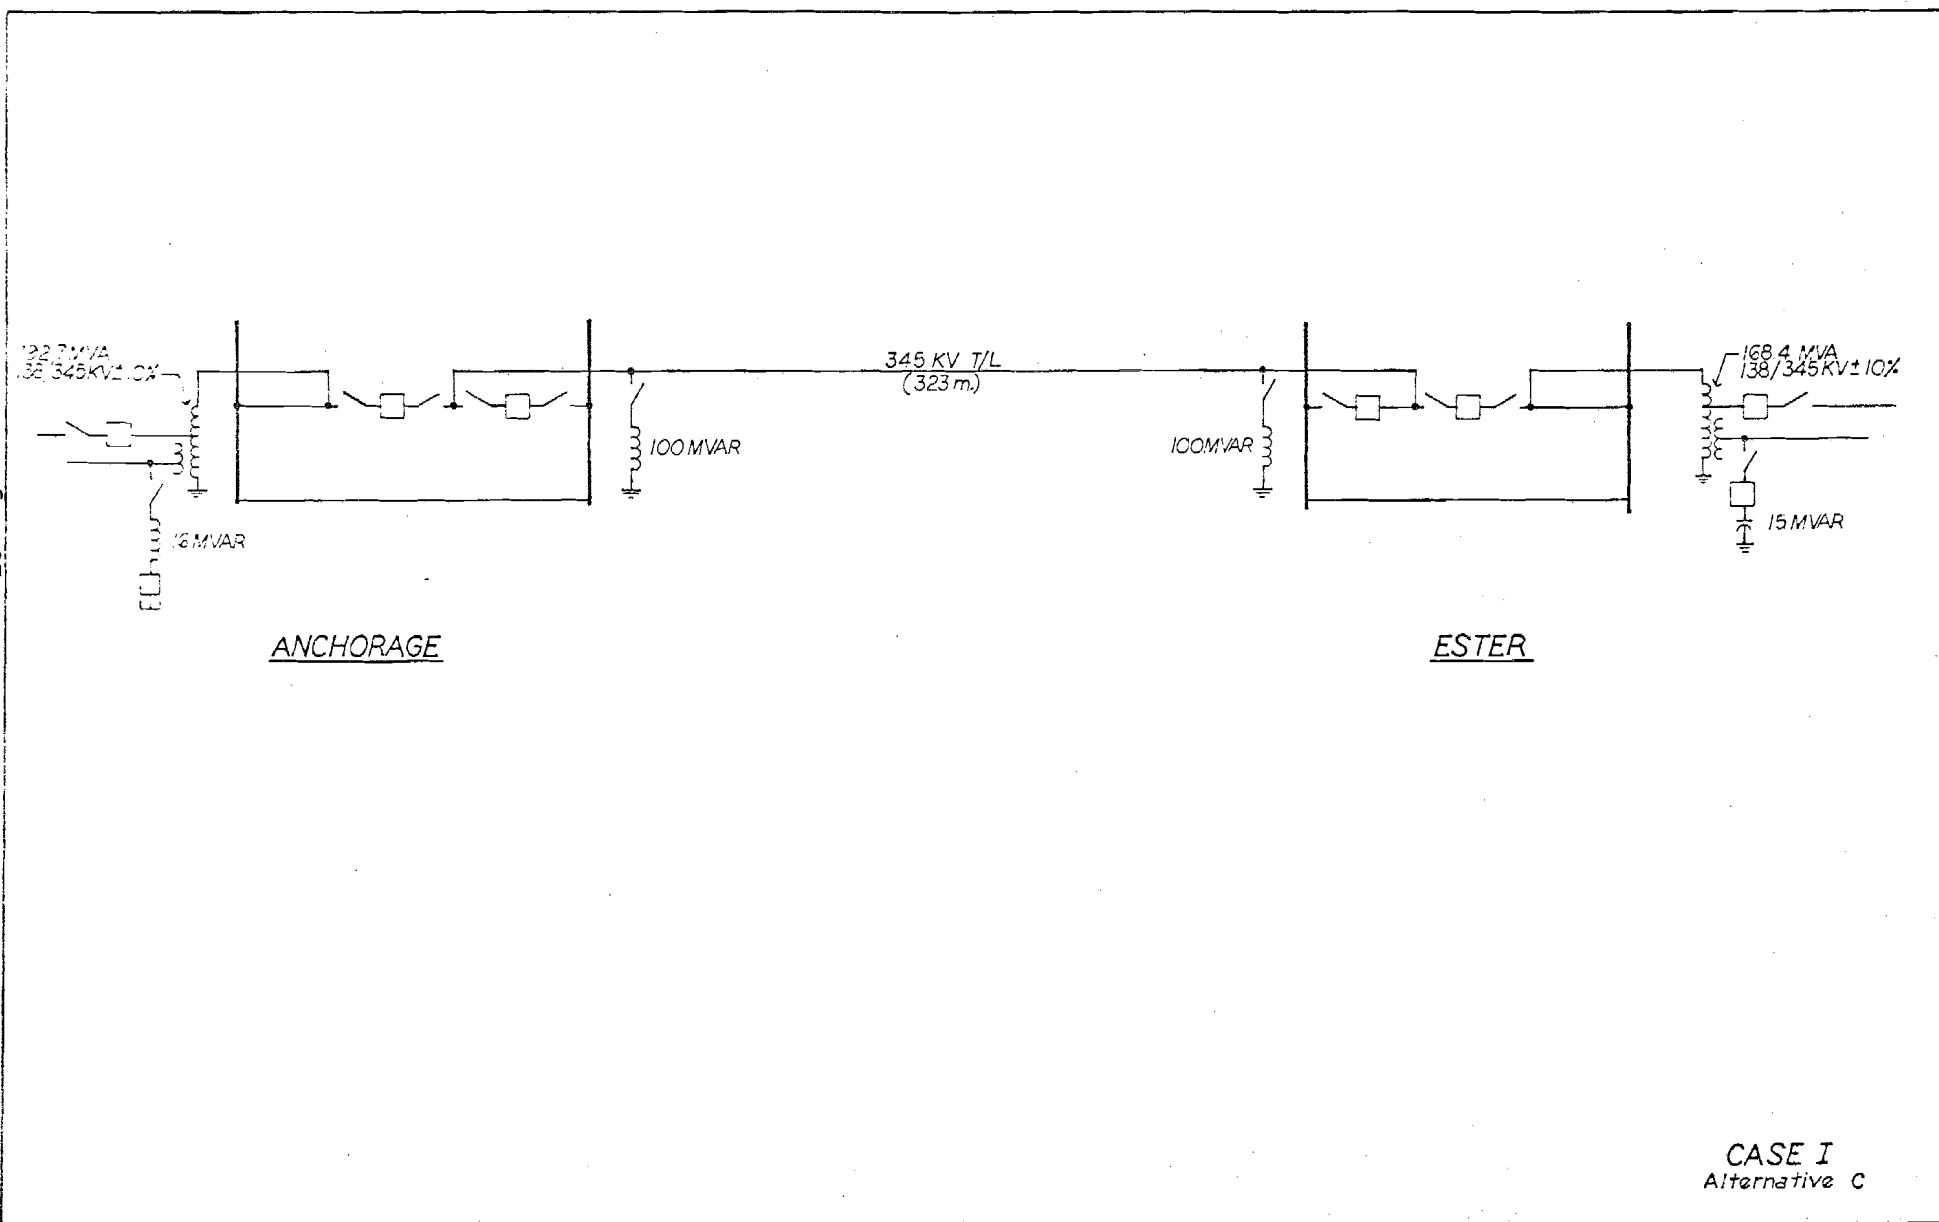


FIGURE 6-10


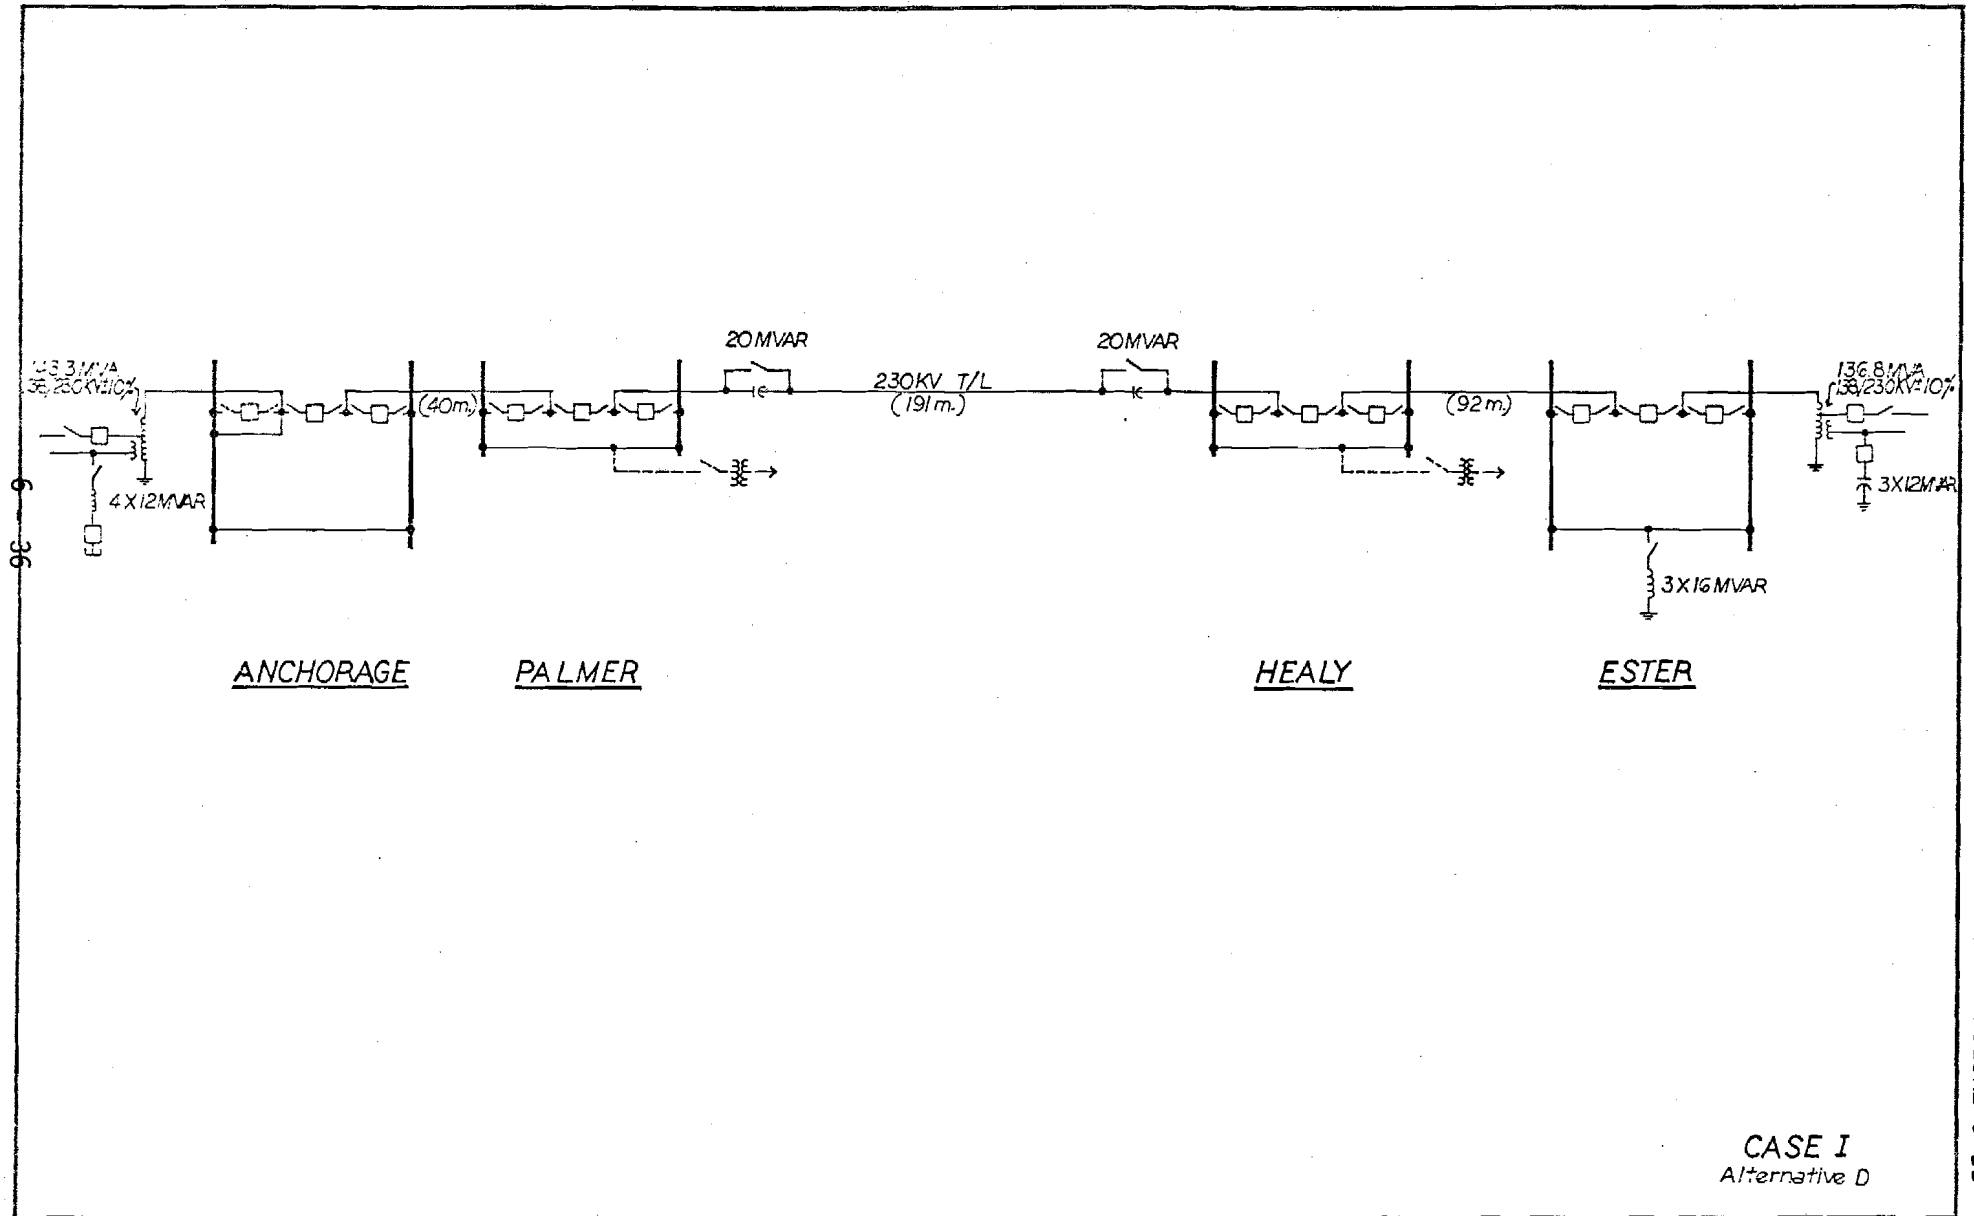


FIGURE 6-11

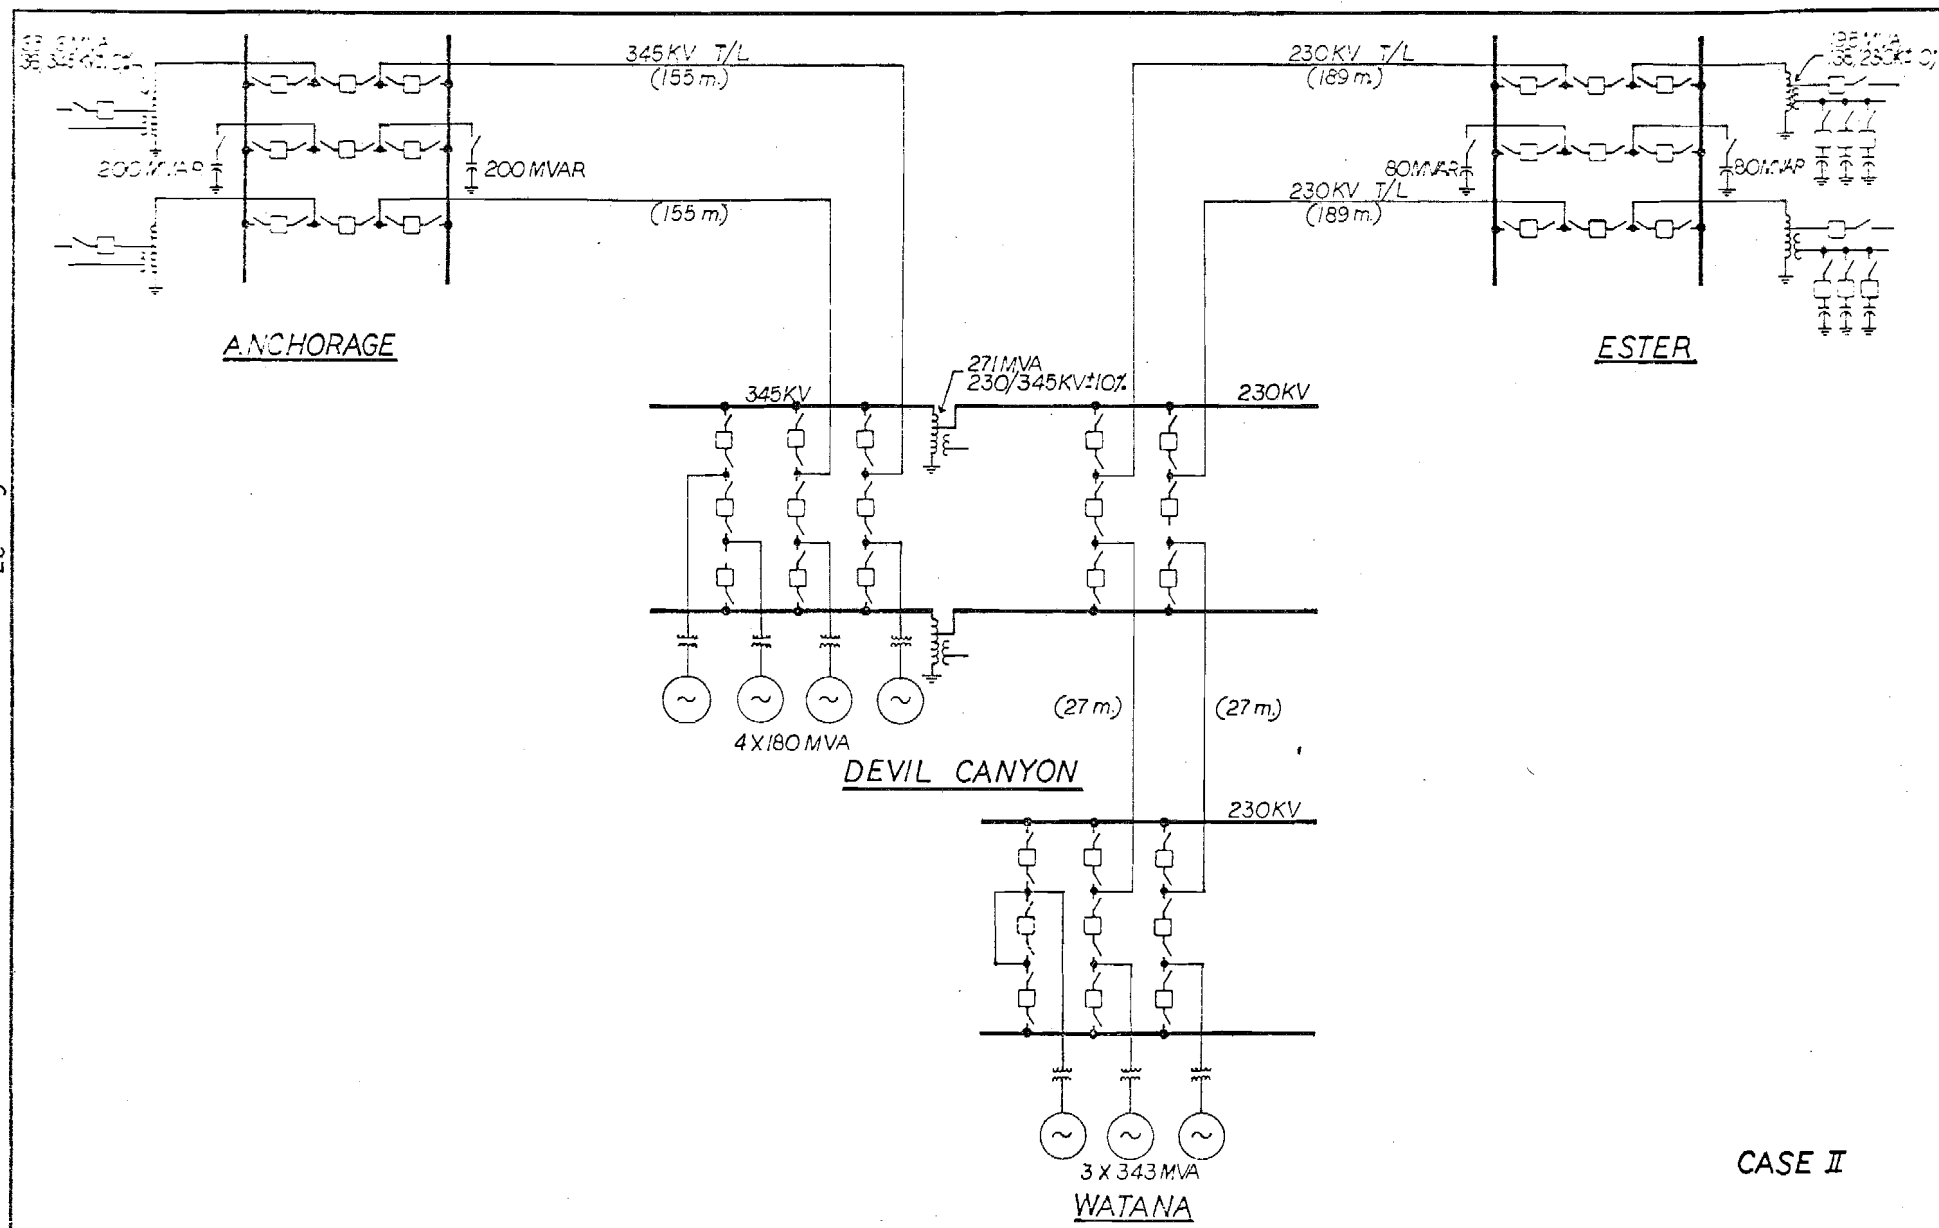

CASE II

FIGURE 6-12

CHAPTER 7  
FACILITY COST ESTIMATES

## CHAPTER 7 FACILITY COST ESTIMATES

### 7.1 TRANSMISSION LINE COSTS

The transmission line costs were obtained from past and current experience of the Consultants with the design and construction of transmission lines in Alaska. Cost data was escalated to 1979 levels and a factor of 1.46 (AVF = Average Value Factor) was applied to total costs to give an average value for construction in the area. The AVF includes a 10% addition for anticipated difficulty with the constraints associated with the selected line route.

#### A. Alaskan Experience

Facility cost estimates for alternative transmission intertie designs are based on an in-depth analysis of pertinent Alaskan transmission lines that have been built and are now in successful operation. Analyses were made based on actual experience to develop material and man-hour costs, together with specific installation requirements for structures, conductors, and footing assemblies. In addition, typical right-of-way clearing costs and other costs associated with the solicitation and obtainment of right-of-way easements, permits, and environmental reviews were gathered to provide representative costs for estimating component items for the Anchorage-Fairbanks Intertie.

The first Alaskan transmission line capable of operating at voltages as high as 230 kV was the Beluga Line. It was constructed for Chugach Electric Association (CEA) in 1967 by City Electric, Inc. of Anchorage. This line traverses about 42.5 miles of undeveloped land, of which about 65% was muskeg swamp. No roads existed to connect the line right-of-way to any highway or railroad, requiring that access be by water (Cook Inlet - Susitna River), by air (helicopter), or by ORV (off-road vehicle). One major river crossing was required along the transmission line route.

The Beluga Line was constructed of aluminum lattice, X-shape, hinged-guyed towers and Drake (795 kcmil ACSR) conductor by the Contractor. Using one tower assembly yard at Anchorage, the Contractor made extensive use of helicopter delivery of men and materials with ORV equipment during winter weather to construct the line. This project was completed at a cost of about \$50,000 per mile, including right-of-way clearing.

The hinged-guyed, X-shaped tower proved successful and has since been used for the following lines described below.

1. Knik Arm Transmission Line - 230 kV (Aluminum Lattice Towers, 795 kcmil Drake ACSR Conductor), 1975. This line was built using Owner-furnished material by force account and contract methods. The Owner (CEA) installed the piling and anchors, and contracted for the right-of-way clearing, tower erection, and wire stringing. Piling and anchors were installed using ORV equipment to carry the power tool for installing anchors and the Del Mag-5 diesel hammer and welding equipment for the piling work. City Electric, Inc. accomplished the tower erection and wire stringing using helicopter and ORV equipment.

<u>Summary of Actual Costs:</u>	<u>\$/Mile</u>
Construction Cost	87,294
Right-of-way Clearing Cost	19,049
Right-of-way Solicitation Cost	<u>7,706</u>
TOTAL (w/o Engineering)	114,049

2. Willow Transmission Line - 115 kV (Tubular Steel Towers, 556.5 kcmil Dove ACSR Conductor), 1978. This line was built by contract using Owner-furnished material. Right-of-way clearing was accomplished by one contractor and line construction by another (Rogers Electric - an experienced Alaska contractor). This line contractor used a vibratory driver to install the 8" H-pile with great success. (This driver has since been used to drive 10" H-pile for another line. In one case, the tool drove a 14" H-pile for a sign support. The contractors are preparing

to drive more 14" piles for a new CEA line.) The introduction of the vibratory pole-driving technique, together with the application of the tubular steel, hinged-guyed, X-tower is expected to realize substantial cost savings on future transmission line projects.

<u>Summary of Actual Costs:</u>	<u>\$/Mile</u>
Construction Cost	73,863
Right-of-way Clearing Cost	10,312
Right-of-way Solicitation Cost	<u>4,909</u>
TOTAL (w/o Engineering)	89,084

#### B. Material Costs

The estimated cost for the tower steel, as well as the physical characteristics were obtained from ITT Meyer Industries (Ref. 1). The cost of steel, therefore, has 1979 as the reference year.

The cost of foundation steel was taken to be \$0.31 per lb for WG Beam. This value is somewhat conservative, as the current market price is \$0.22 per lb.

Prices for insulators and conductors have a reference year of 1977; thereafter, the price was escalated at 7 percent per year through 1979. The cost of right-of-way was based on actual average values paid by utilities in the same area as the proposed lines. Other factors used, that provide good indication of projected costs for the transmission line are:

- Terrain Factor - This factor is used to correct the number of calculated towers per mile to actual towers per mile.
- Line Angle Factor - This factor is used to increase the effective transversal load on the tower, and accounts for the 3<sup>0</sup> design-angle for the towers.

- Tower Weight Factor - This factor is used to increase the total estimated tower weight, to account for heavy angle and dead-end towers.

C. Labor Costs

Labor costs were obtained from actual construction experience, obtained by the Consultants' construction records for transmission lines built in Alaska. This information included the cost of labor and a detailed breakdown of the man-hours required for every specific task included in the construction program. A multiplier of 1.33 was applied to the estimated cost of labor for this period, which then was multiplied by 1.1 as explained in 7.1 above to obtain the 1.46 AVF indicated above.

D. Transportation Costs

An estimated unit cost of \$100 per ton was taken to represent the transportation and shipping costs from the Pacific Northwest to the line route staging depot, including loading and unloading (Ref. 2).

7.2 SUBSTATIONS COSTS

For this report, the facility costs for substations were obtained from the U.S. Department of Energy 1978 version of the previous FPC publication "Hydroelectric Power Evaluation" (Ref. 3). As the values included in the publication are list prices, with 1977 as reference year, they were adjusted to 1979 values by using the U.S. Bureau of Reclamation Index (Ref. 4). The cost of the substations includes the shunt compensation, required at both ends, for operation from no-load to full-load. No reactive power (VAR) compensation support from the source generators was considered in this study.

### 7.3 CONTROL AND COMMUNICATIONS SYSTEM COSTS

Control and communications systems costs are included in the intertie cost estimates. The system is necessary to provide effective control of power system operations, and economic energy dispatch throughout the inter-connected Anchorage-Fairbanks area. The cost estimates include a power line carrier type communications system, a digital supervisory control and data acquisition (SCADA) system, and automatic generation control equipment.

### 7.4 TRANSMISSION INTERTIE FACILITY COSTS

As previously discussed in Chapter 5, transmission line costs were calculated using TLCAP. Computer printout sheets indicating input data and the calculated results for all five intertie alternatives are shown in Appendix B. Costs for substation facilities and the control and communications system were added to the transmission line costs, thus obtaining the investment cost for the total intertie facilities. A cost summary for each of the five alternatives studied is presented in Table 7-1. Detailed cost estimates and supporting data are included in Appendix D.

### 7.5 COST OF TRANSMISSION LOSSES

The Transmission Line Optimization Program (TLCAP) for the selection of the optimum span-conductor combination, includes the cost of demand and energy losses for long transmission lines. The loss components are optimized by varying the voltages at the receiving and sending ends. The program assumes 100 percent volt support at both ends. Table 7-2 presents the present worth (1979) costs of calculated transmission line energy and demand losses.

## 7.6 BASIS FOR GENERATING PLANT FACILITY COSTS

Cost estimates were prepared for all new generating plants (five gas-turbine units and five coal-fired steam plants), and associated substation and transmission facilities which will be affected by the transmission interconnection. The costs for the facilities are summarized in Table 7-3.

The most recent cost data and estimates available for both gas-turbine and coal-fired steam plants planned for the Railbelt area was used as a basis for the generating plant estimates. The three principal sources of cost data and information are included in the references at the end of this chapter. The Battelle study report (Ref. 2) provided background information and specific factors to determine applicable Alaskan construction cost location adjustment factors. The Stanley Consultants report to GVEA (Ref. 5) provided detailed cost estimates for both the 104-MW coal-fired plant at Healy and combustion turbines at the Northpole substation in Fairbanks. These estimates were then used to derive reference costs for other gas-turbine and coal-fired units of different capacity at other Railbelt sites. The nomogram developed by Arkansas Power & Light Company (Ref. 6) was used to determine the 100-MW reference cost estimate from reported costs relevant to the 104-MW coal-fired plant at Healy. The same nomogram was then used to determine plant costs for unit ratings of 200 and 300 MW, taking into consideration economies of scale. Subsequently, the Alaskan construction cost location adjustment factors were applied to derive site specific cost estimates.

Cost estimates for the associated transmission facilities were obtained from cost data developed during this study for the transmission intertie, the Stanley Consultants report (Ref. 5), and typical costs experienced in recent Alaskan transmission projects.

The cost estimates and supporting data are contained in Appendix D.

## 7.7 GENERATING PLANT FUEL COSTS

Benefits in addition to those resulting from generation reserve capacity sharing will result from the supply of firm power over the intertie. An analysis was made of the relative generation costs for both independent and interconnected system expansions to determine the comparative economic advantage of firm power interchange. The fuel cost component of operating expenses is the salient factor which affects the economic comparison of alternative system expansions. Therefore, a year-by-year analysis of alternative modes of generation was completed for each period during which firm power transfer over the intertie is possible, as follows:

From	To	Duration	Transmission Intertie Firm Power Transfer			
			Capacity	% Power Loss <sup>1/</sup>	Energy <sup>2/</sup>	% Energy Loss <sup>1/</sup>
1984	1987	4 yrs.	30 MW	6.9	145 GWh	1.05
1992	1996	5 yrs.	70 MW	6.9	337 GWh	1.05

<sup>1/</sup> Case IB.

<sup>2/</sup> Annual Transmission Capacity Factor of 0.55 assumed for analysis.

Fuel costs were estimated utilizing the trend curves from the Battelle report for future natural gas and coal prices in the Railbelt area. The energy loss component of firm power transfer over the intertie was considered, in estimating the total cost of fuel required to generate sufficient energy in one area to displace a block of energy otherwise generated by a local plant in an independently supplied area.

A year-by-year analysis of the comparative cost of generation is given in Appendix D. Table 7-4 summarizes these costs. Although this analysis is germane to the confirmation of salient considerations regarding the economic feasibility of the intertie, this level of study of fuel costs is in no way a definitive substitution for a detailed year-by-year analysis of production costing for the multi-area interconnection.

## 7.8 MEA UNDERLYING SYSTEM COSTS

The construction of transmission intertie with the intermediate substation at Palmer (Case ID) provides an opportunity for Matanuska Electric Association (MEA) to purchase power at the intermediate substation at Palmer. Information in the System Planning Report (Ref. 8) indicates the following MEA system expansion investment cost for transmission lines and substation facilities with and without the intertie:

Interconnected System	\$1,356,000 (1987)
Independent System	\$6,646,000 (1987)
Independent System	\$2,004,000 (1992)

The above costs are in 1979 dollars, values were escalated by 10% from 1978 to 1979 level. These values were used in an economic analysis to obtain additional benefits for Case ID.

## 7.9 CONSTRUCTION POWER COSTS FOR THE UPPER SUSITNA PROJECT

Completion of the transmission interconnection, prior to the development of the Watana and Devil Canyon sites of the Upper Susitna Project will enable the supply of electrical energy for construction power. A temporary wood-pole line to the sites will be supplied from a transmission tap along the intertie route, near the junction of the site access road with the main highway between Anchorage and Fairbanks. Generally, isolated diesel generation is used at such remote hydropower plant sites.

A comparison was made of the relative costs of isolated diesel generation and energy supply to the sites via the tap-line. Table 7-5 shows alternative cost streams through the construction period corresponding to the introduction of the Watana and Devil Canyon units to the interconnected Railbelt generation expansion, shown on Figure 6-5. The construction schedule, as outlined on page 94 of the Interim Feasibility Report (Ref. 7),

was followed to establish the time frame for economic comparison of alternative modes of construction power supply. Results of the economic comparison indicate a clear advantage for utilizing the intertie as a source of construction power.

#### 7.10 REFERENCES

1. Letter from ITT Meyer Industries to R. W. Retherford Associates, Anchorage, Alaska, January 15, 1979.
2. Battelle Pacific Northwest Laboratories, Alaska Electric Power: An Analysis of Future Requirements and Supply Alternatives for the Railbelt Region, March 1978.
3. DOE, Federal Energy Regulatory Commission, Hydroelectric Power Evaluation (Final Draft), August 1978.
4. U.S. Bureau of Reclamation, "BuRec Construction Costs", Engineering News Record, 22 March 1979.
5. Stanley Consultants, Power Supply Study - 1978, Review Copy of Report to Golden Valley Electric Association, Inc.
6. Power Engineering, "Nomogram calculates economy of scale in power plants", Volume 83, February 1979.
7. U.S. Army Corps of Engineers, South-Central Railbelt Area, Alaska, Upper Susitna River Basin Interim Feasibility Report, December 1975.
8. Robert W. Retherford Associates, System Planning Report, Matanuska Electric Association, Inc., January 1979.

TABLE 7-1

COST SUMMARY FOR INTERTIE FACILITIES<sup>1/</sup>

	Total Cost at 1979 Levels (\$1000)				
	Case IA	Case IB	Case IC	Case ID	Case II
1. <u>Transmission Line:</u>					
Eng'g. & Constr. Supv.	3,012	3,012	7,988	3,012	15,442
Right-of-Way	8,837	8,837	7,573	8,837	12,994
Foundations	8,445	8,445	12,160	8,445	22,966
Towers	21,615	21,615	33,990	21,615	64,974
Hardware	477	477	477	477	1,096
Insulators	503	503	755	503	1,396
Conductor	<u>10,761</u>	<u>10,761</u>	<u>17,663</u>	<u>10,761</u>	<u>36,946</u>
Subtotal	53,650	53,650	80,606	53,650	155,814
2. <u>Substations:</u>					
Eng'g. & Constr. Supv.	1,352	1,352	1,855	2,816	6,902
Land	57	57	46	81	185
Transformers	1,703	1,703	3,291	1,703	11,917
Circuit Breakers	1,093	1,093	1,323	1,953	6,410
Station Equipment	1,223	1,223	1,933	1,345	4,375
Structures & Accessories	<u>3,628</u>	<u>3,628</u>	<u>3,978</u>	<u>4,026</u>	<u>16,411</u>
Subtotal	9,056	9,056	12,426	11,924	46,200
3. <u>Control and Communications:</u>					
Eng'g. & Constr. Supv.	125	125	125	165	200
Equipment	<u>2,375</u>	<u>2,375</u>	<u>2,375</u>	<u>3,135</u>	<u>3,600</u>
Subtotal	<u>2,500</u>	<u>2,500</u>	<u>2,500</u>	<u>3,300</u>	<u>3,800</u>
Total Baseline 1979 Costs	<u>65,206</u>	<u>65,206</u>	<u>95,532</u>	<u>68,874</u>	<u>205,814</u>

<sup>1/</sup> The interest and escalation during the construction and other financial charges are excluded from the costs in this summary. These costs are not relevant for the economic analysis and they appear only in the financial analysis (See Chapter 9 for Case ID).

TABLE 7-2

PRESENT WORTH OF INTERTIE LINE LOSSES  
1984-1997 STUDY PERIOD<sup>1/</sup>

<u>Case</u>	<u>\$ x 1000 (1979)</u>
IA & ID (230 kV)	5,410
IB (230 kV)	7,071
IC (345 kV)	6,429
II A (230 & 345 kV)	
Anchorage - Devil Canyon	11,476
Devil Canyon - Ester	7,076
Watana - Devil Canyon	<u>2,708</u>

<sup>1/</sup> Cost of losses, energy, and demand, escalated at 3% per year.

TABLE 7-3

COST SUMMARY FOR GENERATING FACILITIES<sup>5/</sup>  
(Costs at 1979 Levels<sup>1/</sup>)

Unit Name	Code <sup>2/</sup>	Type <sup>3/</sup>	MW	Installed Cost		Total Cost <sup>4/</sup>	
				Thousand \$	\$/kW	Thousand \$	\$/kW
Northpole #3	NORT 3	SCGT	69	24,385	353	27,934	405
Beluga #9	BELU 9	SCGT	71	33,548	473	42,498	598
Northpole #4	NORT 4	SCGT	69	24,385	353	25,185	365
Anchorage	PEAK A2	SCGT	78	22,620	290	23,400	300
Northpole #5	NORT 5	SCGT	69	24,385	353	25,185	365
Anchorage #11	ANCH 11	Coal	104	99,084	953	105,636	1016
Unit F2	COAL F2	Coal	100	130,000	1300	151,980	1520
Unit No. 5	COAL 5	Coal	200	200,000	1000	212,245	1061
Unit No. 6	COAL 6	Coal	300	274,000	913	292,250	974
Unit No. 1	GEN 1	Coal	300	274,000	913	292,250	974
Unit No. 2	GEN 2	Coal	300	274,000	913	292,250	974

<sup>1/</sup> Investment costs adjusted to January 1979 levels, excluding IDC.

<sup>2/</sup> Code name used in MAREL study.

<sup>3/</sup> SCGT - Simple cycle combustion turbine, includes NO<sub>x</sub> removal equipment.  
COAL - Steam turbine, coal-fired with FGD equipment.

<sup>4/</sup> Total cost includes substation and transmission costs.

<sup>5/</sup> The interest and escalation during the construction and other financial charges are excluded from the costs in this summary. These costs are not relevant for the economic analysis and they appear only in the financial analysis.

TABLE 7-4

SUMMARY  
OF  
ALTERNATIVE GENERATING PLANT FUEL COSTS

<u>Year</u>	<u>\$ 1000 (Escalated)</u>	
	<u>Independent System Operation</u>	<u>Interconnected System Operation</u>
1984	-	-
1985	8,468	7,648
1986	9,324	8,498
1987	10,267	9,029
1992	6,851	8,324
1993	7,212	8,654
1994	7,933	8,016
1995	8,654	8,745
1996	9,015	9,109


TABLE 7-5

ALTERNATIVE COSTS FOR CONSTRUCTION POWER SUPPLY  
TO  
WATANA AND DEVIL CANYON HYDROPOWER SITES  
DURING  
CONSTRUCTION OF UPPER SUSITNA PROJECT

<u>Year</u>	<u>1979 Baseline Costs - \$1000</u>	
	<u>Isolated Diesel Generation at Site</u>	<u>Tapline Supply From Intertie</u>
1985	2,835	267
1986	695	483
1987	697	481
1988	696	478
1989	3,055	752
1990	1,324	902
1991	187	734
1992	623	430
1993	623	419
1994	-500 <sup>1/</sup>	304

<sup>1/</sup> Negative sign indicates that resale value of generating plant exceeds cost of generation in final year.

FIGURE 7-1

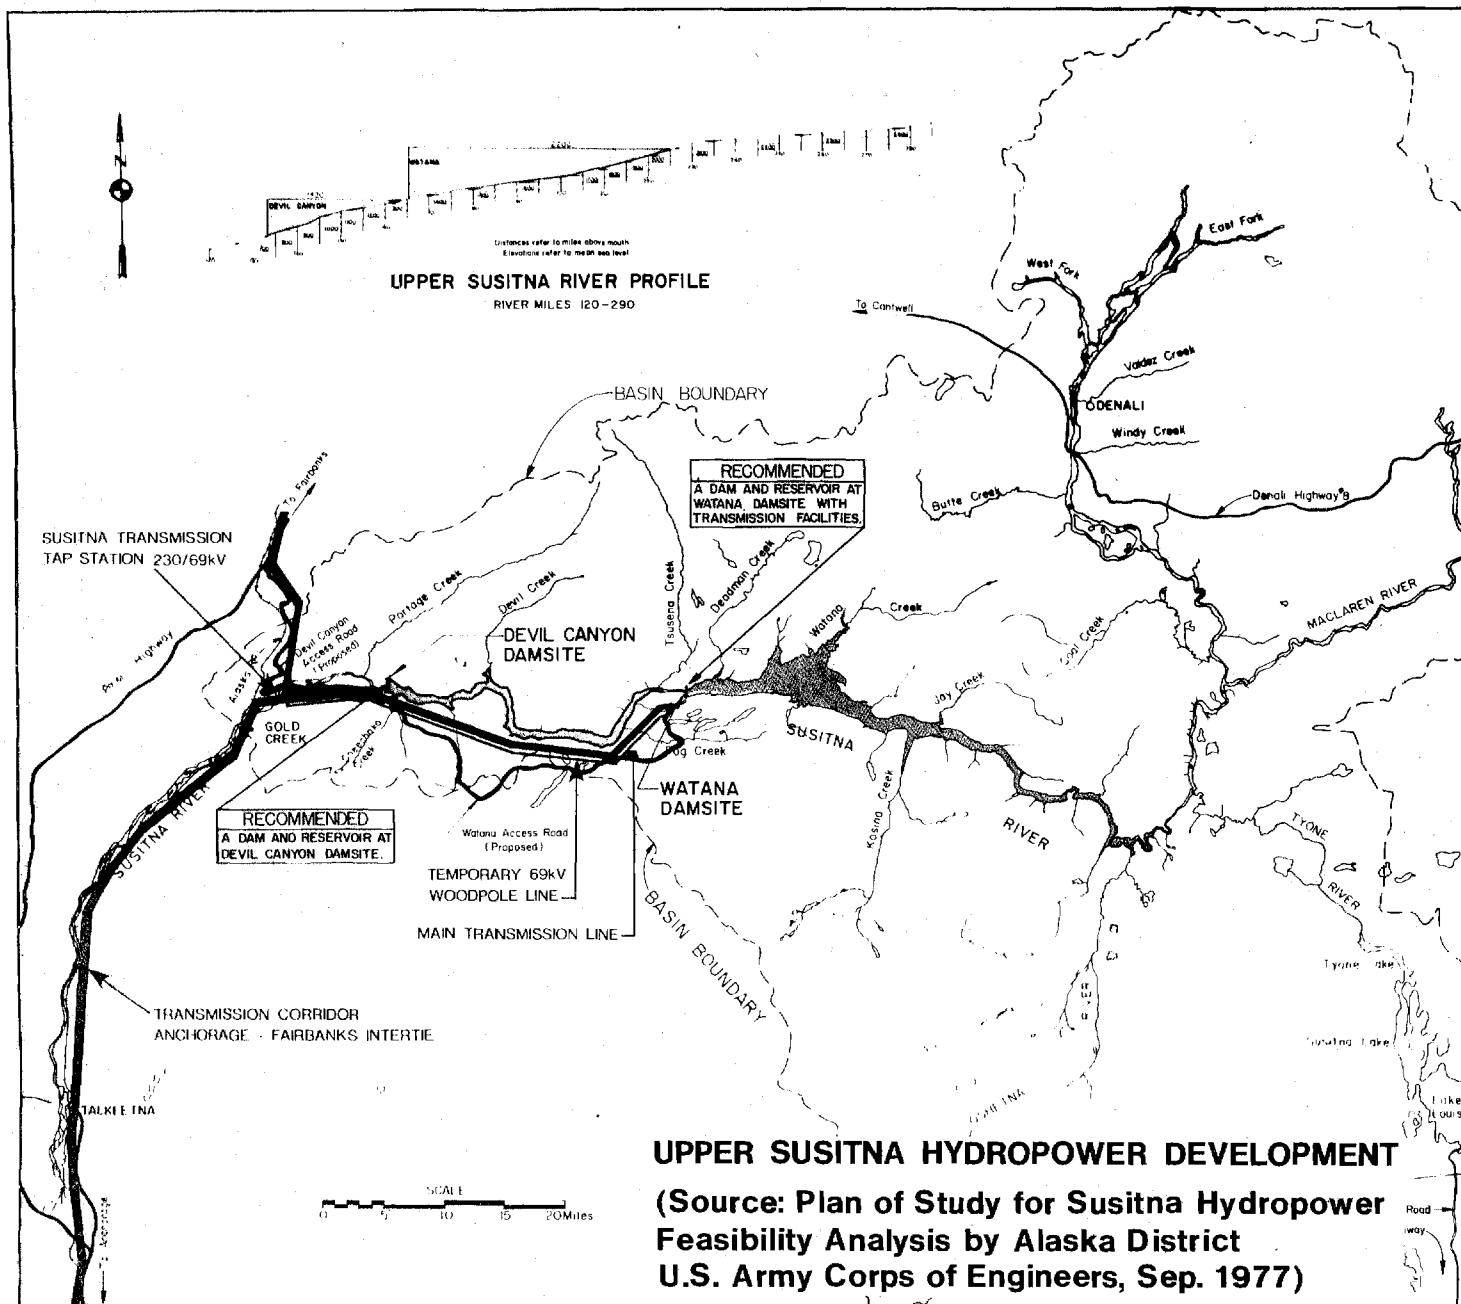

CONSTRUCTION PLAN FOR UPPER SUSITNA PROJECT:

Ref. Interim Feasibility Report - P.94, US Army Corps of Engineers, 12 Dec. 1975

Construction Period for Selected Projects:

Watana Dam - 6 Years  
Devil Canyon Dam - 5 Years  
Total Period - 10 Years (1 Year Overlap)

SUGGESTED REVISED SCHEDULE:

Ref. Chapter 6, Figure 6-5

First Unit On-Line at Watana - Beginning Year 1992  
Last Unit On-Line at Devil Canyon - End of Year 1996  
Period of Overlap in Construction - 2 Years  
Due to Introduction of First Unit at Devil Canyon in 1994

CHAPTER 8  
ECONOMIC FEASIBILITY ANALYSIS

## CHAPTER 8

### ECONOMIC FEASIBILITY ANALYSIS

An economic feasibility analysis was performed to determine which system expansion plan provides the best use of available resources for supplying electrical power to the Railbelt area. Alternative system expansion plans and facility cost estimates were developed in Chapters 6 and 7. In this chapter, the results of the economic feasibility analysis are presented.

#### 8.1 METHODOLOGY

This economic analysis uses the conventional present-worth model. Annual capital disbursement tables, on a year-by-year basis, were prepared for independent and interconnected system expansion plans. To evaluate these plans on an equal basis all capital disbursements were discounted to the 1979 base year and then totalized for each plan to obtain a single 1979 present-worth value for each plan. The difference between the two present worth values is the net present worth or project benefits. This approach does not include additional capital disbursements after 1997. Such disbursements will be required later to replace retired facilities. However, the extension of the present-worth model over the whole life of the proposed intertie will not significantly affect the results of this feasibility study. The year 1997 was chosen as the final year of the study period to include the last unit of Upper Susitna Hydropower Project (Devil Canyon Unit No. 4).

Figures 6-2 thru 6-8 in Chapter 6 show that many plant additions for both independent and interconnected system expansion plans do not vary. Therefore, in this economic analysis, facility costs for the new generating plants not affected by the introduction of the intertie are not considered. Also excluded from the analysis are plant fixed operation and maintenance costs. The exclusion of these O&M costs will somewhat favor the independent system expansion alternatives.

Only capital costs are used to evaluate generation reserve capacity sharing benefits. This simplification is based on the assumption that an average operating cost of generation for reserve sharing is approximately the same in the Anchorage and Fairbanks areas. To account for generating plant operating costs with reasonable accuracy, a multi-area production cost study would be needed. The multi-area production cost model simulates an economic dispatching of generating units in the system and computes expected fuel and variable O&M costs based on the energy (MWh) output for each unit, taking into consideration intertie transfer limits. Since such a study is outside the scope of the present work, a somewhat simplified method was used in this feasibility study. It is definitely recommended that a multi-area production cost study be performed as the next step to finalize this Intertie Economic Feasibility Study.

## 8.2 SENSITIVITY ANALYSIS

A computer program was developed by IECO to analyze the sensitivity of different escalation and discount rates on the capital costs of various alternatives. This program, the Transmission Line Economic Analysis Program (TLEAP), provides the following outputs:

- Tables indicating independent minus interconnected system costs, discounted to the base year 1979.
- Separate tables indicating the discounted value of base year (1979) costs for the independent and interconnected systems.
- Cost disbursement tables for alternative system expansion plans. These tables also include intertie line losses.

Computer printout sheets indicating input data and calculated results for all alternatives included in this economic feasibility analysis are found in Appendix E.

### 8.3 ECONOMIC ANALYSIS

Tables included in this chapter and in Appendix E indicate economic analyses for a range of annual escalation rates of 0% to 12%, and a range of discount rates from 8% to 12%. For principal investigations below, a 10% discount rate is used and cash flow for facilities under consideration is expressed in constant 1979 dollars, only the fuel related energy costs are escalated. The 10% is regarded as the appropriate discount value for Opportunity Cost of Capital and is now required by the Office of Management and Budget (Ref. 1) for economic analyses to determine benefits for all federal projects.

For the purposes of the economic analysis, it is the discount rate corresponding to the opportunity cost of capital which is used to calculate all present values of costs and benefits; the particular cost of interest actually paid on bonds or other obligations is irrelevant since it bears no relationship whatsoever to the project's internal rate of return. It is only a financial (or budgeting) parameter. Therefore, the interest during construction and other financial changes are excluded from the economic analysis. These charges appear only in the financial analysis.

#### A. Benefits Due to Generation Reserve Capacity Sharing (Case IA)

Three cases were investigated to determine intertie benefits due to generation reserve capacity sharing alone; the 230-kV single circuit intertie between Anchorage and Fairbanks. In all cases 130 MW of power transfer capacity was allocated for generation reserve capacity sharing purposes. The economic analysis results indicate the following benefits due to intertie (differential of present worth):

<u>Load Forecast</u>	<u>Intertie Cost (Percent)</u>	<u>Reference Table</u>	<u>Benefits (\$ x 1000) (PW 1979)</u>
Probable	100	8-1	12,475
Probable	125	8-1x	945
Low	100	8-1-LL	2,704

The above results indicate that the 230-kV intertie is economically feasible based on generation reserve capacity sharing alone.

Sensitivity of the results to variations in escalation and discount rates are indicated in Tables 8-1, 8-1x and 8-1-LL. Computer printouts indicating details are included in Appendix E.

B. Benefits Due to Generation Reserve Capacity Sharing and Firm Power Transfer (Case 1B)

Six cases were investigated to determine combined 230-kV intertie benefits due to both firm power transfer and generation reserve capacity sharing. These study cases have one 230-kV single circuit line during the 1984-1991 period and two single circuit 230-kV lines during the 1992-1997 period except for low load forecast case (Table 8-3LL) when the second 230-kV circuit is added in 1995. The economic analysis results indicate the following intertie benefits (differential of present worth):

<u>Load Forecast</u>	<u>Intertie Cost (Percent)</u>	<u>Reference Table</u>	<u>Benefits (\$ x 1000) (PW 1979)</u>
Probable	100	8-3	24,054
Probable	125	8-3x	12,533
Low	100	8-3-LL	-2,626

If the above intertie benefits are combined with the additional benefits due to supply of construction power to the Upper Susitna Hydropower Project site (see Section 7.9), the economic analysis results indicate the following benefits (differential of present worth):

<u>Load Forecast</u>	<u>Intertie Cost (Percent)</u>	<u>Reference Table</u>	<u>Benefits (\$ x 1000) (PW 1979)</u>
Probable	100	8-4	29,633
Probable	125	8-4x	18,112

Sensitivity of the results to variations in escalation and discount rates are indicated in Tables 8-3, 8-3x, 8-3-LL, 8-4 and 8-4x. Computer printouts indicating details are included in Appendix E.

C. Benefits Due to Generation Reserve Sharing and Firm Power Transfer (Case IC)

Two cases were investigated to determine 345 kV intertie benefits due to both: generation reserve sharing only (first line) and generation reserve sharing combined with firm power transfer (second line). These study cases consider one 345 kV single circuit line between Anchorage and Fairbanks. The economic study results indicate the following intertie benefits (differential of present worth):

<u>Load Forecast</u>	<u>Intertie Cost (Percent)</u>	<u>Reference Table</u>	<u>Benefits (\$ x 1000) (PW 1979)</u>
Probable	100	8-2	-3,556
Probable	100	8-7	- 426

The above results indicate that the 345 kV intertie is not economically feasible based on the conditions specified in this study. Additional studies, including interconnected system production costing, may prove the 345 kV intertie feasible.

Sensitivity of the results to variations in escalation and discount rates are indicated in Tables 8-2 and 8-7. Computer printouts indicating details are included in Appendix E.

D. 230-kV Intertie with Intermediate Substations (Case ID)

Four cases were investigated to determine additional benefits due to supply of power to the MEA System at Palmer substation, and construction power to the Upper Susitna Hydropower Project. These cases include a 230-kV single circuit line between Anchorage and Fairbanks (Ester), with intermediate substations at Palmer and Healy. The economic analysis results indicate the following intertie benefits:

<u>Load Forecast</u>	<u>Intertie Cost (Percent)</u>	<u>Reference Table</u>	<u>Benefits (\$ x 1000) (PW 1979)</u>
Probable	100	8-5	17,814
Probable	125	8-5x	9,125

If the above intertie benefits are combined with the additional benefits due to supply of construction power to the Upper Susitna Hydropower Project sites (see Section 7.9), the economic analysis results indicated the following benefits (differential of present worth):

<u>Load Forecast</u>	<u>Intertie Cost (Percent)</u>	<u>Reference Table</u>	<u>Benefits (\$ x 1000) (PW 1979)</u>
Probable	100	8-6	20,344
Probable	125	8-6x	11,656

Sensitivity of the results to variations in escalation and discount rates are indicated in Tables 8-5, 8-5x, 8-6 and 8-6x. Computer printouts indicating details are included in Appendix E.

#### E. Intertie with Upper Susitna Hydropower Project

Only system reliability (MAREL) analyses and facility cost estimates were developed for this alternative system expansion plan (Case II, Chapter 6). The economic feasibility analysis was not performed for this alternative because:

- The methodology of this economic analysis is more appropriate for thermal generation systems. It is not applicable to a large mixed hydro/thermal generation systems. A multi-area production cost study, involving extensive analyses of optimum hydro operations in conjunction with thermal plants, would be required to obtain accurate results.
- A draft copy of the Upper Susitna project report prepared by the Alaska Power Administration (Ref. 2) was received by the Consultants in the course of this study. It includes revisions to unit ratings for the Upper Susitna Project used in the MAREL analyses (as described in Chapter 6). The new total installed capacity is 1573 MW, versus the 1392 MW installed capacity used in development of the expansion plans analyzed in this report.

A study should be performed to accommodate the above revisions to the Susitna power ratings and change to the production economics due to major hydro substitution for thermal energy. The study should examine in detail the economic feasibility of Susitna hydropower, due to the displacement of large increments of thermal power.

For reference, Figure 6-5 in Chapter 6 indicates the initial expansion plan developed for this study. This figure also indicates the thermal generating unit displacement by Upper Susitna Hydropower units.

MAREL study results indicate the following intertie requirements for maintaining the study criteria of equal reliability system expansion with introduction of Upper Susitna power:

<u>Period</u>	<u>Requirement</u>
1992	One 345-kV S/C line to Anchorage One 230-kV S/C line to Fairbanks
1993	One 345-kV S/C line to Anchorage Two 230-kV S/C lines to Fairbanks
1994-1997	Two 345-kV S/C lines to Anchorage Two 230-kV S/C lines to Fairbanks

#### 8.4 REFERENCES

1. Business Week, Economics, Pages 96-97, February 19, 1979.
2. Alaska Power Administration, Upper Susitna River Project Market Analyses Report, March 1979.

ALASKA POWER AUTHORITY  
 ANCHORAGE - FAIRBANKS INTERTIE  
 ECONOMIC FEASIBILITY STUDY

TABLE 8-1

## CASE IA, 230 KV GENERATION RESERVE SHARING ONLY

## PROBABLE LOAD FORECAST CASE

 DIFFERENTIAL DISCOUNTED VALUE OF BASE YEAR (1979) COSTS  
 INDEPENDENT SYSTEM COSTS MINUS INTERCONNECTED SYSTEM COSTS  
 (IN \$1000)

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	10,913	2,434	-1,210	-5,662	-11,042	-17,486	-25,147	-34,196	-44,826	-57,252
8.25	11,173	3,202	-257	-4,491	-9,619	-15,771	-23,095	-31,756	-41,639	-53,853
8.50	11,414	3,927	647	-3,379	-8,265	-14,137	-21,136	-29,424	-39,179	-50,600
8.75	11,634	4,612	1,503	-2,324	-6,977	-12,579	-19,268	-27,197	-36,540	-47,488
9.00	11,836	5,258	2,314	-1,321	-5,752	-11,096	-17,486	-25,071	-34,017	-44,511
9.25	12,020	5,868	3,081	-371	-4,588	-9,683	-15,786	-23,040	-31,605	-41,663
9.50	12,188	6,442	3,806	531	-3,481	-8,339	-14,166	-21,102	-29,501	-38,938
9.75	12,339	6,983	4,491	1,385	-2,430	-7,059	-12,621	-19,252	-27,099	-36,533
10.00	12,475	7,491	5,138	2,194	-1,431	-5,841	-11,149	-17,486	-24,996	-33,841
10.25	12,596	7,969	5,749	2,960	-484	-4,682	-9,747	-15,802	-22,987	-31,458
10.50	12,703	8,417	6,324	3,685	415	-3,581	-8,411	-14,195	-21,068	-29,181
10.75	12,797	8,834	6,867	4,371	1,268	-2,534	-7,139	-12,662	-19,235	-27,003
11.00	12,879	9,231	7,378	5,019	2,076	-1,540	-5,928	-11,202	-17,486	-24,922
11.25	12,949	9,599	7,858	5,630	2,841	-595	-4,776	-9,609	-15,816	-22,934
11.50	13,007	9,943	8,309	6,208	3,566	301	-3,680	-8,482	-14,223	-21,034
11.75	13,055	10,264	8,732	6,752	4,252	1,152	-2,637	-7,218	-12,703	-19,219
12.00	13,093	10,562	9,129	7,265	4,900	1,959	-1,647	-6,014	-11,253	-17,486

Note:

In early years of the expansion plan capital requirements are higher for the independent system plan, but in the later years capital requirements are higher for the interconnected system plan. As the discount rate increases, the sum of present worth decreases more for the interconnected system plan than for the independent system plan, therefore, the differential of the sums of the discounted values increases with the increase in the discount rate.

Due to larger capital requirements in the later years of the expansion plan, the increase in the escalation rate causes a greater increase in capital costs for the interconnected system. As a consequence, the differential of the discounted values (benefits) decrease.

Refer to APPENDIX E for capital disbursement tables and tables of discounted values.

TABLE 8-1

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-1X

CASE 1A, GENERATION RESERVE SHARING ONLY  
TRANSMISSION LINE COSTS INCREASED BY 25%  
PROBABLE LOAD FORECAST CASE

DIFFERENTIAL DISCOUNTED VALUE OF BASE YEAR (1979) COSTS  
INDEPENDENT SYSTEM COSTS MINUS INTERCONNECTED SYSTEM COSTS  
(IN \$1000)

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	-1,410	-11,778	-15,927	-20,897	-26,809	-33,798	-42,019	-51,642	-62,860	-75,889
8.25	-1,046	-10,891	-14,850	-19,598	-25,253	-31,946	-39,824	-49,054	-59,821	-72,333
8.50	-704	-10,048	-13,824	-18,360	-23,768	-30,175	-37,725	-46,577	-56,910	-68,924
8.75	-383	-9,247	-12,847	-17,178	-22,350	-28,484	-35,718	-44,206	-54,122	-65,658
9.00	-81	-8,485	-11,917	-16,052	-20,997	-26,868	-33,798	-41,937	-51,451	-62,528
9.25	201	-7,761	-11,032	-14,979	-19,705	-25,323	-31,962	-39,766	-48,894	-59,529
9.50	466	-7,074	-10,190	-13,957	-18,473	-23,848	-30,207	-37,688	-46,446	-56,656
9.75	714	-6,422	-9,389	-12,982	-17,297	-22,440	-28,529	-35,700	-44,102	-53,903
10.00	945	-5,803	-8,627	-12,054	-16,176	-21,095	-26,926	-33,798	-41,857	-51,265
10.25	1,161	-5,216	-7,903	-11,171	-15,107	-19,810	-25,393	-31,979	-39,708	-48,738
10.50	1,361	-4,659	-7,215	-10,330	-14,088	-18,585	-23,928	-30,238	-37,651	-46,318
10.75	1,548	-4,132	-6,562	-9,529	-13,116	-17,415	-22,528	-28,574	-35,682	-43,999
11.00	1,721	-3,632	-5,941	-8,768	-12,190	-16,298	-21,191	-26,983	-33,798	-41,779
11.25	1,881	-3,159	-5,353	-8,044	-11,308	-15,233	-19,914	-25,461	-31,995	-39,652
11.50	2,030	-2,712	-4,794	-7,355	-10,468	-14,217	-18,695	-24,006	-30,269	-37,615
11.75	2,166	-2,289	-4,265	-6,701	-9,668	-13,248	-17,530	-22,616	-28,618	-35,665
12.00	2,291	-1,889	-3,763	-6,079	-8,907	-12,325	-16,418	-21,287	-27,039	-33,798

Note:

This case is similar to the case presented in Table 8-I, except for the increase in intertie costs by 25 percent which caused an increase in capital requirements for the interconnected system expansion plan. For case analysis refer to note in Table 8-I.

TABLE 8-1X

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-1-LL

CASE IA, 230 KV, GENERATION RESERVE SHARING ONLY  
LOW LOAD FORECAST CASE

DIFFERENTIAL DISCOUNTED VALUE OF BASE YEAR (1979) COSTS  
INDEPENDENT SYSTEM COSTS MINUS INTERCONNECTED SYSTEM COSTS  
(IN \$1000)

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	4,292	6,955	7,203	7,166	6,765	5,904	4,475	2,351	-619	-4,605
8.25	4,095	6,860	7,167	7,206	6,903	6,167	4,895	2,964	232	-3,466
8.50	3,897	6,754	7,114	7,225	7,014	6,396	5,272	3,523	1,016	-2,409
8.75	3,698	6,638	7,048	7,225	7,100	6,593	5,607	4,031	1,736	-1,430
9.00	3,499	6,513	6,968	7,207	7,163	6,759	5,904	4,491	2,397	-524
9.25	3,300	6,379	6,876	7,172	7,203	6,897	6,165	4,906	3,001	312
9.50	3,101	6,237	6,773	7,122	7,224	7,008	6,392	5,278	3,552	1,083
9.75	2,902	6,088	6,660	7,058	7,225	7,095	6,588	5,610	4,053	1,791
10.00	2,704	5,933	6,537	6,981	7,209	7,159	6,753	5,904	4,507	2,442
10.25	2,507	5,772	6,406	6,892	7,177	7,201	6,891	6,163	4,917	3,037
10.50	2,311	5,606	6,267	6,791	7,129	7,223	7,003	6,388	5,284	3,580
10.75	2,116	5,435	6,121	6,681	7,068	7,226	7,090	6,583	5,613	4,074
11.00	1,923	5,261	5,969	6,561	6,993	7,212	7,155	6,748	5,904	4,522
11.25	1,731	5,083	5,811	6,433	6,907	7,182	7,198	6,885	6,161	4,927
11.50	1,541	4,902	5,647	6,296	6,809	7,136	7,222	6,997	6,385	5,290
11.75	1,353	4,718	5,479	6,153	6,701	7,077	7,227	7,085	6,578	5,615
12.00	1,166	4,532	5,308	6,004	6,584	7,005	7,214	7,151	6,742	5,904

Note:

In the early years of the expansion plan capital requirements are somewhat lower for the independent system expansion plan (less new generating capacity is required). In the later years capital requirements are lower for the interconnected system plan. As the discount rate increases, the sum of the present worth decreases more for the independent system plan, therefore, the differential of the sums of the discounted values decrease with the increase in the discount rate.

The above analysis is applicable at the lower escalation rates. Due to marginal differences between capital requirements for both independent and interconnected expansion plans, at higher escalation rates the situation reverses, the differential discounted values (benefits) increase with the increase in the discount rate and decrease with the increase in the escalation rate.

Refer to APPENDIX E for capital disbursement tables and tables of discounted values.

TABLE 8-1-LL

23 AUGUST 79

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-2

CASE IC, 345 kV GENERATION RESERVE SHARING ONLY  
PROBABLE LOAD FORECAST

DIFFERENTIAL DISCOUNTED VALUE OF BASE YEAR (1979) COSTS  
INDEPENDENT SYSTEM COSTS MINUS INTERCONNECTED SYSTEM COSTS  
(IN \$1000)

DISCOUNT RATE	----- ESCALATION RATES -----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	-4,886	-10,869	-13,279	-16,167	-19,601	-23,658	-28,421	-33,984	-40,450	-47,934
8.25	-4,679	-10,354	-12,653	-15,412	-18,698	-22,583	-27,150	-32,489	-38,700	-45,893
8.50	-4,484	-9,865	-12,057	-14,692	-17,835	-21,556	-25,935	-31,058	-37,023	-43,936
8.75	-4,302	-9,401	-11,489	-14,006	-17,011	-20,574	-24,771	-29,687	-35,415	-42,059
9.00	-4,132	-8,959	-10,950	-13,351	-16,225	-19,636	-23,658	-28,374	-33,874	-40,259
9.25	-3,973	-8,540	-10,436	-12,728	-15,474	-18,739	-22,593	-27,117	-32,397	-38,532
9.50	-3,824	-8,143	-9,947	-12,134	-14,758	-17,882	-21,575	-25,913	-30,982	-36,876
9.75	-3,685	-7,766	-9,483	-11,568	-14,075	-17,063	-20,601	-24,761	-29,626	-35,289
10.00	-3,556	-7,408	-9,042	-11,029	-13,423	-16,282	-19,669	-23,658	-28,328	-33,766
10.25	-3,436	-7,070	-8,622	-10,517	-12,802	-15,535	-18,779	-22,603	-27,083	-32,307
10.50	-3,325	-6,749	-8,224	-10,029	-12,210	-14,823	-17,928	-21,593	-25,892	-30,908
10.75	-3,222	-6,445	-7,847	-9,565	-11,646	-14,143	-17,115	-20,627	-24,751	-29,567
11.00	-3,127	-6,158	-7,488	-9,123	-11,108	-13,494	-16,338	-19,702	-23,658	-28,282
11.25	-3,040	-5,885	-7,149	-8,704	-10,596	-12,875	-15,596	-18,819	-22,612	-27,051
11.50	-2,959	-5,630	-6,827	-8,305	-10,109	-12,285	-14,887	-17,973	-21,611	-25,871
11.75	-2,886	-5,388	-6,522	-7,927	-9,645	-11,722	-14,210	-17,165	-20,652	-24,741
12.00	-2,819	-5,159	-6,233	-7,568	-9,204	-11,186	-13,564	-16,393	-19,735	-23,658

8 - 12

TABLE 8-2

23 AUGUST 79

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-3

CASE 1B, 230 KV, GENERATION RESERVE SHARING  
PLUS FIRM POWER TRANSFER  
PROBABLE LOAD FORECAST CASE

DIFFERENTIAL DISCOUNTED VALUE OF BASE YEAR (1979) COSTS  
INDEPENDENT SYSTEM COSTS MINUS INTERCONNECTED SYSTEM COSTS  
(IN \$1000)

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
8.00	24,726	23,316	22,834	20,252	17,893	14,872	11,092	6,448	821	-5,918
8.25	24,678	23,268	22,785	20,195	17,841	14,800	10,928	6,373	2,372	-4,853
8.50	24,619	23,188	22,705	20,103	17,747	14,678	10,806	6,232	3,844	-2,278
8.75	24,549	23,087	22,598	20,027	17,673	14,509	10,628	6,075	5,242	-589
9.00	24,468	22,963	22,503	19,917	17,584	14,394	10,498	5,917	6,568	1,016
9.25	24,378	22,817	22,351	19,777	17,429	14,236	10,316	5,719	7,825	2,543
9.50	24,279	22,650	22,174	19,606	17,284	14,078	10,144	5,544	9,016	3,993
9.75	24,171	22,463	21,973	19,407	17,104	13,897	9,969	5,366	10,144	5,369
10.00	24,054	22,258	21,749	19,181	16,893	13,705	9,787	5,185	11,211	6,676
10.25	23,931	22,034	21,504	18,929	16,650	13,505	9,593	4,992	12,220	7,916
10.50	23,800	21,793	21,238	18,652	16,378	13,297	9,388	4,785	13,174	9,091
10.75	23,662	21,535	20,952	18,351	16,078	12,975	9,164	4,568	14,075	10,204
11.00	23,518	21,263	20,648	18,028	15,752	12,641	8,923	4,328	14,924	11,258
11.25	23,369	20,976	20,320	17,684	15,409	12,297	8,675	4,075	15,725	12,255
11.50	23,214	20,674	20,007	17,319	15,052	11,944	8,413	3,803	16,478	13,197
11.75	23,053	20,360	19,671	16,935	14,683	11,578	8,139	3,519	17,187	14,087
12.00	22,888	20,033	19,321	16,552	14,300	11,201	7,854	3,224	17,853	14,928

8 - 13

TABLE 8-3

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERLINE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-3X

CASE IB, 230 kV, GENERATION RESERVE SHARING  
PLUS FIRM POWER TRANSFER  
TRANSMISSION LINE COSTS INCREASED BY 25%  
PROBABLE LOAD FORECAST CASE

DIFFERENTIAL DISCOUNTED VALUE OF BASE YEAR (1979) COSTS  
INDEPENDENT SYSTEM COSTS MINUS INTERCONNECTED SYSTEM COSTS  
(IN \$1000)

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	12,411	9,113	7,326	5,026	2,136	-1,430	-5,769	-10,987	-17,202	-24,544
8.25	12,467	9,481	7,411	5,648	2,917	-465	-4,591	-9,564	-15,499	-22,522
8.50	12,509	9,822	8,264	6,233	3,654	449	-3,473	-8,211	-13,876	-20,591
8.75	12,540	10,138	8,687	6,781	4,350	1,315	-2,411	-6,924	-12,330	-18,748
9.00	12,559	10,429	9,081	7,246	5,005	2,133	-1,404	-5,700	-10,857	-16,990
9.25	12,567	10,697	9,448	7,778	5,621	2,906	-450	-4,537	-9,454	-15,314
9.50	12,565	10,943	9,788	8,228	6,201	3,636	454	-3,432	-8,119	-13,715
9.75	12,554	11,168	10,103	8,649	6,746	4,325	1,310	-2,365	-6,848	-12,190
10.00	12,533	11,373	10,394	9,042	7,257	4,975	2,121	-1,387	-5,640	-10,738
10.25	12,504	11,558	10,661	9,407	7,736	5,587	2,887	-443	-4,491	-9,354
10.50	12,466	11,725	10,907	9,746	8,185	6,163	3,610	451	-3,399	-8,036
10.75	12,421	11,875	11,133	10,060	8,604	6,704	4,294	1,299	-2,362	-6,782
11.00	12,369	12,008	11,338	10,351	8,995	7,212	4,938	2,102	-1,378	-5,588
11.25	12,309	12,125	11,524	10,619	9,359	7,689	5,546	2,861	-444	-4,453
11.50	12,244	12,228	11,692	10,865	9,697	8,135	6,118	3,578	442	-3,374
11.75	12,172	12,316	11,844	11,091	10,011	8,552	6,656	4,256	1,282	-2,348
12.00	12,095	12,391	11,978	11,297	10,302	8,942	7,161	4,896	2,077	-1,374

28 AUGUST 79

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-3-LL

CASE IB, 230 KV, GENERATION RESERVE SHARING  
PLUS FIRM POWER TRANSFER  
LOW LOAD FORECAST CASE

DIFFERENTIAL DISCOUNTED VALUE OF BASE YEAR (1979) COSTS  
INDEPENDENT SYSTEM COSTS MINUS INTERCONNECTED SYSTEM COSTS  
(IN \$1000)

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	-729	4,879	6,790	8,952	11,395	14,152	17,258	20,755	24,689	29,111
8.25	-996	4,430	6,279	8,373	10,739	13,408	16,416	19,802	23,611	27,892
8.50	-1,254	3,995	5,786	7,813	10,104	12,688	15,601	18,881	22,569	26,714
8.75	-1,503	3,575	5,309	7,271	9,490	11,993	14,814	17,990	21,562	25,576
9.00	-1,743	3,169	4,847	6,748	8,896	11,321	14,053	17,129	20,589	24,476
9.25	-1,976	2,776	4,401	6,242	8,322	10,671	13,318	16,297	19,648	23,413
9.50	-2,200	2,396	3,969	5,752	7,767	10,042	12,606	15,493	18,738	22,385
9.75	-2,417	2,029	3,552	5,279	7,231	9,434	11,918	14,714	17,859	21,391
10.00	-2,626	1,674	3,149	4,821	6,711	8,846	11,253	13,962	17,008	20,431
10.25	-2,828	1,331	2,759	4,378	6,209	8,278	10,609	13,234	16,186	19,502
10.50	-3,023	999	2,381	3,949	5,724	7,727	9,987	12,530	15,390	18,603
10.75	-3,212	678	2,016	3,535	5,254	7,195	9,384	11,849	14,621	17,734
11.00	-3,394	368	1,664	3,134	4,799	6,680	8,802	11,190	13,876	16,894
11.25	-3,569	67	1,322	2,747	4,360	6,182	8,238	10,553	13,156	16,081
11.50	-3,739	-223	992	2,372	3,934	5,700	7,693	9,936	12,460	15,294
11.75	-3,902	-503	673	2,009	3,523	5,234	7,165	9,339	11,785	14,533
12.00	-4,060	-775	364	1,658	3,124	4,783	6,654	8,762	11,133	13,797

23 AUGUST 79

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-4

CASE IB, 230 kV, GENERATION RESERVE SHARING PLUS  
FIRM POWER TRANSFER & SUSITNA PROJECT CONSTRUCTION POWER  
PROBABLE LOAD FORECAST CASE

DIFFERENTIAL DISCOUNTED VALUE OF BASE YEAR (1979) COSTS  
INDEPENDENT SYSTEM COSTS MINUS INTERCONNECTED SYSTEM COSTS  
(IN \$1000)

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	31,206	32,272	31,731	30,748	29,249	27,151	24,364	20,785	16,303	10,791
8.25	31,037	32,350	31,908	31,041	29,679	27,742	25,143	21,783	17,552	12,330
8.50	30,859	32,407	32,058	31,302	30,072	28,289	25,870	22,719	18,730	13,787
8.75	30,672	32,443	32,183	31,534	30,429	28,794	26,547	23,597	19,840	15,164
9.00	30,478	32,468	32,285	31,736	30,751	29,258	27,177	24,418	20,884	16,465
9.25	30,276	32,458	32,363	31,912	31,042	29,684	27,761	25,187	21,866	17,694
9.50	30,068	32,438	32,421	32,062	31,301	30,072	28,301	25,904	22,789	18,852
9.75	29,853	32,402	32,458	32,187	31,531	30,426	28,800	26,572	23,653	19,945
10.00	29,633	32,351	32,476	32,288	31,733	30,746	29,259	27,194	24,464	20,973
10.25	29,407	32,284	32,476	32,368	31,908	31,034	29,680	27,770	25,222	21,940
10.50	29,176	32,204	32,458	32,426	32,057	31,292	30,065	28,305	25,929	22,849
10.75	28,941	32,110	32,424	32,465	32,182	31,520	30,416	28,798	26,589	23,702
11.00	28,702	32,003	32,374	32,484	32,285	31,721	30,733	29,253	27,203	24,501
11.25	28,458	31,885	32,310	32,486	32,365	31,896	31,020	29,670	27,773	25,249
11.50	28,211	31,756	32,232	32,470	32,425	32,046	31,276	30,052	28,302	25,948
11.75	27,961	31,616	32,140	32,438	32,465	32,172	31,504	30,399	28,790	26,600
12.00	27,709	31,466	32,037	32,391	32,486	32,275	31,704	30,715	29,240	27,207

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-4X

CASE IB, 230 kV, GENERATION RESERVE SHARING PLUS  
FIRM POWER TRANSFER & SUSITNA CONSTRUCTION POWER  
TRANSMISSION LINE COSTS INCREASED BY 25%  
PROBABLE LOAD FORECAST CASE

DIFFERENTIAL DISCOUNTED VALUE OF BASE YEAR (1979) COSTS  
INDEPENDENT SYSTEM COSTS MINUS INTERCONNECTED SYSTEM COSTS  
(IN \$1000)

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	18,491	18,069	17,024	15,523	13,492	10,849	7,502	3,350	-1,721	-7,835
8.25	18,425	18,266	17,324	15,944	14,055	11,578	8,424	4,495	-319	-6,139
8.50	18,749	18,441	17,596	16,332	14,579	12,260	9,291	5,576	1,009	-4,527
8.75	18,663	18,594	17,842	16,688	15,065	12,899	10,108	6,598	2,268	-2,995
9.00	18,569	18,726	18,063	17,015	15,516	13,496	10,875	7,562	3,460	-1,542
9.25	18,466	18,838	18,260	17,313	15,934	14,053	11,595	8,471	4,588	-163
9.50	18,355	18,931	18,435	17,584	16,319	14,572	12,270	9,328	5,654	1,145
9.75	18,237	19,007	18,588	17,829	16,673	15,054	12,902	10,134	6,661	2,385
10.00	18,112	19,066	18,720	18,049	16,997	15,502	13,492	10,892	7,613	3,559
10.25	17,980	19,109	18,833	18,246	17,294	15,916	14,044	11,603	8,510	4,671
10.50	17,843	19,136	18,927	18,421	17,564	16,298	14,558	12,271	9,356	5,722
10.75	17,700	19,149	19,004	18,574	17,808	16,650	15,036	12,896	10,152	6,716
11.00	17,552	19,149	19,064	18,707	18,028	16,972	15,480	13,481	10,901	7,655
11.25	17,399	19,135	19,108	18,821	18,225	17,268	15,691	14,028	11,605	8,541
11.50	17,242	19,109	19,138	18,916	18,400	17,537	16,271	14,537	12,266	9,377
11.75	17,080	19,072	19,153	18,994	18,553	17,781	16,621	15,012	12,885	10,164
12.00	16,915	19,024	19,154	19,056	18,687	18,001	16,942	15,452	13,464	10,905

23 AUGUST 79

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-5

CASE ID, 230 KV, GENERATION RESERVE SHARING  
WITH INTERMEDIATE SUBSTATIONS  
PROBABLE LOAD FORECAST CASE

DIFFERENTIAL DISCOUNTED VALUE OF BASE YEAR (1979) COSTS  
INDEPENDENT SYSTEM COSTS MINUS INTERCONNECTED SYSTEM COSTS  
(IN \$1000)

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	18,460	17,550	16,592	15,239	13,431	11,100	8,168	4,552	157	-5,122
8.25	18,406	17,728	16,858	15,610	13,924	11,735	8,967	5,541	1,363	-3,665
8.50	18,343	17,886	17,101	15,953	14,384	12,330	9,721	6,476	2,508	-2,280
8.75	18,272	18,026	17,322	16,269	14,812	12,889	10,431	7,362	3,595	-963
9.00	18,194	18,148	17,521	16,560	15,210	13,413	11,100	8,198	4,625	289
9.25	18,108	18,253	17,700	16,827	15,580	13,902	11,729	8,969	5,601	1,478
9.50	18,016	18,343	17,860	17,070	15,922	14,359	12,320	9,734	6,525	2,608
9.75	17,918	18,417	18,002	17,292	16,238	14,785	12,874	10,438	7,400	3,680
10.00	17,814	18,476	18,126	17,492	16,528	15,182	13,394	11,100	8,228	4,696
10.25	17,704	18,522	18,234	17,673	16,795	15,550	13,880	11,723	9,009	5,660
10.50	17,589	18,555	18,325	17,835	17,040	15,891	14,335	12,309	9,747	6,574
10.75	17,470	18,576	18,402	17,978	17,262	16,207	14,759	12,860	10,444	7,438
11.00	17,346	18,585	18,464	18,104	17,464	16,497	15,154	13,376	11,100	8,256
11.25	17,217	18,582	18,513	18,214	17,646	16,765	15,521	13,859	11,718	9,030
11.50	17,085	18,569	18,548	18,307	17,809	17,009	15,861	14,311	12,299	9,760
11.75	16,949	18,547	18,572	18,386	17,954	17,232	16,176	14,733	12,845	10,450
12.00	16,810	18,514	18,583	18,451	18,082	17,435	16,467	15,126	13,358	11,100

23 AUGUST 79

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRHANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-5X

CASE ID, GENERATION RESERVE SHARING PLUS  
INTERMEDIATE SUBSTATIONS  
TRANSMISSION LINE COSTS INCREASED BY 25%  
PROBABLE LOAD FORECAST CASE

DIFFERENTIAL DISCOUNTED VALUE OF BASE YEAR (1979) COSTS  
INDEPENDENT SYSTEM COSTS MINUS INTERCONNECTED SYSTEM COSTS  
(IN \$1000)

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	9,155	6,772	5,420	3,663	1,439	-1,319	-4,689	-8,755	-13,611	-19,363
8.25	9,181	7,043	5,783	4,133	2,036	-577	-3,778	-7,651	-12,285	-17,783
8.50	9,197	7,294	6,121	4,575	2,598	125	-2,915	-6,601	-11,022	-16,276
8.75	9,205	7,524	6,436	4,989	3,128	789	-2,095	-5,603	-9,819	-14,838
9.00	9,204	7,736	6,729	5,377	3,626	1,417	-1,319	-4,655	-8,673	-13,466
9.25	9,195	7,931	7,001	5,740	4,095	2,009	-584	-3,754	-7,583	-12,159
9.50	9,179	8,108	7,252	6,078	4,535	2,568	113	-2,899	-6,546	-10,912
9.75	9,155	8,269	7,484	6,393	4,948	3,094	771	-2,088	-5,559	-9,725
10.00	9,125	8,415	7,697	6,686	5,335	3,590	1,394	-1,319	-4,621	-8,594
10.25	9,089	8,546	7,893	6,959	5,697	4,057	1,982	-590	-3,730	-7,517
10.50	9,047	8,663	8,072	7,211	6,035	4,495	2,538	100	-2,884	-6,492
10.75	8,999	8,767	8,235	7,444	6,350	4,907	3,061	754	-2,081	-5,516
11.00	8,946	8,858	8,383	7,658	6,644	5,293	3,555	1,372	-1,319	-4,589
11.25	8,888	8,938	8,516	7,856	6,917	5,654	4,020	1,956	-596	-3,707
11.50	8,825	9,006	8,636	8,036	7,170	5,992	4,456	2,508	88	-2,870
11.75	8,758	9,063	8,742	8,201	7,404	6,308	4,867	3,029	737	-2,074
12.00	8,687	9,109	8,835	8,351	7,620	6,602	5,252	3,520	1,350	-1,319

8 - 19

TABLE 8-5X

25 AUGUST 79

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-6

CASE ID, 230 kV, GENERATION RESERVE SHARING  
WITH INTERMEDIATE SUBSTATIONS & SUSITNA CONSTRUCTION POWER  
PROBABLE LOAD FORECAST CASE

DIFFERENTIAL DISCOUNTED VALUE OF BASE YEAR (1979) COSTS  
INDEPENDENT SYSTEM COSTS MINUS INTERCONNECTED SYSTEM COSTS  
(IN \$1000)

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
	=====	=====	=====	=====	=====	=====	=====	=====	=====	=====
8.00	21,345	21,367	20,677	19,609	18,101	16,085	13,486	10,219	6,190	1,296
8.25	21,244	21,483	20,877	19,909	18,518	16,839	14,200	11,117	7,301	2,651
8.50	21,134	21,580	21,055	20,182	18,903	17,156	14,869	11,964	8,352	3,937
8.75	21,018	21,660	21,212	20,430	19,259	17,637	15,497	12,762	9,346	5,156
9.00	20,895	21,723	21,348	20,653	19,585	18,085	16,085	13,513	10,285	6,312
9.25	20,766	21,770	21,465	20,854	19,884	18,499	16,634	14,218	11,172	7,407
9.50	20,630	21,803	21,565	21,033	20,157	18,883	17,147	14,881	12,008	8,443
9.75	20,490	21,821	21,647	21,191	20,405	19,237	17,625	15,503	12,797	9,423
10.00	20,344	21,826	21,712	21,329	20,629	19,562	18,069	16,085	13,539	10,350
10.25	20,194	21,818	21,762	21,448	20,831	19,860	18,481	16,630	14,237	11,226
10.50	20,039	21,798	21,797	21,549	21,011	20,133	18,862	17,138	14,893	12,052
10.75	19,880	21,766	21,818	21,633	21,170	20,381	19,215	17,612	15,508	12,831
11.00	19,717	21,724	21,826	21,701	21,309	20,606	19,539	18,053	16,085	13,564
11.25	19,551	21,672	21,821	21,753	21,430	20,808	19,837	18,463	16,625	14,255
11.50	19,382	21,610	21,804	21,791	21,533	20,988	20,109	18,842	17,129	14,904
11.75	19,209	21,539	21,776	21,815	21,619	21,149	20,357	19,193	17,600	15,514
12.00	19,034	21,459	21,737	21,825	21,689	21,290	20,582	19,516	18,038	16,085

8 - 20

TABLE 8-6

23 AUGUST 79

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-6X

CASE ID, 230 kV, GENERATION RESERVE SHARING  
WITH INTERMEDIATE SUBSTATIONS & SUSITNA CONSTRUCTION POWER  
TRANSMISSION LINE COST INCREASED BY 25%  
PROBABLE LOAD FORECAST CASE

DIFFERENTIAL DISCOUNTED VALUE OF BASE YEAR (1979) COSTS  
INDEPENDENT SYSTEM COSTS MINUS INTERCONNECTED SYSTEM COSTS  
(IN \$1000)

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
6.00	12,040	10,589	9,506	8,032	6,108	3,666	629	-3,088	-7,578	-12,946
6.25	12,018	10,758	9,802	8,432	6,629	4,328	1,454	-2,074	-6,548	-11,467
6.50	11,968	10,967	10,075	8,804	7,117	4,951	2,234	-1,113	-5,179	-10,059
6.75	11,951	11,158	10,326	9,150	7,574	5,537	2,971	-203	-4,068	-8,719
7.00	11,905	11,311	10,556	9,470	8,001	6,089	3,666	660	-3,013	-7,443
7.25	11,852	11,447	10,766	9,767	8,400	6,606	4,322	1,476	-2,012	-6,230
7.50	11,793	11,568	10,950	10,040	8,771	7,091	4,940	2,248	-1,063	-5,077
7.75	11,727	11,673	11,128	10,292	9,116	7,546	5,522	2,977	-163	-3,981
8.00	11,656	11,764	11,283	10,525	9,436	7,971	6,069	3,666	690	-2,940
8.25	11,579	11,842	11,421	10,753	9,752	8,367	6,583	4,316	1,497	-1,952
8.50	11,496	11,906	11,544	10,925	10,006	8,737	7,065	4,929	2,261	-1,014
8.75	11,409	11,958	11,651	11,049	10,258	9,082	7,517	5,506	2,983	-124
9.00	11,318	11,998	11,745	11,255	10,489	9,401	7,940	6,050	3,666	719
9.25	11,222	12,027	11,824	11,395	10,701	9,698	8,336	6,560	4,310	1,518
9.50	11,122	12,046	11,891	11,520	10,894	9,972	8,704	7,040	4,918	2,274
9.75	11,018	12,055	11,946	11,629	11,069	10,224	9,048	7,489	5,491	2,990
10.00	10,911	12,054	11,989	11,725	11,227	10,456	9,367	7,911	6,031	3,666

23 AUGUST 79

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-7

CASE IC, 345 kV, GENERATION RESERVE SHARING PLUS  
FIRM POWER TRANSFER & SUSITNA PROJECT CONSTRUCTION POWER  
PROBABLE LOAD FORECAST

DIFFERENTIAL DISCOUNTED VALUE OF BASE YEAR (1979) COSTS  
INDEPENDENT SYSTEM COSTS MINUS INTERCONNECTED SYSTEM COSTS  
(IN \$1000)

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	-1,444	-6,495	-8,636	-11,240	-14,375	-18,116	-22,547	-27,760	-33,860	-40,959
8.25	-1,277	-6,035	-8,069	-10,549	-13,540	-17,115	-21,354	-26,349	-32,198	-39,013
8.50	-1,122	-5,601	-7,532	-9,892	-12,745	-16,159	-20,215	-24,999	-30,608	-37,148
8.75	-979	-5,190	-7,023	-9,268	-11,987	-15,249	-19,128	-23,709	-29,087	-35,363
9.00	-848	-4,802	-6,540	-8,675	-11,267	-14,381	-18,090	-22,477	-27,631	-33,653
9.25	-728	-4,436	-6,083	-8,113	-10,582	-13,554	-17,100	-21,299	-26,239	-32,016
9.50	-618	-4,091	-5,651	-7,579	-9,930	-12,766	-16,155	-20,174	-24,907	-30,449
9.75	-517	-3,766	-5,242	-7,073	-9,311	-12,016	-15,254	-19,099	-23,634	-28,949
10.00	-426	-3,459	-4,856	-6,594	-8,723	-11,302	-14,395	-18,073	-22,417	-27,513
10.25	-344	-3,171	-4,492	-6,139	-8,164	-10,622	-13,576	-17,094	-21,253	-26,139
10.50	-270	-2,901	-4,147	-5,709	-7,634	-9,976	-12,795	-16,159	-20,141	-24,825
10.75	-205	-2,647	-3,823	-5,302	-7,131	-9,361	-12,052	-15,267	-19,079	-23,567
11.00	-146	-2,409	-3,517	-4,917	-6,654	-8,777	-11,343	-14,416	-18,064	-22,365
11.25	-95	-2,186	-3,230	-4,554	-6,201	-8,222	-10,669	-13,604	-17,094	-21,215
11.50	-51	-1,978	-2,959	-4,210	-5,773	-7,694	-10,027	-12,830	-16,169	-20,115
11.75	-13	-1,783	-2,705	-3,886	-5,367	-7,194	-9,417	-12,093	-15,285	-19,065
12.00	18	-1,602	-2,467	-3,581	-4,984	-6,719	-8,836	-11,390	-14,442	-18,060

CHAPTER 9  
FINANCIAL PLANNING CONCEPTS

## CHAPTER 9

### FINANCIAL PLANNING CONCEPTS

The approach taken towards the financial planning for the intertie facilities represents an initial effort to structure the financial package required to implement the Railbelt interconnection. The concepts included in this chapter are intended to be representative of the conditions under which funding would proceed but are in no way definitive recommendations. Rather, they are anticipated to stimulate discussion amongst the participants and increase the understanding of projected financial obligations.

The proportionate allocation of total project costs between participants has been determined in relation to the tangible cost savings derived from the interconnection and represent an equitable division of the total financial burden. The acceptance of these allocations by participants to an Alaska Intertie Agreement (AIA) will require individual utility financial positions to be evaluated. Provision has been made for projected debt service to be analyzed for each participant, to facilitate the evaluation of financial impact on individual utility operations. What follows is an initial exploration of possible financial arrangements, which will serve as a starting point for successive evaluations by each potential participant as more definitive financial plans are evolved.

#### 9.1 SOURCES OF FUNDS

An initial appraisal of possible sources of funds has been made, to determine a combination which will be both financially advantageous and appropriate to the principal division of cost savings between REA and municipal utilities.

The following sources were examined:

- State of Alaska revenue bonds floated by APA
- REA loans negotiated by APA and participants
- FFB loans negotiated as part of REA loan package
- CFC loans negotiated in conjunction with REA loans
- Municipal bond issues by Anchorage and Fairbanks

A. State of Alaska Revenue Bonds

As State of Alaska revenue bonds would be legally secured by project revenues, a complex formula for revenue generation would be required to arrive at an acceptable level of cash flow to repay the bonds. The formulation could be based on wheeling charges for power flow over the intertie but the number of participants and the differences between their operational requirements could prove an insuperable obstacle to the realization of a final agreement. It is thought that the issue of State bonds should be deferred from present consideration, until such time as a combined generation and transmission project is ready for funding. Within the confines of the Railbelt development, this would be appropriate when consideration is given to the financing of the first hydropower development of the Upper Susitna Project, together with its associated transmission facilities.

Although APA bonds have been retained in the Transmission Line Financial Analysis Program (TLFAP), for analytical purposes, consideration has been given only to the remaining sources in these initial financial plans for implementation of the intertie. The transmission intertie facilities represent what may be regarded as the first stage development of the ultimate transmission system that will be required for the Watana and Devil Canyon hydropower plants of the Upper Susitna Project.

The financial sources discussed in the following sections were considered for composite funding of the Anchorage-Fairbanks Interconnection.

B. Rural Electrification Administration (REA)

The prospective participants, with the exception of the Anchorage and Fairbanks municipal systems, are all REA utilities of the Alaska District. Therefore, a combination of REA insured and guaranteed loans is assumed for the maximum amount of total project financial requirements allowed by federal regulations. REA loans are normally limited to 70 percent of total project costs; however, as OMB restrictions are expected to affect future REA commitments for project funding, this 70 percent limitation was taken to be the magnitude of a loan package comprising both REA and FFB loans. The percentage division between the two sources varies, recent past experience and future projections indicating a range of possibilities, with the FFB portion considerably larger than that of REA.

In the present study, a range of between 20/80 and 40/60 for the combination of REA/FFB loan funds has been assumed for analytical purposes, these percentages being applied to the 70 percent limit for the total loan package, as a proportion of total project costs.

REA loans carry a 5 percent interest rate and have a repayment period of 35 years, the first three years of which require interest only.

C. Federal Financing Bank (FFB)

REA makes guaranteed loans through FFB as a source of supplementary funding for REA utilities. Interest rates for FFB vary but are generally within the range of 9 to 9-1/2 percent. An average of 9-1/4 percent has been used in the financial analysis for this study. A similar 35 year repayment period to that for REA insured loans is normal, with the first three years of interest only also applicable.

The combination REA/FFB loan package offers a means of financing 70 percent of project costs with a minimum of negotiation, as precedents have

been set for this type of financial arrangement. The goal of negotiation would be to maximize the REA loan portion and secure the best interest rate applicable to the FFB loan.

D. National Rural Utilities Cooperative Finance Corporation (CFC)

CFC makes loans to REA utilities to supplement REA funds, although these loans are generally used for distribution type facilities. It is possible that a CFC loan could be obtained for a transmission project such as the Intertie but for purposes of this analysis it has been assumed that CFC funding will not be required. If at the time of negotiation there is a definite advantage to be gained by inclusion of a CFC loan portion with sufficiently attractive terms, the resultant impact on the financial plan can be determined.

E. Municipal Bonds

Anchorage and Fairbanks municipalities both have the authority to arrange financing for a portion of the project by the issuance of tax-exempt, general obligation bonds. As separate bond issues would possibly be made, the bonding rate pertaining to Anchorage could differ from that of Fairbanks. A recent bond issue by the Anchorage Municipal Bond Bank to cover G & T expansion on the AML & P system realized a bond rate of 6.48 percent, with 20 year maturity bonds. A rate of 6.5 percent has been used in this study for the projected Anchorage bonds, with a somewhat more conservative level of 7 percent assumed for the Fairbanks bonding. Both sets of bonds were assumed to be of 20 year maturity.

## 9.2 PROPORTIONAL ALLOCATIONS BETWEEN SOURCES

In the ultimate financial package for the Transmission Intertie, the final negotiated amounts for debt financing and bonding will be agreed to by APA and AIA participants. To arrive at the final allocation of total project costs between possible sources will require a concerted effort on the part of APA and AIA participants, in the successive negotiations with REA and other federal funding agencies such as FFB, together with the officials responsible for decisions relating to issuance of municipal bonds.

To assist with an evaluation of financial positions in relation to possible agreement on questions pertaining to proportional allocations between sources, the Consultants offer the following approach for further consideration.

- A combination of REA and FFB funds would be used to finance a total of 70 percent of project costs. In order to examine the relative improvement of composite financial terms by changes to the percentage allocation between the two sources over a range of combinations, the following allocations were evaluated:

	<u>Combination REA/FFB - %</u>	
Allocation within loan package	20/80	40/60
Allocation of total project costs	14/56	28/42

- The balance of funding, 30 percent of project costs, would be obtained from the following bond issues:

	<u>General Obligation Bonds</u>	
	Anchorage	Fairbanks
Percentage allocation by municipality	18	12

In preparing a financial plan to follow this approach the following analysis was completed using computer programs TLFAP and COMPARE. The results of this analysis are contained in Appendix F, Sheets F-1 thru F-29.

1. An initial run of TLFAP was made with the following allocations and assumptions for funding terms and conditions:

<u>Project Funding</u>	<u>Source</u>	<u>Interest Rate</u>
14%	REA	5%
56%	FFB	9.25%

Above loans have 35 year repayment period with interest only for first three years, during construction period.

18%	AMU	6.5%
12%	FMU	7.0%

Above bond issues have 20 year maturity.

2. On the assumption that the overall financial terms can be improved by changing the proportions of the combination REA/FFB loan package, a second run of TLFAP was made with the following adjustments:

<u>Project Funding</u>	<u>Source</u>	<u>Interest Rate</u>
28%	REA	5%
42%	FFB	9.25%

All other components of project funding remained the same.

It is of interest to compare the composite interest rate for project funding to determine the overall improvement in financial terms. The net effect was a decrease from 8.9 to 8.3 percent for the entire project funding, including all financial sources.

3. To translate this improvement into a present value for purposes of comparison of the respective loan packages, two runs were made using program COMPARE to determine the differential present value of future debt service associated with the two REA/FFB combinations. A net reduction of \$1,472,000 in total financial costs was realized. These computations are shown on Sheets F-27 thru F-29.

### 9.3 ALLOCATED FINANCIAL RESPONSIBILITY FOR PARTICIPANTS

#### A. Basis for Assumption of Financial Obligation

The approach followed to determine the allocated responsibility for financial participation and debt service matched the proportions of total project costs to allocated cost savings derived from interconnection. The cost savings to be realized from implementation of the transmission intertie are several, these being derived from:

1. Reserve capacity sharing, resulting in cancellation or postponement of in-service dates for certain generating units that would be required with independent system expansion. This in turn results in a reduction of total capital investment.
2. Improvement in overall economics of system operation, within the limits of potential power transfers over the intertie.
3. Reduction in capital expenditures for transmission expansion that would be required if the intertie were not built. A definite saving of this type would be realized by Matanuska Electric Association (MEA) if their system could be supplied from the Palmer bus.
4. Reduction in the cost of construction power for the Susitna Project, by use of a transmission tap-line.

Of the above cost savings, the first and third have been fully quantified in this study, the second would require a detailed computer analysis of the operational costs using a multi-area production costing program. In estimating the cost advantages of power transfer, a simplified analysis was made of the potential economies to be obtained from substitution of selected generation blocks on the basis of fuel cost only. This demonstrates adequately the potential for cost saving but is no substitute for a comprehensive analysis of system operation. This would provide a breakdown

by year of the production cost for each unit on the system, whether independent or interconnected, and would include both fuel and O & M components. The simulation of economic dispatch for units on alternative systems is essential for a definitive apportionment of the operational savings between utility participants.

Accordingly, the allocation of cost savings has been determined on the basis of reduction in capital investment by reserve sharing and the elimination of certain expenditures by MEA for transmission expansion. The cost savings to the Susitna Project is not germane to the financial allocations between utilities and has been excluded from analysis.

The cost savings from reserve sharing have been determined by segregating capital disbursements for generating units affected by interconnection between the respective utilities owning and operating the particular units. Table 9-1 indicates the annual capital disbursements by generating utility for independent and interconnected system expansion, together with the cumulative present worth for each of the investment streams.

Cost savings for each participating utility are given by the differential present worth between independent and interconnected investment streams. To these are added the cost savings to MEA for elimination of alternative transmission supply facilities by establishment of the Palmer bus. The cost savings are derived as follows:

<u>Participating Utility</u>	<u>Present Worth of Future Investment - \$1000</u>		
	<u>Independent</u>	<u>Interconnected</u>	<u>Cost Savings</u>
AML&P	103,647	91,869	11,778
CEA	236,840	229,941	6,899
MEA			2,097*
GVEA	43,203	-	<u>43,203</u>
		TOTAL	63,977

\* MEA Cost savings obtained from Section 8.3C on P.8-6.

The large magnitude of savings accruing to GVEA (68% of total) should be subdivided between GVEA and FMUS, as the municipal system will also benefit directly by association with GVEA and the continued purchase of power generated by GVEA will ultimately be reflected in the customer rates of the FMUS service area. To approximate the division of savings, a long-term average ratio between load forecasts for the two systems in the Fairbanks area was taken to be representative of relative magnitudes and resulted in the following apportionment:

	GVEA	FMUS
Percentage Allocation of Cost Savings	56	12

No further breakdown of allocated benefits was deemed appropriate at this stage; however, it may well be that other utilities such as Homer Electric Association (HEA) may decide to assume a minor share of the responsibility for debt service of the total investment in support of the project. In which case non-generating utilities can participate on an elective basis and future analysis can take into consideration minimum funding participation as a percentage of the total. The only utility which is not an immediate direct beneficiary of the intertie is CVEA. Although TLFAP contains a provision for later participation by this utility, it is not anticipated that CVEA will exercise this option prior to the connection of the Glennallen-Valdez system to the Railbelt system, following completion of the first stage development of the Upper Susitna Project.

The assumption of financial obligation was taken to be directly related to the proportionate division of allocated cost savings. The basis for financial apportionment of total project costs is as follows:

<u>Participating Utility</u>	<u>Cost Savings \$ 1000</u>	<u>Percentage Participation</u>
AML&P	11,778	18
CEA	6,899	11
MEA	2,097	3
GVEA	35,827	56
FMUS	7,677	12
TOTAL	63,977	100

These values of percentage participation were used for financial analysis.

## B. Allocation of Total Project Costs

An attempt was made to relate the allocation of project costs between participants to physical facilities in sections of the intertie. Table 9-2 contains a division of total project costs on a percentage basis and a breakdown of percentage allocations between participants, to relate their percentage allocation of total project costs with projected potential ownership of physical facilities within their own service area.

The allocation of costs was aided by considering the logical division of the total facility into three sections:

<u>Section</u>	<u>From</u>	<u>To</u>	<u>Distance (Miles)</u>	<u>% Total</u>
I	Anchorage	Palmer	40	12
II	Palmer	Healy	191	59
III	Healy	Ester	92	29

The costs included in Table 9-2 pertain to Case ID transmission facilities for the probable load forecast expansion, consisting of a single-circuit 230 kV transmission line with intermediate switching at Palmer and Healy. This also allows the realization of investment participation by MEA in the AIA to the extent indicated in Table 9-2, which corresponds to the allocated percentage for MEA. These costs are assumed to be largely associated with the Palmer substation. Similarly, the costs allocated to FMUS are assumed to be related to the Healy-Ester line section, on a joint basis with GVEA.

## C. Allocation of Debt Repayment and Sinking Fund Payments

The responsibility for loan servicing and payment of sinking fund installments is shared by utility participants, in direct proportion to the cost savings derived from the interconnection. A tabulation of the annual payments by each participating utility is given in Appendix F, Sheets F-13 through F-18. It should be noted that the annual payments do include the pro-rata share of payments to the municipal bond sinking funds tabulated on Sheets F-19 and F-20. The totals are given on Sheets F-21 through F-26.

#### 9.4 COSTS FOR RESERVE SHARING AND FIRM POWER TRANSFER

An analysis was made of the relative costs of reserve capacity and firm power transfer for the two alternative financial plans. Tables 9-3A and B provide annual costs for reserve capacity and firm power transfer based upon the total debt service per year required for the two alternative financial plans, including REA/FFB loan packages in two proportionate combinations.

The division of costs between reserve capacity sharing and firm power transfer was made on the basis of the line capacity which was allocated to each specific purpose. The total transfer capacity of the 230 kV single-circuit line is 130 MW, this being divided into 100 MW for reserve capacity and 30 MW for firm power transfer. The annual costs for firm power transfer were converted into energy costs equivalent to wheeling charges for load factors of 40, 55 and 70 percent and energy transfer of 105, 145 and 184 GWh, respectively.

The cost streams progressively diminish according to the magnitude of total debt service for the transmission interconnection facilities. The following summary tabulation provides an indication of the average values over the 32 year loan repayment period, following the interest only three year construction period.

##### AVERAGE VALUES FOR RESERVE CAPACITY AND ENERGY TRANSFER

Combination REA/FFB Loan Package	Reserve Capacity Cost (\$/kW/Yr)	Energy Transfer Cost Equivalent to Wheeling Charge Energy Cost - Mills/kWh		
		(40% LF)	(55% LF)	(70% LF)
20/80	43	12	9	7
40/60	41	12	8	7

It may be observed that the average values correspond approximately to the actual values at the year 2003.

## 9.5 FINANCIAL PLANS FOR FUTURE STAGED DEVELOPMENT

The following is one possible way to plan for funding successive expansions and extensions of the projected interconnection of Railbelt utilities.

### A. Interconnection Extension Between Systems

The implementation of the Anchorage-Fairbanks Transmission Intertie will cause Railbelt utilities to examine their system expansions in relation to those of other utilities, to determine mutual benefits of additional transmission facilities to firm ties between adjacent systems. The cost of associated facilities could be financed on a comprehensive basis, possibly on more advantageous terms than if attempted by individual utilities or municipalities. The cost of such additions to utility systems could be met from a revolving fund administered by APA, on behalf of the participants.

One possibility for application of major funds for system extension would be the interconnection of the CVEA system to the Anchorage end of the intertie. The participation of CVEA in the AIA would then be desirable, with possibly a small allocation for initial intertie facilities, prior to the determination of the timing and cost of the facilities to link the initial interconnection with the CVEA system at Glennallen. This could be implemented on a separate basis, or as part of an integrated plan for transmission of hydropower from the Susitna Project.

### B. Expansion of a Susitna Transmission System

The implementation of the Susitna Hydropower Project would require that a comprehensive financial plan be followed for funding the generation project and associated transmission facilities. The large increments of power possible from the Susitna development would require the expansion of the initial intertie, to receive energy for transmission to Anchorage and Fairbanks.

As part of the comprehensive financial plan, the funding of transmission line and substation facility expansion through time could be arranged on the basis of total incremental funding, with partition of costs and financial obligations between APA and utility participants, on a similar basis to that used for this initial approach to first stage financing of the transmission system interconnection in the Railbelt.

#### 9.6 REFERENCES

1. International Engineering Company, Inc.  
Financial Planning Model
2. Moody's Bond Record  
'Tax Exempt Bond Fields by Ratings'  
'Tax Exempts Vs. Governments and Corporates'  
January 1979

TABLE 9-1

## ALTERNATIVE DISBURSEMENTS OF CAPITAL INVESTMENT FOR GENERATION EXPANSION

\$1000  
(1979)

Year	pw <sup>1</sup>	Anchorage Municipal Light & Power System Expansion		Chugach Electric Association System Expansion		Golden Valley Electric Association System Expansion	
		<u>Independent</u>	<u>Interconnected</u>	<u>Independent</u>	<u>Interconnected</u>	<u>Independent</u>	<u>Interconnected</u>
1979	1.0000						
1982	0.9151	2,009					
1983	0.8885	8,037		10,959		7,670	-
1984	0.8626	30,139		31,539	10,959	20,264	-
1985	0.8375	37,172			31,539		
1986	0.8131	21,127					
1987	0.7894	7,152	2,009				
1988	0.7664		8,037			7,555	-
1989	0.7441		30,139	5,480		17,630	-
1990	0.7224		37,172	21,920	5,480		
1991	0.7014		21,127	82,200	21,920		
1992	0.6810		7,152	101,380	82,200		
1993	0.6611		7,020	58,450	101,380		
1994	0.6419	7,020	16,380	22,820	58,450		
1995	0.6232	16,380			22,820		
	TOTAL pw	103,647	91,869	236,840	229,941	43,203	-

NOTE: Present worth obtained using 3% discount rate, equivalent to 7% cost escalation and 10% discount rate.

TABLE 9-2

ALLOCATION OF TOTAL PROJECT COSTS BETWEEN PARTICIPANTS  
TO  
ALASKAN INTERTIE AGREEMENT  
A I A

SECTIONAL INTERCONNECTION DIVISIONS

Anchorage	Palmer	Healy	Ester
Section I	Section II	Section III	
40 M	191 M	92 M	

INTERTIE COMPONENTSPROJECT COSTS - 1979 \$1000 (%)TOTAL FACILITY

Transmission Line	6644 (10)	31,726 (46)	15,282 (22)	53,652 (78)
Substations:				
Anchorage	3976 (6)			3,976 (6)
Palmer		717 (1) 717 (1)		1,434 (2)
Healy		717 (1) 717 (1)		1,434 (2)
Ester			5,080 (7%)	5,080 (7)
Control & Communications	1,450 (2)	400 (1)	1,450 (2)	3,300 (5)
TOTAL	12,787 (19)	33,560 (49)	22,529 (32)	68,876 (100)

AIA PARTICIPANTSALLOCATIONS OF TOTAL PROJECT COSTS (%)

AM&LP	(8)	(10)	(18)
CEA	(8)	(3)	(11)
MEA	(3)		(3)
GVEA		(36)	(56)
FMUS			(12)

TABLE 9.3A  
 ALLOCATED COSTS FOR RESERVE CAPACITY SHARING AND FIRM POWER TRANSFER  
 WITH  
 FINANCIAL PLAN ALT. 1 - 20/80% COMBINATION REA/FFB LOAN PACKAGE  
 AND  
 MUNICIPAL BONDS

Year	Total Debt Service (1979/\$1000)	Cost of Reserve Capacity Sharing and Firm Power Transfer Based on Capacity Allocation					
		100 MW Reserve (Annual Cost of Reserve Capacity)		Annual Cost (\$1000)	30 MW Firm Power Transfer (Energy Charge - Mills/kwh)		
		(\$1000)	(\$/kW/Yr.)		(40% LF)	(55% LF)	(70% LF)
1984	8,670	6,669	67	2,001	19	14	11
1985	8,523	6,556	66	1,967	19	14	11
1986	8,376	6,443	64	1,933	19	13	10
1987	8,229	6,330	63	1,899	18	13	10
1988	8,082	6,217	62	1,865	18	13	10
1989	7,934	6,103	61	1,831	18	13	10
1990	7,787	5,990	60	1,797	17	12	10
1991	7,640	5,877	59	1,763	17	12	10
1992	7,493	5,764	58	1,729	17	12	9
1993	7,346	5,651	57	1,695	16	12	9
1994	7,199	5,538	55	1,661	16	11	9
1995	7,052	5,425	54	1,627	16	11	9
1996	6,905	5,312	53	1,593	15	11	9
1997	6,758	5,198	52	1,560	15	11	8
1998	6,611	5,085	51	1,526	15	11	8
1999	6,464	4,972	50	1,492	14	10	8
2000	6,317	4,859	49	1,458	14	10	8
2001	6,170	4,746	47	1,424	14	10	8
2002	6,023	4,633	46	1,390	13	10	8
2003	5,876	4,520	45	1,356	13	9	7
2004	3,515	2,704	27	811	8	6	4
2005	3,368	2,591	26	777	7	5	4
2006	3,221	2,478	25	743	7	5	4
2007	3,074	2,365	24	709	7	5	4
2008	2,927	2,252	23	675	6	5	4
2009	2,780	2,138	21	642	6	4	3
2010	2,633	2,025	20	608	6	4	3
2011	2,486	1,912	19	574	6	4	3
2012	2,339	1,799	18	540	5	4	3
2013	2,192	1,686	17	506	5	3	3
2014	2,045	1,573	16	472	5	3	3
2015	1,898	1,460	15	438	4	3	2

TABLE 9.3B  
 ALLOCATED COSTS FOR RESERVE CAPACITY SHARING AND FIRM POWER TRANSFER  
 WITH  
 FINANCIAL PLAN ALT. 2 - 40/60% COMBINATION REA/FFB LOAN PACKAGE  
 AND  
 MUNICIPAL BONDS

Year	Total Debt Service (1979/\$1000)	Cost of Reserve Capacity Sharing and Firm Power Transfer Based on Capacity Allocation					
		100 MW Reserve (Annual Cost of Reserve Capacity)		Annual Cost (\$1000)	30 MW Firm Power Transfer (Energy Charge - Mills/kWh)		
		(\$1000)	(\$/kW/Yr.)		(40% LF)	(55% LF)	(70% LF)
1984	8,194	6,303	63	1,891	18	13	10
1985	8,061	6,201	62	1,860	18	13	10
1986	7,929	6,099	61	1,830	18	13	10
1987	7,797	3,998	60	1,799	17	12	10
1988	7,665	5,896	59	1,769	17	12	10
1989	7,533	5,795	58	1,738	17	12	9
1990	7,401	5,693	57	1,708	16	12	9
1991	7,268	5,591	56	1,677	16	12	9
1992	7,136	5,489	55	1,647	16	11	9
1993	7,004	5,388	54	1,616	16	11	9
1994	6,872	5,286	53	1,586	15	11	9
1995	6,740	5,185	52	1,555	15	11	8
1996	6,608	5,083	51	1,525	15	11	8
1997	6,475	4,981	50	1,494	14	10	8
1998	6,343	4,879	49	1,464	14	10	8
1999	6,211	4,778	48	1,433	14	10	8
2000	6,079	4,676	47	1,403	13	10	8
2001	5,947	4,575	46	1,372	13	9	7
2002	5,815	4,473	45	1,342	13	9	7
2003	5,682	4,371	44	1,311	13	9	7
2004	3,337	2,567	26	770	7	5	4
2005	3,204	2,465	25	739	7	5	4
2006	3,072	2,363	24	709	7	5	4
2007	2,940	2,262	23	678	7	5	4
2008	2,808	2,160	22	648	6	4	4
2009	2,676	2,058	21	618	6	4	3
2010	2,544	1,957	20	587	6	4	3
2011	2,411	1,855	19	556	5	4	3
2012	2,279	1,753	18	526	5	4	3
2013	2,147	1,652	17	495	5	3	3
2014	2,015	1,550	16	465	4	3	3
2015	1,883	1,448	14	435	4	3	2

## CHAPTER 10

### INSTITUTIONAL CONSIDERATIONS

## CHAPTER 10

### INSTITUTIONAL CONSIDERATIONS

The Intertie Advisory Committee has proven itself most useful during this study. It has enabled initial discussions to be held between potential participants in the projected interconnection of Railbelt utilities via the Anchorage-Fairbanks Transmission Intertie. This committee represents a sure, first step towards the formation of a continuing, viable, cohesive entity, through which the intertie can be built and the resulting benefits realized by the continued expansion and operation of the interconnected utility systems in the Railbelt.

#### 10.1 PRESENT INSTITUTIONS AND RAILBELT UTILITIES

The predominant pattern of ownership management and operating responsibility by public power organizations in Alaska is exemplified by the prospective participants to an Alaskan Intertie Agreement (AIA). In addition to REA and municipal utilities in the Railbelt, it is anticipated that both the Alaska Power Administration and the Alaska Power Authority would be parties to the AIA. The probable composition of institutions and participating utilities is anticipated to be:

- Alaska Power Authority
- Anchorage Municipal Light and Power
- Chugach Electric Association, Inc.
- Homer Electric Association, Inc.
- Matanuska Electric Association, Inc.
- Golden Valley Electric Association, Inc.
- Fairbanks Municipal Utility System
- Alaska Power Administration

The above group of utilities may be joined by Copper Valley Electric Association, Inc. at a later date, to extend the interconnected facilities to the Glennallen-Valdez system.

#### A. Statutes and Limitations

The enabling legislation for the Alaska Power Authority (APA) is contained in HB 442 for the Legislature of the State of Alaska. It provides for the establishment of power projects and the authorization to proceed with developments that will serve "to supply power at the lowest reasonable cost to the state's municipal electric, rural electric, cooperative electric, and private electric utilities, and regional electric authorities, and thereby to the consumers of the state, as well as to supply existing or future industrial needs".

APA would mainly act on behalf of the municipal and rural electric utilities as a party to the AIA. Therefore, it is not presently anticipated that the authorized "powers to construct, acquire, finance, and incur debt" would be required for the Intertie Project. Rather APA could integrate and coordinate the efforts of the other participants to the AIA, to ensure that an expeditious approach is maintained during the course of the project.

APA is in an excellent position to coordinate regional programs with its state-wide involvement. For example, such coordination may assist in the process of securing an abridgement of the two county rule for the transmission intertie. Left unresolved, such existing statutes may otherwise constitute a roadblock to the realization of the benefits to be achieved by interconnection of systems of participating utilities over the large geographical area encompassed.

#### B. Jurisdiction and Service Territories

The Alaska Power Authority exercises jurisdiction over power projects in Alaska as a State entity. It parallels the Alaska Power Administration, which has federal jurisdiction in Alaska for the United States Department of Energy in Washington, D.C.

Both State and Federal entities have statewide responsibility in Alaska.

The service territories of the municipal and rural electric utilities are shown on the maps of Figures 4-1, 4-2, and 4-3 in Chapter 4. The confines of the Railbelt result in elongated geographical service areas. Such areas are particularly appropriate in relation to the transmission corridor for the intertie and enable the delineation of easements along the route to be made relative to existing transmission and distribution facilities in the area.

## 10.2 ALASKAN INTERCONNECTED UTILITIES

To provide an identity for the utility participants to the AIA, it is suggested that the name Alaskan Interconnected Utilities (AIU) be adopted by the existing Railbelt utilities to be included in the institutional and management plan for the implementation and operation of the intertie.

### A. Present Arrangements and Future Requirements

To a certain extent, the operating utilities in the Anchorage and Fairbanks areas have already evolved mutual interests. These interests now need to be augmented, to satisfy future operating requirements.

Prior to interconnection, there would be a need to coordinate revised planning for system expansion, the scheduled construction of facilities, and the separate building programs of each utility. A Planning Subcommittee of the Intertie Advisory Committee, composed of technical staff from AIU, would be desirable in the near future if this program is implemented. This planning subcommittee could be empowered to resolve joint planning problems affecting participating members.

Later on, an Operating Subcommittee would be required to determine operating procedures and coordinate system planning policy, working towards centralized economic dispatch for the interconnected system. The need for communications facilities will also need to be addressed, together with the mode of overall system control and data acquisition for interconnected facilities.

## B. Evolution of Institutional Framework

In any approach toward projecting institutional requirements for the establishment of the necessary framework to support the Anchorage-Fairbanks Transmission Intertie, it is essential to preserve a sense of perspective towards the future and allow for the possibility of integrating the presently conceived plans and concepts within a larger and more comprehensive institutional structure. This is particularly appropriate to the task of system interconnection, when successive expansions are necessary to accommodate the incremental additions associated with major generating plants.

In the case of the Railbelt, the possible implementation of the major hydropower developments of the Upper Susitna Project, would require that the institutional structure required for the transmission intertie be compatible with future institutional needs of the Susitna developments. Thus, whatever institutional changes would be brought about by a program of hydropower development of the Susitna should represent only a transition between organizational requirements keyed to transmission system expansion without the facilities of the Susitna developments and with the addition of major hydropower sources, such as Watana and Devil Canyon.

The evolutionary approach to effecting this transition is preferable over an abrupt change of institutional structures and it is thought that, with the acceptance of a pattern of multiple participation in the planning, financing, implementation, and operation of the Intertie, a suitable mode of proportionate involvement can also be considered for applicability to other transmission facilities required for the Susitna Project. This division of fiscal and managerial responsibility can also be extended into the operation of the system.

In this way a maximum of local utility participation can be achieved, with a financially beneficial allocation of total project costs between funding sources to arrive at a least financial cost package to multiple borrowers having pre-arranged sharing of debt-service obligations.

### 10.3 REFERENCES

1. Battelle Pacific Northwest Laboratories, Alaska Electric Power: An Analysis of Future Requirements and Supply Alternatives for the Railbelt Region, March 1978.
2. University of Alaska, Institute for Social and Economic Research, Electric Power in Alaska 1976-1995, August 1976.
3. House Bill 442 in the Legislature of the State of Alaska, Finance Committee, Tenth Legislature - Second Session.

APPENDIX A  
NOTES ON FUTURE USE OF ENERGY IN ALASKA

APPENDIX A

NOTES ON FUTURE USE OF ENERGY IN ALASKA

Power requirements studies analyzing historical data and forecasting future trends have been regularly accomplished for the REA-financed electric utilities in Alaska since they began operation. These studies and their forecasts over the years provide an interesting perspective as to the changes in use of electricity and the change in numbers of users, but do not fully account for the forces that produce these changes.

It is observed that electrical uses increase as the dreary, manual routines of everyday life are displaced by the equivalent electrically-powered devices. This allows the human effort to be directed elsewhere or eliminated. Electric lighting, water pumping (many Alaska homes have their own water systems) and heating, clothes washing, refrigerator, freezer, vacuum cleaner, dishwasher, cooking aids, radio and TV (education and recreation), lawn mower, chain saw, etc., all direct electrical energy toward improving the quality of life and making human effort more productive.

The typical Alaskan family is becoming more productive as a unit through an increasing percentage of the family partners entering the community group of wage earners. Increasing income allows the family to seek out new means of improving the quality of living.

There are on the horizon a number of technological triumphs that will undoubtedly find uses in those communities where the families can assign some of their resources to enhancing their lives. The home computer with its implications of many more "robots" to come and the electric car are just two of such items nearing the scene.

These considerations certainly support the trends of electrical energy use that are being forecast and could well result in the forecasts being

exceeded, if the rising standards of Alaskan life are maintained into the future.

The following paragraphs are a direct excerpt from a system planning report (see Ref. 7 in Section 3) completed in early 1979 for the Matanuska Electric Association, Inc. of Palmer, Alaska. This electric system is the oldest REA-financed system in Alaska and the statistics cited which relate the use of electrical energy to the average family earnings over a period of 35 years of actual history and a forecast of 15 to 25 years are interesting indeed.

#### \*INTRODUCTION

The accomplishment of long-range planning requires that data be estimated for future conditions and that technical answers for those conditions be evaluated in a prudent manner. Technical answers to a defined set of conditions can be readily developed using state-of-the-art methods. An occasional set of conditions prompts innovation when conventional methods appear limited; but, it is demonstrably clear that the estimate of future conditions is the single most significant factor affecting the ultimate value of a long-range plan.

It will be noted in the following System Planning Report a great effort was made to provide accurate and detailed historical data. A better understanding of the nature of electrical consumers and their actual performance amidst the set of observed environmental restraints (political and natural) is bound to be enhanced by such data. It is believed that forecasts of future conditions will also benefit in sufficient measure to make the effort a bargain.

---

\* Excerpted from MEA System Planning Report, January 1979 - see Chapter 3, Ref. 7.

The understanding of a long-range plan in the context of the whole growth of a community or region and in terms more useful to the consumer of electricity and his representatives is believed extra difficult today because of environmental concerns, high inflation and other cost aberrations.

To provide some perspective that is intended to illuminate the broad impact and position of the MEA electric supply system on its service area a tabular listing of significant MEA statistics is included herewith on the following page, Table A-1.

This table contains the 35-year history of MEA and a 20-year forecast based on the data in the Long-Range Plan. The numbers listed may surprise the reader at first inspection but this simple listing of historic factual data and related future estimates serves to demonstrate the powerful influence of electricity on the quality of life and the productivity of the MEA service area.

MEA STATISTICAL SUMMARY - PAST, PRESENT AND FORECAST

Year	Ave. No. Served Average kWh/Mo.	Ave. No. (w/o LP) Average kWh/Mo.	Miles of Line Dist. Trans.	Const. Per Mile Dist.	Ave. Cost Purch. Power \$/kWh	Average Revenue Total Sales \$/kWh	Average Revenue (w/o LP) \$/kWh	Average Bill/Const. (w/o LP) \$/Mo.	Average Family Income \$/Mo.	Portion of Income Percent
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)
1942	$\frac{210}{142}$	$\frac{188}{47}$	$\frac{90}{0}$	2.3	0.020	0.0628	0.1074	5.07	175	2.9
1954	$\frac{1401}{533}$	$\frac{1393}{335}$	$\frac{313}{0}$	4.5	0.0196	0.0450	0.0531	17.82	590	3.02
1966	$\frac{3134}{951}$	$\frac{3113}{694}$	$\frac{708}{63}$	4.4	0.0114	0.0348	0.0366	25.40	885	3.9
1977	$\frac{9434}{1573}$	$\frac{9352}{1318}$	$\frac{1430}{97}$	6.6	0.0128	0.0359	0.0368	48.50	2243	2.4

See Footnotes

Level I ( '82-'85 )	$\frac{16693}{2100}$	$\frac{16510}{1785}$	$\frac{2212}{241}$	7.5	0.0187	0.0546	0.0559	99.78	3303	3.02
Level II ( '87-'92 )	$\frac{30510}{2799}$	$\frac{30060}{2488}$	$\frac{2705}{269}$	11.3	0.0348	0.0692	0.0705	175.30	4853	3.60
Level III ( '92-'99 )	$\frac{55744}{3714}$	$\frac{54956}{3494}$	$\frac{3041}{293}$	18.3	0.0488	0.0829	0.0837	292.45	7131	4.10

The basic historical data was taken from the REA Form 7. Each column is explained as follows:

- (1) The year of operation - MEA first energized its system on January 19, 1942. Level I, II, and III refer to the Load Levels of the December 1978 Long Range Plan. The years in parenthesis are estimated dates when these levels might be reached.
- (2) The total average number of consumers with LPs and their average monthly energy (kWh) use.
- (3) The average number of consumers (w/o LPs) and their average monthly energy (kWh) use.
- (4) Miles of line at year end.
- (5) Average number of consumers served per mile of distribution line - Columns (2) divided by Column (4).
- (6) Cost of purchased power - at Levels I, II and III these are estimates developed by RWR from miscellaneous sources. These forecast are believed to be consistent with other elements of the forecast.
- (7), (8), and (9) For levels I, II and III the figures resulted from a generalized forecast of costs using the investments indicated by the Long Range Plan escalated at 7% per year, the operating costs per consumer escalated @ 7% per year and the purchased power costs of Column (6). It was also assumed that there would be 10% losses of energy and that MEA margins would be 10% of Gross Revenue.
- (10) The estimated average family income is developed from old payroll records, the "Statistical Abstract of the U.S." (Public by Bureau of the Census) 1977, and "The Alaska Economy, Year-End Performance Report 1977" (Published by Alaska Department of Commerce and Economic Development). Future income estimates made by escalating 1977 numbers at 1.08 per year which is the approximate average growth rate of income for the last 35 years.
- (11) Column (9) divided by Column (10) multiplied by 100.

TABLE A-1

APPENDIX B  
TRANSMISSION LINE COST ANALYSIS  
PROGRAM (TLCAP)

APPENDIX B

TRANSMISSION LINE COST ANALYSIS PROGRAM (TLCAP)

B.1 GENERAL DESCRIPTION

The Transmission Line Cost Analysis Program (TLCAP) calculates the installation, operation, and maintenance costs of a transmission line using a detailed unit cost model. It also automatically determines the "optimum" span and conductor size combination. Applications include the following:

- Voltage Selection - TLCAP examines the relative economics of various voltage levels.
- Span and Conductor Optimization - Span and conductor are optimized simultaneously to provide a matrix of present worth costs. Sensitivity of present worth costs to assumed discount rate is also automatically included.
- Tower Type Selection - TLCAP compares the cost impact of alternate tower types.

B.2 COMPUTER PROGRAM APPLICATIONS FOR OPTIMUM TRANSMISSION LINE COSTS

Choosing the most economical voltage level and other line parameters for any projected transmission line is a complex problem. It requires the simultaneous consideration of a multitude of interrelated factors, each of which will have a decided influence on line performance and the installed and operational costs of both the line and the overall system. The installed cost of a line increases rapidly with the voltage used. For typical single-circuit ac lines, the cost increase is approximately in direct proportion to the increase in voltage. On the other hand, the load carrying capacity of a line increases with the square of the voltage,

but this is partially offset by the increase in phase spacing and the resultant increase of line impedance.

Another factor affecting the load carrying capacity and line cost is the size of the conductor and the number of conductors per phase. Since the installed cost of the conductors may constitute as much as 28% of the total line cost, the selection of the conductor is an important decision in any line design.

For EHV lines, conductor size selection is first governed by two basic electrical requirements - the current carrying capacity and the corona performance in terms of corona loss radio interference (R.I.) and television interference (T.V.I.). As the line voltage increases, the corona performance becomes more and more the governing factor in selecting conductor size and bundle configuration.

If consideration is given to the electrical aspects alone, there is an optimum solution as to the size and number of conductors for each voltage level and load carrying requirement. However, the size of the conductor affects the loads on the structures supporting it, as well as the sag, tension, span length, and tower height and weight. All such factors influence the total cost and economics of the line. Hence, both the electrical and mechanical aspects must be considered together in order to arrive at a truly optimized overall line cost. Often a solution which is entirely satisfactory from the electrical viewpoint alone will be in conflict with the mechanical requirements. This is particularly true at locations where heavy ice loading is encountered. For example, a small conductor in a bundle of three may meet all the electrical requirements but may be entirely unsatisfactory mechanically due to excessive sag and overstress. This results in higher towers or shorter spans with more towers per unit length of line than would a larger conductor in a bundle of two. A large number of conductor and phase configurations must usually be tried before an optimum solution is found for a specific voltage level.

The voltage level for any given line should be chosen on the basis of its effect on the system to which it will be connected. This may require medium- or long-range estimation of load flow. For example, it may be more advantageous to build a single 750-kV line instead of two 400-kV lines. Each solution has its own impact on the system with respect to reliability, stability, switching over-voltages, transfer of power, and possibly the cost of future expansion. In other words, the line should be custom designed to meet present and future needs of the system within which it is to operate. It should also provide for the lowest overall cost in terms of investment and operation. Without proper attention to future needs, the "lowest initial cost solution" for a line between two given points may not necessarily be the most desirable or satisfactory one.


In addition to the variables mentioned above, there are numerous other line parameters that must be considered to properly evaluate and compare the various solutions. A few of the more important ones are:

- Conductor material, size, and stranding.
- Tower types, such as rigid or guyed, single or double-circuit, ac or dc, metal or wood.
- Foundation costs.
- Wind and ice load criteria, and their effect on tower cost through transverse, vertical, broken-wire, and/or construction loads.
- Number and strength of insulators.
- Insulator swing and air gap.
- Applicable material and labor costs.
- Investment charges, demand, and annual energy loss charges.

To accurately assess all the complexities and interrelationships, and to integrate them into a totally coordinated design that will produce a line of required performance at minimum cost, a carefully engineered computer program was developed by IECO. Program methodology of TLCAP is shown on Figure C-1. Briefly, program elements include:

## TRANSMISSION LINE COST ANALYSIS PROGRAM (TLCAP)

## METHODOLOGY

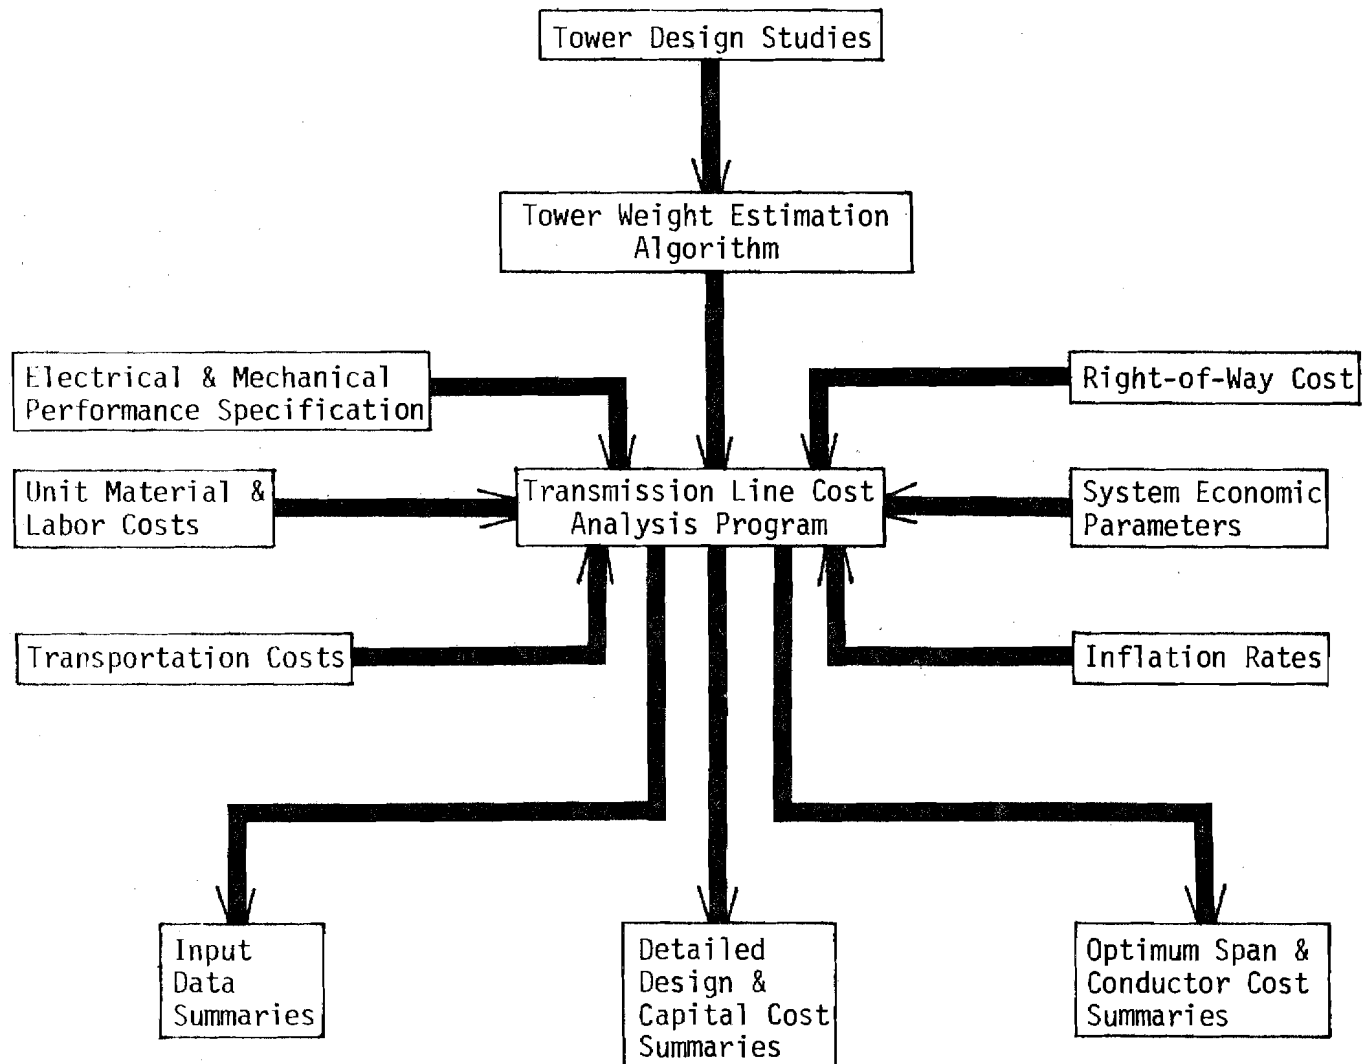

- Conductor Selection - A large variety of conductor sizes and strandings are on file for automatic use by the program. Depending upon line voltage and load, the program determines the minimum power and energy losses for each conductor studied.
- Insulation Selection - The program calculates the incremental cost differences caused by changes in the insulator length, which together with other studies of system performance indicates the best insulation for each voltage level. To ensure maximum transmission capacity, the minimum possible phase spacing is used with each type of tower, considering clearance to tower steel and insulator swing.
- Tower Selection and Span Optimization - The installed cost of towers represents a large portion of the total line cost. Therefore, this item is given special and careful consideration in the calculations. The installed cost of a tower is usually a function of the weight of the steel used. A considerable difference in weight between different tower configurations can be experienced, even in cases where the loads are identical. If to this variable, the variations in loads due to conductor size, bundling, and climatic criteria are added, it becomes evident that correct tower weights can only be determined by an actual tower design in which all the variables are properly considered. Therefore, the optimization program is complemented with a tower design program. Appropriate foundation and insulation costs are added to each tower solution to obtain the total installed cost per tower location. This information is then used by the optimization program to determine the optimum span length (the span that results in the lowest tower cost per unit length of line) for each conductor configuration being considered.

In processing these criteria, including a present worth evaluation of annual energy loss and other time-related charges, the optimization pro-

gram arrives at a long-range minimum cost solution for each voltage level investigated. However, as previously mentioned, the final evaluation of the adequacy of a line should be based upon its present and future effect on the system as a whole. Therefore, the lowest cost solution for a select number of conductor configurations, with their specific electrical characteristics, should be tried in a few additional system study runs to obtain a proper basis for a final decision.

### B.3 TLCAP SAMPLE OUTPUTS

Sample outputs of the TLCAP computer program are shown on the following pages. The output cases are listed below:

- Anchorage - Fairbanks, 230 kV (Case IA).
- Anchorage - Fairbanks, 230 kV (Case IB).
- Anchorage - Fairbanks, 345 kV (Case IC).
- Anchorage - Devil Canyon, 345 kV (Case II-1).
- Devil Canyon - Ester, 230 kV (Case II-2A).
- Watana - Devil Canyon, 230 kV (Case II-3A).

INTERNATIONAL ENGINEERING CO. INC  
SAN FRANCISCO CALIFORNIA

TRANSMISSION LINE COST ANALYSIS PROGRAM  
VERSION 1: 23 FEB 1979,

ANCHORAGE-FAIRBANKS INTERTIE CASE IA  
230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
DATE: 12 APR 79 TIME: 9:29:47

\*\*\*\*\*  
\* INPUT DATA \*  
\*\*\*\*\*

SYSTEM ECONOMIC FACTORS -----	INPUT VALUE -----	REFERENCE YEAR FOR INPUT -----
STARTING YEAR OF STUDY	1979	
ENDING YEAR OF STUDY	1996	
BASE YEAR FOR ESCALATION	1977	
MAXIMUM CIRCUIT LOADING	136.8 MVA	1992
AVERAGE CIRCUIT LOADING	41.0 MVA	1992
DEMAND COST FACTOR	73.0 \$/KW	1979
ENERGY COST FACTOR	13.0 MILLS/KWH	1979
VAR COST FACTOR	0.0 \$/KVAR	1984
CAPITAL COST/DISCOUNT RATE:		
MINIMUM	7.0 PERCENT	1984
MAXIMUM	10.0 PERCENT	1984
NUMBER OF INTERVALS	1	
O&M COST FACTOR	1.5 % CAP.COST	1979
RIGHT OF WAY COST FACTOR	715.0 \$/ACRE	1979
RIGHT OF WAY CLEARING COST	1430.0 \$/ACRE	1979
INTEREST DURING CONSTRUCTION	0.00 % INST.CST	
ENGINEERING FEE	11.00 % INST.CST	

ANCHORAGE-FAIRBANKS INTERTIE CASE 1A  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 12 APR 79 TIME: 9:29:47

\*\*\*\*\*  
 \* INPUT DATA \*  
 \*\*\*\*\*

-----  
 CONDUCTOR DATA

NUMBER PER PHASE	1
CONDUCTOR SPACING	0.0 IN
VOLTAGE	230 KV
VOLTAGE VARIATION	10.00 PCT
LINE FREQUENCY	60 CPS
FAIRWEATHER LOSSES	0.00 KW/MI
LINE LENGTH	323.00 MILES
POWER FACTOR	0.95

-----  
 GROUNDWIRE DATA

NUMBER PER TOWER	0
DIAMETER	0.00 IN
WEIGHT	0.0000 LBS/FT

-----  
 SPAN DATA

MINIMUM	1200. FT
MAXIMUM	1600. FT
INTERVAL	100.0 FT

-----  
 WEATHER DATA

MAXIMUM RAINFALL RATE	1.18 IN/HR
MAXIMUM RAINFALL DURATION	1 HRS/YR
AVERAGE RAINFALL RATE	0.03 IN/HR
AVERAGE RAINFALL DURATION	636 HRS/YR
MAXIMUM SNOWFALL RATE	1.87 IN/HR
MAXIMUM SNOWFALL DURATION	1 HRS/YR
AVERAGE SNOWFALL RATE	0.13 IN/HR
AVERAGE SNOWFALL DURATION	264 HRS/YR
RELATIVE AIR DENSITY	1.000

ANCHORAGE-FAIRBANKS INTERTIF CASE 1A  
230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
DATE: 12 APR 79 TIME: 9:29:47

\*\*\*\*\*  
\*  
\* INPUT DATA \*  
\*  
\*\*\*\*\*

SAG/TENSION DESIGN FACTORS  
-----

EVERYDAY STRESS TEMPERATURE	40. DEGREES F	ICE AND WIND TENSION (PCT UTS)	50. PERCENT
ICE AND WIND TEMPERATURE	0. DEGREES F	HIGH WIND TENSION (PCT UTS)	50. PERCENT
HIGH WIND TEMPERATURE	40. DEGREES F	EXTREME ICE TENSION (PCT UTS)	70. PERCENT
EXTREME ICE TEMPERATURE	30. DEGREES F	ICE THICKNESS WITH WIND	0.50 INCHES
MAX DESIGN TEMP FOR GND CLEARANCE	120. DEGREES F	WIND PRESSURE WITH ICE	4.00 LBS/SQ.FT.
EDS TENSION (PCT UTS)	20. PERCENT	HIGH WIND	9.0 LBS/SQ.FT.
NESC CONSTANT	0.31 LBS/FT	EXTREME ICE	0.50 INCHES

TOWER DESIGN  
-----

TOTAL NUMBER OF PHASES	3	DISTANCE BETWEEN PHASES:	
PHASE SPACING	20.0 FEET	D1	20.00 FT
CONDUCTOR CONFIGURATION FACTOR	1.02	D2	20.00 FT
GROUND CLEARANCE	28.0 FEET	D3	40.00 FT
NO. OF INSULATORS PER TOWER	48	D4	0.00 FT
INSULATOR SAFETY FACTOR	2.50	D5	0.00 FT
STRING LENGTH	6.5 FEET	D6	0.00 FT
I, VEE, OR COMBINATION	3		
FOUNDATION TYPE	4		
TERRAIN FACTOR	1.06 PER UNIT		
LINE ANGLE FACTOR	.0864		
TOWER GROUNDING	0		
TRANSVERSE OVERLOAD FACTOR	2.50		
VERTICAL OVERLOAD FACTOR	1.50		
LONGITUDINAL LOAD	1000. LBS		
MISCELLANEOUS HARDWARE WEIGHT	0.11 TONS/TOWER		
TOWER WEIGHT FACTOR	1.02		

TOWER WEIGHT ESTIMATION ALGORITHM  
-----

TOWER TYPE 9: 230KV TOWER

$$TW = 0.00016 * TH ** 2 - 3.09797 * TH * 0.3333 - 0.08943 * EFFVDL - 0.27367 * EFFIDL + 0.00510 * TH * EFFTDL + 0.00160 * TH * EFFVDL + 18.37912 \text{ KIPS}$$

ANCHORAGE-FAIRBANKS INTERTIE CASE 1A  
230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
DATE: 12 APR 79 TIME: 9:29:47

\*\*\*\*\*  
\* INPUT DATA \*  
\*\*\*\*\*

CONDUCTOR SUMMARY  
\*\*\*\*\*

ID NUMBER	NAME	SIZE(KCM)	STRANDING (AL/ST)	UNIT WEIGHT (LBS/FT)	OUT.DIAM. (INCHES)	TOTAL AREA (SQ.IN.)	MODULUS (EF/E6 PSI)	TEMP.COEF. ALPHA*E-6 PER DEG F
-----	----	-----	-----	-----	-----	-----	-----	-----
24	GROSBEAK	636.0	26/ 7	0.8750	0.9900	0.5809	11.00	10.3
25	EGRET	636.0	30/19	0.9880	1.0190	0.6134	11.30	9.7
26	FLAMINGO	666.0	24/ 7	0.8590	1.0000	0.5914	10.55	10.7
27	GANNET	666.0	26/ 7	0.9180	1.0140	0.6087	11.00	10.3
28	STILT	715.0	24/ 7	0.9210	1.0360	0.6348	10.55	10.7
29	STARLING	715.0	26/ 7	0.9850	1.0510	0.6535	11.00	10.3
30	REDWING	715.0	30/19	1.1110	1.0810	0.6901	11.30	9.7
31	CUCKOO	795.0	24/ 7	1.0240	1.0920	0.7053	10.55	10.7
32	DRAKE	795.0	26/ 7	1.0940	1.1080	0.7261	11.00	10.3
33	TERN	795.0	45/ 7	0.8960	1.0630	0.6676	9.40	11.5
34	CONDOR	795.0	54/ 7	1.0240	1.0930	0.7053	10.85	10.9
35	MALLARD	795.0	30/19	1.2350	1.1400	0.7668	11.30	9.7
36	RUDDY	900.0	45/ 7	1.0150	1.1310	0.7069	9.40	11.5
37	CANARY	900.0	54/ 7	1.1590	1.1620	0.7985	10.85	10.9
38	RAIL	954.0	45/ 7	1.0750	1.1650	0.8011	9.40	11.5
39	CARDINAL	954.0	54/ 7	1.2290	1.1960	0.8464	10.85	10.9

ANCHORAGE-FAIRBANKS INTERTIE CASE 1A  
230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
DATE: 12 APR 79 TIME: 9:29:47

\*\*\*\*\*  
\*  
\* INPUT DATA \*  
\*  
\*\*\*\*\*

CONDUCTOR SUMMARY  
\*\*\*\*\*

ID NUMBER	NAME	ULT.TENS. STRENGTH(LBS)	G.FOM.MEAN RADIUS(FT)	PRICE(\$/LB)	THERM.LIMIT (AMPERES)	AC RESIST. AT 25 DEG C (OHMS/MILE)	IND.REACT. (OHMS/MILE)	CAP.REACT. (MOHM-MILES)
-----	----	-----	-----	-----	-----	-----	-----	-----
24	GROSBEAK	25000.0	0.0335	0.628/1977	790.	0.1452	0.4118	2.6347
25	EGRET	31500.0	0.0351	0.609/1977	870.	0.1447	0.4060	2.6136
26	FLAMINGO	23700.0	0.0335	0.640/1977	810.	0.1399	0.4118	2.6294
27	GANNET	26200.0	0.0343	0.609/1977	820.	0.1373	0.4092	2.6347
28	STILT	25500.0	0.0347	0.627/1977	840.	0.1320	0.4066	2.6400
29	STARLING	28100.0	0.0355	0.608/1977	850.	0.1294	0.4050	2.6453
30	REDWING	34600.0	0.0372	0.612/1977	860.	0.1288	0.3992	2.5661
31	COCKOO	27100.0	0.0366	0.636/1977	900.	0.1214	0.3992	2.5502
32	DRAKE	31200.0	0.0375	0.622/1977	910.	0.1172	0.3992	2.5450
33	TERN	22900.0	0.0352	0.677/1977	890.	0.1188	0.4060	2.5766
34	CONDOR	28500.0	0.0368	0.635/1977	900.	0.1172	0.4002	2.5555
35	MALLARD	38400.0	0.0392	0.599/1977	910.	0.1162	0.3928	2.5186
36	RUDDY	25400.0	0.0374	0.676/1977	935.	0.1082	0.3928	2.5080
37	CANARY	32300.0	0.0392	0.633/1977	950.	0.1040	0.3928	2.5027
38	RAIL	26900.0	0.0385	0.671/1977	970.	0.0998	0.3949	2.5027
39	CARDINAL	34200.0	0.0404	0.632/1977	990.	0.0987	0.3902	2.4816

ANCHORAGE-FAIRBANKS INTERTIF CASE 1A  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 12 APR 79 TIME: 9:29:47

\*\*\*\*\*  
 \* INPUT DATA \*  
 \*\*\*\*\*

UNIT MATERIALS COSTS -----	INPUT VALUE -----	REFERENCE YEAR FOR INPUT -----
PRICE OF TOWER MATERIAL	0.957 \$/LB	1979
PRICE OF CONCRETE	0.00 \$/CU.YD.	1977
PRICE OF GROUND WIRE	0.000 \$/LB	1977
INSTALLED COST OF GROUNDING SYSTEM	0.00 \$/TOWER	1977
TOWER SETUP	1751. \$	1979
TOWER ASSEMBLY	0.455 \$/LB	1979
FOUNDATION SETUP	0. \$	1979
FOUNDATION ASSEMBLY	4140.00 \$/TON	1979
FOUNDATION EXCAVATION	0.00 \$/CU.YD.	1979
PRICE OF MISCELLANEOUS HARDWARE	290.00 \$/TOWER	1977
UNIT LABOR COSTS -----		
REFERENCE YEAR LABOR COST	24.00 \$/MANHOUR	1979
STRING GROUND WIRE	0.0 \$/MILE	1977
STRING LABOR MARKUP	4.2 PER UNIT	
UNIT TRANSPORTATION COSTS -----		
TOWER	100.0 \$/TON	
FOUNDATION CONCRETE	100.0 \$/YD	
FOUNDATION STEEL	100.0 \$/TON	
CONDUCTOR	100.0 \$/TON	
GROUND WIRE	100.0 \$/TON	
INSULATOR	100.0 \$/TON OR \$/M**3	
HARDWARE	100.0 \$/TON	

ANCHORAGE-FAIRBANKS INTERTIE CASE 1A  
230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
DATE: 12 APR 79 TIME: 9:29:47

\*\*\*\*\*  
\*  
\* AUTOMATIC CONDUCTOR SELECTION \*  
\* ALL QUANTITIES PER MILE \*  
\*  
\*\*\*\*\*

-----  
CAPITAL COST/DISCOUNT RATE OF 7.00 PERCENT  
-----

CONDUCTOR			INSTALLED COST					PRESENT WORTH		
NO.	KCM	SPAN(FT)	MATERIALS	TRANSPORTATION	INSTALLATION	ENG/DOC	SUBTOTAL	LINE LOSSES SUBTOTAL	O&M COST SUBTOTAL	LINE COST TOTAL
39	954.	1300.	68147.	3834.	84796.	9328.	166104.	32600.	3284.	201988.
35	795.	1300.	64664.	3721.	82616.	9088.	160089.	39120.	3151.	202359.
35	795.	1400.	65375.	3684.	82031.	9023.	160113.	39120.	3161.	202394.
37	900.	1300.	67299.	3772.	84608.	9307.	164986.	34543.	3257.	202784.
39	954.	1400.	69552.	3828.	84673.	9314.	167367.	32600.	3322.	203288.
37	900.	1400.	68697.	3766.	84494.	9294.	166251.	34543.	3294.	204088.
35	795.	1500.	66879.	3689.	82176.	9039.	161784.	39120.	3206.	204109.
32	795.	1300.	65558.	3685.	83893.	9228.	162364.	39523.	3195.	205082.
30	715.	1500.	63510.	3615.	82301.	9053.	158478.	44166.	3112.	205756.
30	715.	1400.	64204.	3576.	81729.	8990.	158498.	44166.	3122.	205787.
34	795.	1300.	65807.	3659.	84359.	9279.	163104.	39599.	3209.	205913.
32	795.	1400.	66784.	3669.	83683.	9205.	163342.	39523.	3226.	206091.
39	954.	1500.	71843.	3870.	85337.	9387.	170437.	32600.	3397.	206433.
38	954.	1300.	70136.	3831.	86787.	9547.	170300.	32997.	3371.	206667.
39	954.	1200.	70386.	4033.	87082.	9579.	171080.	32600.	3385.	207065.
37	900.	1500.	70983.	3807.	85172.	9369.	169331.	34543.	3369.	207242.
34	795.	1400.	67235.	3653.	84298.	9273.	164459.	39599.	3248.	207306.
35	795.	1600.	69124.	3735.	82979.	9128.	164966.	39120.	3282.	207367.
30	715.	1500.	65702.	3580.	81896.	9009.	160187.	44166.	3167.	207520.
35	795.	1200.	66889.	3916.	85020.	9352.	165176.	39120.	3254.	207549.
37	900.	1200.	69631.	3977.	86926.	9562.	170096.	34543.	3361.	207999.
29	715.	1300.	64091.	3593.	83683.	9205.	160573.	44804.	3150.	208527.
24	636.	1200.	58648.	3345.	82481.	9073.	153548.	52193.	2975.	208715.
32	795.	1500.	68883.	3701.	84257.	9268.	166109.	39523.	3295.	208926.
36	900.	1300.	69499.	3780.	86682.	9535.	169496.	36096.	3351.	208942.

ANCHORAGE-FAIRBANKS INTERTIF CASE 1A  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 12 APR 79 TIME: 9:29:47

\*\*\*\*\*  
 \* COST OUTPUT PER MILE \*  
 \* PRESENT VALUE RATE \*  
 \* 7.00 PERCENT \*  
 \*\*\*\*\*

CONDUCTOR NUMBER = 39  
 954. KCMIL 1300. FT SPAN 87.7 FT TOWER

INSTALLED COST BREAKDOWN	QUANTITY	MATERIAL COST(\$)	TONNAGE	TRANSPORTATION COST(\$)	INSTALLATION COST(\$)	TOTAL COST(\$)
CONDUCTOR	15840. FT	14086.	9.73	973.	18257.	33316.
GROUNDWIRE	0. FT	0.	0.00	0.	0.	0.
INSULATORS	207. UNITS	1313.	1.14	244.		1557.
HARDWARE		1429.	0.47	47.		1477.
TOWERS	4.3 UNITS	38870.	20.31	2031.	26019.	66921.
FOUNDATIONS	4.3 UNITS	3327.		538.	22280.	26145.
RIGHT OF WAY	13. ACRES	9120.			18241.	27361.
IDC/ENGINEERING		9328.				9328.
TOTALS		68147.	31.65	3834.	84796.	166104.

LOSS ANALYSIS	PRESENT VALUE (\$)		
	DEMAND LOSSES	ENERGY LOSSES	TOTAL LOSSES
RESISTANCE LOSSES	24588.	7992.	32580.
CORONA LOSSES	0.	19.	19.
TOTALS	24588.	8011.	32600.

INTERNATIONAL ENGINEERING CO. INC  
SAN FRANCISCO CALIFORNIA

TRANSMISSION LINE COST ANALYSIS PROGRAM  
VERSION 1: 23 FEB 1979,

ANCHORAGE-FAIRBANKS INTERTIE CASE 18  
230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
DATE: 12 APR 79 TIME: 9:37:07

\*\*\*\*\*  
\* INPUT DATA \*  
\*  
\*\*\*\*\*

SYSTEM ECONOMIC FACTORS -----	INPUT VALUE -----	REFERENCE YEAR FOR INPUT -----
STARTING YEAR OF STUDY	1979	
ENDING YEAR OF STUDY	1996	
BASE YEAR FOR ESCALATION	1977	
MAXIMUM CIRCUIT LOADING	136.8 MVA	1992
AVERAGE CIRCUIT LOADING	49.2 MVA	1992
DEMAND COST FACTOR	73.0 \$/KW	1979
ENERGY COST FACTOR	13.0 MILLS/KWH	1979
VAR COST FACTOR	0.0 \$/KVAR	1984
CAPITAL COST/DISCOUNT RATE:		
MINIMUM	7.0 PERCENT	1984
MAXIMUM	10.0 PERCENT	1984
NUMBER OF INTERVALS	1	
O&M COST FACTOR	1.5 % CAP.COST	1979
RIGHT OF WAY COST FACTOR	715.0 \$/ACRE	1979
RIGHT OF WAY CLEARING COST	1430.0 \$/ACRE	1979
INTEREST DURING CONSTRUCTION	0.00 % INST.CST	
ENGINEERING FEE	11.00 % INST.CST	

ANCHORAGE-FAIRBANKS INTERTIE CASE 18  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 12 APR 79 TIME: 9:37:07

\*\*\*\*\*  
 \* INPUT DATA \*  
 \*\*\*\*\*

-----  
 CONDUCTOR DATA

NUMBER PER PHASE 1  
 CONDUCTOR SPACING 0.0 IN  
 VOLTAGE 230 KV  
 VOLTAGE VARIATION 10.00 PCT  
 LINE FREQUENCY 60 CPS  
 FAIRWEATHER LOSSES 0.00 KW/MI  
 LINE LENGTH 323.00 MILES  
 POWER FACTOR 0.95

-----  
 GROUNDWIRE DATA

NUMBER PER TOWER 0  
 DIAMETER 0.00 IN  
 WEIGHT 0.0000 LBS/FT

-----  
 SPAN DATA

MINIMUM 1200. FT  
 MAXIMUM 1600. FT  
 INTERVAL 100.0 FT

-----  
 WEATHER DATA

MAXIMUM RAINFALL RATE 1.18 IN/HR  
 MAXIMUM RAINFALL DURATION 1 HRS/YR  
 AVERAGE RAINFALL RATE 0.03 IN/HR  
 AVERAGE RAINFALL DURATION 636 HRS/YR  
 MAXIMUM SNOWFALL RATE 1.87 IN/HR  
 MAXIMUM SNOWFALL DURATION 1 HRS/YR  
 AVERAGE SNOWFALL RATE 0.13 IN/HR  
 AVERAGE SNOWFALL DURATION 264 HRS/YR  
 RELATIVE AIR DENSITY 1.000

ANCHORAGE-FAIRBANKS INTERTIE CASE IR  
230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
DATE: 12 APR 79 TIME: 9:37:07

\*\*\*\*\*  
\* INPUT DATA \*  
\*\*\*\*\*

SAG/TENSION DESIGN FACTORS  
-----

EVERYDAY STRESS TEMPERATURE	40. DEGREES F	ICE AND WIND TENSION (PCT UTS)	50. PERCENT
ICE AND WIND TEMPERATURE	0. DEGRFES F	HIGH WIND TENSION (PCT UTS)	50. PERCENT
HIGH WIND TEMPERATURE	40. DEGRFES F	EXTREME ICE TENSION (PCT UTS)	70. PERCENT
EXTREME ICE TEMPERATURE	30. DEGREES F	ICE THICKNESS WITH WIND	0.50 INCHES
MAX DESIGN TEMP FOR GND CLEARANCE	120. DEGREES F	WIND PRESSURE WITH ICE	4.00 LBS/SQ.FT.
EDS TENSION (PCT UTS)	20. PERCENT	HIGH WIND	9.0 LBS/SQ.FT.
NESC CONSTANT	0.31 LBS/FT	EXTREME ICE	0.50 INCHES

TOWER DESIGN  
-----

TOTAL NUMBER OF PHASES	3	DISTANCE BETWEEN PHASES:	
PHASE SPACING	20.0 FEET	D1	20.00 FT
CONDUCTOR CONFIGURATION FACTOR	1.02	D2	20.00 FT
GROUND CLEARANCE	28.0 FEET	D3	40.00 FT
NO. OF INSULATORS PER TOWER	48	D4	0.00 FT
INSULATOR SAFETY FACTOR	2.50	D5	0.00 FT
SPRING LENGTH	6.5 FEET	D6	0.00 FT
I, VEE, OR COMBINATION	3		
FOUNDATION TYPE	4		
TERRAIN FACTOR	1.06 PER UNIT		
LINE ANGLE FACTOR	.0864		
TOWER GROUNDING	0		
TRANSVERSE OVERLOAD FACTOR	2.50		
VERTICAL OVERLOAD FACTOR	1.50		
LONGITUDINAL LOAD	1000. LBS		
MISCELLANEOUS HARDWARE WEIGHT	0.11 TONS/TOWER		
TOWER WEIGHT FACTOR	1.02		

TOWER WEIGHT ESTIMATION ALGORITHM  
-----

TOWER TYPE 9: 230KV TOWER

$$TW = 0.00016 * TH ** 2 - 3.09797 * TH * 0.3333 - 0.08943 * EFFVDL - 0.27367 * EFFIDL + 0.00510 * TH * EFFIDL + 0.00160 * TH * EFFVDL + 18.37912 \text{ KIPS}$$

ANCHORAGE-FAIRBANKS INTERTIE CASE 1B  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 12 APR 79 TIME: 9:37:07

\*\*\*\*\*  
 \*  
 \* INPUT DATA \*  
 \*  
 \*\*\*\*\*

CONDUCTOR SUMMARY  
 \*\*\*\*\*

ID NUMBER	NAME	SIZE(KCM)	STRANDING (AL/ST)	UNIT WEIGHT (LBS/FT)	OUT.DIAM. (INCHES)	TOTAL AREA (SQ.IN.)	MODULUS (EF/E6 PSI)	TEMP.COEF. ALPHA*E-6 PER DEG F
-----	----	-----	-----	-----	-----	-----	-----	-----
24	GROSBREAK	636.0	26/ 7	0.8750	0.9900	0.5809	11.00	10.3
25	EGRET	636.0	30/19	0.9880	1.0190	0.6134	11.30	9.7
26	FLAMINGO	666.0	24/ 7	0.8590	1.0000	0.5914	10.55	10.7
27	GANNET	666.0	26/ 7	0.9180	1.0140	0.6087	11.00	10.3
28	STILT	715.0	24/ 7	0.9210	1.0360	0.6348	10.55	10.7
29	STARLING	715.0	26/ 7	0.9850	1.0510	0.6535	11.00	10.3
30	REDWING	715.0	30/19	1.1110	1.0810	0.6901	11.30	9.7
31	CUCKOO	795.0	24/ 7	1.0240	1.0920	0.7053	10.55	10.7
32	DRAKE	795.0	26/ 7	1.0940	1.1080	0.7261	11.00	10.3
33	TERN	795.0	45/ 7	0.8960	1.0630	0.6676	9.40	11.5
34	CONDOR	795.0	54/ 7	1.0240	1.0930	0.7053	10.85	10.9
35	MALLARD	795.0	30/19	1.2350	1.1400	0.7668	11.30	9.7
36	RUDDY	900.0	45/ 7	1.0150	1.1310	0.7069	9.40	11.5
37	CANARY	900.0	54/ 7	1.1590	1.1620	0.7985	10.85	10.9
38	RAIL	954.0	45/ 7	1.0750	1.1650	0.8011	9.40	11.5
39	CARDINAL	954.0	54/ 7	1.2290	1.1960	0.8464	10.85	10.9

ANCHORAGE-FAIRBANKS INTERTIE CASE 1B  
230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
DATE: 12 APR 79 TIME: 9:37:07

\*\*\*\*\*  
\*  
\* INPUT DATA \*  
\*  
\*\*\*\*\*

CONDUCTOR SUMMARY  
\*\*\*\*\*

ID NUMBER	NAME	ULT.TENS. STRENGTH(LBS)	GEOM.MEAN RADIUS(FT)	PRICE(\$/LB)	THERM.LIMIT (AMPERES)	AC RESIST. AT 25 DEG C (OHMS/MILE)	IND.REACT. (OHMS/MILE)	CAP.REACT. (MOHM-MILES)
-----	----	-----	-----	-----	-----	-----	-----	-----
24	GROSBEAK	25000.0	0.0335	0.628/1977	790.	0.1452	0.4118	2.6347
25	EGRET	31500.0	0.0351	0.609/1977	870.	0.1447	0.4060	2.6136
26	FLAMINGO	23700.0	0.0335	0.640/1977	810.	0.1399	0.4118	2.6294
27	GANNET	26200.0	0.0343	0.609/1977	820.	0.1373	0.4092	2.6347
28	STILT	25500.0	0.0347	0.627/1977	840.	0.1320	0.4066	2.6400
29	STARLING	28100.0	0.0355	0.608/1977	850.	0.1294	0.4050	2.6453
30	REDWING	34600.0	0.0372	0.612/1977	860.	0.1288	0.3992	2.5661
31	CUCKOO	27100.0	0.0366	0.636/1977	900.	0.1214	0.3992	2.5502
32	DRAKE	31200.0	0.0375	0.622/1977	910.	0.1172	0.3992	2.5450
33	TERN	22900.0	0.0352	0.677/1977	890.	0.1188	0.4060	2.5766
34	CONDOR	28500.0	0.0368	0.635/1977	900.	0.1172	0.4002	2.5555
35	MALLARD	38400.0	0.0392	0.599/1977	910.	0.1162	0.3928	2.5186
36	RUDDY	25400.0	0.0374	0.676/1977	935.	0.1082	0.3928	2.5080
37	CANARY	32300.0	0.0392	0.633/1977	950.	0.1040	0.3928	2.5027
38	RAIL	26900.0	0.0385	0.671/1977	970.	0.0998	0.3949	2.5027
39	CARDINAL	34200.0	0.0404	0.632/1977	990.	0.0987	0.3902	2.4816

ANCHORAGE-FAIRBANKS INTERTIE CASE 1B  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 12 APR 79 TIME: 9:37:07

\*\*\*\*\*  
 \* INPUT DATA \*  
 \*\*\*\*\*

UNIT MATERIALS COSTS	INPUT VALUE	REFERENCE YEAR FOR INPUT
PRICE OF TOWER MATERIAL	0.957 \$/LB	1979
PRICE OF CONCRETE	0.00 \$/CU.YD.	1977
PRICE OF GROUND WIRE	0.000 \$/LB	1977
INSTALLED COST OF GROUNDING SYSTEM	0.00 \$/TOWER	1977
TOWER SETUP	1751. \$	1979
TOWER ASSEMBLY	0.455 \$/LB	1979
FOUNDATION SETUP	0. \$	1979
FOUNDATION ASSEMBLY	4140.00 \$/TON	1979
FOUNDATION EXCAVATION	0.00 \$/CU.YD.	1979
PRICE OF MISCELLANEOUS HARDWARE	290.00 \$/TOWER	1977

UNIT LABOR COSTS		
REFERENCE YEAR LABOR COST	24.00 \$/MANHOUR	1979
STRING GROUND WIRE	0.0 \$/MILE	1977
STRING LABOR MARKUP	4.2 PER UNIT	

UNIT TRANSPORTATION COSTS	
TOWER	100.0 \$/TON
FOUNDATION CONCRETE	100.0 \$/YD
FOUNDATION STEEL	100.0 \$/TON
CONDUCTOR	100.0 \$/TON
GROUND WIRE	100.0 \$/TON
INSULATOR	100.0 \$/TON OR \$/M**3
HARDWARE	100.0 \$/TON

ANCHORAGE-FAIRBANKS INTERTIE CASE IB  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 12 APR 79 TIME: 9:37:07

\*\*\*\*\*  
 \*  
 \* AUTOMATIC CONDUCTOR SELECTION \*  
 \* ALL QUANTITIES PER MILE \*  
 \*  
 \*\*\*\*\*

-----  
 CAPITAL COST/DISCOUNT RATE OF 7.00 PERCENT  
 -----

-----  
 PRESENT WORTH  
 -----

CONDUCTOR		INSTALLED COST						LINE LOSSES	OKM COST	LINE COST
NO.	KCM	SPAN(FT)	MATERIALS	TRANSPORTATION	INSTALLATION	ENG/IDC	SUBTOTAL	SUBTOTAL	SUBTOTAL	TOTAL
39	954.	1300.	68147.	3834.	84796.	9328.	166104.	35856.	3284.	205244.
37	900.	1300.	67299.	3772.	84608.	9307.	164986.	37993.	3257.	206235.
35	795.	1300.	64664.	3721.	82616.	9088.	160089.	43028.	3151.	206267.
35	795.	1400.	65375.	3684.	82031.	9023.	160113.	43028.	3161.	206302.
39	954.	1400.	69552.	3828.	84673.	9314.	167367.	35856.	3322.	206545.
37	900.	1400.	68697.	3766.	84494.	9294.	166251.	37993.	3294.	207538.
35	795.	1500.	66879.	3689.	82176.	9039.	161784.	43028.	3206.	208017.
32	795.	1300.	65558.	3685.	83893.	9228.	162364.	43468.	3195.	209027.
39	954.	1500.	71843.	3870.	85337.	9387.	170437.	35856.	3397.	209689.
34	795.	1300.	65807.	3659.	84359.	9279.	163104.	43545.	3209.	209858.
38	954.	1300.	70136.	3831.	86787.	9547.	170300.	36293.	3371.	209963.
32	795.	1400.	66784.	3669.	83683.	9205.	163342.	43468.	3226.	210036.
30	715.	1300.	63510.	3615.	82301.	9053.	158478.	48561.	3112.	210151.
30	715.	1400.	64204.	3576.	81729.	8990.	158498.	48561.	3122.	210182.
39	954.	1200.	70386.	4033.	87082.	9579.	171080.	35856.	3385.	210321.
37	900.	1500.	70983.	3807.	85172.	9369.	169331.	37993.	3369.	210693.
34	795.	1400.	67235.	3653.	84298.	9273.	164459.	43545.	3248.	211251.
35	795.	1600.	69124.	3735.	82979.	9128.	164966.	43028.	3282.	211275.
37	900.	1200.	69631.	3977.	86926.	9562.	170096.	37993.	3361.	211450.
35	795.	1200.	66889.	3916.	85020.	9352.	165176.	43028.	3254.	211457.
30	715.	1500.	65702.	3580.	81896.	9009.	160187.	48561.	3167.	211915.
36	900.	1300.	69499.	3780.	86682.	9535.	169496.	39701.	3351.	212547.
38	954.	1400.	72348.	3861.	87234.	9596.	173039.	36293.	3440.	212771.
32	795.	1500.	68883.	3701.	84257.	9268.	166109.	43468.	3295.	212871.
29	715.	1300.	64091.	3593.	83683.	9205.	160573.	49222.	3150.	212944.

ANCHORAGE-FAIRBANKS INTERTIE CASE IR  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 12 APR 79 TIME: 9:37:07

\*\*\*\*\*  
 \*  
 \* COST OUTPUT PER MILE \*  
 \* PRESENT VALUE RATE \*  
 \* 7.00 PERCENT \*  
 \*  
 \*\*\*\*\*

CONDUCTOR NUMBER = 39  
 954. KCMIL 1300. FT SPAN 87.7 FT TOWER

INSTALLED COST BREAKDOWN	QUANTITY	MATERIAL COST(\$)	TONNAGE	TRANSPORTATION COST(\$)	INSTALLATION COST(\$)	TOTAL COST(\$)
CONDUCTOR	15840. FT	14086.	9.73	973.	18257.	33316.
GROUNDWIRE	0. FT	0.	0.00	0.	0.	0.
INSULATORS	207. UNITS	1313.	1.14	244.		1557.
HARDWARE		1429.	0.47	47.		1477.
TOWERS	4.3 UNITS	38870.	20.31	2031.	26019.	66921.
FOUNDATIONS	4.3 UNITS	3327.		538.	22280.	26145.
RIGHT OF WAY	13. ACRES	9120.			18241.	27361.
IDC/ENGINEERING		9328.				9328.
TOTALS		68147.	31.65	3834.	84796.	166104.

PRESENT VALUE (\$)

LOSS ANALYSIS	DEMAND LOSSES	ENERGY LOSSES	TOTAL LOSSES
RESISTANCE LOSSES	24588.	11249.	35837.
CORONA LOSSES	0.	19.	19.
TOTALS	24588.	11268.	35856.

INTERNATIONAL ENGINEERING CO. INC  
SAN FRANCISCO CALIFORNIA

TRANSMISSION LINE COST ANALYSIS PROGRAM  
VERSION 2: 02 AUG 1979,

ANCHORAGE-FAIRBANKS INTERTIE CASE I-C  
345 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
DATE: 15 AUG 79 TIME: 14:06:42

\*\*\*\*\*  
\*  
\* INPUT DATA \*  
\*  
\*\*\*\*\*

SYSTEM ECONOMIC FACTORS	INPUT VALUE	REFERENCE YEAR FOR INPUT
BASE YEAR FOR PW ANALYSIS	1979	
ENDING YEAR OF STUDY	1997	
BASE YEAR FOR ESCALATION	1977	
MAXIMUM CIRCUIT LOADING	168.4 MVA	1984
AVERAGE CIRCUIT LOADING	58.9 MVA	1984
DEMAND COST FACTOR	73.0 \$/KW	1979
ENERGY COST FACTOR	13.0 MILLS/KWH	1979
VAR COST FACTOR	0.0 \$/KVAR	1984
CAPITAL COST/DISCOUNT RATES:		
	7.0 PERCENT	1984
	10.0 PERCENT	1984
O&M COST FACTOR	1.5 % CAP.COST	1984
RIGHT OF WAY COST FACTOR	715.0 \$/ACRE	1979
RIGHT OF WAY CLEARING COST	1430.0 \$/ACRE	1979
INTEREST DURING CONSTRUCTION	0.00 % INST.CST	
ENGINEERING FEE	11.00 % INST.CST	

ANCHORAGE-FAIRBANKS INTERTIE CASE 1-C  
 345 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 14:06:42

\*\*\*\*\*  
 \* INPUT DATA \*  
 \*\*\*\*\*

CONDUCTOR DATA

GROUNDWIRE DATA

SPAN DATA

NUMBER PER PHASE	2	NUMBER PER TOWER	0	MINIMUM	1000. FT
CONDUCTOR SPACING	16.0 IN	DIAMETER	0.00 IN	MAXIMUM	1600. FT
VOLTAGE	345 KV	WEIGHT	0.0000 LBS/FT	INTERVAL	100.0 FT
VOLTAGE VARIATION	10.00 PCT				
LINE FREQUENCY	60 CPS				
FAIRWEATHER LOSSES	1.70 KW/MI				
LINE LENGTH	323.00 MILES				
POWER FACTOR	0.95				

WEATHER DATA

MAXIMUM RAINFALL RATE	1.18 IN/HR
MAXIMUM RAINFALL DURATION	1 HRS/YR
AVERAGE RAINFALL RATE	0.03 IN/HR
AVERAGE RAINFALL DURATION	636 HRS/YR
MAXIMUM SNOWFALL RATE	1.87 IN/HR
MAXIMUM SNOWFALL DURATION	1 HRS/YR
AVERAGE SNOWFALL RATE	0.13 IN/HR
AVERAGE SNOWFALL DURATION	264 HRS/YR
RELATIVE AIR DENSITY	1.000

ANCHORAGE-FAIRBANKS INTERTIE CASE I-C  
 345 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 14:06:42

\*\*\*\*\*  
 \* INPUT DATA \*  
 \*\*\*\*\*

SAG/TENSION DESIGN FACTORS

EVERYDAY STRESS TEMPERATURE	40. DEGREES F	ICE AND WIND TENSION (PCT UTS)	50. PERCENT
ICE AND WIND TEMPERATURE	0. DEGREES F	HIGH WIND TENSION (PCT UTS)	50. PERCENT
HIGH WIND TEMPERATURE	40. DEGREES F	EXTREME ICE TENSION (PCT UTS)	70. PERCENT
EXTREME ICE TEMPERATURE	30. DEGREES F	ICE THICKNESS WITH WIND	0.50 INCHES
MAX DESIGN TEMP FOR GND CLEARANCE	120. DEGREES F	WIND PRESSURE WITH ICE	4.00 LBS/SQ.FT.
EDS TENSION (PCT UTS)	20. PERCENT	HIGH WIND	9.0 LBS/SQ.FT.
NESC CONSTANT	0.31 LBS/FT	EXTREME ICE	0.50 INCHES

TOWER DESIGN

TOTAL NUMBER OF PHASES	3	DISTANCE BETWEEN PHASES:	
PHASE SPACING	27.0 FEET	D1	27.00 FT
CONDUCTOR CONFIGURATION FACTOR	1.00	D2	27.00 FT
GROUND CLEARANCE	32.0 FEET	D3	54.00 FT
NO. OF INSULATORS PER TOWER	72	D4	0.00 FT
INSULATOR SAFETY FACTOR	2.50	D5	0.00 FT
STRING LENGTH	9.5 FEET	D6	0.00 FT
I, VEE, OR COMBINATION	3		
FOUNDATION TYPE	4		
TERRAIN FACTOR	1.06 PER UNIT		
LINE ANGLE FACTOR	.0864		
TOWER GROUNDING	0		
TRANSVERSE OVERLOAD FACTOR	2.50		
VERTICAL OVERLOAD FACTOR	1.50		
LONGITUDINAL LOAD	1000. LBS		
MISCELLANEOUS HARDWARE WEIGHT	0.11 TONS/TOWER		
TOWER WEIGHT FACTOR	1.02		

TOWER WEIGHT ESTIMATION ALGORITHM

TOWER TYPE 10: 345KV TOWER

$$TW = 0.00043*TH**2 - 0.992111*TH**0.6000 - 0.10371*EFFVDL - 0.27365*EFFIDL + 0.00503*TH*EFFIDL + 0.00181*TH*EFFVDL + 20.77701 \text{ KIPS}$$

ANCHORAGE-FAIRBANKS INTERTIE CASE I-C  
 345 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 14:06:42

\*\*\*\*\*  
 \*  
 \* INPUT DATA \*  
 \*  
 \*\*\*\*\*

CONDUCTOR SUMMARY  
 \*\*\*\*\*

ID NUMBER	NAME	SIZE (KCM)	STRANDING (AL/ST)	UNIT WEIGHT (LBS/FT)	OUT. DIAM. (INCHES)	TOTAL AREA (SQ. IN.)	MODULUS (EF/E6 PSI)	TEMP. COEF. ALPHA * E-6 PER DEG F
29	STARLING	715.0	26/ 7	0.9850	1.0510	0.6535	11.00	10.3
30	REDWING	715.0	30/19	1.1110	1.0810	0.6901	11.30	9.7
31	CUCKOO	795.0	24/ 7	1.0240	1.0920	0.7053	10.55	10.7
32	DRAKE	795.0	26/ 7	1.0940	1.1080	0.7261	11.00	10.3
33	TERN	795.0	45/ 7	0.8960	1.0630	0.6676	9.40	11.5
34	CONDOR	795.0	54/ 7	1.0240	1.0930	0.7053	10.85	10.9
35	MALLARD	795.0	30/19	1.2350	1.1400	0.7668	11.30	9.7
36	RUDDY	900.0	45/ 7	1.0150	1.1310	0.7069	9.40	11.5
37	CANARY	900.0	54/ 7	1.1590	1.1620	0.7985	10.85	10.9
38	RAJL	954.0	45/ 7	1.0750	1.1650	0.8011	9.40	11.5
39	CARDINAL	954.0	54/ 7	1.2290	1.1960	0.8464	10.85	10.9
40	ORTOLAN	1033.0	45/ 7	1.1650	1.2130	0.8678	9.40	11.5

ANCHORAGE-FAIRBANKS INTERTIE CASE I-C  
 345 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 14:06:42

\*\*\*\*\*  
 \*  
 \* INPUT DATA \*  
 \*  
 \*\*\*\*\*

CONDUCTOR SUMMARY  
 \*\*\*\*\*

ID NUMBER	NAME	ULT.TENS. STRENGTH(LBS)	GEOM.MEAN RADIUS(FT)	PRICE(\$/LB)	THERM.LIMIT (AMPERES)	AC RESIST. AT 25 DEG C (OHMS/MILE)	IND.REACT. (OHMS/MILE)	CAP.REACT. (MOHM-MILES)
29	STARLING	28100.0	0.0355	0.608/1977	850.	0.1294	0.4050	2.6453
30	REDWING	34600.0	0.0372	0.612/1977	860.	0.1288	0.3992	2.5661
31	CUCKOO	27100.0	0.0366	0.636/1977	900.	0.1214	0.3992	2.5502
32	DRAKE	31200.0	0.0375	0.622/1977	910.	0.1172	0.3992	2.5450
33	TERN	22900.0	0.0352	0.677/1977	890.	0.1188	0.4060	2.5766
34	CUNDOOR	28500.0	0.0368	0.635/1977	900.	0.1172	0.4002	2.5555
35	MALLARD	38400.0	0.0392	0.599/1977	910.	0.1162	0.3928	2.5186
36	RIDDY	25400.0	0.0374	0.676/1977	935.	0.1082	0.3928	2.5080
37	CANARY	32300.0	0.0392	0.633/1977	950.	0.1040	0.3928	2.5027
38	RAIL	26900.0	0.0385	0.671/1977	970.	0.0998	0.3949	2.5027
39	CARDINAL	34200.0	0.0404	0.632/1977	990.	0.0987	0.3902	2.4816
40	ORTOLAN	28900.0	0.0401	0.670/1977	1020.	0.0924	0.3902	2.4658

ANCHORAGE-FAIRBANKS INTERTIE CASE I-C  
 345 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 14:06:42

\*\*\*\*\*  
 \*  
 \* INPUT DATA \*  
 \*  
 \*\*\*\*\*

UNIT MATERIALS COSTS	INPUT VALUE	REFERENCE YEAR FOR INPUT
PRICE OF TOWER MATERIAL	0.957 \$/LB	1979
PRICE OF CONCRETE	0.00 \$/CU.YD.	1977
PRICE OF GROUND WIRE	0.000 \$/LB	1977
INSTALLED COST OF GROUNDING SYSTEM	0.00 \$/TOWER	1977
TOWER SETUP	1751. \$	1979
TOWER ASSEMBLY	0.455 \$/LB	1979
FOUNDATION SETUP	0. \$	1979
FOUNDATION ASSEMBLY	4140.00 \$/TON	1979
FOUNDATION EXCAVATION	0.00 \$/CU.YD.	1979
PRICE OF MISCELLANEOUS HARDWARE	290.00 \$/TOWER	1977

UNIT LABOR COSTS		
REFERENCE YEAR LABOR COST	24.00 \$/MANHOUR	1979
STRING GROUND WIRE	0.0 \$/MILE	1977
STRING LABOR MARKUP	4.2 PER UNIT	

UNIT TRANSPORTATION COSTS	
TOWER	131.0 \$/TON
FOUNDATION CONCRETE	131.0 \$/YD
FOUNDATION STEEL	131.0 \$/TON
CONDUCTOR	131.0 \$/TON
GROUND WIRE	131.0 \$/TON
INSULATOR	131.0 \$/TON OR \$/M**3
HARDWARE	131.0 \$/TON

ANCHORAGE-FAIRBANKS INTERTIE CASE I-C  
 345 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 14:06:42

\*\*\*\*\*  
 \*  
 \* AUTOMATIC CONDUCTOR SELECTION \*  
 \* ALL QUANTITIES PER MILE \*  
 \*  
 \*\*\*\*\*

CAPITAL COST/DISCOUNT RATE OF 7.00 PERCENT

PRESENT WORTH (\$)

B - 29

CONDUCTOR			INSTALLED COST						LINE LOSSES	O&M COST	LINE COST
NO.	KCM	SPAN(FT)	MATERIALS	TRANSP.	INSTALL.	ENGINEER.	IOC	SUBTOTAL	SUBTOTAL	SUBTOTAL	TOTAL
35	795.	1300.	108253.	6482.	110086.	24730.	0.	249551.	46122.	3372.	299046.
35	795.	1400.	110039.	6483.	108849.	24791.	0.	250162.	46122.	3381.	299665.
30	715.	1300.	105622.	6257.	109368.	24337.	0.	245584.	52150.	3319.	301053.
35	795.	1200.	107799.	6557.	112490.	24953.	0.	251799.	46122.	3403.	301324.
30	715.	1400.	107324.	6253.	108105.	24385.	0.	246066.	52150.	3325.	301541.
37	900.	1300.	112812.	6579.	112648.	25524.	0.	257563.	41403.	3481.	302447.
32	795.	1300.	109255.	6395.	111472.	24983.	0.	252106.	47191.	3407.	302703.
35	795.	1500.	113021.	6550.	108617.	25101.	0.	253289.	46122.	3423.	302834.
39	954.	1300.	114706.	6710.	113084.	25795.	0.	260295.	39129.	3517.	302941.
37	900.	1200.	111385.	6608.	114494.	25574.	0.	258061.	41403.	3487.	302751.
39	954.	1200.	113228.	6736.	114915.	25837.	0.	260716.	39129.	3523.	303367.
30	715.	1200.	105232.	6336.	111787.	24569.	0.	247924.	52150.	3350.	303424.
34	795.	1300.	109378.	6337.	111931.	25041.	0.	252687.	47590.	3415.	303691.
32	795.	1200.	108121.	6439.	113468.	25083.	0.	253111.	47191.	3420.	303722.
29	715.	1300.	105955.	6199.	110878.	24534.	0.	247565.	53308.	3345.	304219.
34	795.	1200.	107941.	6369.	113774.	25095.	0.	253229.	47590.	3422.	304242.
30	715.	1500.	110237.	6316.	107857.	24685.	0.	249095.	52150.	3366.	304611.
32	795.	1400.	111805.	6432.	110688.	25182.	0.	254106.	47191.	3434.	304731.
37	900.	1400.	115679.	6631.	112024.	25777.	0.	260112.	41403.	3515.	305029.
29	715.	1200.	104868.	6246.	112878.	24639.	0.	248632.	53308.	3360.	305300.
39	954.	1400.	117620.	6765.	112473.	26054.	0.	262913.	39129.	3553.	305594.
29	715.	1400.	108480.	6233.	110103.	24730.	0.	249545.	53308.	3372.	306225.
34	795.	1400.	112220.	6386.	111322.	25292.	0.	255220.	47590.	3449.	306259.
35	795.	1100.	108831.	6718.	116263.	25499.	0.	257312.	46122.	3477.	306911.
37	900.	1100.	111580.	6730.	117785.	25970.	0.	262065.	41403.	3541.	307009.

ANCHORAGE-FAIRBANKS INTERTIE CASE I-C  
 345 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 14:06:42

\*\*\*\*\*  
 \* COST OUTPUT PER MILE \*  
 \* PRESENT VALUE RATE \*  
 \* 7.00 PERCENT \*  
 \*\*\*\*\*

CONDUCTOR NUMBER = 35  
 795. KCMIL 1300. FT SPAN 89.3 FT TOWER

INSTALLFD COST BREAKDOWN	QUANTITY	MATERIAL COST(\$)	TONNAGE	TRANSPORTATION COST(\$)	INSTALLATION COST(\$)	TOTAL COST(\$)
CONDUCTOR	31680. FT	35171.	19.56	2563.	33947.	71681.
GROUNDWIRE	0. FT	0.	0.00	0.	0.	0.
INSULATORS	310. UNITS	2582.	1.70	480.		3062.
HARDWARE		1874.	0.47	62.		1936.
TOWERS	4.3 UNITS	83824. - ?	33.41 -	4377. -	49735.	137936.
FOUNDATIONS	4.3 UNITS	6280.		1015.	42054.	49349.
RIGHT OF WAY (107FT)	13. ACRES	12167.			18565.	30732.
SUB-TOTALS		141897.	55.15	8497.	144301.	294695.
IDC						0.
ENGINEERING						32416.
						TOTAL 327111.
PRESENT WORTH		108253.		6482.	110086.	224821.
IDC						0.
ENGINEERING						24730.
						TOTAL 249551.

PRESENT WORTH (\$)

LOSS ANALYSIS	DEMAND LOSSES	ENERGY LOSSES	TOTAL LOSSES
RESISTANCE LOSSES	25483.	14441.	39924.
CORONA LOSSES: INSULATORS	1624.	3145.	4768.
CONDUCTOR	-	1430.	1430.
TOTALS	27107.	19015.	46122.

INTERNATIONAL ENGINEERING CO. INC  
SAN FRANCISCO, CALIFORNIA

TRANSMISSION LINE COST ANALYSIS PROGRAM  
VERSION 2: 02 AUG 1979,

ANCHORAGE-DEVIL CANYON CASE II-1  
345 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
DATE: 15 AUG 79 TIME: 15:56:14

\*\*\*\*\*  
\* INPUT DATA \*  
\*  
\*\*\*\*\*

B - 31

SYSTEM ECONOMIC FACTORS -----	INPUT VALUE -----	REFERENCE YEAR FOR INPUT -----
BASE YEAR FOR PW ANALYSIS	1979	
ENDING YEAR OF STUDY	1997	
BASE YEAR FOR ESCALATION	1977	
MAXIMUM CIRCUIT LOADING	631.6 MVA	1992
AVERAGE CIRCUIT LOADING	347.4 MVA	1992
DEMAND COST FACTOR	73.0 \$/KW	1979
ENERGY COST FACTOR	13.0 MILLS/KWH	1979
VAR COST FACTOR	0.0 \$/KVAR	1984
CAPITAL COST/DISCOUNT RATES:		
	7.0 PERCENT	1984
	10.0 PERCENT	1984
OKM COST FACTOR	1.5 % CAP.COST	1984
RIGHT OF WAY COST FACTOR	715.0 \$/ACRE	1979
RIGHT OF WAY CLEARING COST	1430.0 \$/ACRE	1979
INTEREST DURING CONSTRUCTION	0.00 % INST.CST	
ENGINEERING FEE	11.00 % INST.CST	

ANCHORAGE-DEVIL CANYON CASE II-1  
 345 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 15:56:14

\*\*\*\*\*  
 \* INPUT DATA \*  
 \*\*\*\*\*

-----  
 CONDUCTOR DATA

NUMBER PER PHASE	2
CONDUCTOR SPACING	18.0 IN
VOLTAGE	345 KV
VOLTAGE VARIATION	10.00 PCT
LINE FREQUENCY	60 CPS
FAIRWEATHER LOSSES	1.70 KW/MI
LINE LENGTH	155.00 MILES
POWER FACTOR	0.95

-----  
 GROUNDWIRE DATA

NUMBER PER TOWER	0
DIAMETER	0.00 IN
WEIGHT	0.0000 LBS/FT

-----  
 SPAN DATA

MINIMUM	1000. FT
MAXIMUM	1600. FT
INTERVAL	100.0 FT

-----  
 WEATHER DATA

MAXIMUM RAINFALL RATE	1.18 IN/HR
MAXIMUM RAINFALL DURATION	1 HRS/YR
AVERAGE RAINFALL RATE	0.03 IN/HR
AVERAGE RAINFALL DURATION	636 HRS/YR
MAXIMUM SNOWFALL RATE	1.87 IN/HR
MAXIMUM SNOWFALL DURATION	1 HRS/YR
AVERAGE SNOWFALL RATE	0.13 IN/HR
AVERAGE SNOWFALL DURATION	264 HRS/YR
RELATIVE AIR DENSITY	1.000

ANCHORAGE-DEVIL CANYON CASE II-1  
 345 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 15:56:14

\*\*\*\*\*  
 \* INPUT DATA \*  
 \*\*\*\*\*

SAG/TENSION DESIGN FACTORS  
 -----

EVERYDAY STRESS TEMPERATURE	40. DEGREES F	ICE AND WIND TENSION (PCT UTS)	50. PERCENT
ICE AND WIND TEMPERATURE	0. DEGREES F	HIGH WIND TENSION (PCT UTS)	50. PERCENT
HIGH WIND TEMPERATURE	40. DEGREES F	EXTREME ICE TENSION (PCT UTS)	70. PERCENT
EXTREME ICE TEMPERATURE	30. DEGREES F	ICE THICKNESS WITH WIND	0.50 INCHES
MAX DESIGN TEMP FOR GND CLEARANCE	120. DEGREES F	WIND PRESSURE WITH ICE	4.00 LBS/SQ.FT.
EDS TENSION (PCT UTS)	20. PERCENT	HIGH WIND	9.0 LBS/SQ.FT.
NESC CONSTANT	0.31 LBS/FT	EXTREME ICE	0.50 INCHES

TOWER DESIGN  
 -----

TOTAL NUMBER OF PHASES	3	DISTANCE BETWEEN PHASES:	
PHASE SPACING	27.0 FEET	D1	27.00 FT
CONDUCTOR CONFIGURATION FACTOR	1.02	D2	27.00 FT
GROUND CLEARANCE	32.0 FEET	D3	54.00 FT
NO. OF INSULATORS PER TOWER	72	D4	0.00 FT
INSULATOR SAFETY FACTOR	2.50	D5	0.00 FT
STRING LENGTH	9.5 FEET	D6	0.00 FT
I, VEF, OR COMBINATION	3		
FOUNDATION TYPE	4		
TERRAIN FACTOR	1.06 PER UNIT		
LINE ANGLE FACTOR	.0864		
TOWER GROUNDING	0		
TRANSVERSE OVERLOAD FACTOR	2.50		
VERTICAL OVERLOAD FACTOR	1.50		
LONGITUDINAL LOAD	1000. LBS		
MISCELLANEOUS HARDWARE WEIGHT	0.11 TONS/TOWER		
TOWER WEIGHT FACTOR	1.02		

TOWER WEIGHT ESTIMATION ALGORITHM  
 -----

TOWER TYPE 10: 345KV TOWER

$$TW = 0.00043 \cdot TH^*2 - 0.992111 \cdot TH^*0.6000 - 0.10371 \cdot EFFVDL - 0.27365 \cdot LEFFIDL + 0.00503 \cdot TH \cdot EFFIDL + 0.00181 \cdot TH \cdot EFFVDL + 20.77701 \text{ KIPS}$$

ANCHORAGE-DEVIL CANYON CASE II-1  
 345 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 15:56:14

\*\*\*\*\*  
 \* INPUT DATA \*  
 \*\*\*\*\*

CONDUCTOR SUMMARY  
 \*\*\*\*\*

B - 34

ID NUMBER	NAME	SIZE(KCM)	STRANDING (AL/ST)	UNIT WEIGHT (LBS/FT)	OUT.DIAM. (INCHES)	TOTAL AREA (SQ.IN.)	MODULUS (EF/E6 PSI)	TEMP.COEF. ALPHA*E-6 PER DEG F
29	STARLING	715.0	26/ 7	0.9850	1.0510	0.6535	11.00	10.3
30	PEDWING	715.0	30/19	1.1110	1.0810	0.6901	11.30	9.7
31	CUCKOO	795.0	24/ 7	1.0240	1.0920	0.7053	10.55	10.7
32	DRAKE	795.0	26/ 7	1.0940	1.1080	0.7261	11.00	10.3
33	TERN	795.0	45/ 7	0.8960	1.0630	0.6676	9.40	11.5
34	CONDOR	795.0	54/ 7	1.0240	1.0930	0.7053	10.85	10.9
35	MALLARD	795.0	30/19	1.2350	1.1400	0.7668	11.30	9.7
36	RUDDY	900.0	45/ 7	1.0150	1.1310	0.7069	9.40	11.5
37	CANARY	900.0	54/ 7	1.1590	1.1620	0.7985	10.85	10.9
38	RAIL	954.0	45/ 7	1.0750	1.1650	0.8011	9.40	11.5
39	CARDINAL	954.0	54/ 7	1.2290	1.1960	0.8464	10.85	10.9
40	ORTOLAN	1033.0	45/ 7	1.1650	1.2130	0.8678	9.40	11.5

ANCHORAGE-DEVIL CANYON CASE II-1  
 345 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 15:56:14

\*\*\*\*\*  
 \* INPUT DATA \*  
 \*\*\*\*\*

CONDUCTOR SUMMARY  
 \*\*\*\*\*

ID NUMBER	NAME	ULT.TENS. STRENGTH(LBS)	GEOM.MEAN RADIUS(FT)	PRICE(\$/LB)	THERM.LIMIT (AMPERES)	AC RESIST. AT 25 DEG C (OHMS/MILE)	IND.REACT. (OHMS/MILE)	CAP.REACT. (MOHM-MILES)
B - 35	29 STAPLING	28100.0	0.0355	0.608/1977	850.	0.1294	0.4050	2.6453
	30 REDWING	34600.0	0.0372	0.612/1977	860.	0.1288	0.3992	2.5661
	31 CUCKOO	27100.0	0.0366	0.636/1977	900.	0.1214	0.3992	2.5502
	32 DRAKE	31200.0	0.0375	0.622/1977	910.	0.1172	0.3992	2.5450
	33 TERN	22900.0	0.0352	0.677/1977	890.	0.1188	0.4060	2.5766
	34 CONDOR	28500.0	0.0368	0.635/1977	900.	0.1172	0.4002	2.5555
	35 MALLARD	38400.0	0.0392	0.599/1977	910.	0.1162	0.3928	2.5186
	36 RUDDY	25400.0	0.0374	0.676/1977	935.	0.1082	0.3928	2.5080
	37 CANARY	32300.0	0.0392	0.633/1977	950.	0.1040	0.3928	2.5027
	38 RAIL	26900.0	0.0385	0.671/1977	970.	0.0998	0.3949	2.5027
	39 CARDINAL	34200.0	0.0404	0.632/1977	990.	0.0987	0.3902	2.4816
	40 ORTOLAN	28900.0	0.0401	0.670/1977	1020.	0.0924	0.3902	2.4658

ANCHORAGE-DEVIL CANYON CASE II-1  
 345 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 15:56:14

\*\*\*\*\*  
 \* INPUT DATA \*  
 \*\*\*\*\*

UNIT MATERIALS COSTS	INPUT VALUE	REFERENCE YEAR FOR INPUT
PRICE OF TOWER MATERIAL	0.957 \$/LB	1979
PRICE OF CONCRETE	0.00 \$/CU.YD.	1977
PRICE OF GROUND WIRE	0.000 \$/LB	1977
INSTALLED COST OF GROUNDING SYSTEM	0.00 \$/TOWER	1977
TOWER SETUP	1751. \$	1979
TOWER ASSEMBLY	0.455 \$/LB	1979
FOUNDATION SETUP	0. \$	1979
FOUNDATION ASSEMBLY	4140.00 \$/TON	1979
FOUNDATION EXCAVATION	0.00 \$/CU.YD.	1979
PRICE OF MISCELLANEOUS HARDWARE	290.00 \$/TOWER	1977

UNIT LABOR COSTS		
REFERENCE YEAR LABOR COST	24.00 \$/MANHOUR	1979
STRING GROUND WIRE	0.0 \$/MILE	1977
STRING LABOR MARKUP	4.2 PER UNIT	

UNIT TRANSPORTATION COSTS	
TOWER	225.0 \$/TON
FOUNDATION CONCRETE	225.0 \$/YD
FOUNDATION STEEL	225.0 \$/TON
CONDUCTOR	225.0 \$/TON
GROUND WIRE	225.0 \$/TON
INSULATOR	225.0 \$/TON OR \$/M**3
HARDWARE	225.0 \$/TON

ANCHORAGE-DEVIL CANYON CASE II-1  
 345 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 15:56:14

\*\*\*\*\*  
 \*  
 \* AUTOMATIC CONDUCTOR SELECTION \*  
 \* ALL QUANTITIES PER MILE \*  
 \*  
 \*\*\*\*\*

CAPITAL COST/DISCOUNT RATE OF 7.00 PERCENT

PRESENT WORTH (\$)

CONDUCTOR			INSTALLED COST						LINE LOSSES	O&M COST	LINE COST
NO.	KCM	SPAN(FT)	MATERIALS	TRANSP.	INSTALL.	ENGINEER.	IDC	SUBTOTAL	SUBTOTAL	SUBTOTAL	TOTAL
39	954.	1300.	114706.	6707.	106803.	25104.	0.	253320.	103751.	3423.	360494.
39	954.	1200.	113228.	6733.	109119.	25199.	0.	254279.	103751.	3436.	361466.
40	1033.	1200.	117782.	6833.	111149.	25934.	0.	261697.	96912.	3536.	362145.
39	954.	1400.	117620.	6763.	105670.	25306.	0.	255358.	103751.	3451.	362560.
40	1033.	1300.	120420.	6862.	109426.	26038.	0.	262747.	96912.	3551.	363209.
37	900.	1300.	112812.	6577.	106335.	24830.	0.	250553.	109695.	3386.	363634.
37	900.	1200.	111385.	6606.	108671.	24933.	0.	251594.	109695.	3400.	364689.
40	1033.	1100.	116899.	6903.	114340.	26196.	0.	264337.	96912.	3572.	364821.
37	900.	1400.	115679.	6629.	105183.	25024.	0.	252516.	109695.	3412.	365623.
39	954.	1100.	113373.	6852.	112838.	25637.	0.	258700.	103751.	3496.	365947.
38	954.	1200.	114994.	6655.	110421.	25528.	0.	257598.	105138.	3481.	366218.
38	954.	1300.	117510.	6678.	108644.	25611.	0.	258442.	105138.	3492.	367073.
39	954.	1500.	121880.	6892.	105583.	25779.	0.	260134.	103751.	3515.	367400.
40	1033.	1400.	124683.	6982.	108982.	26471.	0.	267117.	96912.	3610.	367639.
38	954.	1100.	114231.	6732.	113666.	25809.	0.	260438.	105138.	3519.	369096.
37	900.	1100.	111580.	6728.	112411.	25379.	0.	256098.	109695.	3461.	369253.
35	795.	1300.	108253.	6480.	104166.	24079.	0.	242978.	123194.	3283.	369455.
35	795.	1400.	110039.	6480.	102462.	24088.	0.	243069.	123194.	3285.	369548.
37	900.	1500.	119895.	6755.	105080.	25490.	0.	257220.	109695.	3476.	370391.
38	954.	1400.	121645.	6790.	108142.	26023.	0.	262601.	105138.	3549.	371288.
35	795.	1500.	113021.	6548.	101728.	24343.	0.	245640.	123194.	3319.	372154.
35	795.	1200.	107799.	6555.	107003.	24349.	0.	245705.	123194.	3320.	372220.
32	795.	1300.	109255.	6393.	105210.	24294.	0.	245153.	124675.	3313.	373141.
36	900.	1200.	113498.	6546.	110037.	25309.	0.	255389.	114545.	3451.	373385.
34	795.	1300.	109378.	6334.	105529.	24337.	0.	245578.	124885.	3319.	373781.

ANCHORAGE-DEVIL CANYON CASE II-1  
 345 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 15:56:14

\*\*\*\*\*  
 \* COST OUTPUT PER MILE \*  
 \* PRESENT VALUE RATE \*  
 \* 7.00 PERCENT \*  
 \*\*\*\*\*

CONDUCTOR NUMBER = 39  
 954. KCMIL 1300. FT SPAN 94.7 FT TOWER

INSTALLED COST BREAKDOWN	QUANTITY	MATERIAL COST(\$)	TONNAGE	TRANSPORTATION COST(\$)	INSTALLATION COST(\$)	TOTAL COST(\$)
CONDUCTOR	31680. FT	63449.	19.47	4380.	58264.	126094.
GROUNDWIRE	0. FT	0.	0.00	0.	0.	0.
INSULATORS	310. UNITS	4436.	1.70	824.		5260.
HARDWARE		3219.	0.47	107.		3326.
TOWERS	4.3 UNITS	154265.	35.79	8052.	90323.	252640.
FOUNDATIONS	4.3 UNITS	10790.		1744.	72256.	84790.
RIGHT OF WAY (113FT)	14. ACRES	22181.			19697.	41877.
SUB-TOTALS		258340.	57.43	15107.	240540.	513987.
IDC						0.
ENGINEERING						56539.
						TOTAL 570526.
PRESENT WORTH		114706.		6707.	106803.	228216.
IDC						0.
ENGINEERING						25104.
						TOTAL 253320.

LOSS ANALYSTS	PRESENT WORTH (\$)		
	DEMAND LOSSES	ENERGY LOSSES	TOTAL LOSSES
RESISTANCE LOSSES	53177.	48068.	101245.
CORONA LOSSES: INSULATORS	696.	1498.	2194.
CONDUCTOR	-	313.	313.
TOTALS	53872.	49879.	103751.

INTERNATIONAL ENGINEERING CO., INC  
SAN FRANCISCO CALIFORNIA

TRANSMISSION LINE COST ANALYSIS PROGRAM  
VERSION 2: 02 AUG 1979,

DEVIL CANYON-ESTER CASE II-2A  
230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
DATE: 16 AUG 79 TIME: 13:14:31

\*\*\*\*\*  
\* INPUT DATA \*  
\*\*\*\*\*

B - 39

SYSTEM ECONOMIC FACTORS	INPUT VALUE	REFERENCE YEAR FOR INPUT
BASE YEAR FOR PW ANALYSIS	1979	
ENDING YEAR OF STUDY	1997	
BASE YEAR FOR ESCALATION	1977	
MAXIMUM CIRCUIT LOADING	194.7 MVA	1992
AVERAGE CIRCUIT LOADING	107.1 MVA	1992
DEMAND COST FACTOR	73.0 \$/KW	1979
ENERGY COST FACTOR	13.0 MILLS/KWH	1979
VAR COST FACTOR	0.0 \$/KVAR	1984
CAPITAL COST/DISCOUNT RATES:		
	7.0 PERCENT	1984
	10.0 PERCENT	1984
O&M COST FACTOR	1.5 % CAP.COST	1984
RIGHT OF WAY COST FACTOR	715.0 \$/ACRE	1979
RIGHT OF WAY CLEARING COST	1430.0 \$/ACRE	1979
INTEREST DURING CONSTRUCTION	0.00 % INST.CST	
ENGINEERING FEE	11.00 % INST.CST	

DEVIL CANYON-ESTER CASE II-2A  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 16 AUG 79 TIME: 13:14:31

\*\*\*\*\*  
 \* INPUT DATA \*  
 \*\*\*\*\*

CONDUCTOR DATA

GROUNDWIRE DATA

SPAN DATA

NUMBER PER PHASE	1	NUMBER PER TOWER	0	MINIMUM	1000. FT
CONDUCTOR SPACING	0.0 IN	DIAMETER	0.00 IN	MAXIMUM	1400. FT
VOLTAGE	230 KV	WEIGHT	0.0000 LBS/FT	INTERVAL	100.0 FT
VOLTAGE VARIATION	10.00 PCT				
LINE FREQUENCY	60 CPS				
FAIRWEATHER LOSSES	0.00 KW/MI				
LINE LENGTH	189.00 MILES				
POWER FACTOR	0.95				

WEATHER DATA

MAXIMUM RAINFALL RATE	1.18 IN/HR
MAXIMUM RAINFALL DURATION	1 HRS/YR
AVERAGE RAINFALL RATE	0.03 IN/HR
AVERAGE RAINFALL DURATION	636 HRS/YR
MAXIMUM SNOWFALL RATE	1.87 IN/HR
MAXIMUM SNOWFALL DURATION	1 HRS/YR
AVERAGE SNOWFALL RATE	0.13 IN/HR
AVERAGE SNOWFALL DURATION	264 HRS/YR
RELATIVE AIR DENSITY	1.000

DEVIL CANYON-ESTER CASE 11-2A  
230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
DATE: 16 AUG 79 TIME: 13:14:31

\*\*\*\*\*  
\* INPUT DATA \*  
\*\*\*\*\*

SAG/TENSION DESIGN FACTORS

EVERYDAY STRESS TEMPERATURE	40. DEGREES F	ICE AND WIND TENSION (PCT UTS)	50. PERCENT
ICE AND WIND TEMPERATURE	0. DEGREES F	HIGH WIND TENSION (PCT UTS)	50. PERCENT
HIGH WIND TEMPERATURE	40. DEGREES F	EXTREME ICE TENSION (PCT UTS)	70. PERCENT
EXTREME ICE TEMPERATURE	30. DEGREES F	ICE THICKNESS WITH WIND	0.50 INCHES
MAX DESIGN TEMP FOR GND CLEARANCE	120. DEGREES F	WIND PRESSURE WITH ICE	4.00 LBS/SQ.FT.
EDS TENSION (PCT UTS)	20. PERCENT	HIGH WIND	9.0 LBS/SQ.FT.
NESC CONSTANT	0.31 LBS/FT	EXTREME ICE	0.50 INCHES

TOWER DESIGN

TOTAL NUMBER OF PHASES	3	DISTANCE BETWEEN PHASES:	
PHASE SPACING	20.0 FEET	D1	20.00 FT
CONDUCTOR CONFIGURATION FACTOR	1.02	D2	20.00 FT
GROUND CLEARANCE	28.0 FEET	D3	40.00 FT
NO. OF INSULATORS PER TOWER	48	D4	0.00 FT
INSULATOR SAFETY FACTOR	2.50	D5	0.00 FT
STRING LENGTH	6.5 FEET	D6	0.00 FT
I, VEE, OR COMBINATION	3		
FOUNDATION TYPE	4		
TERRAIN FACTOR	1.06 PER UNIT		
LINE ANGLE FACTOR	.0864		
TOWER GROUNDING	0		
TRANSVERSE OVERLOAD FACTOR	2.50		
VERTICAL OVERLOAD FACTOR	1.50		
LONGITUDINAL LOAD	1000. LBS		
MISCELLANEOUS HARDWARE WEIGHT	0.11 TONS/TOWER		
TOWER WEIGHT FACTOR	1.02		

TOWER WEIGHT ESTIMATION ALGORITHM

TOWER TYPE 9: 230KV TOWER

$$TW = 0.00016 * TH ** 2 - 3.09797 * TH * 0.3333 - 0.08943 * EFFVDL - 0.27367 * EFFTDL + 0.00510 * TH * EFFTDL + 0.00160 * TH * EFFVDL + 18.37912 \text{ KIPS}$$

DEVIL CANYON-ESTER CASE II-2A  
230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
DATE: 16 AUG 79 TIME: 13:14:31

\*\*\*\*\*  
\* INPUT DATA \*  
\*\*\*\*\*

CONDUCTOR SUMMARY  
\*\*\*\*\*

B - 42

ID NUMBER	NAME	SIZE(KCM)	STRANDING (AL/ST)	UNIT WEIGHT (LBS/FT)	OUT.DIAM. (INCHES)	TOTAL AREA (SQ.IN.)	MODULUS (EF/E6 PSI)	TEMP.COEF. ALPHA*E-6 PER DEG F
35	MALLARD	795.0	30/19	1.2350	1.1400	0.7668	11.30	9.7
36	RUDDY	900.0	45/ 7	1.0150	1.1310	0.7069	9.40	11.5
37	CANARY	900.0	54/ 7	1.1590	1.1620	0.7985	10.85	10.9
38	RATL	954.0	45/ 7	1.0750	1.1650	0.8011	9.40	11.5
39	CARDINAL	954.0	54/ 7	1.2290	1.1960	0.8464	10.85	10.9
40	ORTOLAN	1033.0	45/ 7	1.1650	1.2130	0.8678	9.40	11.5
41	CURLEW	1033.0	54/ 7	1.3310	1.2460	0.9169	10.85	10.9
42	BLUEJAY	1113.0	45/ 7	1.2550	1.2590	0.9346	9.40	11.5
43	FINCH	1113.0	54/19	1.4310	1.2930	0.9849	10.30	10.8
44	BUNTING	1192.0	45/ 7	1.3440	1.3020	1.0010	9.40	11.5
45	GRACKLE	1192.0	54/19	1.5330	1.3330	1.0552	10.30	10.8
46	HITTERN	1272.0	45/ 7	1.4340	1.3450	1.0680	9.40	11.5
47	PHEASANT	1272.0	54/19	1.6350	1.3820	1.1256	10.30	10.8
48	DIPPER	1351.0	45/ 7	1.5220	1.3850	1.1350	9.40	11.5
49	MARTIN	1351.0	54/19	1.7370	1.4240	1.1959	10.30	10.8
50	BORULINK	1431.0	45/ 7	1.6130	1.4270	1.2020	9.40	11.5
51	PLOVER	1431.0	54/19	1.8400	1.4650	1.2663	10.30	10.8
52	NUTHATCH	1510.0	45/ 7	1.7020	1.4660	1.2680	9.40	11.5
53	PARROT	1510.0	54/19	1.9420	1.5060	1.3366	10.30	10.8
54	LARKING	1590.0	45/ 7	1.7920	1.5020	1.3350	9.40	11.5
55	FALCON	1590.0	54/19	2.0440	1.5450	1.4076	10.30	10.8

DEVIL CANYON-ESTER CASE II-2A  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 16 AUG 79 TIME: 13:14:31

\*\*\*\*\*  
 \* INPUT DATA \*  
 \*\*\*\*\*

CONDUCTOR SUMMARY  
 \*\*\*\*\*

ID NUMBER	NAME	ULT.TENS. STRENGTH(LBS)	GEOM.MEAN RADIUS(FT)	PRICE(\$/LB)	THERM.LIMIT (AMPERES)	AC RESIST. AT 25 DEG C (OHMS/MILE)	IND.REACT. (OHMS/MILE)	CAP.REACT. (MOHM-MILES)	
B - 43	35	MALLARD	38400.0	0.0392	0.599/1977	910.	0.1162	0.3928	2.5186
	36	RUDDY	25400.0	0.0374	0.676/1977	935.	0.1082	0.3928	2.5080
	37	CANARY	32300.0	0.0392	0.633/1977	950.	0.1040	0.3928	2.5027
	38	RAIL	26900.0	0.0385	0.671/1977	970.	0.0998	0.3949	2.5027
	39	CARDINAL	34200.0	0.0404	0.632/1977	990.	0.0987	0.3902	2.4816
	40	ORTOLAN	28900.0	0.0401	0.670/1977	1020.	0.0924	0.3902	2.4658
	41	CURLFW	37100.0	0.0420	0.628/1977	1040.	0.0913	0.3849	2.4446
	42	BLUEJAY	30900.0	0.0416	0.669/1977	1070.	0.0861	0.3860	2.4341
	43	FINCH	40200.0	0.0436	0.639/1977	1090.	0.0855	0.3802	2.4130
	44	BUNTING	33200.0	0.0431	0.665/1977	1120.	0.0808	0.3817	2.4077
	45	GRACKLE	43100.0	0.0451	0.642/1977	1130.	0.0797	0.3759	2.3866
	46	HITIFRN	35400.0	0.0445	0.665/1977	1160.	0.0760	0.3780	2.3813
	47	PHFASANT	44800.0	0.0466	0.638/1977	1180.	0.0750	0.3722	2.3602
	48	DIPPER	37600.0	0.0459	0.663/1977	1210.	0.0723	0.3738	2.3602
	49	MARTIN	47600.0	0.0480	0.638/1977	1230.	0.0708	0.3680	2.3338
	50	ROBOLINK	39800.0	0.0472	0.662/1977	1250.	0.0686	0.3712	2.3338
	51	PLOVER	50400.0	0.0494	0.637/1977	1270.	0.0671	0.3648	2.3074
	52	NUTHATCH	41600.0	0.0485	0.664/1977	1300.	0.0640	0.3670	2.3126
	53	PARROT	53200.0	0.0508	0.630/1977	1320.	0.0602	0.3622	2.2862
	54	LAPWING	43800.0	0.0497	0.660/1977	1340.	0.0623	0.3638	2.2915
	55	FALCON	56000.0	0.0521	0.636/1977	1360.	0.0612	0.3580	2.2704

DEVIL CANYON-ESTER CASE 11-2A  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 16 AUG 79 TIME: 13:14:31

\*\*\*\*\*  
 \* INPUT DATA \*  
 \*\*\*\*\*

UNIT MATERIALS COSTS	INPUT VALUE	REFERENCE YEAR FOR INPUT
PRICE OF TOWER MATERIAL	0.957 \$/LB	1979
PRICE OF CONCRETE	0.00 \$/CU.YD.	1977
PRICE OF GROUND WIRE	0.000 \$/LB	1977
INSTALLED COST OF GROUNDING SYSTEM	0.00 \$/TOWER	1977
TOWER SETUP	1751. \$	1979
TOWER ASSEMBLY	0.455 \$/LB	1979
FOUNDATION SETUP	0. \$	1979
FOUNDATION ASSEMBLY	4140.00 \$/TON	1979
FOUNDATION EXCAVATION	0.00 \$/CU.YD.	1979
PRICE OF MISCELLANEOUS HARDWARE	290.00 \$/TOWER	1977

UNIT LABOR COSTS		
REFERENCE YEAR LABOR COST	24.00 \$/MANHOUR	1979
STRING GROUND WIRE	0.0 \$/MILE	1977
STRING LABOR MARKUP	4.2 PER UNIT	

UNIT TRANSPORTATION COSTS	
TOWER	225.0 \$/TON
FOUNDATION CONCRETE	225.0 \$/YD
FOUNDATION STEEL	225.0 \$/TON
CONDUCTOR	225.0 \$/TON
GROUND WIRE	225.0 \$/TON
INSULATOR	225.0 \$/TON OR \$/M**3
HARDWARE	225.0 \$/TON

DEVIL CANYON-ESTER CASE II-2A  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 16 AUG 79 TIME: 13:14:31

\*\*\*\*\*  
 \*  
 \* AUTOMATIC CONDUCTOR SELECTION \*  
 \* ALL QUANTITIES PER MILE \*  
 \*  
 \*\*\*\*\*

CAPITAL COST/DISCOUNT RATE OF 7.00 PERCENT

PRESENT WORTH (\$)-----

B - 45

CONDUCTOR			INSTALLED COST						LINE LOSSES	O&M COST	LINE COST
NO.	KCM	SPAN(FT)	MATERIALS	TRANSP.	INSTALL.	ENGINEER.	TDC	SUBTOTAL	SUBTOTAL	SUBTOTAL	TOTAL
53	1510.	1300.	77500.	4475.	77209.	17510.	0.	176693.	26241.	2388.	205322.
45	1192.	1300.	71932.	4085.	75510.	16668.	0.	168194.	35382.	2273.	205849.
53	1510.	1400.	79192.	4486.	76292.	17597.	0.	177568.	26241.	2400.	206209.
45	1192.	1400.	73329.	4080.	74456.	16705.	0.	168571.	35382.	2278.	206231.
53	1510.	1200.	76778.	4517.	78952.	17627.	0.	177874.	26241.	2404.	206519.
49	1351.	1300.	75070.	4291.	76525.	17148.	0.	173034.	31161.	2338.	206533.
47	1272.	1300.	73744.	4201.	76187.	16954.	0.	171086.	33142.	2312.	206540.
43	1113.	1300.	70592.	3997.	75192.	16476.	0.	166257.	38174.	2247.	206678.
51	1431.	1300.	76397.	4383.	76872.	17342.	0.	174994.	29429.	2365.	206787.
43	1113.	1400.	71977.	3992.	74137.	16512.	0.	166617.	38174.	2252.	207043.
47	1272.	1400.	75327.	4205.	75226.	17023.	0.	171782.	33142.	2321.	207245.
49	1351.	1400.	76685.	4298.	75577.	17222.	0.	173781.	31161.	2348.	207290.
45	1192.	1200.	71486.	4142.	77380.	16831.	0.	169839.	35382.	2295.	207516.
51	1431.	1400.	78051.	4392.	75039.	17422.	0.	175804.	29429.	2376.	207608.
41	1033.	1300.	69272.	3918.	74975.	16298.	0.	164464.	41005.	2222.	207692.
49	1351.	1200.	74425.	4338.	78300.	17277.	0.	174340.	31161.	2356.	207857.
47	1272.	1200.	73131.	4249.	77974.	17089.	0.	172443.	33142.	2330.	207916.
55	1590.	1300.	79058.	4566.	77541.	17728.	0.	178894.	26692.	2417.	208003.
51	1431.	1200.	75715.	4428.	78630.	17465.	0.	176238.	29429.	2382.	208048.
41	1033.	1400.	70679.	3913.	73936.	16338.	0.	164865.	41005.	2228.	208098.
43	1113.	1200.	70161.	4055.	77066.	16641.	0.	167924.	38174.	2269.	208368.
55	1590.	1400.	80792.	4580.	76642.	17821.	0.	179835.	26692.	2430.	208957.
55	1590.	1200.	78298.	4606.	79267.	17839.	0.	180010.	26692.	2433.	209134.
41	1033.	1200.	68813.	3976.	76829.	16458.	0.	166075.	41005.	2244.	209324.
48	1351.	1300.	76070.	4234.	77504.	17359.	0.	175166.	31875.	2367.	209408.

DEVIL CANYON-ESTER CASE II-2A  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 16 AUG 79 TIME: 13:14:31

\*\*\*\*\*  
 \*  
 \* COST OUTPUT PER MILE \*  
 \* PRESENT VALUE RATE \*  
 \* 7.00 PERCENT \*  
 \*  
 \*\*\*\*\*

CONDUCTOR NUMBER = 53  
 1510. KCMIL 1300. FT SPAN 84.9 FT TOWER

INSTALLED COST BREAKDOWN	QUANTITY	MATERIAL COST(\$)	TONNAGE	TRANSPORTATION COST(\$)	INSTALLATION COST(\$)	TOTAL COST(\$)
CONDUCTOR	15840. FT	49971.	15.38	3461.	45797.	99229.
GROUNDWIRE	0. FT	0.	0.00	0.	0.	0.
INSULATORS	207. UNITS	2957.	1.14	549.		3507.
HARDWARE		3219.	0.47	107.		3326.
TOWERS	4.3 UNITS	91008.	21.11	4750.	60247.	156006.
FOUNDATIONS	4.3 UNITS	7493.		1211.	50178.	58882.
RIGHT OF WAY (101FT)	12. ACRES	19895.			17667.	37562.
SUB-TOTALS		174544.	38.10	10078.	173889.	358511.
IDC						0.
ENGINEERING						39436.
					TOTAL	397947.
PRESENT WORTH		77500.		4475.	77209.	159183.
IDC						0.
ENGINEERING						17510.
					TOTAL	176693.

LOSS ANALYSIS	PRESENT WORTH (\$)		
	DEMAND LOSSES	ENERGY LOSSES	TOTAL LOSSES
RESISTANCE LOSSES	13781.	12459.	26240.
CORONA LOSSES: INSULATORS	0.	0.	0.
CONDUCTOR	-	1.	1.
TOTALS	13781.	12460.	26241.

INTERNATIONAL ENGINEERING CO. INC  
SAN FRANCISCO CALIFORNIA

TRANSMISSION LINE COST ANALYSIS PROGRAM  
VERSION 2: 02 AUG 1979,

WATANA-DEVIL CANYON CASE II-3A  
230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
DATE: 15 AUG 79 TIME: 16:29:16

\*\*\*\*\*  
\* INPUT DATA \*  
\*\*\*\*\*

B - 47

SYSTEM ECONOMIC FACTORS -----	INPUT VALUE -----	REFERENCE YEAR FOR INPUT -----
BASE YEAR FOR PW ANALYSIS	1979	
ENDING YEAR OF STUDY	1997	
BASE YEAR FOR ESCALATION	1977	
MAXIMUM CIRCUIT LOADING	514.0 MVA	1992
AVERAGE CIRCUIT LOADING	282.7 MVA	1992
DEMAND COST FACTOR	73.0 \$/KW	1979
ENERGY COST FACTOR	13.0 MILLS/KWH	1979
VAR COST FACTOR	0.0 \$/KVAR	1984
CAPITAL COST/DISCOUNT RATES:		
	7.0 PERCENT	1984
	10.0 PERCENT	1984
O&M COST FACTOR	1.5 % CAP.COST	1984
RIGHT OF WAY COST FACTOR	715.0 \$/ACRE	1979
RIGHT OF WAY CLEARING COST	1430.0 \$/ACRE	1979
INTEREST DURING CONSTRUCTION	0.00 % INST.CST	
ENGINEERING FEE	11.00 % INST.CST	

WATANA-DEVIL CANYON CASE 11-3A  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 16:29:16

\*\*\*\*\*  
 \* INPUT DATA \*  
 \*\*\*\*\*

-----  
 CONDUCTOR DATA

NUMBER PER PHASE	1
CONDUCTOR SPACING	0.0 IN
VOLTAGE	230 KV
VOLTAGE VARIATION	10.00 PCT
LINE FREQUENCY	60 CPS
FAIRWEATHER LOSSES	0.00 KW/MI
LINE LENGTH	27.00 MILES
POWER FACTOR	0.95

-----  
 GROUNDWIRE DATA

NUMBER PER TOWER	0
DIAMETER	0.00 IN
WEIGHT	0.0000 LBS/FT

-----  
 SPAN DATA

MINIMUM	1200. FT
MAXIMUM	1600. FT
INTERVAL	100.0 FT

-----  
 WEATHER DATA

MAXIMUM RAINFALL RATE	1.18 IN/HR
MAXIMUM RAINFALL DURATION	1 HRS/YR
AVERAGE RAINFALL RATE	0.03 IN/HR
AVERAGE RAINFALL DURATION	636 HRS/YR
MAXIMUM SNOWFALL RATE	1.87 IN/HR
MAXIMUM SNOWFALL DURATION	1 HRS/YR
AVERAGE SNOWFALL RATE	0.13 IN/HR
AVERAGE SNOWFALL DURATION	264 HRS/YR
RELATIVE AIR DENSITY	1.000

WATANA-DEVIL CANYON CASE 11-3A  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 16:29:16

\*\*\*\*\*  
 \*  
 \* INPUT DATA \*  
 \*  
 \*\*\*\*\*

SAG/TENSION DESIGN FACTORS  
 -----

EVERYDAY STRESS TEMPERATURE	40. DEGREES F	ICE AND WIND TENSION (PCT UTS)	50. PERCENT
ICE AND WIND TEMPERATURE	0. DEGREES F	HIGH WIND TENSION (PCT UTS)	50. PERCENT
HIGH WIND TEMPERATURE	40. DEGREES F	EXTREME ICE TENSION (PCT UTS)	70. PERCENT
EXTREME ICE TEMPERATURE	30. DEGREES F	ICE THICKNESS WITH WIND	0.50 INCHES
MAX DESIGN TEMP FOR GND CLEARANCE	120. DEGREES F	WIND PRESSURE WITH ICE	4.00 LBS/SQ.FT.
EDS TENSION (PCT UTS)	20. PERCENT	HIGH WIND	9.0 LBS/SQ.FT.
WESC CONSTANT	0.31 LBS/FT	EXTREME ICE	0.50 INCHES

TOWER DESIGN  
 -----

TOTAL NUMBER OF PHASES	3	DISTANCE BETWEEN PHASES:	
PHASE SPACING	20.0 FEET	D1	20.00 FT
CONDUCTOR CONFIGURATION FACTOR	1.02	D2	20.00 FT
GROUND CLEARANCE	28.0 FEET	D3	40.00 FT
NO. OF INSULATORS PER TOWER	48	D4	0.00 FT
INSULATOR SAFETY FACTOR	2.50	D5	0.00 FT
STRING LENGTH	6.5 FEET	D6	0.00 FT
1, VEE, OR COMBINATION	3		
FOUNDATION TYPE	4		
TERRAIN FACTOR	1.06 PER UNIT		
LINE ANGLE FACTOR	.0864		
TOWER GROUNDING	0		
TRANSVERSE OVERLOAD FACTOR	2.50		
VERTICAL OVERLOAD FACTOR	1.50		
LONGITUDINAL LOAD	1000. LBS		
MISCELLANEOUS HARDWARE WEIGHT	0.11 TONS/TOWER		
TOWER WEIGHT FACTOR	1.02		

TOWER WEIGHT ESTIMATION ALGORITHM  
 -----

TOWER TYPE 9: 230KV TOWER

$$TW = 0.00016 * TH ** 2 + 3.09797 * TH * 0.3333 + 0.08943 * EFFVDL + 0.27367 * EFFTDL + 0.00510 * TH * EFFTDL + 0.00160 * TH * EFFVDL + 18.37912 \text{ KIPS}$$

WATANA-DEVIL CANYON CASE II-3A  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 16:29:16

\*\*\*\*\*  
 \*  
 \* INPUT DATA \*  
 \*  
 \*\*\*\*\*

CONDUCTOR SUMMARY  
 \*\*\*\*\*

ID NUMBER	NAME	ULT.TENS. STRENGTH(LBS)	GEOM.MEAN RADIUS(FT)	PRICE(\$/LB)	THERM.LIMIT (AMPERES)	AC RESIST. AT 25 DEG C (OHMS/MILE)	IND.REACT. (OHMS/MILE)	CAP.REACT. (MOHM-MILES)
-----	-----	-----	-----	-----	-----	-----	-----	-----
52	NUTHATCH	41600.0	0.0485	0.664/1977	1300.	0.0649	0.3670	2.3126
53	PAPROT	53200.0	0.0508	0.630/1977	1320.	0.0602	0.3622	2.2862
54	LAPWING	43800.0	0.0497	0.660/1977	1340.	0.0623	0.3638	2.2915
55	FALCON	56000.0	0.0521	0.636/1977	1360.	0.0612	0.3580	2.2704
56	CHUKAR	55600.0	0.0534	0.675/1977	1440.	0.0560	0.3548	2.2387
57	BLUERIRD	63400.0	0.0588	0.673/1977	1610.	0.0475	0.3443	2.1648
58	KIWI	50900.0	0.0570	0.699/1977	1600.	0.0480	0.3480	2.1806

WATANA-DEVIL CANYON CASE II-3A  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 16:29:16

\*\*\*\*\*  
 \*  
 \* INPUT DATA \*  
 \*  
 \*\*\*\*\*

CONDUCTOR SUMMARY  
 \*\*\*\*\*

ID NUMBER	NAME	SIZE(KCM)	STRANDING (AL/ST)	UNIT WEIGHT (LBS/FT)	OUT.DIAM. (INCHES)	TOTAL AREA (SQ.IN.)	MODULUS (EF/E6 PSI)	TEMP.COEF. ALPHA*E-6 PER DEG F
-----	----	-----	-----	-----	-----	-----	-----	-----
52	NUTHATCH	1510.0	45/ 7	1.7020	1.4660	1.2680	9.40	11.5
53	PARROT	1510.0	54/19	1.9420	1.5060	1.3366	10.30	10.8
54	LAPWING	1590.0	45/ 7	1.7920	1.5020	1.3350	9.40	11.5
55	FALCON	1590.0	54/19	2.0440	1.5450	1.4076	10.30	10.8
56	CHUKAR	1780.0	84/19	2.0740	1.6020	1.5120	9.05	11.3
57	BLUEBIRD	2156.0	84/19	2.5120	1.7620	1.8280	9.05	11.3
58	KIWI	2167.0	72/ 7	2.3040	1.7370	1.7760	9.25	12.0

WATANA-DEVIL CANYON CASE II-3A  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 16:29:16

\*\*\*\*\*  
 \* INPUT DATA \*  
 \*\*\*\*\*

UNIT MATERIALS COSTS	INPUT VALUE	REFERENCE YEAR FOR INPUT
-----	-----	-----
PRICE OF TOWER MATERIAL	0.957 \$/LB	1979
PRICE OF CONCRETE	0.00 \$/CU.YD.	1977
PRICE OF GROUND WIRE	0.000 \$/LB	1977
INSTALLED COST OF GROUNDING SYSTEM	0.00 \$/TOWER	1977
TOWER SETUP	1751. \$	1979
TOWER ASSEMBLY	0.455 \$/LB	1979
FOUNDATION SETUP	0. \$	1979
FOUNDATION ASSEMBLY	4140.00 \$/TON	1979
FOUNDATION EXCAVATION	0.00 \$/CU.YD.	1979
PRICE OF MISCELLANEOUS HARDWARE	290.00 \$/TOWER	1977

UNIT LABOR COSTS		
-----		
REFERENCE YEAR LABOR COST	24.00 \$/MANHOUR	1979
STRING GROUND WIRE	0.0 \$/MILE	1977
STRING LABOR MARKUP	4.2 PER UNIT	

UNIT TRANSPORTATION COSTS	
-----	
TOWER	225.0 \$/TON
FOUNDATION CONCRETE	225.0 \$/YD
FOUNDATION STEEL	225.0 \$/TON
CONDUCTOR	225.0 \$/TON
GROUND WIRE	225.0 \$/TON
INSULATOR	225.0 \$/TON OR \$/M**3
HARDWARE	225.0 \$/TON

WATANA-DEVIL CANYON CASE II-3A  
230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
DATE: 15 AUG 79 TIME: 16:29:16

\*\*\*\*\*  
\*  
\* AUTOMATIC CONDUCTOR SELECTION \*  
\* ALL QUANTITIES PER MILE \*  
\*  
\*\*\*\*\*

CAPITAL COST/DISCOUNT RATE OF 7.00 PERCENT

PRESENT WORTH (\$)

B - 53	CONDUCTOR		INSTALLED COST						LINE LOSSES	O&M COST	LINE COST
	NO.	KCM	SPAN(FT)	MATERIALS	TRANSP.	INSTALL.	ENGINEER.	IDC	SUBTOTAL	SUBTOTAL	TOTAL
	57	2156.	1300.	89569.	5100.	80419.	19260.	0.	194349.	140540.	337515.
	57	2156.	1400.	92123.	5155.	79928.	19493.	0.	196698.	140540.	339896.
	57	2156.	1200.	90137.	5212.	82759.	19592.	0.	197700.	140540.	340911.
	58	2167.	1300.	92415.	5120.	82288.	19780.	0.	199603.	142049.	344350.
	57	2156.	1500.	95769.	5263.	80188.	19934.	0.	201155.	140540.	344413.
	58	2167.	1200.	92234.	5199.	84224.	19982.	0.	201640.	142049.	346414.
	58	2167.	1400.	95089.	5221.	82335.	20190.	0.	203734.	142049.	348537.
	57	2156.	1600.	100185.	5417.	81131.	20541.	0.	207274.	140540.	350615.
	56	1780.	1300.	82764.	4674.	78631.	18268.	0.	184336.	166266.	353093.
	56	1780.	1400.	84951.	4709.	77966.	18439.	0.	186066.	166266.	354846.
	58	2167.	1500.	100672.	5381.	83211.	20819.	0.	210083.	142049.	354971.
	56	1780.	1200.	83451.	4792.	81029.	18620.	0.	187890.	166266.	356695.
	53	1510.	1300.	77500.	4475.	77209.	17510.	0.	176693.	179055.	358137.
	56	1780.	1500.	88068.	4795.	78040.	18799.	0.	189701.	166266.	358530.
	53	1510.	1400.	79192.	4486.	76292.	17597.	0.	177568.	179055.	359023.
	53	1510.	1500.	81760.	4545.	76087.	17863.	0.	180255.	179055.	361746.
	53	1510.	1200.	79083.	4637.	80048.	18014.	0.	181782.	179055.	363294.
	55	1590.	1300.	79058.	4566.	77541.	17728.	0.	178894.	182109.	363420.
	58	2167.	1600.	106552.	5599.	84847.	21670.	0.	218667.	142049.	363671.
	56	1780.	1600.	92071.	4927.	78781.	19336.	0.	195115.	166266.	364017.
	55	1590.	1400.	80792.	4580.	76642.	17821.	0.	179835.	182109.	364373.
	53	1510.	1600.	85158.	4649.	76521.	18296.	0.	184623.	179055.	366174.
	55	1590.	1500.	83400.	4641.	76453.	18094.	0.	182588.	182109.	367164.
	52	1510.	1200.	72903.	4183.	77499.	17004.	0.	171590.	193430.	367338.
	55	1590.	1200.	80560.	4724.	80343.	18219.	0.	183846.	182109.	368439.

WATANA-DEVIL CANYON CASE II-3A  
 230 KV TRANSMISSION LINE COST ANALYSIS AND CONDUCTOR OPTIMIZATION  
 DATE: 15 AUG 79 TIME: 16:29:16

\*\*\*\*\*  
 \* COST OUTPUT PER MILE \*  
 \* PRESENT VALUE RATE \*  
 \* 7.00 PERCENT \*  
 \*\*\*\*\*

CONDUCTOR NUMBER = 57  
 2156. KCMIL 1300. FT SPAN 87.4 FT TOWER

INSTALLED COST BREAKDOWN	QUANTITY	MATERIAL COST(\$)	TONNAGE	TRANSPORTATION COST(\$)	INSTALLATION COST(\$)	TOTAL COST(\$)
CONDUCTOR	15840. FT	69050.	19.90	4476.	48940.	122466.
GROUNDWIRE	0. FT	0.	0.00	0.	0.	0.
INSULATORS	207. UNITS	2957.	1.14	549.		3507.
HARDWARE		3219.	0.47	107.		3326.
TOWERS	4.3 UNITS	98547.	22.86	5144.	63832.	167522.
FOUNDATIONS	4.3 UNITS	7493.		1211.	50178.	58882.
RIGHT OF WAY (104FT)	13. ACRES	20461.			18170.	38630.
SUB-TOTALS		201727.	44.37	11487.	181119.	394333.
IDC						0.
ENGINEERING						43377.
						TOTAL 437710.
PRESENT WORTH		89569.		5100.	80419.	175089.
IDC						0.
ENGINEERING						19260.
						TOTAL 194349.

PRESENT WORTH (\$)

LOSS ANALYSTS	DEMAND LOSSES	ENERGY LOSSES	TOTAL LOSSES
RESISTANCE LOSSES	73819.	66721.	140540.
CORONA LOSSES: INSULATORS	0.	0.	0.
CONDUCTOR	-	0.	0.
TOTALS	73819.	66721.	140540.

APPENDIX C  
MULTI-AREA RELIABILITY  
PROGRAM (MAREL)

<b>POWER TECHNOLOGIES INC</b>	MULTI AREA RELIABILITY PROGRAM (MAREL)	BULLETIN PTI/103 Page 1 of 3
P. O. BOX 1058	SCHENECTADY, NEW YORK 12301	518 374-1220

SUMMARY

The Multi-Area Reliability Program (MAREL) computes the Loss of Load Probability (LOLP) reliability index for electric generating systems of several areas interconnected by a transmission network without any restrictions on the network topology. The program permits the study of large power pools and reliability councils as well as individual utilities imbedded in an extensive interconnection. The program is intended to be used in the design and analysis of generation systems and the interconnection capability requirements needed to share reserves among the interconnected areas. The program may be used for as many as six or seven interconnected areas modeled directly. A greater number may be accommodated by developing equivalent systems. The output includes area and total system LOLP indices as well as data on the probable causes of failures and their locations in the network. The program structure is flexible so that load and capacity models may be as detailed as required and at the same time, the complex evaluation of the individual area reliability levels may be performed with efficiency.

PROGRAM  
ELEMENTS  
AND MODELS

The structure of MAREL is shown in block form on Figure 1. Input data may be provided for each case or partially supplied by saved case files. The program structure is set up to analyze one year at a time under the control of the user. This facilitates the development of system expansions interactively or with a series of runs on a batch basis without the risk of the possibility of using excessive computer time.

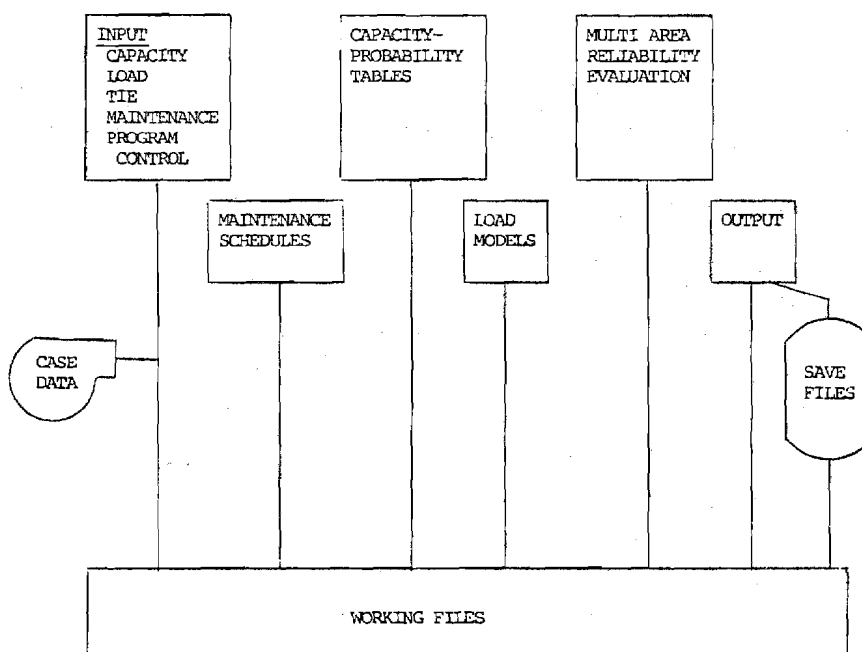


FIGURE 1

STRUCTURE OF MULTI AREA RELIABILITY PROGRAM

- Loads are modeled by area with distributions of peak loads for each 'season' of the year. A season may be of whatever length is appropriate for the study, weeks, months, or longer intervals.
- Capacity Models are developed for each area for each season of the year and are available capacity-probability density tables.
- Maintenance Outages are simulated either by adding the capacity on outage to the appropriate area and season load model or by modification of the proper capacity-probability table. Maintenance may be prescheduled and input or done automatically within MAREL by an algorithm designed to level available area generation reserves over the year.
- Transmission Interconnections are modeled by the use of a linear flow network which models the limitations on individual tie line transfer capabilities considering their forced outage rates (if desired) without restrictions on the network configuration or topology.
- Program Controls are set by the user to establish the fineness with which the loads and capacities are represented and to set tolerance levels on the LOLP computations to save unnecessary computer effort and cost.
- Program Output may include area load and capacity models as well as maintenance schedules, three sets of both seasonal and annual area and system LOLP indices, the probabilities of various failure modes. That is, the program automatically calculates area LOLP values as though the area were isolated and then two separate LOLP values with the actual interconnection. These two LOLP indices represent the extremes of possible operating policies concerning the sharing of generation reserves, (1) sharing only available reserves, and (2) sharing load losses up to the transfer limitations imposed by the network. Failure mode probabilities show the probabilities and locations of failures caused by generation shortages or transmission limitations as well as combinations and indicate the probabilities that each individual tie may be limiting. These data are useful in developing reliable system designs.
- System Size is not restricted except by limits on acceptable computational effort and cost. Past PTI system studies have included two interconnected reliability councils represented by nine or ten areas and incorporating approximately 500 units for a total of 100,000 mw of generation.
- Generation reliability level analysis which includes the effects of the interconnected system for the expansion planning of individual utilities and power pools.
- Planning of interconnections to achieve regional integration and more widespread sharing of generation reserves.
- Evaluation of the reliability benefits of strengthening ties vis-a-vis additions to generation reserves.

PROGRAM  
APPLICATIONS

- Assistance in locating weak portions of a system in order to locate new bulk power facilities for maximum reliability improvement.
- Analysis of the reliability benefits of new jointly-owned plants located remotely or within one system's territory.
- Evaluation of the ability of individual utilities to reliably survive the postponement of new plant additions in their own and interconnected systems.

AVAILABILITY  
AND SUPPORT

MAREL is available for use at PTI for studies by individual utilities or groups of systems. It may also be leased for installation on a client's computer. The lease entitles the user to:

- Complete set of source code for all modules including all MAREL activities and subroutines.
- Engineering and program reference manuals.
- Installation on a suitable PRIME 400 computer at the client's site and a training seminar.

Installation on other computers is feasible but will only be done on the basis of charging for the time and expense required.

Since PTI is a consulting engineering organization and uses MAREL in studies for clients, the program is continually being enhanced and updated.

While updates are not included in the MAREL lease price, PTI will offer all significant MAREL improvements to lessees at add-on prices.

PTI can assist MAREL users in the development of system equivalents where their use is attractive to the user.

FOR FURTHER  
INFORMATION

Contact: C.K. Pang, Senior Engineer  
or  
A.J. Wood, Principal Engineer  
Power Technologies, Inc.  
P.O. Box 1058  
Schenectady, N.Y. 12301

Tel. (518) 374-1220  
Telex 145498 POWER TECH SCH

MULTI-AREA RELIABILITY PROGRAM (MAREL)

SAMPLE OUTPUT SHEETS

FOR

TWO-AREA RELIABILITY STUDY - YEAR 1989

Note: The following other output sheets (35 cases) are on file with Alaska Power Authority under a separate cover:

- Independent System Expansion Plans  
(years 1984 through 1996)
- Interconnected System Expansion Plans  
(years 1984 through 1996)
- Interconnected System Expansion, Three-Area Reliability Study  
with Susitna (years 1992 through 1996)
- Interconnected System Expansion Plans, with Firm Power Transfer  
(years 1984 through 1987 and 1992 through 1996)

IECREL \*TIE89

01/18/79 11:01

PRT018

C - 5

```
*****
*****
001
002
003
004 WWW WWW WWW WWW WWW W
005 W W W W W W W
006 W W W W W W W
007 W WWW W WWW WWW W
008 W W W W W W W
009 W W W W W W W
010 WWW WWW WWW W W WWW WWW
011
012
013
014
015 WWW WWW WWW WWW WWW
016 W W W W W W W W W
017 WWW W W W W W W W
018 WW WW W W WWW WWW
019 WWW W W W W W W
020 W W W W W W W
021
022
023
*****
*****
```

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM:

----- MULTI-AREA RELIABILITY PROGRAM - MAREL -----

----- VERSION : NOVEMBER 15, 1978 -----

----- POWER TECHNOLOGIES, INC. -----

\*\*\*\*\*  
\*\*  
\*\* 01 - 18 - 1979 \*\*  
\*\*  
\*\*\*\*\*

S T U D Y   C A S E:

\*\*\*\*\*  
\*\*  
\*\* ANCHORAGE - FAIRBANKS TRANSMISSION INTERTIE ECONOMIC FEASIBILITY \*\*  
\*\*  
\*\* 2-AREA RELIABILITY STUDY - YEAR 1989 : INTERCONNECTED - 1/15/1979 \*\*  
\*\*  
\*\*\*\*\*

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM

```

*****
**                                **
** ANCHORAGE - FAIRBANKS TRANSMISSION INTERTIE ECONOMIC FEASIBILITY **
**                                **
** 2-AREA RELIABILITY STUDY - YEAR 1989 : INTERCONNECTED - 1/15/1979 **
**                                **
*****

```

YEAR OF STUDY = 1989

PROBABILITY THRESHOLD = 0.10E-07

FAILURE PROB. THRESHOLD = 0.20E-08

PROB. RATIO FOR LOAD LEV.= 0.0100

ROUNDING MW STEP SIZE = 1

MAX. NO. OF AREAS WITH NEGATIVE  
MARGIN TO BE EXAMINED = 2

MAX. OF CAPACITY STEPS = 50

----- SYSTEM DATA -----

NO. OF AREAS OR BUSES = 2

NO. OF AREAS WITH GENERATION = 2

NO. OF AREAS WITH LOADS = 2

NO. OF LINES WITH OUTAGES = 1

NO. OF FIRM LINES = 0

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM

ANCHORAGE - FAIRBANKS TRANSMISSION INTERTIE ECONOMIC FEASIBILITY  
2-AREA RELIABILITY STUDY - YEAR 1989 : INTERCONNECTED - 1/15/1979

----- DATA FOR LINES WITH OUTAGES -----  
--- AVAILABLE CAPACITY PROBABILITY ---

LINE NO. 1, LINK NO. 3  
TIE FROM AREA 1 ANCHOR -TO- AREA 2 FAIRBA

LEVEL	CAP(FOR)	CAP(REV)	PROBABILITY
1	0	0	0.004000
2	130	130	0.996000

----- TIME USED IN CPUS : INCREMENT = 2, ELAPSED = 2

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM

GENERATOR UNIT DATA FOR ANCHORAGE-FAIRBANKS STUDY  
TWO AREA SYSTEM JANUARY 15 1979

SUMMARY ON CAPACITY, PEAK LOAD AND MAINTENANCE : AREA ANCHOR

SEASON	1	2	3	4	5	6	7	8	9
INSTALLED CAPACITY (MW)	1747	1747	1747	1747	1747	1747	1747	1747	1747
PEAK LOAD (MW)	1200	882	789	752	729	725	826	886	1441

INSTALLED RESERVES :

MW	547	865	958	995	1018	1022	921	861	306
PERCENT	45.58	98.07	121.42	132.31	139.64	140.97	111.50	97.18	21.24

CAPACITY ON  
MAINTENANCE (MW)

0	135	227	256	286	287	188	122	0
---	-----	-----	-----	-----	-----	-----	-----	---

RESERVES AFTER MAINTENANCE :

MW	547	730	731	739	732	735	733	739	306
PERCENT	45.58	82.77	92.65	98.27	100.41	101.38	88.74	83.41	21.24

UNIT RETIREMENTS AND INSTALLATIONS :

NO.	UNIT	CAP(MW)	F.O.R.	RET/INST	SEASON	DATE
1	COAL 2	200	0.057	INST	1	1/1989

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM

GENERATOR UNIT DATA FOR ANCHORAGE-FAIRBANKS STUDY  
TWO AREA SYSTEM JANUARY 15 1979

SUMMARY ON CAPACITY, PEAK LOAD AND MAINTENANCE : AREA FAIRBANKS

SEASON	1	2	3	4	5	6	7	8	9
INSTALLED CAPACITY (MW)	385	385	385	385	385	385	385	385	385
PEAK LOAD (MW)	274	177	135	119	112	130	136	166	313

INSTALLED RESERVES :

MW	111	203	250	266	273	255	249	219	72
PERCENT	40.51	117.51	185.19	223.53	243.75	196.15	183.09	131.93	23.00

CAPACITY ON  
MAINTENANCE (MW)

0	14	53	72	100	65	54	25	0
---	----	----	----	-----	----	----	----	---

RESERVES AFTER MAINTENANCE :

MW	111	194	195	194	173	190	195	194	72
PERCENT	40.51	109.60	144.44	163.03	154.46	146.15	143.38	116.87	23.00

UNIT RETIREMENTS AND INSTALLATIONS :

NO.	UNIT	CAP(MW)	F.O.R.	RET/INST	SEASON	DATE
---	---	-----	-----	-----	-----	---

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM

GENERATOR UNIT DATA FOR ANCHORAGE-FAIRBANKS STUDY  
TWO AREA SYSTEM JANUARY 15 1979

SUMMARY ON CAPACITY AND PEAK LOAD BY AREA

AREA	<u>ANCHOR</u>	<u>FAIRBA</u>
PEAK LOAD SEASON	9	9
INSTALLED CAPACITY (MW) AT ANNUAL PEAK	1747	385
ANNUAL PEAK LOAD (MW)	1441	313
INSTALLED RESERVES (MW)	306	72
RESERVES IN PERCENT OF ANNUAL PEAK LOAD	21.24	23.00
AREA WEIGHTED AVERAGE UNIT FOR (PERCENT)	5.46	7.42
AREA ANNUAL AVERAGE MAINTENANCE (PERCENT)	9.55	11.11

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM

GENERATOR UNIT DATA FOR ANCHORAGE-FAIRBANKS STUDY  
TWO AREA SYSTEM  
JANUARY 15 1979

-----SUMMARY BY AREAS-----

	AREA	NO.OF UNITS	CAP.(MW)
1	ANCHOR	36	1747
2	FAIRBA	24	385

SEASONAL RESERVES IN PERCENT OF PEAK LOADS  
AFTER MAINTENANCE OF UNITS FOR THE TOTAL SYSTEM

SEASON	RESERVES	ORDER	SEASON	RESERVES
1	44.6404	1	9	21.5507
2	87.2521	2	1	44.6404
3	100.2164	3	2	87.2521
4	107.1182	4	8	88.6882
5	107.6100	5	7	96.4657
6	108.1871	6	3	100.2164
7	96.4657	7	4	107.1182
8	88.6882	8	5	107.6100
9	21.5507	9	6	108.1871

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM

GENERATOR UNIT DATA FOR ANCHORAGE-FAIRBANKS STUDY  
TWO AREA SYSTEM JANUARY 15 1979

MAINTENANCE SUMMARY BY MW AND PERCENT OF TOTAL AREA CAPACITY :

SEASON	AREA	ANCHOR	AREA	FAIRBA
1	0	0.00	0	0.00
2	135	7.73	14	3.64
3	227	12.99	55	14.29
4	256	14.65	72	18.70
5	286	16.37	100	25.97
6	287	16.43	65	16.88
7	188	10.76	54	14.03
8	122	6.98	25	6.49
9	0	0.00	0	0.00

AREA EFOR                      5.4550                      7.4169

SYSTEM EFOR      =      5.8093

EFOR : WEIGHTED EFFECTIVE FORCED OUTAGE RATE IN PERCENT.

\*\*\* END OF PROGRAM MNTCE \*\*\*

----- TIME USED IN CPUS : INCREMENT =      2, ELAPSED =      4

----- TIME USED IN CPUS : INCREMENT =      0, ELAPSED =      4

\*\*\* AREA 1 ANCHOR HAS NO UNITS ON \*\*\*  
\*\*\* MAINTENANCE FOR SEASONS : 1 9 \*\*\*

\*\*\* AREA 2 FAIRBA HAS NO UNITS ON \*\*\*

\*\*\* MAINTENANCE FOR SEASONS : 1 9 \*\*\*

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM

ANCHORAGE - FAIRBANKS TRANSMISSION INTERTIE ECONOMIC FEASIBILITY  
2-AREA RELIABILITY STUDY - YEAR 1989 : INTERCONNECTED - 1/15/1979

--- LOSS OF LOAD PROBABILITY AT VARIOUS AREAS ---

AT AREA	PROBABILITY ISOLATED	PROBABILITY WITH LLS	PROBABILITY WITHOUT LLS
-----	-----	-----	-----
1 ANCHOR	0.149268E+00	0.798471E-01	0.676829E-01
2 FAIRBA	0.190494E+01	0.909675E-01	0.394379E-01
SYSTEM		0.915377E-01	0.915377E-01

NOTE : LLS = LOAD LOSS SHARING

\*\*\*\*\* ALL PROBABILITIES ARE IN DAYS/PERIOD \*\*\*\*\*

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM

ANCHORAGE - FAIRBANKS TRANSMISSION INTERTIE ECONOMIC FEASIBILITY  
2-AREA RELIABILITY STUDY - YEAR 1989 : INTERCONNECTED - 1/15/1979

--- PROBABILITY OF MINIMAL CUTS ---

<u>CUT</u>	<u>PROBABILITY</u>	<u>CUT MEMBERS(LINKS)</u>
1	0.792771E-01	1 2
2	0.570032E-03	1 3
3	0.116904E-01	2 3

\*\*\*\*\* ALL PROBABILITIES ARE IN DAYS/PERIOD \*\*\*\*\*

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM

ANCHORAGE - FAIRBANKS TRANSMISSION INTERTIE ECONOMIC FEASIBILITY  
2-AREA RELIABILITY STUDY - YEAR 1989 : INTERCONNECTED - 1/15/1979

--- MINIMAL CUTS AND DEFICIENT NODES(AREAS) ---

CUT	PROBABILITY	NODES(AREAS) IN DEFICIENT REGION
---	-----	-----
1	0.792771E-01	1 ANCHOR 2 FAIRBA
2	0.570032E-03	1 ANCHOR
3	0.116904E-01	2 FAIRBA

\*\*\*\*\* ALL PROBABILITIES ARE IN DAYS/PERIOD \*\*\*\*\*

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM

ANCHORAGE - FAIRBANKS TRANSMISSION INTERTIE ECONOMIC FEASIBILITY  
2-AREA RELIABILITY STUDY - YEAR 1989 : INTERCONNECTED - 1/15/1979

--- PROBABILITY THAT EACH LINE IS LIMITING ---

LINE	LINK	DESCRIPTION		TOTAL	FORWARD	REVERSE
---	---	A R E A	TO	PROBABILITY	DIRECTION	DIRECTION
---	---	---	---	---	---	---
1	3	1 ANCHOR	TO 2 FAIRBA	0.122604E-01	0.116904E-01	0.570032E-03

\*\*\*\*\* ALL PROBABILITIES ARE IN DAYS/PERIOD \*\*\*\*\*

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM

ANCHORAGE - FAIRBANKS TRANSMISSION INTERTIE ECONOMIC FEASIBILITY  
2-AREA RELIABILITY STUDY - YEAR 1989 : INTERCONNECTED - 1/15/1979

ISOLATED SITUATION - SUMMARY :

AREA LOLP IN DAYS/PERIOD BY SEASONS:

<u>SEASON</u>	<u>AREA ANCHOR</u>	<u>AREA FAIRBA</u>
1	0.0021	0.3096
2	0.0000	0.0071
3	0.0000	0.0000
4	0.0000	0.0000
5	0.0000	0.0000
6	0.0000	0.0000
7	0.0000	0.0000
8	0.0000	0.0000
9	0.1472	1.5882
YEAR	0.1493	1.9049

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM

ANCHORAGE - FAIRBANKS TRANSMISSION INTERTIE ECONOMIC FEASIBILITY  
2-AREA RELIABILITY STUDY - YEAR 1989 : INTERCONNECTED - 1/15/1979

ISOLATED SITUATION - SUMMARY :

EXPECTED MW-DAYS LOSS BY SEASONS.

SEASON	AREA ANCHOR	AREA FAIRBA
1	0.09	7.45
2	0.00	0.14
3	0.00	0.00
4	0.00	0.00
5	0.00	0.00
6	0.00	0.00
7	0.00	0.00
8	0.00	0.00
9	8.87	44.23
YEAR	8.9548	51.8097

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM

ANCHORAGE - FAIRBANKS TRANSMISSION INTERTIE ECONOMIC FEASIBILITY  
2-AREA RELIABILITY STUDY - YEAR 1989 : INTERCONNECTED - 1/15/1979

ISOLATED SITUATION - SUMMARY :

EXPECTED MW DEFICIENCY BY SEASON.

SEASON	AREA ANCHOR	AREA FAIRBA
1	42.38	24.04
2	13.57	19.22
3	0.00	0.00
4	0.00	0.00
5	0.00	0.00
6	0.00	0.00
7	0.00	0.00
8	0.00	0.00
9	60.24	27.85

INDICES FOR THE YEAR :

MW-DAYS	8.95	51.81
LOLP-DAYS	0.15	1.90
E(MW)	59.99	27.20

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM

ANCHORAGE - FAIRBANKS TRANSMISSION INTERTIE ECONOMIC FEASIBILITY  
2-AREA RELIABILITY STUDY - YEAR 1989 : INTERCONNECTED - 1/15/1979

INTERCONNECTED WITH LOAD LOSS SHARING :

AREA LOLP IN DAYS/PERIOD BY SEASONS.

<u>SEASON</u>	<u>AREA ANCHOR</u>	<u>AREA FAIRBA</u>
1	0.0004	0.0020
2	0.0000	0.0000
3	0.0000	0.0000
4	0.0000	0.0000
5	0.0000	0.0000
6	0.0000	0.0000
7	0.0000	0.0000
8	0.0000	0.0000
9	0.0794	0.0890
YEAR	0.0798	0.0910

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM:

ANCHORAGE - FAIRBANKS TRANSMISSION INTERTIE ECONOMIC FEASIBILITY  
2-AREA RELIABILITY STUDY - YEAR 1989 : INTERCONNECTED - 1/15/1979

INTERCONNECTED WITH NO LOAD LOSS SHARING :  
AREA LOLP IN DAYS/PERIOD BY SEASONS.

<u>SEASON</u>	<u>AREA ANCHOR</u>	<u>AREA FAIRBA</u>
1	0.0003	0.0017
2	0.0000	0.0000
3	0.0000	0.0000
4	0.0000	0.0000
5	0.0000	0.0000
6	0.0000	0.0000
7	0.0000	0.0000
8	0.0000	0.0000
9	0.0673	0.0378
YEAR	0.0677	0.0394

POWER TECHNOLOGIES, INC.  
MULTI-AREA RELIABILITY PROGRAM

ANCHORAGE - FAIRBANKS TRANSMISSION INTERTIE ECONOMIC FEASIBILITY  
2-AREA RELIABILITY STUDY - YEAR 1989 : INTERCONNECTED - 1/15/1979

--- SYSTEM RESULT SUMMARY IN PER UNIT ---

PROBABILITY OF SUCCESS EVENTS = 0.999648E+00  
PROBABILITY OF FAILURE EVENTS = 0.352068E-03  
PROBABILITY OF NEGLECTED UNSPECIFIED EVENTS = 0.270125E-08  
SUM OF THE ABOVE 3 PROBABILITIES = 0.100000E+01  
  
PROBABILITY OF UNCLASSIFIED FAILURE EVENTS = 0.620649E-09

\*\*\*\*\*  
\*\*\* NOTE: THE SUM OF THE FIRST 3 MUST BE 1.0000 \*\*\*  
\*\*\* WITHIN REASONABLE TOLERANCE. \*\*\*  
\*\*\*\*\*

DEFINITION OF EVENTS :

SUCCESS : ALL LOADS SATISFIED.

FAILURE : ONE OR MORE AREA LOADS NOT SATISFIED.

UNSPECIFIED : NOT IDENTIFIED AS EITHER SUCCESS OR FAILURE.

UNCLASSIFIED FAILURE : CAUSE OF FAILURE NOT ESTABLISHED.  
CAUSE OF FAILURE IS INDICATED BY MINIMAL CUTS.

TOTAL ELAPSED TIME IN CPUS = 20

\*\*\*\*\* END OF PROGRAM MAREL \*\*\*\*\*

ANCHORAGE - FAIRBANKS TRANSMISSION INTERTIE ECONOMIC FEASIBILITY  
2-AREA RELIABILITY STUDY - YEAR 1996 : INTERCONNECTED - 1/15/1979

2	1	0	0	0	0	0	0	0	0
0	0	0	0	1	0	0	0	0	0
0	0	0	0	0	0				
1	1	1	4						

1996  
0.1E-07 0.2E-07 0.5E-05  
0.01 0.10

2 1 50  
2 1 0 2 2  
ANCHORFAIRBA

	1	2	2
1	0	0	0.004000
2	130	130	0.996000

LOAD DATA IN PER UNIT INTERVAL DURATION CURVE  
TWO AREA SYSTEM JANUARY 15 1979

[illegible][illegible]

416. 446. 477. 511.  
 0.37390.69900.73710.76040.57490.59710.56630.51110.43240.41150.38330.37470.3587  
 0.35320.33330.41770.42010.43730.46190.53190.57490.89190.93370.93491.00000.7690  
 1.00000.97420.94670.94670.94530.93130.89480.86540.84290.8177  
 1.00000.93670.92790.92790.90510.89980.88950.85940.82790.7891  
 1.00000.99320.96670.94830.94300.92320.90330.88300.86670.8267  
 1.00000.97520.96120.94510.86910.83200.82390.81100.79000.6769  
 1.00000.98560.98290.95940.95300.94560.91880.90810.90170.8825  
 1.00000.99790.99590.98770.97940.95820.93620.90530.89300.8827  
 1.00000.98480.95010.93710.91970.89370.88970.87200.86120.8091  
 1.00000.96270.96150.95190.93510.91590.88700.88220.87980.8558  
 1.00000.99150.99150.99150.97160.96270.93180.89200.88920.8693  
 1.00001.00000.95120.93130.92540.92310.92240.90750.90450.8955  
 1.00000.99040.99040.94550.92310.91990.91670.91350.87820.8558  
 1.00000.96720.95410.92790.92460.90490.89840.89510.87870.8721  
 1.00000.96920.96920.95890.95890.94520.94520.93150.92120.9041  
 1.00000.98960.97220.96370.95320.94790.93400.92360.92010.8507  
 1.00000.96770.93870.93230.91290.90320.90320.90320.87100.8677  
 1.00000.37250.37060.86760.86460.85220.84710.84410.83820.8359  
 1.00000.94440.90640.90640.89470.82750.82750.82460.81870.8012  
 1.00000.99720.97750.96350.96350.94940.90820.93320.91010.8904  
 1.00000.99470.96810.93090.92320.90960.90690.90160.88320.8836  
 1.00000.93350.93300.91450.90990.89610.88910.88450.86870.8568  
 1.00000.99150.92920.97650.94920.92950.92740.91830.91450.9017  
 1.00000.96690.91120.89260.88840.79890.73970.64460.61020.6028  
 1.00000.97710.91050.90790.90790.89340.88950.88550.86820.8434  
 1.00000.97110.86830.83050.81870.79630.79240.74510.73320.7201  
 1.00000.99510.93160.97300.97170.95530.91650.88450.82430.6818  
 1.00000.99840.93920.92010.89940.88980.88500.84820.81310.7971

GENERATOR UNIT DATA FOR ANCHORAGE-FAIRBANKS STUDY  
 TWO AREA SYSTEM JANUARY 15 1979

1	1	1
2	1	1.0E-12
ANCHOR	44	12
1.0		
1 ANCH 1	15	0.055
2 ANCH 2	15	0.055
3 ANCH 3	19	0.055
4 ANCH 4	32	0.055
5 ANCH 5	37	0.055
6 ANCH 6	12	0.055
7 ANCH 7	73	0.055
8 ANCH7S	21	0.055
9 ANCH 8	73	0.055
10 BELU 1	15	0.055
11 BELU 2	15	0.055
12 BELU 3	54	0.055
13 BELU 4	9	0.055
14 BELU 5	54	0.055
15 BELU 6	68	0.055
16 BELU 7	68	0.055
17 BELU 8	68	0.055
18 BERN 1	8	0.055
19 BERN 2	20	0.055
20 BERN 3	24	0.055

21 INTL 1 14 0.055  
 22 INTL 2 14 0.055  
 23 INTL 3 19 0.055  
 24 COOP 1 8 0.016  
 25 COOP 2 8 0.016  
 26 KNIT A 15 0.059 R 1/1986  
 27 INTL 4 71 0.055  
 28 INTL 5 71 0.055  
 29 INTL 6 71 0.055  
 30 INTL 7 71 0.055  
 31 HOMER 7 0.055  
 32 EKLUTH 30 0.016  
 33 BELU 9 71 0.055 N 1/1986  
 34 ANCH 9 78 0.055 N 1/1985  
 35 ANCH10 104 0.057 N 1/1986  
 36 COAL 1 200 0.057 N 1/1987  
 37 ANCH11 104 0.057 N 1/1993  
 38 COAL 2 200 0.057 N 1/1989  
 39 COAL 3 200 0.057 N 1/1990  
 40 COAL 4 200 0.057 N 1/1991  
 41 COAL 5 200 0.057 N 1/1992  
 42 PEAKA1 78 0.055 N 1/1993  
 43 GEN 1 300 0.079 N 1/1994  
 44 GEN 2 300 0.079 N 1/1996  
 45 PEAKA2 78 0.055 N 1/1995

-99

COOP 1  
 COOP 2  
 EKLUTH

-99

1

9

-99

FAIRDA 26 12  
 1.0

1 CHEN 1 5 0.059  
 2 CHEN 2 2 0.059  
 3 CHEN 3 2 0.059  
 4 CHEN 4 20 0.059  
 5 CHEN 5 5 0.055  
 6 CHEN 6 24 0.055  
 7 DIES 1 3 0.295  
 8 DIES 2 3 0.295  
 9 DIES 3 2 0.295  
 10 ZEHN 1 17 0.055  
 11 ZEHN 2 17 0.055  
 12 ZEHN 3 4 0.055  
 13 ZEHN 4 4 0.055  
 14 ZEHN D1 3 0.295  
 15 ZEHN D2 3 0.295  
 16 ZEHN D3 3 0.295  
 17 ZEHN D4 2 0.295  
 18 ZEHN D5 2 0.295  
 19 HEAL 1 26 0.059  
 20 HEAL D 3 0.295

21	NORT 1	65	0.055		
22	NORT 2	65	0.055		
23	UALASK	5	0.295		
25	COALF1	100	0.057	N	1/1988
27	COALF2	100	0.057	N	1/1992
28	COALF3	100	0.057	N	1/1995
-99					
-99					
1					
9					
-99					

APPENDIX D  
DATA AND COST ESTIMATES FOR TRANSMISSION  
INTERTIE AND GENERATING PLANTS

APPENDIX D

DATA AND COST ESTIMATES FOR  
TRANSMISSION INTERTIE AND GENERATING PLANTS

D.1 DATA AND COST ESTIMATES FOR TRANSMISSION INTERTIE

A. Cost Summary and Disbursements for Intertie Facilities

Total Cost at 1979 Levels - \$1000					
	<u>Case IA</u>	<u>Case IB</u>	<u>Case IC</u>	<u>Case ID</u>	<u>Case II</u>
1. <u>Transmission Line:</u>					
Eng'g. & Constr. Supv.	3,012	3,012	7,988	3,012	15,442
Right-of-Way	8,837	8,837	7,573	8,837	12,994
Foundations	8,445	8,445	12,160	8,445	22,966
Towers	21,615	21,615	33,990	21,615	64,974
Hardware	477	477	477	477	1,096
Insulators	503	503	755	503	1,396
Conductor	<u>10,761</u>	<u>10,761</u>	<u>17,663</u>	<u>10,761</u>	<u>36,946</u>
Subtotal	53,650	53,650	80,606	53,650	155,814
2. <u>Substations:</u>					
Eng'g. & Constr. Supv.	1,352	1,352	1,855	2,816	6,902
Land	57	57	46	81	185
Transformers	1,703	1,703	3,291	1,703	11,917
Circuit Breakers	1,093	1,093	1,323	1,953	6,410
Station Equipment	1,223	1,223	1,933	1,345	4,375
Structures & Accessories	<u>3,628</u>	<u>3,628</u>	<u>3,978</u>	<u>4,026</u>	<u>16,411</u>
Subtotal	9,056	9,056	12,426	11,924	46,200
3. <u>Control and Communications:</u>					
Eng'g. & Constr. Supv.	125	125	125	165	200
Equipment	<u>2,375</u>	<u>2,375</u>	<u>2,375</u>	<u>3,135</u>	<u>3,600</u>
Subtotal	<u>2,500</u>	<u>2,500</u>	<u>2,500</u>	<u>3,300</u>	<u>3,800</u>
Total Baseline 1979 Costs	<u>65,206</u>	<u>65,206</u>	<u>95,532</u>	<u>68,874</u>	<u>205,814</u>

Capital disbursements for each of the above cases are given on following computation sheets, these being identical to those later used for financial planning purposes with selected alternative.

# CAPITAL INVESTMENT DISBURSEMENTS FOR TRANSMISSION INTERTIE CASES IA & IB

	1981-1	1981-2	1982-1	1982-2	1983-1	1983-2	TOTAL
<b>1. TRANSMISSION LINE</b>							
ENGINEERING AND CONSTRUCTION							
SUPERVISION	452	753	0	392	693	723	3012
RIGHT OF WAY	0	2209	6628	0	0	0	8837
FOUNDATIONS	0	0	0	2280	6165	0	8445
TOWERS	0	0	0	0	9727	11888	21615
HARDWARE	0	0	0	0	72	405	477
INSULATORS	0	0	0	0	75	428	503
CONDUCTOR	0	0	0	0	1614	9147	10761
SUB-TOTAL	452	2962	6628	2672	18346	22591	53650
<b>2. SUBSTATIONS</b>							
ENGINEERING & CONSTRUCTION							
SUPERVISION	270	270	270	270	135	135	1352
LAND	57	0	0	0	0	0	57
TRANSFORMERS	0	0	341	596	596	170	1703
CIRCUIT BREAKERS	0	0	219	383	383	109	1093
STATION EQUIPMENT	0	0	245	428	428	122	1223
STRUCTURES & ACCESSORIES	0	0	726	1451	1451	0	3628
SUB-TOTAL	327	270	1800	3128	2993	537	9056
<b>3. CONTROL AND COMMUNICATIONS</b>							
ENGINEERING AND INSTALLATION							
SUPERVISION	0	0	0	0	54	71	125
EQUIPMENT	0	0	0	0	950	1425	2375
SUB-TOTAL	0	0	0	0	1004	1496	2500
<b>TOTAL</b>	<b>779</b>	<b>3233</b>	<b>8428</b>	<b>5800</b>	<b>22342</b>	<b>24624</b>	<b>65206</b>
<b>TOTAL FOR YEAR</b>	<b>0</b>	<b>4012</b>	<b>0</b>	<b>14228</b>	<b>0</b>	<b>46967</b>	<b>65206</b>

# CAPITAL INVESTMENT DISBURSEMENTS FOR TRANSMISSION INTERTIE CASE IC

	1981-1	1981-2	1982-1	1982-2	1983-1	1983-2	TOTAL
<b>1. TRANSMISSION LINE</b>							
ENGINEERING AND CONSTRUCTION							
SUPERVISION	1198	1997	0	1038	1837	1917	7988
RIGHT OF WAY	0	1893	5680	0	0	0	7573
FOUNDATIONS	0	0	0	3283	8877	0	12160
TOWERS	0	0	0	0	15296	18695	33990
HARDWARE	0	0	0	0	72	405	477
INSULATORS	0	0	0	0	113	642	755
CONDUCTOR	0	0	0	0	2649	15014	17663
SUB-TOTAL	1198	3890	5680	4322	28844	36672	80606
<b>2. SUBSTATIONS</b>							
ENGINEERING & CONSTRUCTION							
SUPERVISION	371	371	371	371	186	186	1855
LAND	46	0	0	0	0	0	46
TRANSFORMERS	0	0	658	1152	1152	329	3291
CIRCUIT BREAKERS	0	0	265	463	463	132	1323
STATION EQUIPMENT	0	0	387	677	677	193	1933
STRUCTURES & ACCESSORIES	0	0	796	1591	1591	0	3978
SUB-TOTAL	417	371	2476	4254	4068	840	12426
<b>3. CONTROL AND COMMUNICATIONS</b>							
ENGINEERING AND INSTALLATION							
SUPERVISION	0	0	0	0	54	71	125
EQUIPMENT	0	0	0	0	950	1425	2375
SUB-TOTAL	0	0	0	0	1004	1496	2500
<b>TOTAL</b>	<b>1615</b>	<b>4261</b>	<b>8156</b>	<b>8575</b>	<b>33916</b>	<b>39009</b>	<b>95532</b>
<b>TOTAL FOR YEAR</b>	<b>0</b>	<b>5876</b>	<b>0</b>	<b>16731</b>	<b>0</b>	<b>72925</b>	<b>95532</b>

# **CAPITAL INVESTMENT DISBURSEMENTS FOR TRANSMISSION INTERTIE CASE ID**

	1981-2	1982-1	1982-2	1983-1	1983-2	TOTAL
<b>1. TRANSMISSION LINE</b>						
ENGINEERING AND CONSTRUCTION						
SUPERVISION	452	753	0	392	693	3012
RIGHT OF WAY	0	2209	6628	0	0	8837
FOUNDATIONS	0	0	0	2280	6165	8445
TOWERS	0	0	0	0	9727	21615
HARDWARE	0	0	0	0	72	477
INSULATORS	0	0	0	0	75	503
CONDUCTOR	0	0	0	0	1614	10761
<b>SUB-TOTAL</b>	<b>452</b>	<b>2962</b>	<b>6628</b>	<b>2672</b>	<b>18346</b>	<b>53650</b>
<b>2. SUBSTATIONS</b>						
ENGINEERING & CONSTRUCTION						
SUPERVISION	563	563	563	563	282	2816
LAND	81	0	0	0	0	81
TRANSFORMERS	0	0	341	596	596	1703
CIRCUIT BREAKERS	0	0	391	684	684	1953
STATION EQUIPMENT	0	0	269	471	471	1345
STRUCTURES & ACCESSORIES	0	0	805	1610	1610	4026
<b>SUB-TOTAL</b>	<b>644</b>	<b>563</b>	<b>2369</b>	<b>3924</b>	<b>3642</b>	<b>11924</b>
<b>3. CONTROL AND COMMUNICATIONS</b>						
ENGINEERING AND INSTALLATION						
SUPERVISION	0	0	0	0	71	165
EQUIPMENT	0	0	0	0	1254	3135
<b>SUB-TOTAL</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>1325</b>	<b>3300</b>
<b>TOTAL</b>	<b>1096</b>	<b>3525</b>	<b>8996</b>	<b>6596</b>	<b>23313</b>	<b>68874</b>
<b>TOTAL FOR YEAR</b>	<b>0</b>	<b>4621</b>	<b>0</b>	<b>15592</b>	<b>0</b>	<b>68874</b>

# **CAPITAL INVESTMENT DISBURSEMENTS FOR TRANSMISSION INTERTIE CASE II**

	1981-1	1981-2	1982-1	1982-2	1983-1	1983-2	TOTAL
<b>1. TRANSMISSION LINE</b>							
ENGINEERING AND CONSTRUCTION							
SUPERVISION	2316	3861	0	2007	3552	3706	15442
RIGHT OF WAY	0	3249	9746	0	0	0	12994
FOUNDATIONS	0	0	0	6201	16765	0	22966
TOWERS	0	0	0	0	29238	35736	64974
HARDWARE	0	0	0	0	164	932	1096
INSULATORS	0	0	0	0	209	1187	1396
CONDUCTOR	0	0	0	0	5542	31404	36946
<b>SUB-TOTAL</b>	<b>2316</b>	<b>7109</b>	<b>9746</b>	<b>8208</b>	<b>55471</b>	<b>72964</b>	<b>155814</b>
<b>2. SUBSTATIONS</b>							
ENGINEERING & CONSTRUCTION							
SUPERVISION	1380	1380	1380	1380	690	690	6902
LAND	185	0	0	0	0	0	185
TRANSFORMERS	0	0	2383	4171	4171	1192	11917
CIRCUIT BREAKERS	0	0	1282	2244	2244	641	6410
STATION EQUIPMENT	0	0	875	1531	1531	438	4375
STRUCTURES & ACCESSORIES	0	0	3282	6564	6564	0	16411
<b>SUB-TOTAL</b>	<b>1565</b>	<b>1380</b>	<b>9203</b>	<b>15890</b>	<b>15200</b>	<b>2960</b>	<b>46200</b>
<b>3. CONTROL AND COMMUNICATIONS</b>							
ENGINEERING AND INSTALLATION							
SUPERVISION	0	0	0	0	86	114	200
EQUIPMENT	0	0	0	0	1440	2160	3600
<b>SUB-TOTAL</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>1526</b>	<b>2274</b>	<b>3800</b>
<b>TOTAL</b>	<b>3882</b>	<b>8489</b>	<b>18948</b>	<b>24099</b>	<b>72197</b>	<b>78198</b>	<b>205814</b>
<b>TOTAL FOR YEAR</b>	<b>0</b>	<b>12371</b>	<b>0</b>	<b>43047</b>	<b>0</b>	<b>150396</b>	<b>205814</b>

B. Case IA & IB, Anchorage-Fairbanks Intertie, 230 kV s/c Transmission System, 323 Miles

1. Cost Summary

T/L Cost @ \$166,104 per mile	\$53,652,000
Anchorage Substation	3,974,000
Ester Substation	5,080,000
Control and Communications System	<u>2,500,000</u>
TOTAL	\$65,206,000

2. Anchorage Substation Costs

1	138-kV Circuit Breaker Structures and Accessories	\$ 86,000 108,000
1	138-kV Air Disconnect Switch Structures and Accessories	11,000 38,000
4	13.8-kV, 12-MVAR Shunt Reactor Bank Structures and Accessories	420,000 315,000
4	13.8-kV Circuit Breaker Structures and Accessories	154,000 119,000
4	13.8-kV Air Disconnect Switch Structures and Accessories	31,000 64,000
4	1Ø - 48 MVA, 138/230-kV Autotransformer Structures and Accessories	1,020,000 538,000
2	230-kV Circuit Breakers Structures and Accessories	338,000 407,000
4	230-kV Air Disconnect Switch Structures and Accessories	70,000 232,000
	Land 2 acres	<u>23,000</u>
	TOTAL	\$3,974,000

3. Ester Substation Costs

1	138-kV Circuit Breaker Structures and Accessories	\$ 86,000 108,000
1	138-kV Air Disconnect Switch Structures and Accessories	11,000 38,000
3	13.8-kV, 12-MVAR Shunt Capacitor Bank Structures and Accessories	265,000 198,000
3	13.8-kV Circuit Breaker Structures and Accessories	116,000 89,000
4	1Ø, 46 MVA, 138/230-kV Autotransformer Structures and Accessories	984,000 516,000
3	230-kV Circuit Breaker Structures and Accessories	507,000 613,000
9	230-kV Air Disconnect Switch Structures and Accessories	157,000 528,000
3	230-kV, 16-MVAR Reactor Structures and Accessories	474,000 356,000
	Land 3 acres	<u>34,000</u>
	TOTAL	\$5,080,000

C. Case IC, Anchorage-Fairbanks Intertie, 345 kV s/c Transmission  
System, 323 miles

1. Cost Summary

T/L Cost @ \$249,551 per mile	\$80,606,000
Anchorage Substation	6,195,000
Ester Substation	6,231,000
Control and Communications System	<u>2,500,000</u>
TOTAL	\$95,532,000

2. Anchorage Substation Costs

1	138-kV Circuit Breaker	\$ 86,000
	Structures and Accessories	108,000
1	138-kV Air Disconnect Switch	11,000
	Structures and Accessories	38,000
1	13.8-kV 16-MVAR Shunt Reactor Bank	112,000
	Structures and Accessories	84,000
1	13.8-kV Circuit Breaker	39,000
	Structures and Accessories	30,000
1	13.8-kV Air Disconnect Switch	8,000
	Structures and Accessories	16,000
4	1Ø - 48-MVA, 138/345-kV Autotransformer	1,936,000
	Structures and Accessories	725,000
2	345-kV Circuit Breaker	653,000
	Structures and Accessories	340,000
5	345-kV Air Disconnect Switch	114,000
	Structures and Accessories	330,000
4	1Ø - 33-1/3-MVAR, 345-kV Shunt Reactor	882,000
	Structures and Accessories	660,000
	Land 2 acres	23,000
	TOTAL	\$6,195,000

3. Ester Substation Cost

1	138-kV Circuit Breaker	\$ 86,000
	Structures and Accessories	108,000
1	138-kV Air Disconnect Switch	11,000
	Structures and Accessories	38,000
1	13.8-kV, 15-MVAR Shunt Capacitor	132,000
	Structures and Accessories	100,000
1	13.8-kV Circuit Breaker	39,000
	Structures and Accessories	30,000
1	13.8-kV Air Disconnect Switch	8,000
	Structures and Accessories	16,000

3. Ester Substation Cost (Continued)

4	1Ø - 48 MVA, 138/345-kV Autotransformer Structures and Accessories	\$1,936,000 725,000
2	345-kV Circuit Breaker Structures and Accessories	653,000 340,000
5	345-kV Air Disconnect Switch Structures and Accessories	114,000 330,000
4	1Ø - 33-1/3-MVAR, 345-kV Shunt Reactor Structures and Accessories	882,000 660,000
	Land 2 acres	<u>23,000</u>
	TOTAL	\$6,231,000

D. Case ID, Anchorage-Fairbanks Intertie, 230 kV s/c Transmission  
System, 323 miles

1. Cost Summary

T/L Cost @ \$166,104 per mile	\$53,652,000
Anchorage Substation	3,976,000
Palmer Substation	1,434,000
Healy Substation	1,434,000
Ester Substation	5,080,000
Control and Communications System	<u>3,300,000</u>
TOTAL	\$68,876,000

2. Anchorage-Palmer, 230 kV s/c Transmission System, 40 miles

T/L Cost @ \$166,104 per mile	\$ 6,644,000
Anchorage Substation	3,976,000
Palmer Substation	717,000
Control and Communications System	<u>1,450,000</u>
TOTAL	\$12,787,000

3. Palmer-Healy, 230 kV s/c Transmission System, 190.5 miles

T/L Cost @ \$166,104 per mile	\$31,726,000
Palmer Substation	717,000
Healy Substation	717,000
Control and Communications System	<u>400,000</u>
TOTAL	\$33,560,000

4. Healy-Ester, 230 kV s/c Transmission System, 92 miles

T/L Cost @ \$166,104 per mile	\$15,282,000
Healy Substation	717,000
Ester Substation	5,080,000
Control and Communications System	<u>1,450,000</u>
TOTAL	\$22,529,000

5. Anchorage Substation Costs

1	138-kV Circuit Breaker	\$ 86,000
	Structures and Accessories	108,000
1	138-kV Air Disconnect Switch	11,000
	Structures and Accessories	38,000
4	13.8-kV, 12-MVAR Shunt Reactor Bank	420,000
	Structures and Accessories	315,000
4	13.8-kV Circuit Breaker	154,000
	Structures and Accessories	119,000
4	13.8-kV Air Disconnect Switch	31,000
	Structures and Accessories	64,000
4	1Ø - 48-MVA, 138/230-kV Autotransformer	1,020,000
	Structures and Accessories	538,000
2	230-kV Circuit Breakers	338,000
	Structures and Accessories	407,000
4	230-kV Air Disconnect Switch	70,000
	Structures and Accessories	234,000
	Land 2 acres	<u>23,000</u>
	TOTAL	\$ 3,976,000

6. Palmer Substation - (One Line Bay)

1.5	230-kV Circuit Breaker Structures and Accessories	\$ 253,000 305,000
2	230-kv Air Disconnect Switch Structures and Accessories	36,000 117,000
	Land	<u>6,000</u>
	TOTAL	\$ 717,000

7. Healy Substation - (One Line Bay)

1.5	230-kV Circuit Breaker Structures and Accessories	253,000 305,000
2	230-kV Air Disconnect Switch Structures and Accessories	36,000 117,000
	Land	<u>6,000</u>
	TOTAL	\$ 717,000

8. Ester Substation Costs

1	138-kV Circuit Breaker Structures and Accessories	\$ 86,000 108,000
1	138-kV Air Disconnect Switch Structures and Accessories	11,000 38,000
3	13.8-kV, 12-MVAR Shunt Capacitor Bank Structures and Accessories	265,000 198,000
3	13.8-kV Circuit Breaker Structures and Accessories	116,000 89,000
4	1Ø - 46-MVA, 138/230-kV Autotransformer Structures and Accessories	984,000 516,000
3	230-kV Circuit Breaker Structures and Accessories	507,000 613,000

8. Ester Substation Costs (Continued)

9	230-kV Air Disconnect Switch Structures and Accessories	\$ 157,000 528,000
3	230-kV, 16-MVAR Reactor Structures and Accessories	474,000 356,000
	Land 3 acres	<u>34,000</u>
	TOTAL	\$5,080,000

E. Case II, Anchorage - Upper Susitna - Fairbanks Intertie

345 kV 2-s/c Anchorage-Devil Canyon	155 miles
230 kV 2-s/c Devil Canyon-Ester	189 miles
230 kV 2-s/c Watana-Devil Canyon	27 miles

1. Cost Summary

Anchorage - Devil Canyon T/L @ \$506,640 per mile*	\$ 78,529,000
Devil Canyon - Ester T/L @ \$353,386 per mile*	66,790,000
Watana - Devil Canyon T/L @ \$388,698 per mile*	10,495,000
Anchorage Substation	23,160,000
Devil Canyon Substation	10,109,000
Ester Substation	11,339,000
Watana Substation	1,592,000
Control and Communications System	<u>3,800,000</u>
TOTAL	\$205,814,000

\* Includes two single-circuit lines.

2. Anchorage Substation Cost

2	138-kV Circuit Breaker Structures and Accessories	\$ 172,000 216,000
2	138-kV Air Disconnect Switch Structures and Accessories	23,000 76,000
7	1Ø - 210.5-MVA, 138/345-kV Autotransformer Structures and Accessories	8,516,000 3,404,000
9	345-kV Circuit Breaker Structures and Accessories	2,938,000 1,528,000
18	345-kV Air Disconnect Switch Structures and Accessories	408,000 1,191,000
2	345-kV, 200-MVAR Shunt Capacitor Structures and Accessories	2,647,000 1,984,000
	Land 5 acres	<u>57,000</u>
	TOTAL	\$23,160,000

3. Devil Canyon Substation Cost

3	345-kV Circuit Breaker Structures and Accessories	\$ 981,000 509,000
6	345-kV Air Disconnect Switch Structures and Accessories	138,000 399,000
7	1Ø - 90.3-MVA, 230/345-kV Autotransformer Structures and Accessories	3,418,000 1,466,000
6	230-kV Circuit Breaker Structures and Accessories	1,015,000 1,224,000
12	230-kV Air Disconnect Switch Structures and Accessories	210,000 703,000
	Land 4 acres	<u>46,000</u>
	TOTAL	\$10,109,000

#### 4. Ester Substation Cost

2	138-kV Circuit Breaker Structures and Accessories	\$ 172,000 216,000
2	138-kV Air Disconnect Switch Structures and Accessories	23,000 76,000
7	1Ø - 65-MVA, 138/345-kV Autotransformer Structures and Accessories	2,086,000 1,253,000
6	13.8-kV Air Disconnects Structures and Accessories	46,000 96,000
6	13.8-kV Circuit Breaker Structures and Accessories	232,000 181,000
6	13.8-kV, 6-MVAR Capacitor Structures and Accessories	264,000 200,000
9	230-kV Circuit Breaker Structures and Accessories	1,523,000 1,838,000
18	230-kV Air Disconnect Switch Structures and Accessories	314,000 1,055,000
2	230-kV, 80-MVAR Capacitor Structures and Accessories	968,000 727,000
	Land 6 acres	<u>69,000</u>
	TOTAL	\$11,339,000

#### 5. Watana Substation Cost

3	230-kV Circuit Breakers Structures and Accessories	\$ 508,000 613,000
6	230-kV Disconnect Switch Structures and Accessories	106,000 348,000
	Land	<u>17,000</u>
	TOTAL	\$ 1,592,000

## D.2 DATA AND COST ESTIMATES FOR GENERATING PLANTS

### B. Cost Estimates and Disbursements for Generating Plants

Note: Only specific units affected by interconnection of Anchorage and Fairbanks systems are considered:

#### 1. Northpole #3 (NORT 3) 69 MW SCGT in Fairbanks Area.

This unit is necessary for independent system expansion.  
Will not be required if interconnection assured.

Rating - 68.6 MW (net) Combustion Turbine  
Fuel - Distillate from North Pole Refinery

Ref. Table B-1, Appendix B of Stanley Consultants Review Report  
For 1983 Installation:

Unit Cost =	\$31,482,000		
NO <sub>x</sub> Cost	<u>1,387,000</u>		
Subtotal	\$32,869,000	or	\$476/kW
Assoc. Transm. <sup>1/</sup>	<u>4,783,000</u>		
TOTAL	\$37,652,000	or	\$546/kW

See Also: P. 45 of GVEA Power Supply Study - 1978 by Stanley  
Consultants & P. 28 - Table 10 Escalation Rates.

Period	GNP Deflators		
	Labor (∓20%)	Material (∓80%)	Composite
1983-1980	1.085	1.07	1.075
1980-1979	1.095	1.08	1.085

#### Summary of Costs:

Facility	1979 Baseline Costs		
Gas-Turbine Unit	\$24,385,000	or	\$353/kW
Assoc. Transm.	<u>3,549,000</u>		
Total Capital Investment	\$27,934,000	or	\$405/kW

Disbursements - \$1000			
Pre-Operational Period	1st Year (1983)		2nd Year (1984)
Gas-Turbine Unit	7,315	(30%)	17,070 (70%)
Assoc. Transm.	<u>355</u>	(10%)	<u>3,194</u> (90%)
Total Facilities	\$7,670		\$20,264

<sup>1/</sup> Relocation of facilities and expansion of existing Northpole substation.

2. Beluga #9 (BELU 9) 71 MW RCGT in Anchorage Area.

This unit will be postponed for one year by interconnection, from beginning year 1985 to 1986.

This unit will draw on Beluga gas reserves for fuel supply. Design of unit is assumed to be simple-cycle, similar to existing units on Chugach System - Ref. Beluga Units 1, 2, 4, 6, & 7.

Estimated Cost of Unit:

From Reference Cost Estimate for NORT 3 at Fairbanks

Cost at Bus-bar of 69 MW unit = \$353/kW

By comparison for 71 MW unit = \$350/kW

Now applying Alaskan construction cost location factors from Battelle Report, Table 6.3, P. 6.12

Applicable factor from Fairbanks to Beluga =  $\frac{1.62}{1.2} = 1.35$

Estimated Cost = \$473/kW or \$33,548,000

Disbursements:

<u>Pre-Operational Period</u>	<u>1st Year</u>	<u>2nd Year</u>
Independent Expansion	1983	1984
Interconnected Expansion	1984	1985
Proportion of Total	30%	70%
Investment - \$1000	10,064	23,484

Associated Transmission Facilities:

Transmission Line (allow 50 miles) @ \$126,000/mile

Total Cost of Line Facilities = \$6,300,000

Substation Additions at Beluga and Knik Arm = \$2,650,000

Total Transmission Line and Substation Facilities = \$8,950,000

Disbursements:

<u>Pre-Operational Period</u>	<u>1979 Baseline Costs</u>	
	<u>1st Year</u>	<u>2nd Year</u>
Independent Expansion	1983	1984
Interconnected Expansion	1984	1985
Proportion of Total	10%	90%
Investment - \$1000		
Transm. & Substations	895	8,055
Total Facilities		<u>\$42,490,000</u>

3. Northpole #4 (NORT 4) 69 MW SCGT in Fairbanks Area.

This unit is necessary for independent system expansion.

Will not be required with an interconnected system.

Scheduled In-Service Beginning Year 1990

Unlike NORT 3, no transmission additions will be required, with completion of relocation and expansion of the substation.

Considering only cost of unit with assoc. transf. and swgr.

For 1979 Baseline Cost Levels:

Total Capital Investment = \$25,185,000 or \$365/kW

Disbursements:

<u>Pre-Operational Period</u>	<u>1st Year (1988)</u>	<u>2nd Year (1989)</u>
GT unit, transf. & swgr.	7,555 (30%)	17,630 (70%)

4. Anchorage Peaking Unit #2 (PEAK A2) 78 MW SCGT

This unit is required for both independent and interconnected systems but in-service date is advanced one year with intertie.

Basing cost of addition on Northpole Unit 4 installation -  
i.e. SCGT unit with associated transformer and switching.

Estimated cost based on rating, with allowance for scale.

For 1979 Baseline Cost Levels:

69 MW GT Unit Total Cost = \$25,185,000 or \$365/kW

78 MW GT Unit Total Cost = \$28,080,000 or \$360/kW

Now applying Alaskan construction cost location adjustment factor  
from Battelle Report Table 6.3 P. 6.12

Applicable factor from Fairbanks to Anchorage =  $1/1.2 = 0.83$

Total Capital Investment = \$23,400,000 or \$300/kW

Disbursements:

<u>Year</u>	<u>Independent</u>	<u>Interconnected</u>	<u>% Total</u>	<u>Cost - \$1000</u>
1	1994	1993	30	7,020
2	1995	1994	70	16,380

5. Northpole #5 (NORT 5) 69 SCGT in Fairbanks Area.

This unit is necessary for independent system expansion.  
Will not be required with an interconnected system.

Scheduled In-Service Beginning Year 1997

The addition of this unit completes the expansion for the independent systems of the Railbelt Area, the time frame is such that for interconnected expansion, with the staged increments of hydro capacity from the Susitna development, the last unit at Devil Canyon would be on-line beginning year 1997.

Similar to NORT 4, no transmission additions are assumed to be required, such that power would be delivered from the expanded Northpole Substation to the existing system.

Considering only cost of unit, with associated transf. and swgr.

For 1979 Baseline Cost Levels:

Total Capital Investment = \$25,185,000 or \$365/kW

Disbursements:

	(\$1000)	
<u>Pre-Operational Period:</u>	<u>1st Year (1995)</u>	<u>2nd Year (1996)</u>
GT unit, transf. & swgr.	7,555 (30%)	17,630 (70%)

6. Anchorage #11 (ANCH 11) 104 MW Coal-Fired Steam-Electric Plant.

This unit will be required for independent system expansion but will be postponed, with interconnection, from in-service 1988 to 1993.

Cost estimate for this plant is based on Healy Unit 2 estimate prepared by Stanley Consultants, with applicable Alaskan construction cost location adjustment factor.

From Stanley Consultants Report to GVEA, Appendix A, P. A-1.

For 1984 Installation Date (1978 Cost Levels):

Healy Unit 2 Plant (Without FGD):

Plant and Equipment	\$102,924,000	or	\$ 990/kW
Contingency	<u>3,088,000</u>		
Total Construction Cost	\$107,012,000	or	\$1029/kW
Eng'g., Legal & Overhead	<u>14,982,000</u>		
TOTAL	\$121,994,000	or	\$1173/kW
Escalating @ 10% to 1979 Cost Level	.....		\$1290/kW
Total Baseline 1979 Cost without FGD =	<u>\$134,160,000</u>		

Now Including Cost of Desulphurization:

Plant and Equipment	\$111,174,000	or	\$1069/kW
Contingency	<u>3,335,000</u>		
Total Construction Cost	\$114,509,000	or	\$1101/kW
Eng'g., Legal & Overhead	<u>16,031,000</u>		
TOTAL	\$130,540,000	or	\$1255/kW
Escalating @ 10% to 1979 Cost Level	.....		\$1380/kW
Total Baseline 1979 Cost with FGD =	<u>\$143,520,000</u>		

Associated Transmission Facilities:

Assuming relatively short transmission line with substation facilities required, for connection to existing AML&P transmission system in Anchorage area.

Cost Estimate for Transmission Line:

Transmission Line (allow 30 miles) @ \$126,000/mile  
Total Cost of Line Facilities = \$3,780,000

Cost Estimate for Substation Facilities:

Equipment	\$2,700,000
Contingency	<u>203,000</u>
Total Construction Cost	\$2,903,000
Eng'g., Legal & Overhead	<u>377,000</u>
TOTAL	\$3,280,000
Escalating @ 10% to 1979 Cost Level	
Total 1979 Baseline Cost	<u>\$3,608,000</u>

Summary of Costs:

	<u>WO/FGD</u>	<u>W/FGD</u>
Coal-Fired Plant (104 MW)	\$134,160,000	\$143,520,000
Transmission Line	3,780,000	3,780,000
Substation Facilities	<u>3,608,000</u>	<u>3,608,000</u>
TOTAL	\$141,548,000	\$150,908,000

Now applying Alaskan construction cost location adjustment factor from Table 6.3 P. 6.12 of Battelle Study Report:

From Healy to Anchorage - Location Factor =  $1.7/2.42 = 0.70$

Applying this factor, Total Costs = \$99,084,000 \$105,636,000  
or = \$953/kW \$1016/kW

Disbursements - \$1000

Coal-Fired Plant (ANCH 11)

		<u>1979 Baseline Costs</u>		
		<u>% Total</u>	<u>WO/FGD</u>	<u>W/FGD</u>
<u>Pre-Operational Year:</u>				
<u>Independent</u>	<u>Interconnected</u>			
1. 1982	1987	2	1,878	2,009
2. 1983	1988	8	7,513	8,037
3. 1984	1989	30	28,174	30,139
4. 1985	1990	37	34,747	37,172
5. 1986	1991	20	18,783	20,093
6. 1987	1992	3	2,817	3,014

Associated Transmission Facilities

5. 1986	1991	20	1,034	1,034
6. 1987	1992	80	4,138	4,138

7. Coal-Fired Unit F2 (COAL F2) 100 MW in Fairbanks Area.

This unit will be required for both the independent and inter-connected system expansions, with generation reserve sharing only. However, with both reserve sharing and firm power transfer, it is replaced, together with COAL 5, by a 300 MW unit (COAL 6).

This unit will be very similar to ANCH 11, which in turn was based on the Healy Unit 2 Plant, as reported by Stanley Consultants. The unit costs will be increased proportionately, to allow for the change of unit size from 104 MW to 100 MW. This has been economically scaled using the nomograph (Figures D-1 and D-2) in this appendix.

For Generating Plant COAL F2:

<u>Plant Cost Estimates:</u>	<u>1979 Baseline Cost Levels</u>
Without FGD	\$120,000,000 or \$1200/kw
With FGD	\$130,000,000 or \$1300/kw

Associated Transmission Facilities:

Assuming a plant site location at or near Healy, the transmission line and substation requirements are similar to those required for Healy Unit 2. Reference Stanley Consultants Review Report to GVEA, Appendix A, P. A-1:

Transmission Facility Costs:

	<u>1979 Cost Levels (1.1 x 1978 Costs)</u>	
	<u>Transmission Line</u>	<u>Substation Facilities</u>
Equipment and Material	\$15,510,000	\$3,348,000
Contingency	<u>465,000</u>	<u>100,000</u>
Construction Cost	\$15,975,000	\$3,448,000
Eng'g., Legal & Overhead	<u>2,455,000</u>	<u>102,000</u>
TOTAL	<u>\$18,430,000</u>	<u>\$3,550,000</u>

Disbursements - \$1000

Coal-Fired Unit (COAL F2):

<u>Pre-Operational Year:</u>	<u>1979 Baseline Costs</u>		
	<u>% Total</u>	<u>WO/FGD</u>	<u>W/FGD</u>
1. 1986	2	2,400	2,600
2. 1987	8	9,600	10,400
3. 1988	30	36,000	39,000
4. 1989	37	44,400	48,100
5. 1990	20	24,000	26,000
6. 1991	3	3,600	3,900

Associated Transmission Facilities:

5. 1990	20	4,400	4,400
6. 1991	80	17,580	17,580

8. Coal-Fired Unit 5 (COAL 5) 200 MW in Anchorage Area.

This unit will be required for both the independent and inter-connected system expansions, with generation reserve sharing only. However, with both reserve sharing and firm power transfer, it is replaced, together with COAL F2, by a 300-MW unit (COAL 6).

The cost estimate for this generating plant was obtained by scaling costs from a base reference of 100 MW to 200 MW, using the nomograph (Figures D-1 and D-2) contained in this Appendix. Then Alaskan construction cost location adjustment factors were used to determine the cost relevant to the Beluga site in the Anchorage Area.

From Healy to Beluga - Location Factor =  $2.75/2.42 = 1.14$

For Generating Plant COAL 5

Plant Cost Estimates:

	<u>1979 Baseline Cost Levels (\$1000)</u>	
	<u>Healy Site</u>	<u>Beluga Site</u>
Without FGD	\$165,000 or \$825/kW	\$188,000 or \$ 940/kW
With FGD	\$175,000 or \$875/kW	\$200,000 or \$1000/kW

Associated Transmission Facilities:

Assuming a section of transmission line and substation facilities, for connection to existing transmission system in Anchorage area.

Transmission Line (allow 50 miles) @ \$174,000/mile  
Total Cost of Line Facilities = \$ 8,700,000  
Substation Terminal at Knik Arm = 3,545,000  
Total Transmission Facilities \$12,245,000

Disbursements - \$1000

Coal-Fired Unit (COAL 5)

<u>Pre-Operational Year:</u>	<u>1979 Baseline Costs</u>		
	<u>% Total</u>	<u>WO/FGD</u>	<u>W/FGD</u>
1. 1986	2	3,760	4,000
2. 1987	8	15,040	16,000
3. 1988	30	56,400	60,000
4. 1989	37	69,560	74,000
5. 1990	20	37,600	40,000
6. 1991	3	5,640	6,000

Associated Transmission Facilities:

5. 1990	20	2,450	2,450
6. 1991	80	9,795	9,795

9. Coal-Fired Unit 6 (COAL 6) 300 MW in Anchorage Area.

This unit will not be required either for independent or inter-connected system expansion for generation reserve sharing only. However, with reserve capacity sharing and firm power transfer, it will replace both COAL F2 and COAL 5.

The cost estimate for this plant has been derived from the cost for the reference 100 MW plant, using the nomograph (Figures D-1 and D-2) contained in this Appendix. This enabled consideration of economies of scale obtained when the unit capacity is changed from 100 to 300 MW and the differential costs associated with the two sites, according to the Alaskan construction cost location adjustment factor, similar to that developed for COAL 5.

Plant Cost Estimates:

	1979 Baseline Cost Levels (\$1000)	
	Healy Site	Beluga Site
Without FGD	\$200,000 or \$667/kW	\$228,000 or \$760/kW
With FGD	\$240,000 or \$800/kW	\$274,000 or \$913/kW

Associated Transmission Facilities:

Assuming a section of transmission line and substation facilities,  
for connection to existing transmission system in Anchorage area.

Transmission Line (allow 50 miles) @ \$240,000/mile  
Total Cost of Line Facilities = \$12,000,000  
Substation Terminal at Knik Arm = 6,250,000  
Total Transmission Facilities \$18,250,000

Disbursements - \$1000

Coal-Fired Unit (COAL 6)

<u>Pre-Operational Year:</u>	1979 Baseline Costs		
	% Total	WO/FGD	W/FGD
1. 1986	2	4,560	5,480
2. 1987	8	18,240	21,920
3. 1988	30	68,400	82,200
4. 1989	37	84,360	101,380
5. 1990	20	45,600	54,800
6. 1991	3	6,840	8,220

Associated Transmission Facilities:

5. 1990	20	3,650	3,650
6. 1991	80	14,600	14,600

10. Coal-Fired Unit 2 (GEN 2) 300 MW at New Site in Anchorage Area.

This unit is required for both independent and interconnected systems but in-service date postponed one year with intertie.

For Generating Plant COAL 6:

It is assumed that site will be near to previous plant location at Beluga, in sufficient proximity to assume cost basis to be identical, with difference only in the time frame for construction.

Cost estimate for plant and associated transmission facilities are then identical to that for COAL 6.

Disbursements - \$1000

Coal-Fired Unit (GEN 2)

<u>Pre-Operational Year:</u>			<u>1979 Baseline Costs</u>		
			<u>% Total</u>	<u>WO/FGD</u>	<u>W/FGD</u>
	<u>Independent</u>	<u>Interconnected</u>			
1.	1989	1990	2	4,560	5,480
2.	1990	1991	8	18,240	21,920
3.	1991	1992	30	68,400	82,200
4.	1992	1993	37	84,360	101,380
5.	1993	1994	20	45,600	54,800
6.	1994	1995	3	6,840	8,220

Associated Transmission Facilities:

5.	1993	1994	20	3,650	3,650
6.	1994	1995	80	14,600	14,600

### D.3 DATA AND COST ESTIMATES FOR SUPPLY OF CONSTRUCTION POWER TO UPPER SUSITNA PROJECT SITES

The requirements of the combined Railbelt area generation expansion, with inclusion of both Watana and Devil Canyon power from the Susitna development, schedules Unit 1 from Devil Canyon in January 1995, only 3 years after the first unit goes on line at Watana Damsite. Assuming as a first construction schedule that of the U.S. Army Corps of Engineers, the construction periods are 6 and 5 years, respectively, for Watana earthfill dam and the concrete arch dam at Devil Canyon. Thus, with the generation staging of the plan for interconnection, the total construction period would be 11 years, with pre-operational construction periods of 6 years for Watana and 5 years for Devil Canyon. There would be concurrent construction during 2 years.

Prior to the first unit on-line at Watana, construction power would be required for 6 years at Watana and 2 years at Devil Canyon. It is assumed, for purposes of analysis, that separate provision would need to be made for the full construction power needs at both sites. From estimates by the Consultants:

#### Connected Load

Watana	4000 kW (estimated at 3750 kW)
Devil Canyon	3400 kW (estimated at 3350 kW)

#### Operational Assumptions for Both Sites:

6 months/yr intensive operation	@ 0.65 LF
6 months/yr light loading	@ 0.30 LF

Corresponding to construction planning assumptions of U.S. Corps of Engineers.

Figure 7-1 of Chapter 7 shows the recommended sites at Watana and Devil Canyon for the Susitna development and the routing of the tap line to the sites from the transmission tap station, located on the main transmission corridor for the Anchorage-Fairbanks Intertie. The tap line can later be used also for a subtransmission circuit for distribution in the area, following the completion of the construction program.

A. Alternative 1 - Cost of Construction Power by Diesel Generation  
(This will constitute benefits for B/C analysis)

Basic Assumptions:

1. Diesel units purchased for Watana will be used for a period of 6 years and then sold at depreciated value.
2. Diesel units purchased for Devil Canyon will be used for a period of 5 years and then sold at depreciated value.
3. No provision will be made at Devil Canyon for tapping 230-kV line from Watana once energized, due to prior purchase of diesel units for construction power.
4. Diesel units will be installed in multiples of 675 kW net/unit.
  - 6 units at Watana                      4050 kW net capacity
  - 5 units at Devil Canyon              3375 kW net capacity

From previous construction power estimates for diesel unit installations:

$$1979 \text{ Cost} = \$700/\text{kW}$$

Installation for Watana construction power units would be made in 1985, ready for service in January 1986.

Escalating @ 7% through 1985 - Cost Level = \$1050/kW.

Installation for Devil Canyon construction power units would be made in 1989, ready for service in January 1990.

Escalating @ 7% through 1989 - Cost Level = \$1377/kW.

Cost of Diesel Installations:

Watana	=	$\$1050 \times 4050$	=	\$4,252,500
Devil Canyon	=	$\$1377 \times 3355$	=	\$4,647,375

This capital investment would be disbursed in 1985 and 1989, respectively, for Watana and Devil Canyon.

### Cost of Diesel Operation During Construction

Basic Assumption: Maximum Coincident Demand = Connected Load

This, incidentally, introduces a measure of maximum loading which tends to compensate for an initial lower estimate of construction power requirements by a factor equivalent to projected diversity.

Average Energy Usage Per Year:

$$\text{Watana} \quad 3750 (0.65 + 0.30) \frac{8760}{2} \text{ kWh} = 15,603,750 \text{ kWh}$$

Say 15.60 GWh/yr for 6 yrs.

$$\text{Devil Canyon} \quad 3350 (0.65 + 0.30) \frac{8760}{2} \text{ kWh} = 13,939,350 \text{ kWh}$$

Say 13.94 GWh/yr for 5 yrs.

### Operating Characteristics of Diesel Units:

Fuel Rate Assumed - 13 kWh/gal (diesel fuel)

Base Price for Diesel Fuel - 41.2 ¢/gal (1977 actual)

Plus 5% Allowance for Lube Oil - 43.3 ¢/gal

To be escalated @ 11% to 1980 and 7% thereafter.

O&M for diesel units estimated at 5% of total cost of incremental generation.

<u>Year</u>	<u>Watana Dam</u>	<u>Year</u>	<u>Devil Canyon</u>
1986	\$1,118,500		
1987	1,198,100		
1988	1,280,800		
1989	1,371,200		
1990	1,468,000	1990	\$1,311,800
1991	1,569,400	1991	1,402,400
		1992	1,501,300
		1993	1,607,300
		1994	1,708,800

# DIESEL GENERATION OPERATING COSTS

<u>Year</u>	<u>Diesel Fuel Including Lube Oil</u>		<u>O&amp;M (mills/kWh)</u>	<u>Total Operating Cost (mills/kWh)</u>
	<u>¢/gal</u>	<u>mills/kWh</u>		
1977	43.3	33.3	1.7	35.0
1978	48.1	37.0	1.9	38.9
1979	53.3	41.0	2.1	43.1
1980	59.2	45.5	2.3	47.8
1981	63.3	48.7	2.4	51.1
1982	67.8	52.2	2.6	54.8
1983	72.5	55.8	2.8	58.6
1984	77.6	59.7	3.0	62.7
1985	83.0	63.8	3.2	67.0
1986	88.8	68.3	3.4	71.7
1987	95.1	73.2	3.6	76.8
1988	101.7	78.2	3.9	82.1
1989	108.8	83.7	4.2	87.9
1990	116.5	89.6	4.5	94.1
1991	124.6	95.8	4.8	100.6
1992	133.3	102.5	5.2	107.7
1993	142.7	109.8	5.5	115.3
1994	152.6	117.4	5.9	123.3

### Depreciated Value of Diesel Units:

Basic Assumption of 15-Year Service Life.

Assume Straight-Line Depreciation

#### 1. Watana Installation

Installed Cost (new) = \$4,252,500 (1985)

Depreciation/Year = 283,500

Depreciated Value (1991) 6-Year Period = \$2,551,500

#### 2. Devil Canyon Installation

Installed Cost (new) = \$4,647,375 (1989)

Depreciation/Year = 309,825

Depreciated Value (1994) 5-Year Period = \$3,098,250

### Discounted Value of Benefits (Diesel Generation Alternative)

Base Year 1979 (Discounted @ 7%)

<u>Year</u>	<u>PWF<sup>1</sup></u>	<u>Construction Cost (\$)</u>	<u>Operating Cost (\$)</u>	<u>Total Cost (\$)</u>	<u>Present Value (\$)</u>
1979	1.00000				
1985	0.66634	4,252,500		4,252,500	2,833,611
1986	0.62274		1,118,500	1,118,500	696,535
1987	0.58200		1,198,100	1,198,100	697,294
1988	0.54393		1,280,800	1,280,800	696,666
1989	0.50834	4,647,375	1,371,200	6,018,575	3,059,482
1990	0.47509		2,779,800	2,779,800	1,320,655
1991	0.44401	-2,551,500	2,971,800	420,300	186,617
1992	0.41496		1,501,300	1,501,300	622,979
1993	0.38781		1,607,300	1,607,300	623,327
1994	0.36244	-3,098,250	1,718,800	-1,379,450	-499,968
				TOTAL PW <sup>1</sup>	10,237,198

(- sign denotes assumed resale value)

B. Alternative 2 - Cost of Construction Power by Temporary Tapline  
(This will represent costs for B/C analysis)

Basic Assumptions:

1. Same loading conditions and time frame as per Alternative 1.
2. Sequence of temporary construction as per previous assumptions.
3. Reuse of substation equipment possible after construction program completed but no salvage value on line material. (Note: Possible reuse as distribution line to recreational areas.) Assume resale value of substation equipment to be depreciated value based on 25-year life of facilities.
4. Cost of power based on wholesale rates in Railbelt area.  
From previous estimates for line and substation facilities:

Construction Costs:

69-kV subtransmission line - \$3,200,000 (1985 level)

Susitna tap station + Watana substation facilities

Baseline cost level = \$26.50/kVA (1979)

Escalating @ 7% to 1985 (6 yrs)

Construction Cost = \$40/kVA (1985)

Total Construction Cost = \$400,000

69/4.16 kW, 5 MVA, Substation at Devil Canyon (1979 levels)

Transformer - \$45,000 fob factory (Virginia)

Allowing 5% for shipping and handling, etc.

At jobsite cost = \$47,250

Fused Disc. Sw. = 2,750

Structure, Conc, pad, etc. = 5,000

TOTAL \$55,000

Construction Costs:

Equipment	60%	\$55,000
Labor	30%	28,000
Design	10%	<u>9,000</u>
TOTAL		\$92,000 or \$18.4/kVA (1979)

Substation would be installed in 1989.

Escalated at 7% from 1979 levels.

1989 Construction Cost = \$36.2/kVA

Total Construction Cost = \$181,000

O&M For Temporary Construction Power Line Maintenance

69 kV Wood Pole line - Approximately 40 miles long (11 + 29 M)

	<u>Year</u>	<u>\$/M</u>	<u>Total O&amp;M Costs (\$)</u>
40 M Total {	1986	330	13,200
	1987	345	13,800
	1988	360	14,400
	1989	380	15,200
	1990	400	16,000
	1991	420	16,800
29 M Total {	1992	440	12,800
	1993	460	13,300
	1994	485	14,000

Note: That due to overlap in construction schedules for Watana and Devil Canyon the capacity of the Susitna tap station will need to be doubled by addition of second 5 MVA transfer. This will be moved to spares inventory after 2 years.

## Cost of Construction Power Supplied over Temporary Line Facility

Based on information from RWRA 2/1/79

Wholesale rates for Railbelt area, with combination of Susitna

Hydropower and large coal-fired plant feeding interconnection.

<u>Year</u>	<u>Rate of Change</u>	<u>Wholesale Rate (mills/kWh)</u>	<u>Cost of Energy (mills/kWh)</u>	
			<u>Bus-Bar</u>	<u>Substation</u>
1979	}	17	Note: <u>1977 Cost Levels</u>	
1980		18		
1981		20		
1982		22		
1983	}	24	27.3	30.2
1984		26		
1985		28		
1986		30		
1987		32		
1988	}	34	31.0	33.5
1989		37		
1990		39		
1991		42		
1992		45		
1993	}	47	33.2	36.6
1994		50		
1995				
2000			36.2	39.1

# Conversion of Total Energy Rate to 2-Part Tariff

Assumption: 100 MW Power Transfer at 0.6 LF is 525.6 GWh/yr.

Year	Bulk Rate (mills/kWh)	Total Revenue for Bulk Rate (\$1000)	50/50 Revenue From:		Equivalent Tariff	
			Demand (\$1000)	Energy (\$1000)	Demand Rate (\$/kWh)	Energy Rate (mills/kWh)
1979	17	8,935.2	4,467.6		74.5	8.5
1980	18	9,460.8	4,730.4		78.8	9.0
1981	20	10,512.0	5,256.0		87.6	10.0
1982	22	11,563.2	5,781.6		96.4	11.0
1983	24	12,614.4	6,307.2		105.1	12.0
1984	26	13,665.6	6,832.8		113.9	13.0
1985	28	14,716.8	7,358.4		122.6	14.0
1986	30	15,768.0	7,884.0		131.4	15.0
1987	32	16,819.2	8,409.6		140.2	16.0
1988	34	17,870.4	8,935.2		148.9	17.0
1989	37	19,447.2	9,723.6		162.1	18.5
1990	39	20,498.4	10,249.2		170.8	19.5
1991	42	22,075.2	11,037.6		184.0	21.0
1992	45	23,652.0	11,826.0		197.1	22.5
1993	47	24,703.2	12,351.6		205.9	23.5
1994	50	26,280.0	13,140.0		219.0	25.0

Allow 5% adder for line and substation losses - assume the resulting rates are applicable to price construction power.

### Cost Estimate for Construction Power

Assuming same loading as for diesel generation alternative.

#### 1. Watana Damsite (3750 kW, 15.6 GWh/yr)

Year	Demand Rate (\$/kW)	Energy Rate (mills/kWh)	Construction Power Costs		
			Demand (\$)	Energy (\$)	Total (\$)
1986	138.0	15.8	517,500	246,480	763,980
1987	147.2	16.8	552,000	262,080	814,080
1988	156.3	17.9	586,125	279,240	865,365
1989	170.2	19.4	638,250	302,640	940,890
1990	179.3	20.5	672,375	319,800	992,175
1991	193.2	22.1	724,500	344,760	1,069,260

#### 2. Devil Canyon Damsite (3350 kW, 13.94 GWh/yr)

Year	Demand Rate (\$/kW)	Energy Rate (mills/kWh)	Construction Power Costs		
			Demand (\$)	Energy (\$)	Total (\$)
1990	179.3	20.5	600,655	285,770	886,425
1991	193.2	22.1	647,220	308,074	955,294
1992	207.0	23.6	693,450	328,984	1,022,434
1993	216.2	24.7	724,270	344,318	1,068,588
1994	230.0	26.3	770,500	366,622	1,137,122

## Depreciated Value of Substation Facilities

Basic Assumption of 25-Year Service Life

Assume Straight Line Depreciation

### 1. Watana Substation

Installed Cost (new) = \$ 27.6/kVA (1985)  
= \$138,000  
Depreciation/Year = \$ 5,520  
Depreciated Value = \$104,880 (1991) (6-year period)

### 2. Devil Canyon Substation

Installed Cost (new) = \$ 36.2/kVA (1989)  
= \$ 181,000  
Depreciation/Year = \$ 7,240  
Depreciated Value = \$ 144,800 (1994) (5-year period)

### 3. Susitna Tap Station/Watana Bus Tap

Installed Cost (new) = \$ 262,000 (1985)  
Depreciation/Year = \$ 10,480  
Depreciated Value = \$ 167,680 (1994) (7-year period)

To transfer 5 MVA facility from Susitna Tap to Watana.

Cost of removal and transfer = \$30,000 (1991)

Cost of second 5 MVA step-down facility at Susitna tap.

In 1989 for Supplementary power to Devil Canyon = \$343,400

Depreciated value after 2 years = \$315,900

Discounted Value of Costs (Sub-Transmission Tapline Alternative)

Base Year 1979 (Discounted @ 7%)

Year	PWF'	Construction Cost (\$)	O&M (\$)	Cost of Power (\$)	Total Cost (\$)	Present Value (\$)
1979	1.00000					
1985	0.66634	400,000			400,000	266,536
1986	0.62274		13,200	763,980	777,180	483,981
1987	0.58200		13,800	814,080	827,880	481,826
1988	0.54393		14,400	865,365	879,765	478,531
1989	0.50834	524,400	15,200	940,890	1,480,490	752,592
1990	0.47509		16,000	1,878,600	1,894,600	900,106
1991	0.44401	-390,780*	16,800	2,024,554	1,650,574	732,871
1992	0.41496		12,800	1,022,434	1,035,234	429,581
1993	0.38781		13,300	1,068,588	1,081,888	419,567
1994	0.36244	-312,480	14,000	1,137,122	838,642	<u>303,957</u>
					TOTAL PW'	5,249,548

\* Including one-time cost of transfer of tap facilities and resale value of 5-MVA substation.

B/C Ratio for Construction Power Supply by Tapline.

$$\begin{aligned}
 \text{B/C Ratio} &= \frac{\text{Discounted Cost of Diesel Generation Alternative}}{\text{Discounted Cost of Tapline Alternative}} \\
 &= \frac{10,237,198}{5,249,548} \\
 &= \underline{1.95}
 \end{aligned}$$

DERIVATION  
OF  
INPUT COST DATA FOR ECONOMIC ANALYSIS  
TO OBTAIN  
BASELINE COSTS ASSOCIATED WITH THE TWO CONSTRUCTION POWER ALTERNATIVES

<u>Year</u>	<u>7% Deflator</u>	<u>Alternative I</u>		<u>Alternative II</u>	
		<u>Diesel Generation</u>		<u>Tapline Supply</u>	
		<u>Escalated</u>	<u>Deflated</u>	<u>Escalated</u>	<u>Deflated</u>
1979	1.00				
1980	1.07				
1981	1.14				
1982	1.23				
1983	1.31				
1984	1.40				
1985	1.50	4,252,500	2,835,000	400,000	266,670
1986	1.61	1,118,500	694,720	777,180	482,720
1987	1.72	1,198,100	696,570	827,880	481,330
1988	1.84	1,280,800	696,090	879,765	478,130
1989	1.97	6,018,575	3,055,110	1,480,490	751,520
1990	2.10	2,779,800	1,323,710	1,894,600	902,190
1991	2.25	420,300	186,800	1,650,574	733,590
1992	2.41	1,501,300	622,950	1,035,234	429,560
1993	2.58	1,607,300	622,980	1,081,888	419,340
1994	2.76	-1,379,450	-499,800	838,642	303,860

# SUMMARY

## BASELINE COSTS (1979) ASSOCIATED WITH TWO CONSTRUCTION POWER ALTERNATIVES

Year	<u>\$1000 (1979)</u>	
	(Independent)	(Interconnected)
	Diesel	Tapline
	<u>Generation</u>	<u>Supply</u>
1985	2,835	267
1986	695	483
1987	697	481
1988	696	478
1989	3,055	752
1990	1,324	902
1991	187	734
1992	623	430
1993	623	419
1994	-500 <sup>1/</sup>	304

<sup>1/</sup> Negative sign indicates net resale value predominates over costs.

#### D.4 ALTERNATIVE GENERATING PLANT FUEL COSTS

The year-by-year analysis of comparative fuel costs follows:

##### A. First Period (1984-87) - Firm Power Transfer of 30 MW, 145 GWh

<u>Year</u>	<u>Interconnected System Expansion</u>	<u>Independent System Expansion</u>
1984	The number and type of generating plants is identical to that for each system operating independently.	Each independent system would be supplied by operational units on basis of economic dispatch to meet individual area needs.

The determination of relative economic advantage to either system, of a firm power transfer, would require a detailed analysis, necessitating production costing of economically dispatched units for the Anchorage and Fairbanks systems. It is a reasonable measure to delete the comparison of marginal advantages accruing for this year of operation.

1985	ANCH 9 - 78 MW SCGT is added to AML&P system, obviating the need for both NORT 3 and BELU 9.	Two units are required in Anchorage area, ANCH 9 - 78 MW SCGT and BELU 9 - 71 MW RCGT, together with NORT 3 - 69 MW SCGT unit at the Northpole Station in Fairbanks.
------	----------------------------------------------------------------------------------------------	----------------------------------------------------------------------------------------------------------------------------------------------------------------------

As a first approximation, the relative generation cost advantage may be determined by estimating the respective fuel costs associated with the generation of 145 GWh of energy by either ANCH 9 or NORT 3, taking into consideration different primary fuel costs and thermal efficiencies. The unit ratings are sufficiently close to justify this analytical approach, on the basic assumption that equivalent energy would be generated during the year by the two units. An adjustment would then be made to allow for the differential cost of supplying line losses in the transmission intertie, which would amount to 1.5 GWh/yr.

## Comparative Fuel Costs:

### ANCH 9 - 78 MW SCGT

From Battelle Report (see Figure D-3)

See Figure D-1

Trend Curve for HR8444 New Gas  
with 8% inflation and escalation

1985 Fuel Cost = \$3.60/MBTU

Net Heat Rate = 14,500 BTU/kWh

Annual Cost of Fuel (ACF)

to generate 145 GWh:

$$\begin{aligned} \text{ACF @ } 0.21 \text{ PCF}^{2/} &= \$3.60 \times 145 \times 14,500 \\ &= \$7,569,000 \end{aligned}$$

### NORT 3 - 69 MW SCGT

From Stanley Consultants Report P. 21

1978 Fuel Cost = \$1.98/MBTU

Escalating @ 10% per year<sup>1/</sup>:

1985 Fuel Cost = \$3.86/MBTU

For distillate from North Pole refinery

From Table 6, P. 22:

Net Heat Rate = 15,130 BTU/kWh

Annual Cost of Fuel (ACF)

to generate 145 GWh:

$$\begin{aligned} \text{ACF @ } 0.24 \text{ PCF}^{2/} &= \$3.86 \times 145 \times 15,130 \\ &= \$8,468,000 \end{aligned}$$

The total cost comparison is in favor of ANCH 9 generation to supply Fairbanks.

Total cost of generation, including loss component = \$7,648,000.

1986 BELU 9 - 71 MW SCGT is added to CEA system, the inter-connection having served to delay the in-service of the combustion turbine by one year. It is assumed that this unit will be operated for supply to CEA system only during first year of operation.

ANCH 10 - 104 MW coal-fired plant is added to AML&P system for both independent and interconnected system expansions. KNIK A - 15 MW thermal power plant (CEA) is also retired from both expansions.

The relative economic advantage is attributable to the fuel cost differential between distillate for NORT 3 generation and Beluga gas for generation by either ANCH 9 or BELU 9. Selecting ANCH 9 as in the previous analysis for 1985:

<sup>1/</sup> 7% inflation + 3% escalation.

<sup>2/</sup> PCF = Plant Capacity Factor.

Comparative Fuel Costs:

ANCH 9 - 79 MW SCGT

1986 Fuel Cost = \$4.00/MBTU  
Net Heat Rate = 14,500 BTU/kWh  
Annual Cost of Fuel (ACF)  
to generate 145 GWh:  
ACF @ 0.21 PCF = \$8,410,000

NORT 3 - 69 MW SCGT

1986 Fuel Cost = \$4.25/MBTU  
Net Heat Rate = 15,130 BTU/kWh  
Annual Cost of Fuel (ACF)  
to generate 145 GWh:  
ACF @ 0.24 PCF = \$9,324,000

The cost comparison is once again in favor of ANCH 9 generation to supply the equivalent amount of energy over intertie, as would otherwise be generated locally in Fairbanks.

Total cost of ANCH 9 generation, including transmission loss = \$8,498,000.

1987 This is the first year of operation of COAL 1 - 200 MW coal-fired plant on the Anchorage system. As this would be the first year of operation for the first major coal-fired plant in the Railbelt, for either independent or interconnected expansions, it would be thus common to the two alternatives. The relative cost advantages would then again be determined by consideration of the relative generation cost for ANCH 9 and NORT 3.

Comparative Fuel Costs:

ANCH 9 - 79 MW SCGT

1987 Fuel Cost = \$4.25/MBTU  
Net Heat Rate = 14,500 BTU/kWh  
Annual Cost of Fuel (ACF)  
to generate 145 GWh:  
ACF @ 0.21 PCF = \$8,936,000

NORT 3 - 69 MW SCGT

1987 Fuel Cost = \$4.68/MBTU  
Net Heat Rate = 15,130 BTU/kWh  
Annual Cost of Fuel (ACF)  
to generate 145 GWh:  
ACF @ 0.21 PCF = \$10,267,000

Total cost of ANCH 9 generation, including transmission loss = \$9,029,000.

B. Second Period (1992-96) - Firm Power Transfer of 70 MW, 337 GWh

<u>Year</u>	<u>Interconnected System Expansion</u>	<u>Independent System Expansion</u>
1992	Interconnected operation obviates the need for COAL 5 - 200 MW unit in Anchorage area and COAL F2 - 100 MW unit in Fairbanks area. Comparable generation is maintained by COAL 6 - 300 MW unit in Anchorage area.	COAL 5 would have to be added to Anchorage system and COAL F2 to Fairbanks.

Comparative economic advantage is determined by relative magnitude of fuel costs, for either COAL 6 or COAL F2, to generate same energy.

Comparative Fuel Costs:

	● <u>COAL 6 - 300 MW</u>	● <u>COAL F2 - 100 MW</u>
From Battelle Report (see Figure D-4)		
Fuel Cost in 1992	\$2.60/MBTU	\$1.90/MBTU
Net Heat Rate	9,500 BTU/kWh	10,700 BTU/kWh
ACF to generate 337 GWh	\$8,324,000	\$6,851,000

The comparative advantage in this case moves to the use of Healy coal. However, as with interconnection, the unit COAL F2 will be eliminated in favor of the economies of scale associated with the COAL 6 unit. Without production costing, it is not possible to determine the overall economic advantage of introducing COAL 6, so for present analysis it is assumed that no economic energy transfer is possible. However, as a first approximation, the fuel costs for this year will be entered into economic analysis to consider the effect of the differential.

1993	<p>ANCH 11 - 104 MW coal-fired unit added to AML&amp;P system in this year for interconnected expansion, after an interval of five years following the in-service date for same unit with independent expansion. PEAK A1 - 78 MW combustion turbine also in-service from beginning of year.</p>	<p>PEAK A1 - 78 MW combustion turbine in-service from beginning of year, for independent expansion of Anchorage system.</p>
------	-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------

Of interest in this year is a comparison between the cost of energy generation for ANCH 11 and COAL F2 using the same source of fuel, Healy coal. Thus, the relative advantage of either generating at the existing plant site at Healy or in the vicinity of Anchorage may be examined for similar capacity units having the same thermal efficiency, to determine the economies of energy transfer by intertie.

Comparative Fuel Costs:

	• <u>ANCH 11</u>	• <u>COAL F2</u>
Cost of Healy coal in 1993	\$2.4/MBTU <sup>1/</sup>	\$2.00/MBTU <sup>2/</sup>
Net Heat Rate	10,700 BTU/kWh	10,700 BTU/kWh
ACF to generate 337 GWh	\$8,654,000	\$7,212,000

Once again the comparative advantage lies with the generation of energy at the Healy site. However, with interconnection the need for COAL F2 disappears in favor of the economies of scale attendant on COAL 6. It may be noted that the cost differential in favor of Healy disappears if the COAL F2 site would be moved away from Healy for environmental reasons to say Nenana. In this case, the cost of generation would be approximately the same whether coal were transported either to Anchorage or Nenana, as the transmission loss, associated with ANCH 11 (104 MW) generation and transfer over the intertie, would be compensated for by the slightly higher heat rate to be expected with the 100 MW unit of COAL F2.

---

<sup>1/</sup> Delivered to Anchorage plant site.

<sup>2/</sup> Delivered to Healy plant site.

1994 As GEN 1 - 300 MW coal-fired generating plant added for both independent and interconnected system expansions, the previous combination of ANCH 11 and COAL F2 can again be examined to determine the differential cost of fuel.

Comparative Fuel Costs:

	● <u>ANCH 11</u>	● <u>COAL F2</u>
Cost of Healy coal in 1994 (Minemouth Generation, FOB Tipple)	\$2.5/MBTU	\$2.2/MBTU
Net Heat Rate	10,700 BTU/kWh	10,700 BTU/kWh
ACF to generate 337 GWh	\$9,015,000	\$7,933,000

It may be noted that due to divergence of fuel cost trends after 1993, for coal delivered to either Anchorage or Nenana, rather than minemouth, the economic advantage moves progressively towards generation at an Anchorage location, with transfer of the equivalent energy over the intertie. However, in 1994, it is possible to transmit energy generated economically at Healy to Anchorage over the intertie.

Total cost of COAL F2 generation, including transmission loss = \$8,016,000.

1995	COAL F3 - 100 MW coal-fired plant is introduced to the Fairbanks area and PEAK A2 - 78 MW combustion turbine is added to the AML&P system. Interconnection results in the postponement by one year of the 300 MW GEN 2 in the Anchorage area.	GEN 2 - 300 MW coal-fired plant is introduced to the Anchorage area with independent system expansion but the 78 MW combustion turbine PEAK A2 is not required in addition to the large coal-fired plant. COAL F3 is added to the system in the Fairbanks area.
------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------

As COAL F3 is common to both the independent and interconnected system expansions, it is of interest whether the gas-fired PEAK A2 in Anchorage could economically displace the equivalent energy generated by the coal-fired unit COAL F3 in the Fairbanks area.

Comparative Fuel Costs:

	● <u>PEAK A2</u>	● <u>COAL F3</u>
Cost of New Gas in 1995 (HR 8444 - 8% infl. + esc.)	\$7.70/MBTU	
Cost of Healy Coal in 1995 (Minemouth Plant, FOB Tipple)		\$2.40/MBTU
Net Heat Rate	14,500 BTU/kWh	10,700 BTU/kWh
ACF to generate 337 GWh	\$37,626,000	\$8,654,000

There is a definite economic advantage to coal generation at Healy and energy transfer over the intertie to displace gas-fired generation in Anchorage.

Total cost of COAL F3 generation, including transmission loss = \$8,745,000.

1996 GEN 2 - 300 MW coal-fired plant is introduced to the Anchorage area, the inter-connection serving to postpone its in-service date by one year.

PEAK A2 - 78 MW combustion turbine is introduced to the AML&P system in Anchorage.

In this final year of analysis, it is of interest to compare the relative economic advantages of coal-fired generation at either the Fairbanks (Healy) or Anchorage (Beluga) sites.

Comparative Fuel Costs:

	● <u>GEN 2</u>	● <u>COAL F3</u>
Cost of Beluga Coal in 1996	\$3.3/MBTU	
Cost of Healy Coal in 1996		2.5/MBTU
Net Heat Rate	9,500 BTU/kWh	10,700 BTU/kWh
ACF to generate 337 GWh	\$10,565,000	\$9,015,000

Once again it is more economical to generate in the Fairbanks area and transfer energy south over the intertie to Anchorage.

Total cost of COAL F3 generation, including transmission loss = \$9,109,000.

# Nomogram calculates economy of scale in power plants

By JAMES McALISTER, Arkansas Power & Light Co.

Historically, the per unit cost of larger power plants has been less than that of smaller plants. The proportionality was examined in some detail in the article "Economy of Scale in Power Plants" in the August 1977 issue of POWER ENGINEERING Magazine, p. 51.

The basic equation is:

$$(C_1/C_2) = (MW_1/MW_2)^P$$

Where:

- $C_1$  cost of plant 1
- $C_2$  cost of plant 2
- $MW_1$  capability of plant 1
- $MW_2$  capability of plant 2
- $P$  proportionality factor

For many years, this proportionality factor averaged about 0.6, which led to the so-called "Six-tenths Power Law." However, as explained in the article referred to above, extended project schedules and inflation cause the factor to increase

This nomogram solves the equation and permits a cost comparison of plants of different sizes. It assumes, of course, that they are essentially identical in construction technique, design and time frame, and that the only significant difference is in size.

**Example:** A 200-MW plant can be built for \$200 million. Find the cost of a similar 1000-MW plant.

**Solution:** (1) Connect unit ratings of 200 MW and 1000 MW on the  $MW_1$  and  $MW_2$  scales, and mark intersection with Reference Line X. (2) Align this point with assumed scaling factor  $P = 0.6$  and extend to cut Reference Line Y. (3) Connect this point with 0.2 on  $C_1$  scale and extend to  $C_2$  scale. Read answer as \$0.53 billion. **END**

To obtain an extra copy of this article, circle 206 on Reader Service Card




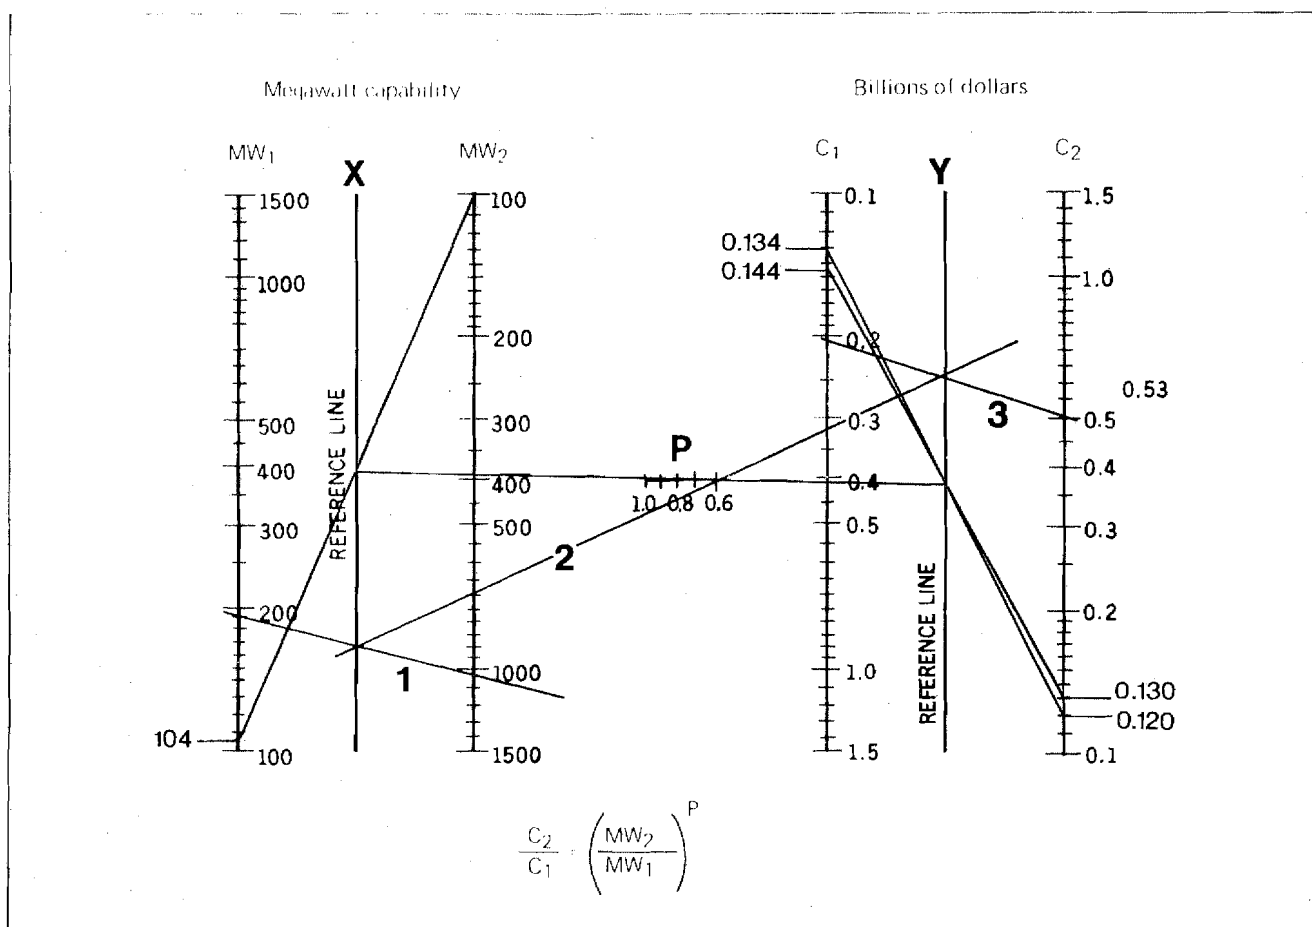



FIGURE D-2

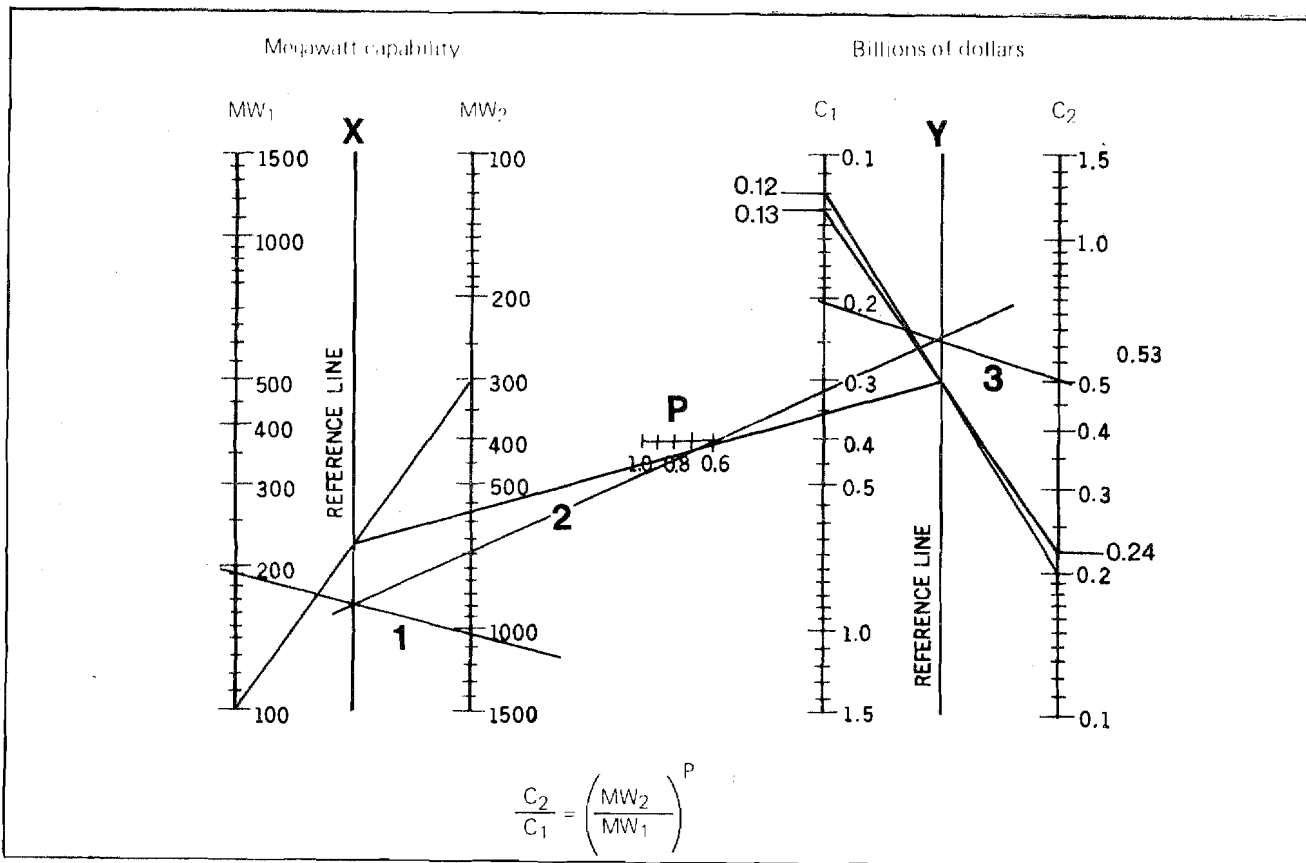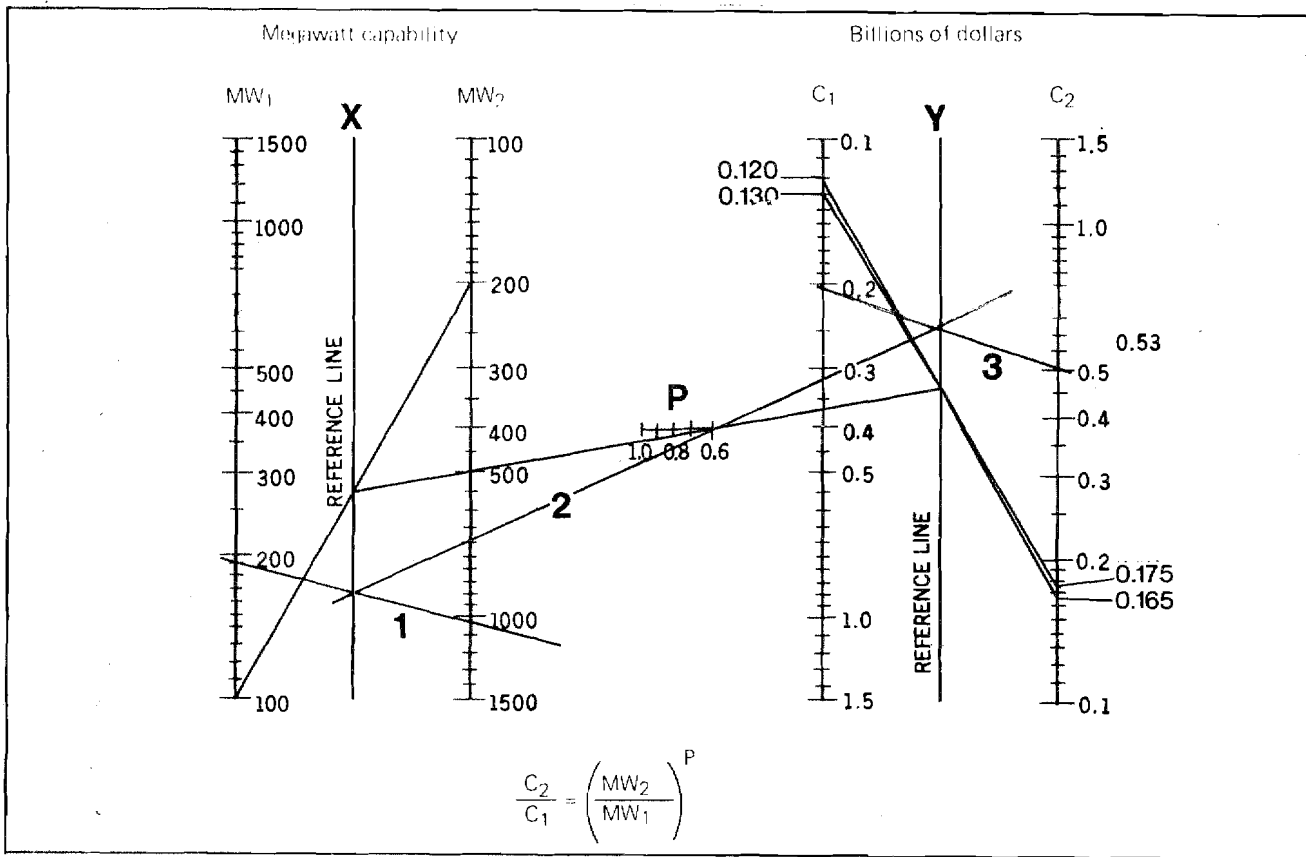

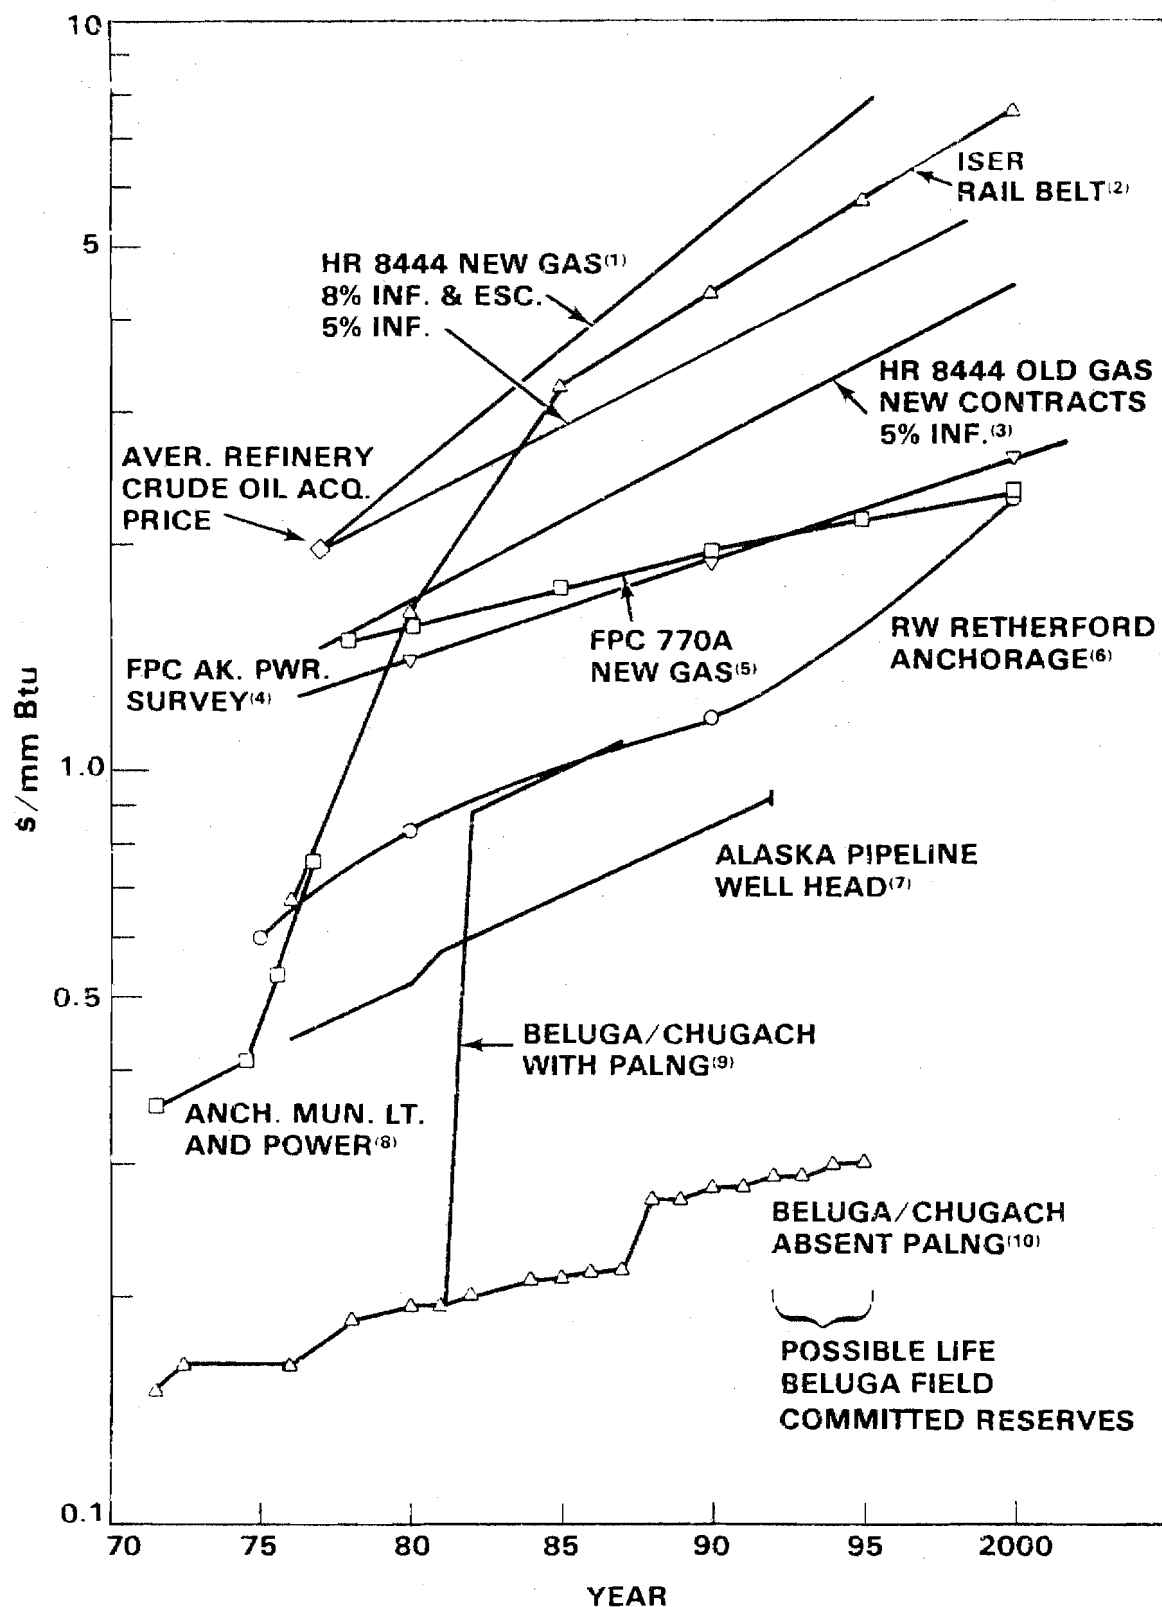

## ESTIMATES OF FUTURE NATURAL GAS PRICES

(Source: Battelle Final Report 'Alaskan Electric Power', March 1978/Figure 6-6)

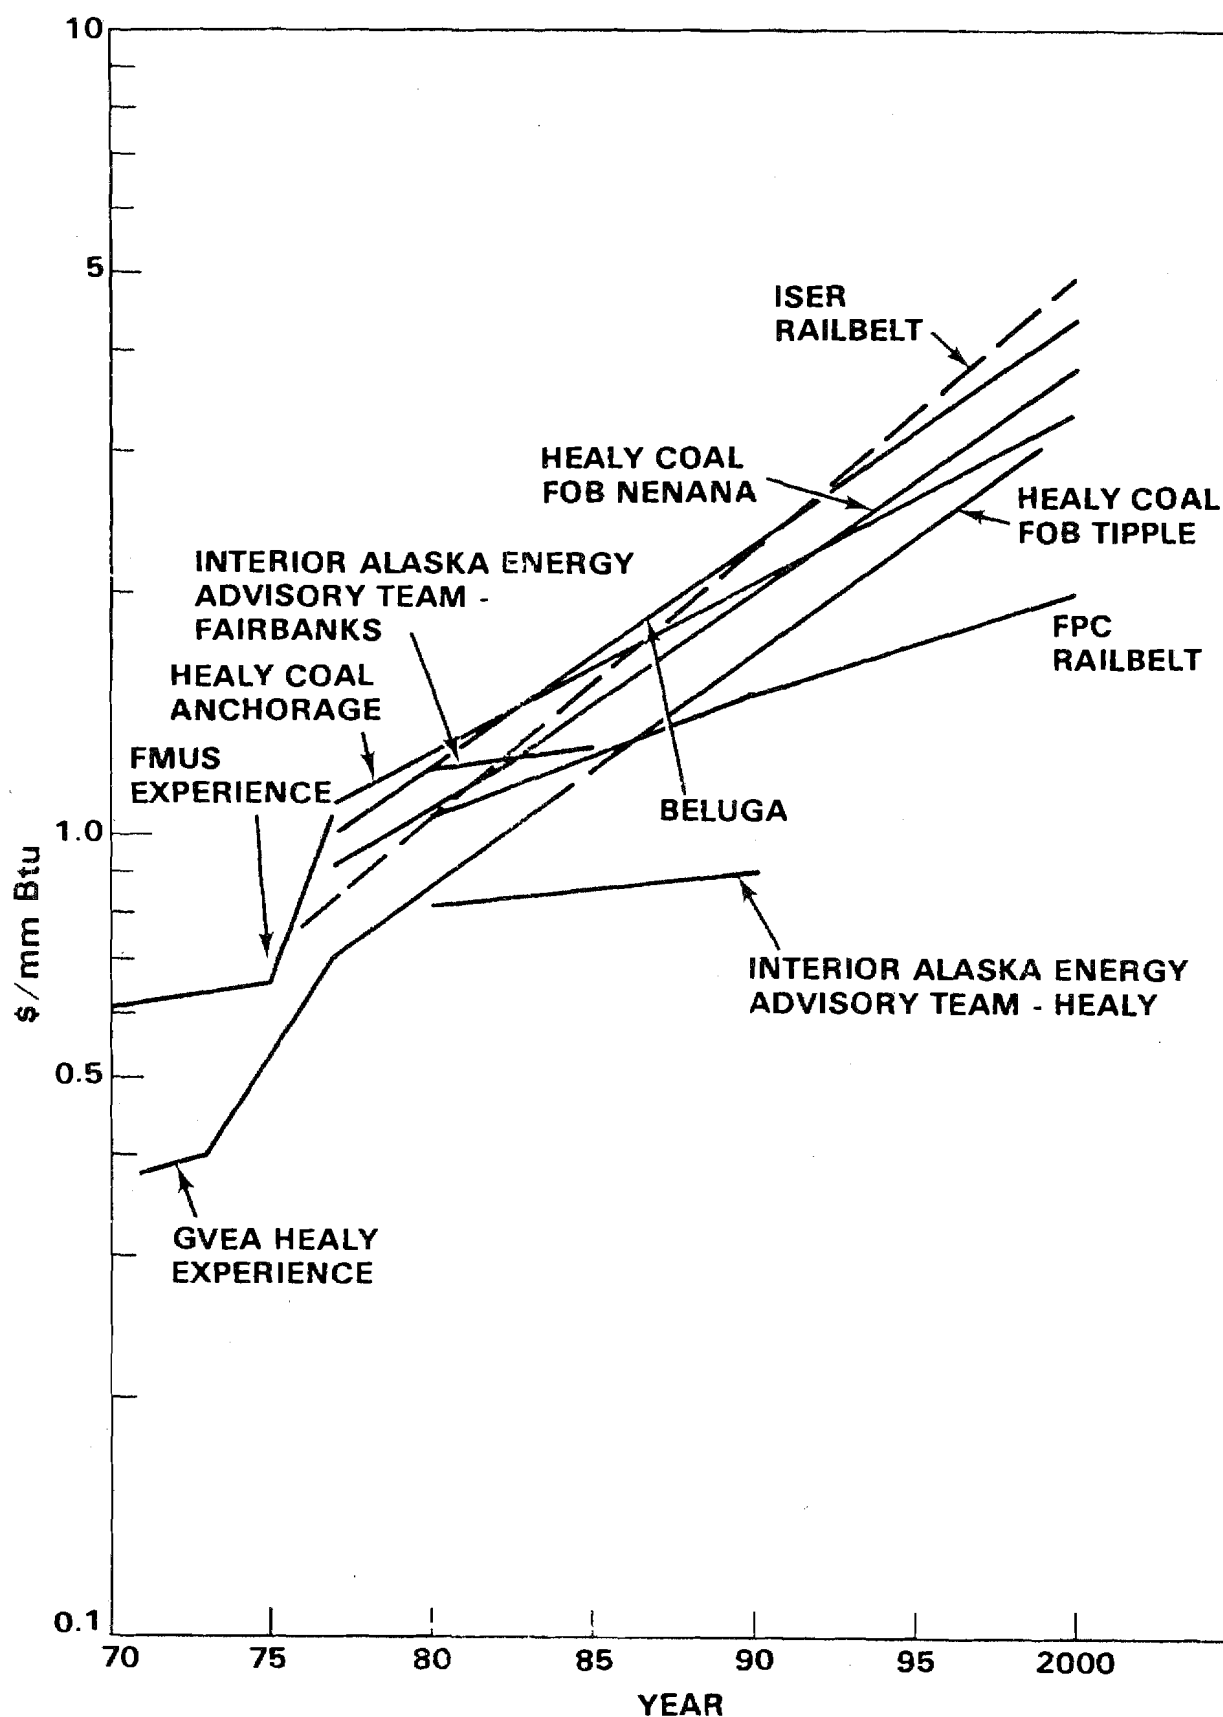

### ESTIMATES OF FUTURE COAL PRICES

(Source: Battelle Final Report 'Alaskan Electric Power', March 1978/Figure 6-7)

## APPENDIX E

### TRANSMISSION LINE ECONOMIC ANALYSIS PROGRAM (TLEAP)

APPENDIX E  
TRANSMISSION LINE ECONOMIC  
ANALYSIS PROGRAM (TLEAP)

TABLE 8-1	CASE IA
TABLE 8-1x	CASE IA
TABLE 8-1-LL	CASE IA
TABLE 8-2	CASE IC
TABLE 8-3	CASE IB
TABLE 8-3x	CASE IB
TABLE 8-3-LL	CASE IB
TABLE 8-4	CASE IB
TABLE 8-4x	CASE IB
TABLE 8-5	CASE ID
TABLE 8-5x	CASE ID
TABLE 8-6	CASE ID
TABLE 8-6x	CASE ID
TABLE 8-7	CASE IC

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-1

DISCOUNTED VALUE OF BASE YEAR (1979) INDEPENDENT SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	244,472	354,109	388,978	427,474	469,977	516,903	568,712	625,909	689,048	758,736
8.25	239,365	346,235	380,203	417,695	459,079	504,760	555,184	610,839	672,263	740,046
8.50	234,394	338,581	371,675	408,193	448,493	492,967	542,048	596,209	655,972	721,910
8.75	229,556	331,140	363,586	398,960	438,209	481,513	529,292	582,005	640,159	704,309
9.00	224,847	323,904	355,328	389,987	428,217	470,386	516,903	568,213	624,808	687,225
9.25	220,262	316,868	347,495	381,266	418,507	459,576	504,870	554,820	609,903	670,641
9.50	215,798	310,024	339,878	372,787	409,070	449,073	493,181	541,812	595,430	654,541
9.75	211,451	303,368	332,471	364,545	399,897	438,867	481,824	529,177	581,375	638,909
10.00	207,217	296,892	325,267	356,530	390,981	428,947	470,789	516,903	567,724	623,729
10.25	203,093	290,591	318,259	348,736	382,312	419,505	460,066	504,978	554,464	608,986
10.50	199,076	284,461	311,443	341,156	373,883	409,932	449,644	493,390	541,581	594,667
10.75	195,162	278,494	304,810	333,783	365,686	400,820	439,513	482,129	529,065	580,757
11.00	191,348	272,687	298,357	326,611	357,714	391,959	429,665	471,185	516,903	567,244
11.25	187,631	267,034	292,076	319,632	349,960	383,343	420,091	460,546	505,084	554,114
11.50	184,008	261,530	285,963	312,842	342,417	374,963	410,781	450,204	493,596	541,355
11.75	180,476	256,172	280,013	306,234	335,078	366,811	401,728	440,149	482,429	528,955
12.00	177,033	250,953	274,220	299,802	327,936	358,882	392,923	430,372	471,574	516,903

DISCOUNTED VALUE OF BASE YEAR (1979) INTERCONNECTED SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	233,560	351,674	390,188	433,136	481,019	534,389	593,859	660,105	733,874	815,988
8.25	228,191	343,033	380,460	422,186	468,698	520,531	578,278	642,594	714,202	793,899
8.50	222,980	334,654	371,028	411,573	456,758	507,104	563,184	625,633	695,151	772,510
8.75	217,922	326,528	361,883	401,284	445,186	494,092	548,560	609,202	676,699	751,797
9.00	213,011	318,646	353,015	391,309	433,969	481,482	534,389	593,284	658,825	731,736
9.25	208,242	311,000	344,414	381,636	423,094	469,260	520,656	577,860	641,509	712,304
9.50	203,610	303,582	336,072	372,257	412,551	457,412	507,346	562,914	624,731	693,479
9.75	199,112	296,385	327,980	363,160	402,327	445,925	494,445	548,429	608,474	675,241
10.00	194,743	289,401	320,129	354,336	392,412	434,788	481,938	534,389	592,720	657,569
10.25	190,497	282,623	312,511	345,776	382,796	423,988	469,812	520,779	577,450	640,444
10.50	186,373	276,043	305,118	337,471	373,468	413,513	458,054	507,585	562,649	623,847
10.75	182,364	269,656	297,943	329,412	364,418	403,354	446,652	494,792	548,300	607,760
11.00	178,469	263,455	290,979	321,592	355,638	393,499	435,593	482,386	534,389	592,166
11.25	174,682	257,434	284,218	314,002	347,119	383,938	424,867	470,355	520,900	577,048
11.50	171,000	251,587	277,654	306,634	338,851	374,661	414,461	458,686	507,819	562,389
11.75	167,421	245,908	271,281	299,482	330,826	365,659	404,365	447,367	495,132	548,174
12.00	163,941	240,392	265,091	292,538	323,036	356,923	394,569	436,386	482,827	534,389

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-1

	CAPITAL DISBURSEMENTS		FUEL COMPONENT OF OPERATING COSTS	
	IN \$1000 FOR		IN \$1000 FOR	
	ALTERNATIVE SYSTEM EXPANSIONS		ALTERNATIVE SYSTEM EXPANSIONS	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	INDEPENDENT ESCALATED \$	INTERCONNECTED ESCALATED \$
1979				
1980				
1981		4,001		
1982	2,009	14,228		
1983	26,666	46,967		
1984	81,942	11,515		
1985	37,172	32,062		
1986	21,127	492		
1987	7,152	2,472		
1988	7,555	8,473		
1989	23,110	30,549		
1990	21,920	43,038		
1991	82,200	43,411		
1992	101,380	89,694		
1993	58,450	108,723		
1994	29,840	75,134		
1995	16,580	23,106		
1996		270		
1997		254		

E-3

	ADDITIONAL DISBURSEMENTS		SUSITNA CONSTRUCTION POWER COSTS	
	IN \$1000 FOR		IN \$1000 FOR	
	UNDERLYING TRANSMISSION SYSTEM		ALTERNATIVE MODES OF SUPPLY	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	DIESEL GENERATION COSTS - \$79	INTERTIE TAPLINE COSTS - \$79
1979				
1980				
1981				
1982				
1983				
1984				
1985				
1986				
1987				
1988				
1989				
1990				
1991				
1992				
1993				
1994				
1995				
1996				
1997				

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-1X

DISCOUNTED VALUE OF BASE YEAR (1979) INDEPENDENT SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	244,472	354,109	388,978	427,474	469,977	516,903	568,712	625,909	689,048	758,736
8.25	239,365	346,235	380,203	417,695	459,079	504,760	555,184	610,839	672,263	740,046
8.50	234,394	338,581	371,675	408,193	448,493	492,967	542,048	596,209	655,972	721,910
8.75	229,556	331,140	363,386	398,960	438,209	481,513	529,292	582,005	640,159	704,309
9.00	224,847	323,904	355,328	389,987	428,217	470,386	516,903	568,213	624,808	687,225
9.25	220,262	316,868	347,495	381,266	418,507	459,576	504,870	554,820	609,903	670,641
9.50	215,798	310,024	339,878	372,787	409,070	449,073	493,181	541,812	595,430	654,541
9.75	211,451	303,368	332,471	364,545	399,897	438,867	481,824	529,177	581,375	638,909
10.00	207,217	296,892	325,267	356,530	390,981	428,947	470,789	516,903	567,724	623,729
10.25	203,093	290,591	318,259	348,736	382,312	419,305	460,066	504,978	554,464	608,986
10.50	199,076	284,461	311,443	341,156	373,883	409,932	449,644	493,390	541,581	594,667
10.75	195,162	278,494	304,810	333,783	365,686	400,820	439,513	482,129	529,065	580,757
11.00	191,348	272,687	298,357	326,611	357,714	391,959	429,665	471,185	516,903	567,244
11.25	187,631	267,034	292,076	319,632	349,960	383,343	420,091	460,546	505,084	554,114
11.50	184,008	261,530	285,963	312,842	342,417	374,963	410,781	450,204	493,596	541,355
11.75	180,476	256,172	280,013	306,234	335,078	366,811	401,728	440,149	482,429	528,955
12.00	177,033	250,953	274,220	299,802	327,936	358,882	392,923	430,372	471,574	516,903

DISCOUNTED VALUE OF BASE YEAR (1979) INTERCONNECTED SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	245,883	365,887	404,905	448,371	496,785	550,701	610,731	677,551	751,908	834,625
8.25	240,411	357,126	395,053	437,293	484,332	536,706	595,008	659,893	732,084	812,379
8.50	235,098	348,629	385,499	426,553	472,261	523,143	579,773	642,786	712,882	790,834
8.75	229,939	340,386	376,233	416,139	460,559	509,997	565,009	626,211	694,281	769,967
9.00	224,928	332,389	367,245	406,040	449,213	497,254	550,701	610,150	676,259	749,753
9.25	220,061	324,629	358,527	396,245	438,212	484,900	536,832	594,586	658,798	730,171
9.50	215,332	317,098	350,067	386,744	427,543	472,922	523,388	579,500	641,876	711,197
9.75	210,737	309,789	341,859	377,527	417,195	461,306	510,353	564,877	625,477	692,811
10.00	206,272	302,695	333,894	368,585	407,157	450,042	497,715	550,701	609,581	674,994
10.25	201,933	295,807	326,162	359,907	397,419	439,116	485,458	536,956	594,172	657,724
10.50	197,714	289,120	318,658	351,486	387,971	428,517	473,572	523,628	579,233	640,985
10.75	193,614	282,626	311,372	343,312	378,802	418,234	462,042	510,703	564,748	624,756
11.00	189,626	276,319	304,298	335,378	369,905	408,257	450,857	498,167	550,701	609,022
11.25	185,749	270,193	297,429	327,676	361,268	398,576	440,005	486,007	537,078	593,766
11.50	181,978	264,242	290,757	320,197	352,885	389,180	429,476	474,211	523,865	578,970
11.75	178,310	258,461	284,277	312,935	344,746	380,059	419,258	462,765	511,048	564,820
12.00	174,742	252,843	277,983	305,881	336,844	371,206	409,541	451,659	498,612	550,701

23 AUGUST 79

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-1X

	CAPITAL DISBURSEMENTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS		FUEL COMPONENT OF OPERATING COSTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	INDEPENDENT ESCALATED \$	INTERCONNECTED ESCALATED \$
1979				
1980				
1981		5,014		
1982	2,009	17,785		
1983	26,666	58,709		
1984	81,942	11,515		
1985	37,172	32,062		
1986	21,127	492		
1987	7,152	2,472		
1988	7,555	8,473		
1989	23,110	30,549		
1990	21,920	43,038		
1991	82,200	43,411		
1992	101,340	89,694		
1993	58,450	108,723		
1994	29,840	75,134		
1995	16,380	23,106		
1996		270		
1997		254		

	ADDITIONAL DISBURSEMENTS IN \$1000 FOR UNDERLYING TRANSMISSION SYSTEM		SUSITNA CONSTRUCTION POWER COSTS IN \$1000 FOR ALTERNATIVE MODES OF SUPPLY	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	DIESEL GENERATION COSTS - \$79	INTERTIE TAPLINE COSTS - \$79

1979  
1980  
1981  
1982  
1983  
1984  
1985  
1986  
1987  
1988  
1989  
1990  
1991  
1992  
1993  
1994  
1995  
1996  
1997

ALASKA POWER AUTHORITY  
 ANCHORAGE - FAIRBANKS INTERTIE  
 ECONOMIC FEASIBILITY STUDY

TABLE 8-1-LL

 DISCOUNTED VALUE OF BASE YEAR (1979) INDEPENDENT SYSTEM COSTS  
 IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	238,103	373,719	418,575	468,876	525,259	588,432	659,178	738,366	826,958	926,017
8.25	232,028	363,691	407,220	456,025	510,723	571,998	640,610	717,398	803,294	899,327
8.50	226,142	353,981	396,227	443,586	496,654	556,095	622,643	697,112	780,403	873,513
8.75	220,437	344,578	385,583	431,543	483,037	540,704	605,258	677,485	758,258	848,542
9.00	214,906	335,470	375,276	419,884	469,854	525,807	588,432	658,492	736,832	824,384
9.25	209,545	326,648	365,293	408,593	457,090	511,386	572,147	640,112	716,099	801,012
9.50	204,347	318,101	355,624	397,659	444,732	497,424	556,382	622,322	696,035	778,396
9.75	199,306	309,820	346,257	387,069	432,764	483,906	541,121	605,102	676,616	756,510
10.00	194,417	301,795	337,182	376,811	421,173	470,816	526,345	588,432	657,819	735,328
10.25	189,676	294,019	328,390	366,873	409,946	458,138	512,037	572,292	639,623	714,825
10.50	185,076	286,482	319,869	357,244	399,070	445,859	498,181	556,665	622,007	694,978
10.75	180,614	279,176	311,611	347,914	388,533	433,965	484,761	541,531	604,950	675,763
11.00	176,284	272,093	303,607	338,873	378,324	422,442	471,762	526,874	588,432	657,159
11.25	172,082	265,226	295,849	330,110	368,431	411,278	459,170	512,677	572,435	639,144
11.50	168,004	258,567	288,326	321,616	358,843	400,460	446,970	498,925	556,942	621,697
11.75	164,046	252,110	281,033	313,381	349,550	399,977	435,148	485,602	541,934	604,800
12.00	160,203	245,846	273,961	305,398	340,541	379,816	423,693	472,694	527,394	588,432

 DISCOUNTED VALUE OF BASE YEAR (1979) INTERCONNECTED SYSTEM COSTS  
 IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	233,811	366,765	411,372	461,709	518,495	582,528	654,703	736,015	827,576	930,622
8.25	227,934	356,831	400,054	448,819	503,821	565,831	635,714	714,434	803,062	902,793
8.50	222,245	347,227	389,113	436,361	489,641	549,699	617,372	693,589	779,387	875,922
8.75	216,739	337,940	378,536	424,319	475,937	534,112	599,651	673,453	756,522	849,972
9.00	211,407	328,957	368,308	412,677	462,691	519,048	582,528	654,001	734,435	824,909
9.25	206,245	320,269	358,417	401,421	449,887	504,489	565,982	635,206	713,098	800,700
9.50	201,246	311,864	348,851	390,537	437,508	490,416	549,990	617,044	692,482	777,313
9.75	196,404	303,732	339,597	380,011	425,538	476,811	534,534	599,492	672,562	754,718
10.00	191,713	295,863	330,645	369,830	413,963	463,657	519,592	582,528	653,312	732,886
10.25	187,169	288,247	321,984	359,981	402,769	450,937	505,146	566,130	634,707	711,788
10.50	182,765	280,876	313,602	350,453	391,941	438,636	491,178	550,276	616,723	691,398
10.75	178,498	273,741	305,490	341,233	381,465	426,739	477,671	534,948	599,337	671,689
11.00	174,361	266,833	297,639	332,312	371,331	415,230	464,607	520,126	582,528	652,637
11.25	170,351	260,144	290,038	323,677	361,524	404,097	451,971	505,792	566,275	634,217
11.50	166,463	253,666	282,679	315,319	352,034	393,324	439,748	491,928	550,557	616,407
11.75	162,693	247,392	275,554	307,228	342,849	382,900	427,922	478,517	535,356	599,184
12.00	159,037	241,314	268,653	299,394	333,957	372,811	416,479	465,543	520,652	582,528

28 AUGUST 79

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-1-LL

	CAPITAL DISBURSEMENTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS		FUEL COMPONENT OF OPERATING COSTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	INDEPENDENT ESCALATED \$	INTERCONNECTED ESCALATED \$
1979				
1980				
1981		4,011		
1982		14,228		
1983	18,629	46,967		
1984	58,823	11,515		
1985	16,380	32,062		
1986		492		
1987		463		
1988		436		
1989	2,600	410		
1990	23,435	2,986		
1991	78,550	23,799		
1992	130,300	78,892		
1993	131,780	130,623		
1994	79,930	132,084		
1995	30,375	80,216		
1996	17,630	23,090		
1997		254		

	ADDITIONAL DISBURSEMENTS IN \$1000 FOR UNDERLYING TRANSMISSION SYSTEM		SUSITNA CONSTRUCTION POWER COSTS IN \$1000 FOR ALTERNATIVE MODES OF SUPPLY	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	DIESEL GENERATION COSTS - \$79	INTERTIE TAPLINE COSTS - \$79
1979				
1980				
1981				
1982				
1983				
1984				
1985				
1986				
1987				
1988				
1989				
1990				
1991				
1992				
1993				
1994				
1995				
1996				
1997				

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

DISCOUNTED VALUE OF BASE YEAR (1979) INDEPENDENT SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	251,442	367,521	404,713	445,907	491,538	542,088	598,088	660,126	728,848	804,970
8.25	246,071	359,139	395,342	435,430	479,824	528,991	583,447	643,759	710,556	784,529
8.50	240,847	350,998	386,242	425,258	468,454	516,283	569,243	627,885	692,818	764,711
8.75	235,766	343,088	377,404	415,382	457,417	503,949	555,461	612,487	675,615	745,495
9.00	230,823	335,403	368,819	405,791	446,703	491,979	542,088	597,548	658,929	726,861
9.25	226,015	327,936	360,480	396,476	436,299	480,358	529,110	583,054	642,744	708,789
9.50	221,335	320,678	352,377	387,429	426,196	469,077	516,512	568,988	627,041	691,260
9.75	216,782	313,624	344,503	378,639	416,384	458,123	504,284	555,338	611,804	674,255
10.00	212,349	306,766	336,850	370,099	406,853	447,486	492,412	542,088	597,018	657,757
10.25	208,035	300,098	329,412	361,801	397,594	437,154	480,884	529,226	582,668	641,748
10.50	203,834	293,615	322,182	353,736	388,598	427,119	469,689	516,738	568,759	626,213
10.75	199,744	287,309	315,152	345,898	379,856	417,370	458,817	504,613	555,217	611,134
11.00	195,761	281,177	308,316	338,278	371,361	407,898	448,256	492,837	542,088	596,498
11.25	191,881	275,211	301,669	330,869	363,104	398,694	437,996	481,401	529,340	582,289
11.50	188,102	269,407	295,203	323,660	355,077	389,749	428,028	470,292	516,960	568,494
11.75	184,421	263,759	288,914	316,661	347,273	381,055	418,341	459,499	504,936	555,098
12.00	180,833	258,263	282,795	309,847	339,686	372,604	408,928	449,014	493,256	542,088

DISCOUNTED VALUE OF BASE YEAR (1979) INTERCONNECTED SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	256,328	378,390	417,991	462,074	511,139	565,746	626,509	694,110	769,298	852,904
8.25	250,750	369,493	407,995	450,842	498,522	551,575	610,597	676,248	749,256	830,422
8.50	245,332	360,863	398,299	439,950	486,289	537,839	595,177	658,943	729,840	808,647
8.75	240,069	352,489	388,894	429,388	474,429	524,524	580,232	642,173	711,030	787,554
9.00	234,955	344,363	379,769	419,143	462,927	511,614	565,746	625,922	692,803	767,120
9.25	229,987	336,476	370,916	409,204	451,773	499,097	551,703	610,170	675,141	747,321
9.50	225,159	328,821	362,324	399,563	440,954	486,959	538,087	594,901	658,023	728,136
9.75	220,467	321,389	353,986	390,207	430,459	475,186	524,885	580,099	641,430	709,544
10.00	215,905	314,174	345,892	381,129	420,276	463,767	512,081	565,746	625,346	691,523
10.25	211,471	307,168	338,035	372,318	410,396	452,690	499,663	551,828	609,751	674,055
10.50	207,159	300,363	330,406	363,765	400,808	441,942	487,617	538,331	594,630	657,121
10.75	202,966	293,754	322,999	355,462	391,502	431,513	475,932	525,239	579,967	640,702
11.00	198,888	287,334	315,805	347,401	382,469	421,392	464,594	512,540	565,746	624,780
11.25	194,921	281,097	308,817	339,573	373,700	411,569	453,592	500,219	551,952	609,340
11.50	191,062	275,036	302,030	331,971	365,186	402,034	442,915	488,265	538,570	594,365
11.75	187,307	269,147	295,436	324,587	356,919	392,778	432,551	476,665	525,588	579,838
12.00	183,652	263,422	289,028	317,415	348,890	383,790	422,492	465,407	512,991	565,746

23 AUGUST 79

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-2

	CAPITAL DISBURSEMENTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS		FUEL COMPONENT OF OPERATING COSTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	INDEPENDENT ESCALATED \$	INTERCONNECTED ESCALATED \$
1979				
1980				
1981		4,872		
1982	2,009	18,056		
1983	26,666	72,604		
1984	81,942	11,326		
1985	37,172	31,886		
1986	21,127	328		
1987	7,152	2,319		
1988	7,555	8,529		
1989	23,110	30,604		
1990	21,920	43,092		
1991	82,200	43,463		
1992	101,380	89,973		
1993	58,450	108,988		
1994	29,840	75,387		
1995	23,935	23,347		
1996	17,630	499		
1997		473		

	ADDITIONAL DISBURSEMENTS IN \$1000 FOR UNDERLYING TRANSMISSION SYSTEM		SUSITNA CONSTRUCTION POWER COSTS IN \$1000 FOR ALTERNATIVE MODES OF SUPPLY	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	DIESEL GENERATION COSTS - \$79	INTERTIE TAPLINE COSTS - \$79

1979  
1980  
1981  
1982  
1983  
1984  
1985  
1986  
1987  
1988  
1989  
1990  
1991  
1992  
1993  
1994  
1995  
1996  
1997

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

DISCOUNTED VALUE OF BASE YEAR (1979) INDEPENDENT SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	450,441	646,867	708,932	777,234	852,386	935,064	1,026,007	1,126,021	1,235,993	1,356,889
8.25	440,558	632,139	692,645	759,218	832,456	913,013	1,001,606	1,099,020	1,206,114	1,323,827
8.50	430,938	617,813	676,806	741,701	813,080	891,578	977,892	1,072,784	1,177,086	1,291,712
8.75	421,574	603,877	661,401	724,667	794,242	870,742	954,844	1,047,287	1,148,882	1,260,512
9.00	412,458	590,320	646,415	708,101	775,923	850,484	932,439	1,022,507	1,121,474	1,230,199
9.25	403,582	577,128	631,838	691,987	758,109	830,787	910,658	998,420	1,094,838	1,200,744
9.50	394,939	564,292	617,654	676,312	740,783	811,632	889,481	975,006	1,068,948	1,172,120
9.75	386,522	551,799	603,854	661,063	723,929	793,004	868,888	952,241	1,043,783	1,144,300
10.00	378,323	539,640	590,424	646,225	707,534	774,885	848,863	930,107	1,019,317	1,117,258
10.25	370,337	527,804	577,353	631,787	691,583	757,260	829,386	908,583	995,530	1,090,971
10.50	362,558	516,282	564,630	617,737	676,063	740,113	810,441	887,650	972,400	1,065,414
10.75	354,978	505,063	552,246	604,061	660,959	723,430	792,011	867,290	949,907	1,040,564
11.00	347,592	494,139	540,188	590,749	646,260	707,196	774,081	847,485	928,031	1,016,399
11.25	340,394	483,501	528,448	577,791	631,952	691,398	756,635	828,218	906,752	992,899
11.50	333,379	473,141	517,010	565,174	618,025	676,022	739,658	809,472	886,052	970,041
11.75	326,542	463,049	505,883	552,889	604,467	661,056	723,136	791,231	865,913	947,807
12.00	319,876	453,218	495,040	540,925	591,265	646,486	707,055	773,480	846,318	926,177

DISCOUNTED VALUE OF BASE YEAR (1979) INTERCONNECTED SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	425,715	623,551	686,899	756,982	834,493	920,193	1,014,914	1,119,573	1,235,172	1,362,807
8.25	415,880	608,574	670,250	738,473	815,914	897,313	989,478	1,091,297	1,203,742	1,327,880
8.50	406,320	594,025	654,080	720,498	793,933	875,100	964,786	1,063,852	1,173,242	1,293,990
8.75	397,026	579,890	638,372	703,040	774,529	853,533	940,815	1,037,212	1,143,640	1,261,101
9.00	387,990	566,157	623,113	686,083	755,684	832,590	917,541	1,011,350	1,114,906	1,229,183
9.25	379,204	552,811	608,287	669,610	737,380	812,251	894,942	986,242	1,087,013	1,198,201
9.50	370,660	539,842	593,880	653,606	719,599	792,496	872,995	961,861	1,059,933	1,168,127
9.75	362,351	527,236	579,881	638,056	702,325	773,307	851,680	938,186	1,033,639	1,138,930
10.00	354,269	514,983	566,274	622,945	685,542	754,666	830,976	915,192	1,008,106	1,110,582
10.25	346,407	503,071	553,049	608,259	669,233	736,555	810,863	892,859	983,310	1,083,055
10.50	338,758	491,489	540,192	593,985	653,384	718,957	791,323	871,165	959,226	1,056,323
10.75	331,315	480,228	527,693	580,110	637,981	701,855	772,338	850,089	935,832	1,030,360
11.00	324,073	469,277	515,540	566,621	623,008	685,235	753,889	829,612	913,106	1,005,142
11.25	317,025	458,626	503,723	553,507	608,453	669,081	735,960	809,715	891,027	980,644
11.50	310,166	448,266	492,230	540,755	594,303	653,378	718,535	790,379	869,573	956,844
11.75	303,488	438,189	481,052	528,354	580,544	638,112	701,597	771,586	848,726	933,720
12.00	296,988	428,385	470,179	516,294	567,165	623,270	685,131	753,321	828,465	911,250

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-3

	CAPITAL DISBURSEMENTS IN \$1000 FOR		FUEL COMPONENT OF OPERATING COSTS IN \$1000 FOR	
	ALTERNATIVE SYSTEM EXPANSIONS		ALTERNATIVE SYSTEM EXPANSIONS	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	INDEPENDENT ESCALATED \$	INTERCONNECTED ESCALATED \$
1979				
1980				
1981		4,011		
1982	2,009	14,228		
1983	26,666	46,967		
1984	81,942	11,551		
1985	37,172	32,097	8,468	7,648
1986	27,727	6,006	9,324	8,498
1987	33,552	24,420	10,267	9,029
1988	106,555	90,673		
1989	145,210	135,940		
1990	94,760	115,716		
1991	119,475	113,198		
1992	101,380	89,694	6,851	8,324
1993	58,450	108,723	7,212	8,654
1994	29,840	75,134	7,933	8,016
1995	23,935	23,106	8,654	8,745
1996	17,630	270	9,015	9,109
1997		254		

	ADDITIONAL DISBURSEMENTS IN \$1000 FOR		SUSITNA CONSTRUCTION POWER COSTS IN \$1000 FOR	
	UNDERLYING TRANSMISSION SYSTEM		ALTERNATIVE MODES OF SUPPLY	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	DIESEL GENERATION COSTS - \$79	INTERTIE TAPLINE COSTS - \$79

1979  
1980  
1981  
1982  
1983  
1984  
1985  
1986  
1987  
1988  
1989  
1990  
1991  
1992  
1993  
1994  
1995  
1996  
1997

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-3X

DISCOUNTED VALUE OF BASE YEAR (1979) INDEPENDENT SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	450,441	646,867	708,932	777,234	852,386	935,064	1,026,007	1,126,021	1,235,993	1,356,889
8.25	440,558	632,139	692,645	759,218	832,456	913,013	1,001,606	1,099,020	1,206,114	1,323,827
8.50	430,938	617,813	676,806	741,701	813,080	891,578	977,892	1,072,784	1,177,086	1,291,712
8.75	421,574	603,877	661,401	724,667	794,242	870,742	954,844	1,047,287	1,148,882	1,260,512
9.00	412,458	590,320	646,415	708,101	775,923	850,484	932,439	1,022,507	1,121,474	1,230,199
9.25	403,582	577,128	631,838	691,987	758,109	830,787	910,658	998,420	1,094,838	1,200,744
9.50	394,939	564,292	617,654	676,312	740,783	811,632	889,481	975,006	1,068,948	1,172,120
9.75	386,522	551,799	603,854	661,063	723,929	793,004	868,888	952,241	1,043,783	1,144,300
10.00	378,323	539,640	590,424	646,225	707,534	774,885	848,863	930,107	1,019,317	1,117,258
10.25	370,337	527,804	577,353	631,787	691,583	757,260	829,386	908,583	995,530	1,090,971
10.50	362,558	516,282	564,630	617,737	676,063	740,113	810,441	887,650	972,400	1,065,414
10.75	354,978	505,063	552,246	604,061	660,959	723,430	792,011	867,290	949,907	1,040,564
11.00	347,592	494,139	540,188	590,749	646,260	707,196	774,081	847,485	928,031	1,016,399
11.25	340,394	483,501	528,448	577,791	631,952	691,398	756,635	828,218	906,752	992,899
11.50	333,379	473,141	517,016	565,174	618,025	676,022	739,658	809,472	886,052	970,041
11.75	326,542	463,049	505,883	552,889	604,467	661,056	723,136	791,231	865,913	947,807
12.00	319,876	453,218	495,040	540,925	591,265	646,486	707,055	773,480	846,318	926,177

E - 12

DISCOUNTED VALUE OF BASE YEAR (1979) INTERCONNECTED SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	438,030	637,754	701,606	772,207	850,250	936,495	1,031,776	1,137,008	1,253,195	1,381,433
8.25	428,091	622,658	684,834	753,570	829,539	913,478	1,006,197	1,108,585	1,221,613	1,346,349
8.50	418,429	607,991	668,541	735,469	809,426	891,129	981,365	1,080,995	1,190,963	1,312,303
8.75	409,035	593,739	652,713	717,886	789,892	869,427	957,255	1,054,211	1,161,211	1,279,261
9.00	399,899	579,891	637,334	700,805	770,919	848,351	933,843	1,028,207	1,132,331	1,247,190
9.25	391,015	566,431	622,390	684,209	752,488	827,881	911,108	1,002,957	1,104,292	1,216,058
9.50	382,374	553,349	607,867	668,084	734,582	807,996	889,026	978,437	1,077,067	1,185,834
9.75	373,968	540,631	593,751	652,414	717,183	788,679	867,578	954,624	1,050,631	1,156,490
10.00	365,790	528,268	580,030	637,184	700,277	769,910	846,742	931,494	1,024,957	1,127,996
10.25	357,834	516,246	566,691	622,381	683,847	751,673	826,499	909,026	1,000,021	1,100,325
10.50	350,091	504,557	553,723	607,991	667,878	733,951	806,831	887,199	975,800	1,073,450
10.75	342,557	493,188	541,113	594,001	652,355	716,726	787,718	865,991	952,269	1,047,346
11.00	335,223	482,131	528,850	580,399	637,265	699,984	769,143	845,383	929,408	1,021,988
11.25	328,085	471,376	516,924	567,172	622,594	683,709	751,089	825,357	907,195	997,352
11.50	321,135	460,913	505,324	554,309	608,328	667,887	733,540	805,893	885,609	973,415
11.75	314,370	450,733	494,040	541,798	594,455	652,503	716,480	786,974	864,631	950,456
12.00	307,782	440,828	483,062	529,628	580,963	637,544	699,893	768,583	844,241	927,552

CAPITAL DISBURSEMENTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS		FUEL COMPONENT OF OPERATING COSTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS	
INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	INDEPENDENT ESCALATED \$	INTERCONNECTED ESCALATED \$
1979			
1980			
1981			
1982	2,009		
1983	26,606		
1984	81,942		
1985	37,172		
1986	27,727		
1987	33,552		
1988	106,555		
1989	145,210		
1990	94,760		
1991	110,475		
1992	101,380		
1993	58,450		
1994	29,840		
1995	23,935		
1996	17,630		
1997			

ADDITIONAL DISBURSEMENTS IN \$1000 FOR UNDERLYING TRANSMISSION SYSTEM	SUSITNA CONSTRUCTION POWER COSTS IN \$1000 FOR ALTERNATIVE MODES OF SUPPLY
1	1
2	2
3	3
4	4
5	5
6	6
7	7
8	8
9	9
10	10
11	11
12	12
13	13
14	14
15	15
16	16
17	17
18	18
19	19
20	20
21	21
22	22
23	23
24	24
25	25
26	26
27	27
28	28
29	29
30	30
31	31
32	32
33	33
34	34
35	35
36	36
37	37
38	38
39	39
40	40
41	41
42	42
43	43
44	44
45	45
46	46
47	47
48	48
49	49
50	50
51	51
52	52
53	53
54	54
55	55
56	56
57	57
58	58
59	59
60	60
61	61
62	62
63	63
64	64
65	65
66	66
67	67
68	68
69	69
70	70
71	71
72	72
73	73
74	74
75	75
76	76
77	77
78	78
79	79
80	80
81	81
82	82
83	83
84	84
85	85
86	86
87	87
88	88
89	89
90	90
91	91
92	92
93	93
94	94
95	95
96	96
97	97
98	98
99	99
100	100

	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	DIESEL GENERATION COSTS - \$79	INTERTIE TAPLINE COSTS - \$79
1979				
1980				
1981				
1982				
1983				
1984				
1985				
1986				
1987				
1988				
1989				
1990				
1991				
1992				
1993				
1994				
1995				
1996				
1997				

ALASKA POWER AUTHORITY  
 ANCHORAGE - FAIRHANKS INTERTIE  
 ECONOMIC FEASIBILITY STUDY

TABLE 8-3-LL

 DISCOUNTED VALUE OF BASE YEAR (1979) INDEPENDENT SYSTEM COSTS  
 IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	237,690	352,449	389,849	431,534	477,981	529,713	587,311	651,414	722,726	802,024
8.25	232,026	343,607	379,955	420,460	465,585	515,836	571,777	634,027	703,268	780,253
8.50	226,529	335,031	370,360	409,724	453,568	502,386	556,724	617,180	684,417	759,164
8.75	221,192	326,713	361,055	399,312	441,917	489,349	542,134	600,855	666,153	738,734
9.00	216,009	318,642	352,029	389,216	430,621	476,710	527,992	585,033	648,454	718,939
9.25	210,977	310,812	343,274	379,423	419,667	464,455	514,283	569,698	631,302	699,759
9.50	206,090	303,214	334,779	369,924	409,043	452,572	500,992	554,833	614,678	681,172
9.75	201,342	295,840	326,537	360,709	398,739	441,049	488,105	540,421	598,564	663,157
10.00	196,730	288,683	318,539	351,769	388,743	429,872	475,608	526,448	582,943	645,696
10.25	192,250	281,735	310,777	343,093	379,045	419,031	463,487	512,899	567,798	628,769
10.50	187,896	274,990	303,242	334,674	369,636	408,514	451,732	499,759	553,112	612,359
10.75	183,665	268,441	295,928	326,503	360,506	398,310	440,328	487,015	538,871	596,447
11.00	179,552	262,082	288,827	318,572	351,645	388,409	429,265	474,653	525,059	581,018
11.25	175,555	255,906	281,932	310,872	343,044	378,801	418,531	462,661	511,663	566,054
11.50	171,669	249,908	275,237	303,396	334,696	369,476	408,115	451,026	498,667	551,541
11.75	167,890	244,081	268,734	296,138	326,591	360,425	398,006	439,736	486,060	537,463
12.00	164,216	238,420	262,419	289,089	318,722	351,639	388,195	428,781	473,827	523,806

 DISCOUNTED VALUE OF BASE YEAR (1979) INTERCONNECTED SYSTEM COSTS  
 IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	238,419	347,569	383,059	422,582	466,586	515,562	570,053	630,659	698,037	772,913
8.25	233,022	339,177	373,675	412,087	454,846	502,429	555,362	614,225	679,657	752,361
8.50	227,783	331,036	364,574	401,911	443,464	489,698	541,122	598,299	661,848	732,450
8.75	222,695	323,138	355,747	392,041	432,428	477,356	527,320	582,865	644,591	713,158
9.00	217,753	315,474	347,182	382,468	421,725	465,389	513,939	567,904	627,865	694,463
9.25	212,953	308,036	338,873	373,182	411,345	453,784	500,965	553,401	611,654	676,346
9.50	208,290	300,818	330,810	364,172	401,276	442,530	488,386	539,340	595,940	658,787
9.75	203,759	293,811	322,985	355,431	391,508	431,614	476,187	525,707	580,705	641,766
10.00	199,356	287,009	315,390	346,948	382,032	421,026	464,355	512,486	565,935	625,265
10.25	195,078	280,405	308,018	338,716	372,836	410,753	452,878	499,665	551,612	609,268
10.50	190,919	273,492	300,861	330,725	363,913	400,786	441,745	487,229	537,722	593,756
10.75	186,876	267,764	293,912	322,968	355,252	391,115	430,944	475,166	524,250	578,713
11.00	182,946	261,715	287,164	315,437	346,845	381,729	420,463	463,463	511,183	564,124
11.25	179,124	255,839	280,610	308,125	338,685	372,619	410,293	452,108	498,506	549,974
11.50	175,407	250,130	274,245	301,025	330,761	363,776	400,422	441,090	486,208	536,247
11.75	171,792	244,584	268,062	294,129	323,068	355,191	390,841	430,397	474,274	522,930
12.00	168,276	239,194	262,055	287,431	315,597	346,856	381,541	420,019	462,694	510,010

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-3-LL

CAPITAL DISBURSEMENTS  
IN \$1000 FOR  
ALTERNATIVE SYSTEM EXPANSIONS

INDEPENDENT INTERCONNECTED  
COSTS - \$79 COSTS - \$79

Year	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79
1979		
1980		
1981		4,011
1982		14,228
1983	18,629	46,967
1984	58,823	11,551
1985	16,380	32,097
1986		526
1987		495
1988		436
1989	6,600	5,890
1990	33,955	22,306
1991	116,630	90,119
1992	122,100	123,363
1993	72,850	73,001
1994	37,275	70,091
1995	7,555	286
1996	17,630	270
1997		254

FUEL COMPONENT OF OPERATING COSTS  
IN \$1000 FOR  
ALTERNATIVE SYSTEM EXPANSIONS

INDEPENDENT INTERCONNECTED  
ESCALATED \$ ESCALATED \$

Year	INDEPENDENT ESCALATED \$	INTERCONNECTED ESCALATED \$
1979		
1980		
1981		
1982		
1983		
1984		
1985	8,468	7,648
1986	9,324	8,498
1987	10,267	9,029
1988		
1989		
1990		
1991		
1992		
1993		
1994		
1995	8,654	8,745
1996	9,015	9,109
1997		

ADDITIONAL DISBURSEMENTS  
IN \$1000 FOR  
UNDERLYING TRANSMISSION SYSTEM

INDEPENDENT INTERCONNECTED  
COSTS - \$79 COSTS - \$79

Year	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79
1979		
1980		
1981		
1982		
1983		
1984		
1985		
1986		
1987		
1988		
1989		
1990		
1991		
1992		
1993		
1994		
1995		
1996		
1997		

SUSITNA CONSTRUCTION POWER COSTS  
IN \$1000 FOR  
ALTERNATIVE MODES OF SUPPLY

DIESEL GENERATION INTERTIE TAPLINE  
COSTS - \$79 COSTS - \$79

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

DISCOUNTED VALUE OF BASE YEAR (1979) INDEPENDENT SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	460,026	660,366	723,622	793,213	869,761	953,949	1,046,525	1,148,307	1,260,188	1,383,148
8.25	449,953	645,365	707,037	774,872	849,475	931,510	1,021,701	1,120,844	1,229,806	1,349,537
8.50	440,149	630,774	690,907	757,038	829,753	909,697	997,574	1,094,156	1,200,286	1,316,886
8.75	430,604	616,579	675,218	739,694	810,576	888,491	974,122	1,068,220	1,171,602	1,285,163
9.00	421,311	602,768	659,956	722,824	791,927	867,872	951,324	1,043,010	1,143,726	1,254,340
9.25	412,262	589,329	645,108	706,415	773,790	847,822	929,158	1,018,504	1,116,632	1,224,387
9.50	403,450	576,250	630,660	690,452	756,148	828,324	907,606	994,680	1,090,297	1,195,276
9.75	394,867	563,521	616,601	674,920	738,987	809,360	886,647	971,516	1,064,696	1,166,981
10.00	386,508	551,131	602,919	659,808	722,292	790,913	866,264	948,992	1,039,805	1,139,477
10.25	378,364	539,070	589,602	645,101	706,047	772,967	846,438	927,087	1,015,603	1,112,737
10.50	370,430	527,327	576,639	630,787	690,239	755,508	827,151	905,782	992,068	1,086,739
10.75	362,700	515,893	564,019	616,855	674,856	738,519	808,389	885,059	969,179	1,061,458
11.00	355,167	504,759	551,732	603,292	659,883	721,987	790,133	864,899	946,916	1,036,872
11.25	347,825	493,916	539,767	590,088	645,308	705,897	772,369	845,285	925,259	1,012,961
11.50	340,669	483,354	528,116	577,232	631,119	690,236	755,081	826,200	904,190	989,702
11.75	333,694	473,066	516,768	564,713	617,305	674,991	738,255	807,629	883,691	967,075
12.00	326,894	463,043	505,715	552,520	603,854	660,149	721,877	789,555	863,745	945,062

DISCOUNTED VALUE OF BASE YEAR (1979) INTERCONNECTED SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	428,820	628,094	691,891	762,464	840,512	926,799	1,022,162	1,127,522	1,243,886	1,372,357
8.25	418,917	613,015	675,129	743,831	819,796	903,768	996,558	1,099,061	1,212,254	1,337,207
8.50	409,290	598,367	658,849	725,735	799,681	881,408	971,704	1,071,437	1,181,556	1,303,099
8.75	399,932	584,136	643,035	708,160	780,147	859,697	947,575	1,044,623	1,151,762	1,269,999
9.00	390,833	570,308	627,671	691,088	761,176	838,614	924,147	1,018,592	1,122,841	1,237,875
9.25	381,985	556,871	612,744	674,503	742,748	818,139	901,398	993,318	1,094,766	1,206,693
9.50	373,362	543,812	598,239	658,390	724,847	798,252	879,305	968,776	1,067,509	1,176,424
9.75	365,014	531,119	584,143	642,733	707,456	778,934	857,848	944,944	1,041,042	1,147,037
10.00	356,875	518,781	570,443	627,519	690,559	760,167	837,005	921,798	1,015,341	1,118,504
10.25	348,957	506,786	557,126	612,733	674,139	741,933	816,758	899,316	990,382	1,090,797
10.50	341,254	495,124	544,181	598,360	658,182	724,216	797,086	877,477	966,139	1,063,889
10.75	333,759	483,784	531,595	584,390	642,673	706,998	777,973	856,261	942,590	1,037,756
11.00	326,465	472,756	519,357	570,808	627,598	690,265	759,399	835,646	919,712	1,012,371
11.25	319,367	462,030	507,457	557,602	612,943	674,001	741,349	815,615	897,486	987,712
11.50	312,458	451,598	495,884	544,762	598,694	658,190	723,805	796,149	875,888	963,754
11.75	305,733	441,449	484,628	532,275	584,840	642,819	706,751	777,229	854,901	940,476
12.00	299,186	431,576	473,678	520,130	571,369	627,874	690,173	758,840	834,504	917,856

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-4

	CAPITAL DISBURSEMENTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS		FUEL COMPONENT OF OPERATING COSTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	INDEPENDENT ESCALATED \$	INTERCONNECTED ESCALATED \$
1979				
1980				
1981		4,011		
1982	2,009	14,228		
1983	26,666	46,967		
1984	81,942	11,551		
1985	37,172	32,097	8,468	7,648
1986	27,727	6,006	9,324	8,498
1987	33,552	24,420	10,267	9,029
1988	106,555	90,673		
1989	145,210	135,940		
1990	94,760	115,716		
1991	119,475	113,198		
1992	101,380	89,694	6,851	8,324
1993	58,450	108,723	7,212	8,654
1994	29,840	75,134	7,933	8,016
1995	23,935	23,106	8,654	8,745
1996	17,630	270	9,015	9,109
1997		254		

	ADDITIONAL DISBURSEMENTS IN \$1000 FOR UNDERLYING TRANSMISSION SYSTEM		SUSITNA CONSTRUCTION POWER COSTS IN \$1000 FOR ALTERNATIVE MODES OF SUPPLY	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	DIESEL GENERATION COSTS - \$79	INTERTIE TAPLINE COSTS - \$79

1979				
1980				
1981				
1982				
1983				
1984				
1985			2,835	267
1986			695	483
1987	6,646	1,356	697	481
1988			696	478
1989			3,055	752
1990			1,324	902
1991			187	734
1992	2,004		623	430
1993			623	419
1994			-500	304
1995				
1996				
1997				

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

DISCOUNTED VALUE OF BASE YEAR (1979) INDEPENDENT SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	460,026	560,366	723,622	793,213	869,761	953,949	1,046,525	1,148,307	1,260,188	1,383,148
8.25	449,953	545,365	707,037	774,872	849,475	931,510	1,021,701	1,120,844	1,229,806	1,349,537
8.50	440,149	530,774	690,907	757,038	829,753	909,697	997,574	1,094,156	1,200,286	1,316,886
8.75	430,604	516,579	675,218	739,694	810,576	888,491	974,122	1,068,220	1,171,602	1,285,163
9.00	421,311	502,768	659,956	722,824	791,927	867,872	951,324	1,043,010	1,143,726	1,254,340
9.25	412,262	489,329	645,108	706,415	773,790	847,822	929,158	1,018,504	1,116,632	1,224,387
9.50	403,450	476,250	630,660	690,452	756,148	828,324	907,606	994,680	1,090,297	1,195,276
9.75	394,867	463,521	616,601	674,920	738,987	809,360	886,647	971,516	1,064,696	1,166,981
10.00	386,508	451,131	602,919	659,808	722,292	790,913	866,264	948,992	1,039,805	1,139,477
10.25	378,364	439,070	589,602	645,101	706,047	772,967	846,438	927,087	1,015,603	1,112,737
10.50	370,430	427,327	576,639	630,787	690,239	755,508	827,151	905,782	992,068	1,086,739
10.75	362,700	415,893	564,019	616,855	674,856	738,519	806,389	885,059	969,179	1,061,458
11.00	355,167	404,759	551,732	603,292	659,883	721,987	790,133	864,899	946,916	1,036,872
11.25	347,825	393,916	539,767	590,088	645,308	705,897	772,369	845,285	925,259	1,012,961
11.50	340,669	383,354	528,116	577,232	631,119	690,236	755,081	826,200	904,190	989,702
11.75	333,694	373,066	516,768	564,713	617,305	674,991	738,255	807,629	883,691	967,075
12.00	326,894	363,043	505,715	552,520	603,854	660,149	721,877	789,555	863,745	945,062

E-18

DISCOUNTED VALUE OF BASE YEAR (1979) INTERCONNECTED SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	441,134	642,297	706,598	777,690	856,269	943,101	1,039,023	1,144,957	1,261,909	1,390,984
8.25	431,128	627,099	689,713	758,928	835,421	919,932	1,013,278	1,116,349	1,230,125	1,355,676
8.50	421,400	612,333	673,311	740,706	815,174	897,436	988,283	1,088,580	1,199,277	1,321,412
8.75	411,940	597,985	657,376	723,005	795,511	875,591	964,015	1,061,622	1,169,333	1,288,159
9.00	402,742	584,042	641,893	705,809	776,411	854,376	940,449	1,035,448	1,140,266	1,255,882
9.25	393,796	570,491	626,847	689,102	757,856	833,769	917,564	1,010,033	1,112,045	1,224,549
9.50	385,095	557,319	612,225	672,868	739,830	813,752	895,336	985,353	1,084,643	1,194,131
9.75	376,631	544,514	598,014	657,091	722,315	794,305	873,746	961,383	1,058,034	1,164,597
10.00	368,396	532,066	584,199	641,758	705,294	775,411	852,771	938,100	1,032,193	1,135,918
10.25	360,384	519,962	570,769	626,854	688,753	757,052	832,394	915,484	1,007,093	1,108,066
10.50	352,587	508,191	557,711	612,366	672,676	739,210	812,594	893,511	982,712	1,081,016
10.75	345,000	496,744	545,015	598,281	657,048	721,869	793,353	872,162	959,027	1,054,742
11.00	337,615	485,611	532,668	584,585	641,855	705,014	774,653	851,418	936,014	1,029,217
11.25	330,426	474,780	520,659	571,267	627,083	688,629	756,478	831,257	913,654	1,004,419
11.50	323,428	464,244	508,978	558,316	612,720	672,699	738,810	811,663	891,925	980,325
11.75	316,614	453,993	497,616	545,718	598,752	657,210	721,635	792,617	870,807	956,912
12.00	309,979	444,019	486,561	533,465	585,167	642,149	704,935	774,103	850,280	934,158

23 AUGUST 79

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-4X

CAPITAL DISBURSEMENTS  
IN \$1000 FOR  
ALTERNATIVE SYSTEM EXPANSIONS

FUEL COMPONENT OF OPERATING COSTS  
IN \$1000 FOR  
ALTERNATIVE SYSTEM EXPANSIONS

	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	INDEPENDENT ESCALATED \$	INTERCONNECTED ESCALATED \$
1979				
1980				
1981		5,014		
1982	2,009	17,785		
1983	26,666	58,709		
1984	81,942	11,551		
1985	37,172	32,097	8,468	7,648
1986	27,727	6,006	9,324	8,498
1987	55,552	24,420	10,267	9,029
1988	106,555	90,673		
1989	145,210	135,940		
1990	94,760	115,716		
1991	119,475	113,198		
1992	101,380	89,694	6,851	8,324
1993	58,450	108,723	7,212	8,654
1994	29,840	75,134	7,933	8,016
1995	23,935	23,106	8,654	8,745
1996	17,630	270	9,015	9,109
1997		254		

ADDITIONAL DISBURSEMENTS  
IN \$1000 FOR  
UNDERLYING TRANSMISSION SYSTEM

SUSITNA CONSTRUCTION POWER COSTS  
IN \$1000 FOR  
ALTERNATIVE MODES OF SUPPLY

	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	DIESEL GENERATION COSTS - \$79	INTERTIE TAPLINE COSTS - \$79
1979				
1980				
1981				
1982				
1983				
1984				
1985			2,835	267
1986			695	483
1987	6,646	1,356	697	481
1988			696	478
1989			3,055	752
1990			1,324	902
1991			187	734
1992	2,004		623	430
1993			623	419
1994			-500	304
1995				
1996				
1997				

ALASKA POWER AUTHORITY  
 ANCHORAGE - FAIRBANKS INTERTIE  
 ECONOMIC FEASIBILITY STUDY

TABLE 8-5

 DISCOUNTED VALUE OF BASE YEAR (1979) INDEPENDENT SYSTEM COSTS  
 IN \$1000

DISCOUNT RATE	----- ESCALATION RATES -----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	255,770	373,662	411,407	453,201	499,483	550,738	607,502	670,367	739,985	817,076
8.25	250,311	365,154	401,898	442,573	487,603	537,460	592,662	653,783	721,456	796,376
8.50	245,001	356,869	392,663	432,253	476,072	524,575	578,265	637,698	703,487	776,307
8.75	239,837	348,859	383,693	422,233	464,878	512,069	564,295	622,094	686,059	756,845
9.00	234,813	341,057	374,980	412,501	454,009	499,930	550,738	606,954	669,154	737,972
9.25	229,924	333,474	366,514	403,049	443,455	488,145	537,580	592,264	652,754	719,666
9.50	225,167	326,104	358,289	393,867	433,205	476,704	524,808	578,007	636,843	701,909
9.75	220,537	318,940	350,295	384,947	423,250	465,593	512,408	564,170	621,402	684,682
10.00	216,030	311,975	342,526	376,279	413,579	454,803	500,369	550,738	606,417	667,966
10.25	211,643	305,203	334,973	367,856	404,183	444,322	488,678	537,698	591,873	651,746
10.50	207,371	298,618	327,631	359,669	395,054	434,142	477,325	525,037	577,754	636,004
10.75	203,212	292,213	320,492	351,711	386,182	424,250	466,297	512,742	564,047	620,723
11.00	199,161	285,983	313,550	343,975	377,559	414,640	455,584	500,801	550,738	605,890
11.25	195,215	279,922	306,799	336,453	369,178	405,300	445,176	489,202	537,814	591,489
11.50	191,371	274,025	300,232	329,138	361,030	396,223	435,063	477,936	525,261	577,506
11.75	187,626	268,286	293,843	322,024	353,108	387,399	425,236	466,989	513,069	563,927
12.00	183,977	262,702	287,627	315,105	345,404	378,821	415,684	456,353	501,225	550,738

E - 20

 DISCOUNTED VALUE OF BASE YEAR (1979) INTERCONNECTED SYSTEM COSTS  
 IN \$1000

DISCOUNT RATE	----- ESCALATION RATES -----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	237,310	356,112	394,816	437,962	486,052	539,638	599,334	665,815	739,828	822,198
8.25	231,905	347,426	385,040	426,963	473,679	525,725	583,695	648,243	720,092	800,042
8.50	226,658	339,003	375,562	416,301	461,688	512,244	568,544	631,222	700,978	778,587
8.75	221,565	330,833	366,372	405,964	450,065	499,180	553,864	614,732	682,464	757,808
9.00	216,619	322,909	357,459	395,942	438,798	486,517	539,638	598,756	664,529	737,683
9.25	211,815	315,221	348,614	386,223	427,875	474,243	525,851	583,275	647,153	718,188
9.50	207,150	307,762	340,428	376,797	417,283	462,344	512,488	568,273	630,317	699,301
9.75	202,619	300,524	332,293	367,655	407,012	450,808	499,534	553,732	614,002	681,002
10.00	198,216	293,494	324,399	358,787	397,050	439,621	486,975	539,638	598,190	663,270
10.25	193,939	286,681	316,740	350,183	387,388	428,772	474,798	525,974	582,864	646,085
10.50	189,762	280,063	309,306	341,834	378,014	418,250	462,990	512,727	568,007	629,430
10.75	185,742	273,637	302,091	333,733	368,920	408,044	451,538	499,882	553,003	613,285
11.00	181,815	267,398	295,086	325,871	360,096	398,142	440,430	487,425	539,638	597,634
11.25	177,998	261,339	288,286	318,239	351,532	388,535	429,656	475,344	526,096	582,460
11.50	174,286	255,455	281,683	310,831	343,221	379,213	419,202	463,625	512,962	567,746
11.75	170,677	249,740	275,271	303,638	335,154	370,167	409,060	452,256	500,224	553,477
12.00	167,167	244,187	269,044	296,654	327,323	361,386	399,218	441,227	487,867	539,638

23 AUGUST 79

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-5

CAPITAL DISBURSEMENTS  
IN \$1000 FOR  
ALTERNATIVE SYSTEM EXPANSIONS

FUEL COMPONENT OF OPERATING COSTS  
IN \$1000 FOR  
ALTERNATIVE SYSTEM EXPANSIONS

	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	INDEPENDENT ESCALATED \$	INTERCONNECTED ESCALATED \$
1979				
1980				
1981		4,621		
1982	2,009	15,594		
1983	26,666	48,874		
1984	81,942	11,515		
1985	37,172	32,062		
1986	21,127	492		
1987	7,152	2,472		
1988	7,555	8,473		
1989	23,110	30,549		
1990	21,920	43,038		
1991	82,200	43,411		
1992	101,380	89,694		
1993	58,450	108,723		
1994	29,840	75,134		
1995	23,935	23,106		
1996	17,630	270		
1997		254		

ADDITIONAL DISBURSEMENTS  
IN \$1000 FOR  
UNDERLYING TRANSMISSION SYSTEM

SUSITNA CONSTRUCTION POWER COSTS  
IN \$1000 FOR  
ALTERNATIVE MODES OF SUPPLY

	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	DIESEL GENERATION COSTS - \$79	INTERTIE TAPLINE COSTS - \$79
1979				
1980				
1981				
1982				
1983				
1984				
1985				
1986				
1987	6,646	1,356		
1988				
1989				
1990				
1991				
1992	2,004			
1993				
1994				
1995				
1996				
1997				

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-5X

DISCOUNTED VALUE OF BASE YEAR (1979) INDEPENDENT SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	255,770	373,662	411,407	453,201	499,483	550,738	607,502	670,367	739,985	817,076
8.25	250,311	365,154	401,898	442,573	487,603	537,460	592,662	653,783	721,456	796,376
8.50	245,001	356,889	392,663	432,253	476,072	524,575	578,265	637,698	703,487	776,307
8.75	239,837	348,859	383,693	422,233	464,878	512,069	564,295	622,094	686,059	756,845
9.00	234,813	341,057	374,980	412,501	454,009	499,930	550,738	606,954	669,154	737,972
9.25	229,924	333,474	366,514	403,049	443,455	488,145	537,580	592,264	652,754	719,666
9.50	225,167	326,104	358,289	393,867	433,205	476,704	524,808	578,007	636,843	701,909
9.75	220,537	318,940	350,295	384,947	423,250	465,593	512,408	564,170	621,402	684,682
10.00	216,030	311,975	342,526	376,279	413,579	454,803	500,369	550,738	606,417	667,966
10.25	211,643	305,203	334,973	367,856	404,183	444,322	488,678	537,698	591,873	651,746
10.50	207,371	298,618	327,631	359,669	395,054	434,142	477,325	525,037	577,754	636,004
10.75	203,212	292,213	320,492	351,711	386,182	424,250	466,297	512,742	564,047	620,723
11.00	199,161	285,983	313,550	343,975	377,559	414,640	455,584	500,801	550,738	605,890
11.25	195,215	279,922	306,799	336,453	369,178	405,300	445,176	489,202	537,814	591,489
11.50	191,371	274,025	300,232	329,138	361,030	396,223	435,063	477,936	525,261	577,506
11.75	187,626	268,286	293,843	322,024	353,108	387,399	425,236	466,989	513,069	563,927
12.00	183,977	262,702	287,627	315,105	345,404	378,821	415,684	456,353	501,225	550,738

DISCOUNTED VALUE OF BASE YEAR (1979) INTERCONNECTED SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	246,615	366,889	405,988	449,539	498,044	552,057	612,191	679,121	753,596	836,439
8.25	241,130	358,111	396,115	438,439	485,568	538,037	596,441	661,434	733,741	814,159
8.50	235,804	349,595	386,542	427,678	473,474	524,450	581,180	644,299	714,509	792,582
8.75	230,632	341,335	377,257	417,244	461,750	511,280	566,390	627,697	695,878	771,683
9.00	225,609	333,320	368,251	407,124	450,383	498,513	552,057	611,609	677,828	751,438
9.25	220,729	325,543	359,514	397,310	439,360	486,137	538,164	596,018	660,337	731,825
9.50	215,988	317,996	351,037	387,790	428,670	474,136	524,695	580,906	643,388	712,821
9.75	211,381	310,671	342,811	378,554	418,302	462,499	511,637	566,258	626,961	694,406
10.00	206,905	303,561	334,828	369,593	408,244	451,213	498,975	552,057	611,039	676,560
10.25	202,554	296,657	327,080	360,897	398,486	440,265	486,696	538,288	595,603	659,262
10.50	198,324	289,955	319,559	352,458	389,019	429,646	474,787	524,936	580,639	642,495
10.75	194,213	283,446	312,257	344,267	379,832	419,343	463,235	511,988	566,128	626,240
11.00	190,215	277,124	305,167	336,316	370,916	409,346	452,029	499,429	552,057	610,479
11.25	186,327	270,984	298,282	328,597	362,261	399,645	441,157	487,246	538,410	595,196
11.50	182,546	265,019	291,596	321,102	353,860	390,230	430,607	475,427	525,173	580,375
11.75	178,868	259,224	285,101	313,823	345,704	381,091	420,369	463,960	512,332	566,001
12.00	175,290	253,592	278,792	306,754	337,785	372,220	410,432	452,833	499,875	552,057

23 AUGUST 79

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-5X

CAPITAL DISBURSEMENTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS		FUEL COMPONENT OF OPERATING COSTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS	
INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	INDEPENDENT ESCALATED \$	INTERCONNECTED ESCALATED \$

1979		
1980		
1981		5,014
1982	2,009	17,785
1983	20,666	58,709
1984	81,942	11,515
1985	37,172	32,062
1986	21,127	492
1987	7,152	2,472
1988	7,555	8,473
1989	23,110	30,549
1990	21,920	43,038
1991	82,200	43,411
1992	101,380	89,694
1993	58,450	108,723
1994	29,840	75,134
1995	23,935	23,106
1996	17,630	270
1997		254

ADDITIONAL DISBURSEMENTS  
IN \$1000 FOR  
UNDERLYING TRANSMISSION SYSTEM

INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79
-----------------------------	--------------------------------

1979	
1980	
1981	
1982	
1983	
1984	
1985	
1986	
1987	6,646
1988	
1989	
1990	
1991	
1992	2,004
1993	
1994	
1995	
1996	
1997	

SUSITNA CONSTRUCTION POWER COSTS  
IN \$1000 FOR  
ALTERNATIVE MODES OF SUPPLY

DIESEL GENERATION COSTS - \$79	INTERTIE TAPLINE COSTS - \$79
-----------------------------------	----------------------------------

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-6

DISCOUNTED VALUE OF BASE YEAR (1979) INDEPENDENT SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	261,027	381,019	419,402	461,886	508,913	560,973	618,607	682,411	753,044	831,230
8.25	255,466	372,366	409,734	451,083	496,843	547,488	603,542	665,583	734,247	810,239
8.50	250,057	363,958	400,344	440,594	485,127	534,401	588,925	649,258	716,017	789,885
8.75	244,795	355,789	391,222	430,408	473,752	521,698	574,740	633,419	698,335	770,146
9.00	239,676	347,851	382,360	420,515	462,706	509,367	560,973	618,051	681,181	751,002
9.25	234,694	340,136	373,750	410,905	451,980	497,394	547,610	603,137	664,538	732,432
9.50	229,846	332,636	365,382	401,568	441,562	485,769	534,638	588,663	648,389	714,417
9.75	225,127	325,346	357,250	392,497	431,442	474,479	522,043	574,613	632,717	696,937
10.00	220,534	318,257	349,346	383,681	421,610	463,513	509,813	560,973	617,506	679,976
10.25	216,062	311,364	341,661	375,114	412,057	452,862	497,936	547,730	602,741	663,515
10.50	211,707	304,660	334,190	366,786	402,774	442,514	486,400	534,870	588,406	647,538
10.75	207,466	298,140	326,925	358,691	393,753	432,459	475,194	522,381	574,488	632,028
11.00	203,336	291,796	319,860	350,820	384,984	422,688	464,307	510,251	560,973	616,971
11.25	199,312	285,625	312,988	343,167	376,459	413,193	453,730	498,468	547,847	602,351
11.50	195,392	279,620	306,303	335,724	368,171	403,963	443,450	487,020	535,099	588,154
11.75	191,573	273,776	299,799	328,484	360,112	394,990	433,461	475,897	522,714	574,366
12.00	187,851	268,088	293,471	321,442	352,275	386,267	423,750	465,089	510,682	560,973

DISCOUNTED VALUE OF BASE YEAR (1979) INTERCONNECTED SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	239,682	359,652	398,725	442,277	490,812	544,888	605,121	672,193	746,854	829,934
8.25	234,223	350,883	388,857	431,175	478,325	530,849	589,342	654,466	726,946	807,588
8.50	228,923	342,378	379,289	420,413	466,223	517,245	574,055	637,294	707,665	785,948
8.75	223,777	334,130	370,010	409,978	454,493	504,061	559,243	620,658	688,989	764,990
9.00	218,781	326,128	361,012	399,861	443,121	491,282	544,888	604,539	670,896	744,690
9.25	213,929	318,366	352,284	390,051	432,095	478,895	530,976	588,919	653,367	725,025
9.50	209,216	310,834	343,818	380,535	421,404	466,886	517,491	573,782	636,381	705,974
9.75	204,637	303,525	335,604	371,306	411,036	455,242	504,418	559,110	619,920	687,514
10.00	200,190	296,431	327,634	362,353	400,981	443,951	491,744	544,888	603,967	669,625
10.25	195,868	289,546	319,900	353,666	391,227	433,001	479,455	531,100	588,504	652,289
10.50	191,668	282,862	312,393	345,237	381,764	422,380	467,537	517,732	573,513	635,486
10.75	187,566	276,373	305,107	337,058	372,583	412,078	455,979	504,769	558,980	619,198
11.00	183,618	270,072	298,034	329,119	363,674	402,083	444,768	492,198	544,888	603,407
11.25	179,761	263,953	291,167	321,413	355,029	392,385	433,893	480,005	531,223	588,096
11.50	176,011	258,010	284,499	313,933	346,638	382,974	423,341	468,178	517,969	573,250
11.75	172,364	252,237	278,023	306,670	338,493	373,842	413,103	456,704	505,114	558,852
12.00	168,817	246,629	271,734	299,617	330,585	364,977	403,168	445,572	492,644	544,888

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

	CAPITAL DISBURSEMENTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS		FUEL COMPONENT OF OPERATING COSTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	INDEPENDENT ESCALATED \$	INTERCONNECTED ESCALATED \$
1979				
1980				
1981		4,621		
1982	2,009	15,594		
1983	26,666	48,874		
1984	81,942	11,515		
1985	57,172	32,062		
1986	21,127	492		
1987	7,152	2,472		
1988	7,555	8,473		
1989	23,110	30,549		
1990	21,920	43,038		
1991	82,200	43,411		
1992	101,380	89,694		
1993	58,450	108,723		
1994	29,840	75,134		
1995	23,935	23,106		
1996	17,630	270		
1997		254		
	ADDITIONAL DISBURSEMENTS IN \$1000 FOR UNDERLYING TRANSMISSION SYSTEM		SUSITNA CONSTRUCTION POWER COSTS IN \$1000 FOR ALTERNATIVE MODES OF SUPPLY	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	DIESEL GENERATION COSTS - \$79	INTERTIE TAPLINE COSTS - \$79
1979				
1980				
1981				
1982				
1983				
1984				
1985			2,835	267
1986			695	483
1987	6,646	1,356	697	481
1988			696	478
1989			3,055	752
1990			1,324	902
1991			187	734
1992	2,004		623	430
1993			623	419
1994			-500	304
1995				
1996				
1997				

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-6X

DISCOUNTED VALUE OF BASE YEAR (1979) INDEPENDENT SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	261,027	381,019	419,402	461,886	508,913	560,973	618,607	682,411	753,044	831,230
8.25	255,466	372,366	409,734	451,083	496,843	547,488	603,542	665,583	734,247	810,239
8.50	250,057	363,958	400,344	440,594	485,127	534,401	588,925	649,258	716,017	789,885
8.75	244,795	355,789	391,222	430,408	473,752	521,698	574,740	633,419	698,335	770,146
9.00	239,676	347,851	382,360	420,515	462,706	509,367	560,973	618,051	681,181	751,002
9.25	234,694	340,136	373,750	410,905	451,980	497,394	547,610	603,137	664,538	732,432
9.50	229,846	332,636	365,382	401,568	441,562	485,769	534,638	588,663	648,389	714,417
9.75	225,127	325,346	357,250	392,497	431,442	474,479	522,043	574,613	632,717	696,937
10.00	220,534	318,257	349,346	383,681	421,610	463,513	509,813	560,973	617,506	679,976
10.25	216,062	311,364	341,661	375,114	412,057	452,662	497,936	547,730	602,741	663,515
10.50	211,707	304,660	334,190	366,786	402,774	442,514	486,400	534,870	588,406	647,538
10.75	207,466	298,140	326,925	358,691	393,753	432,459	475,194	522,381	574,488	632,028
11.00	203,336	291,796	319,860	350,820	384,984	422,688	464,307	510,251	560,973	616,971
11.25	199,312	285,625	312,988	343,167	376,459	413,193	453,730	498,468	547,847	602,351
11.50	195,392	279,620	306,303	335,724	368,171	403,963	443,450	487,020	535,099	588,154
11.75	191,573	273,776	299,799	328,484	360,112	394,990	433,461	475,897	522,714	574,366
12.00	187,851	268,088	293,471	321,442	352,275	386,267	423,750	465,089	510,682	560,973

DISCOUNTED VALUE OF BASE YEAR (1979) INTERCONNECTED SYSTEM COSTS  
IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	248,987	370,430	409,897	453,853	502,804	557,307	617,978	685,499	760,622	844,175
8.25	243,448	361,567	399,932	442,651	490,214	543,160	602,088	667,657	740,595	821,706
8.50	238,069	352,971	390,268	431,790	478,009	529,450	586,691	650,371	721,196	799,944
8.75	232,845	344,632	380,896	421,258	466,177	516,161	571,769	633,622	702,403	778,865
9.00	227,771	336,540	371,804	411,044	454,705	503,278	557,307	617,392	684,194	758,445
9.25	222,842	328,688	362,984	401,138	443,580	490,788	543,288	601,662	666,551	738,662
9.50	218,053	321,068	354,426	391,528	432,791	478,678	529,698	586,415	649,452	719,494
9.75	213,400	313,672	346,122	382,205	422,326	466,933	516,521	571,636	632,880	700,918
10.00	208,878	306,493	338,063	373,159	412,174	455,543	503,744	557,307	616,816	682,916
10.25	204,483	299,522	330,240	364,381	402,325	444,494	491,353	543,414	601,243	665,466
10.50	200,210	292,754	322,646	355,861	392,769	433,776	479,335	529,941	586,145	648,551
10.75	196,057	286,182	315,274	347,592	383,495	423,377	467,677	516,875	571,505	632,152
11.00	192,018	279,798	308,115	339,565	374,494	413,287	456,367	504,202	557,307	616,252
11.25	188,091	273,598	301,163	331,771	365,758	403,495	445,394	491,908	543,537	600,833
11.50	184,271	267,574	294,412	324,204	357,277	393,991	434,746	479,981	530,180	585,880
11.75	180,555	261,721	287,853	316,855	349,043	384,766	424,413	468,408	517,223	571,376
12.00	176,940	256,030	281,482	309,718	341,047	375,811	414,383	457,178	504,652	557,307

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE 8-6X

	CAPITAL DISBURSEMENTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS		FUEL COMPONENT OF OPERATING COSTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	INDEPENDENT ESCALATED \$	INTERCONNECTED ESCALATED \$
1979				
1980				
1981		5,014		
1982	2,009	17,785		
1983	26,666	58,709		
1984	81,942	11,515		
1985	57,172	32,062		
1986	21,127	492		
1987	7,152	2,472		
1988	7,555	8,473		
1989	23,110	30,549		
1990	21,920	43,038		
1991	82,200	43,411		
1992	101,380	89,694		
1993	58,450	108,723		
1994	29,840	75,134		
1995	23,935	23,106		
1996	17,630	270		
1997		254		

	ADDITIONAL DISBURSEMENTS IN \$1000 FOR UNDERLYING TRANSMISSION SYSTEM		SUSITNA CONSTRUCTION POWER COSTS IN \$1000 FOR ALTERNATIVE MODES OF SUPPLY	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	DIESEL GENERATION COSTS - \$79	INTERTIE TAPLINE COSTS - \$79
1979				
1980				
1981				
1982				
1983				
1984				
1985			2,835	267
1986			695	483
1987	6,646	1,356	697	481
1988			696	478
1989			3,055	752
1990			1,324	902
1991			187	734
1992	2,004		623	430
1993			623	419
1994			-500	304
1995				
1996				
1997				

E - 27

ALASKA POWER AUTHORITY  
 ANCHORAGE - FAIRBANKS INTERTIE  
 ECONOMIC FEASIBILITY STUDY

 DISCOUNTED VALUE OF BASE YEAR (1979) INDEPENDENT SYSTEM COSTS  
 IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	265,461	403,640	441,469	483,353	529,729	581,084	637,955	700,932	770,669	847,886
8.25	279,302	394,426	431,253	472,015	517,139	567,095	622,402	683,633	751,423	826,467
8.50	273,312	385,477	421,332	461,008	504,918	553,518	607,312	666,854	732,758	805,699
8.75	267,488	376,782	411,696	450,320	493,055	540,342	592,669	650,575	714,654	785,559
9.00	261,823	368,334	402,336	439,940	481,536	527,551	578,459	634,781	697,092	766,027
9.25	256,312	360,125	393,242	429,859	470,351	515,134	564,667	619,454	680,054	747,082
9.50	250,950	352,146	384,406	420,065	459,488	503,078	551,278	604,580	663,523	728,703
9.75	245,734	344,391	375,820	410,551	448,937	491,370	538,280	590,142	647,480	710,872
10.00	240,657	336,851	367,474	401,306	438,688	480,000	525,659	576,127	631,911	693,570
10.25	235,716	329,521	359,363	392,322	428,730	468,956	513,403	562,520	616,798	676,779
10.50	230,906	322,393	351,477	383,590	419,054	458,227	501,500	549,308	602,126	660,483
10.75	226,223	315,461	343,809	375,102	409,651	447,803	489,938	536,477	587,882	644,664
11.00	221,663	308,718	336,354	366,851	400,513	437,675	478,706	524,015	574,051	629,306
11.25	217,223	302,158	329,102	358,828	391,629	427,832	467,794	511,911	560,618	614,396
11.50	212,898	295,777	322,050	351,026	382,993	418,265	457,190	500,151	547,572	599,917
11.75	208,686	289,567	315,188	343,439	374,596	408,965	446,884	488,726	534,899	585,855
12.00	204,582	283,524	308,513	336,059	366,430	399,924	436,868	477,623	522,587	572,197

 DISCOUNTED VALUE OF BASE YEAR (1979) INTERCONNECTED SYSTEM COSTS  
 IN \$1000

DISCOUNT RATE	-----ESCALATION RATES-----									
	0%	4%	5%	6%	7%	8%	9%	10%	11%	12%
8.00	286,905	410,135	450,105	494,593	544,104	599,201	660,502	728,692	804,529	888,845
8.25	280,578	400,461	439,322	482,564	530,679	584,209	643,756	709,982	783,621	865,479
8.50	274,434	391,077	428,864	470,900	517,663	569,678	627,527	691,853	763,365	842,847
8.75	268,467	381,972	418,718	459,588	505,042	555,591	611,797	674,285	743,740	820,922
9.00	262,671	373,136	408,876	448,016	492,803	541,932	596,549	657,258	724,723	799,681
9.25	257,040	364,561	399,325	437,972	480,933	528,688	581,767	640,753	706,293	779,098
9.50	251,568	356,237	390,057	427,644	469,419	515,644	567,433	624,754	688,430	759,152
9.75	246,251	348,156	381,062	417,624	458,248	503,386	553,534	609,242	671,114	739,821
10.00	241,083	340,311	372,331	407,899	447,411	491,302	540,054	594,200	654,327	721,083
10.25	236,060	332,092	363,854	398,461	436,894	479,578	526,979	579,614	638,051	702,918
10.50	231,176	325,294	355,624	389,299	426,688	468,203	514,296	565,467	622,268	685,307
10.75	226,427	318,108	347,632	380,404	416,782	457,164	501,990	551,744	606,961	668,231
11.00	221,810	311,127	339,871	371,768	407,166	446,451	490,050	538,431	592,114	651,671
11.25	217,318	304,345	332,332	363,381	397,830	436,053	478,463	525,515	577,713	635,611
11.50	212,950	297,754	325,009	355,237	388,766	425,959	467,217	512,982	563,741	620,032
11.75	208,699	291,350	317,894	347,325	379,963	416,159	456,301	500,819	550,184	604,920
12.00	204,564	285,126	310,980	339,640	371,414	406,643	445,704	489,013	537,029	590,258

23 AUGUST 79

ALASKA POWER AUTHORITY  
ANCHORAGE - FAIRBANKS INTERTIE  
ECONOMIC FEASIBILITY STUDY

TABLE A-7

	CAPITAL DISBURSEMENTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS		FUEL COMPONENT OF OPERATING COSTS IN \$1000 FOR ALTERNATIVE SYSTEM EXPANSIONS	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	INDEPENDENT ESCALATED \$	INTERCONNECTED ESCALATED \$
1979				
1980				
1981		4,872		
1982	2,009	18,056		
1983	26,600	72,604		
1984	81,942	11,326		
1985	37,172	31,886	8,468	7,648
1986	21,127	328	9,324	8,498
1987	7,152	2,319	10,267	9,029
1988	7,555	8,529		
1989	23,110	30,604		
1990	21,920	43,092		
1991	82,200	43,463		
1992	101,380	89,973	6,851	8,324
1993	58,450	108,988	7,212	8,654
1994	29,840	75,387	7,933	8,016
1995	23,955	23,347	8,654	8,745
1996	17,650	499	9,015	9,109
1997		473		

	ADDITIONAL DISBURSEMENTS IN \$1000 FOR UNDERLYING TRANSMISSION SYSTEM		SUSITNA CONSTRUCTION POWER COSTS IN \$1000 FOR ALTERNATIVE MODES OF SUPPLY	
	INDEPENDENT COSTS - \$79	INTERCONNECTED COSTS - \$79	DIESEL GENERATION COSTS - \$79	INTERTIE TAPLINE COSTS - \$79
1979				
1980				
1981				
1982				
1983				
1984				
1985			2,835	267
1986			695	483
1987			697	481
1988			696	478
1989			3,055	752
1990			1,324	902
1991			187	734
1992			623	450
1993			623	419
1994			-500	304
1995				
1996				
1997				

APPENDIX F  
TRANSMISSION LINE FINANCIAL ANALYSIS

APPENDIX F  
TRANSMISSION LINE FINANCIAL ANALYSIS

ANCHORAGE-FAIRBANKS INTERCONNECTION  
SEMI-ANNUAL DISBURSEMENTS  
FOR  
TRANSMISSION INTERTIE FACILITIES  
(TLFAP)  
1979  
BASE-LINE  
AND  
ESCALATED  
COSTS

16 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
SEMI-ANNUAL DISBURSEMENTS FOR TRANSMISSION INTERTIE FACILITIES  
COSTS INFLATED FROM 1979 BASELINE

LINE NO		1981-1	1981-2	1982-1	1982-2	1983-1	1983-2	TOTAL
172.0	1. TRANSMISSION LINE							
174.0	ENGRG & CONSTR. SUPERV.	452	783	0	440	810	879	3365
176.0	RIGHT OF WAY	0	2298	7169	0	0	0	9466
178.0	FOUNDATIONS	0	0	0	2565	7212	0	9777
180.0	TOWERS	0	0	0	0	11379	14464	25843
182.0	HARDWARE	0	0	0	0	84	493	577
184.0	INSULATORS	0	0	0	0	88	520	608
186.0	CONDUCTOR	0	0	0	0	1888	11129	13017
189.0								
190.0	SUB-TOTAL	452	3081	7169	3005	21462	27485	62653
191.0								
200.0	2. SUBSTATIONS							
202.0	ENGRG & CONST. SUPERV.	563	586	609	634	329	343	3064
204.0	LAND	81	0	0	0	0	0	81
206.0	TRANSFORMERS	0	0	368	670	697	207	1943
208.0	CIRCUIT BREAKERS	0	0	422	769	800	238	2229
210.0	STATION EQUIPMENT	0	0	291	530	551	164	1535
211.0	STRUCTURES & ACCESSORIES	0	0	871	1811	1884	0	4566
215.0								
216.0	SUBTOTAL	644	586	2562	4414	4261	951	13418
217.0								
218.0	3. CONTROL AND COMMUNICATIONS							
219.0	ENGINEERING AND INSTALLATION							
220.0	SUPERVISION	0	0	0	0	83	114	197
222.0	EQUIPMENT	0	0	0	0	1467	2289	3756
224.0								
226.0	SUB-TOTAL	0	0	0	0	1550	2403	3953
228.0								
230.0	TOTAL	1096	3666	9730	7419	27273	30839	80024
232.0								
234.0	SUMMARY OF PRICE ESCALATION							
235.0	AT 8.0% PA	0	141	734	824	3960	5492	11150

ANCHORAGE-FAIRBANKS INTERCONNECTION

ALTERNATIVE FINANCIAL PLANS

70% PROJECT FUNDING WITH REA/FFB LOAN PACKAGE

14% - REA LOAN @ 5%, 35 YEARS (20%)	ALT. 1
56% - FFB LOAN @ $9\frac{1}{4}\%$ , 35 YEARS (80%)	

28% - REA LOAN @ 5%, 35 YEARS (40%)	ALT. 2
42% - FFB LOAN @ $9\frac{1}{4}\%$ , 35 YEARS (60%)	

30% PROJECT FUNDING WITH AMU/FMU BONDS

18% - AMU BONDS @  $6\frac{1}{2}\%$ , 20 YEAR MATURITY  
12% - FMU BONDS @ 7%, 20 YEAR MATURITY

16 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
FUNDING SOURCES AND  
INTEREST DURING CONSTRUCTION

20-80 REA-FFB

LINE NO		1981-1	1981-2	1982-1	1982-2	1983-1	1983-2	TOTAL
400.0	FUNDING SOURCES							
401.0	APA BOND	0	0	0	0	0	0	0
402.0	REA LOAN	153	513	1362	1039	3818	4318	11203
403.0	CFC LOAN	0	0	0	0	0	0	0
404.0	FFB LOAN	614	2053	5449	4155	15273	17270	44814
405.0	AMU SHORT TERM LOAN	197	660	1751	1335	4909	5551	14404
406.0	FMU SHORT TERM LOAN	132	440	1168	890	3273	3701	9603
408.0								
409.0	TOTAL	1096	3666	9730	7419	27273	30839	80024
410.0								
411.0	INTEREST DURING CONSTRUCTION							
412.0	APA BOND	0	0	0	0	0	0	0
413.0	REA LOAN	2	10	34	64	124	226	460
414.0	CFC LOAN	0	0	0	0	0	0	0
415.0	FFB LOAN	14	76	249	471	921	1673	3405
416.0	AMU SHORT TERM LOAN	10	53	173	328	640	1163	2366
417.0	FMU SHORT TERM LOAN	7	35	116	218	427	775	1578
420.0								
421.0	TOTAL	33	174	572	1081	2112	3838	7809
422.0								

16 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
DEBT TABLE AND  
COMPOSITE INTEREST RATE

20-80 REA-FFB

LINE NO		1981-1	1981-2	1982-1	1982-2	1983-1	1983-2	TOTAL
430.0	% DEBT ASSUMED BY EACH UTILITY							
432.0	AML & P	18	0	0	0	0	0	18
434.0	CFA	11	0	0	0	0	0	11
436.0	MEA	3	0	0	0	0	0	3
438.0	HEA	0	0	0	0	0	0	0
442.0	FMUS	12	0	0	0	0	0	12
444.0	GVEA	56	0	0	0	0	0	56
446.0	CVEA	0	0	0	0	0	0	0
447.0								
448.0								
449.0								
450.0	DEBT ASSUMED BY EACH UTILITY							
452.0	AML & P	197	660	1751	1335	4909	5551	14404
454.0	CFA	121	403	1070	816	3000	3392	8803
456.0	MEA	33	110	292	223	818	925	2401
458.0	HEA	0	0	0	0	0	0	0
462.0	FMUS	132	440	1168	890	3273	3701	9603
464.0	GVEA	614	2053	5449	4155	15273	17270	44814
466.0	CVEA	0	0	0	0	0	0	0
468.0								
470.0	TOTAL DEBT	1096	3666	9730	7419	27273	30839	80024
472.0								
474.0								
476.0								
510.0	COMPOSITE INTEREST RATE	0.089	0.0	0.0	0.0	0.0	0.0	0.089

16 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
FUNDING SOURCES AND  
INTEREST DURING CONSTRUCTION

40-60 REA-FFB

LINE NO	1981-1	1981-2	1982-1	1982-2	1983-1	1983-2	TOTAL
400.0 FUNDING SOURCES							
401.0 APA BOND	0	0	0	0	0	0	0
402.0 REA LOAN	307	1027	2725	2077	7636	8635	22407
403.0 CFC LOAN	0	0	0	0	0	0	0
404.0 FFB LOAN	460	1540	4087	3116	11455	12953	33610
405.0 AMU SHORT TERM LOAN	197	660	1751	1335	4909	5551	14404
406.0 FMU SHORT TERM LOAN	132	440	1168	890	3273	3701	9603
408.0							
409.0 TOTAL	1096	3666	9730	7419	27273	30839	80024
410.0							
411.0 INTEREST DURING CONSTRUCTION							
412.0 APA BOND	0	0	0	0	0	0	0
413.0 REA LOAN	4	21	67	127	249	452	920
414.0 CFC LOAN	0	0	0	0	0	0	0
415.0 FFB LOAN	11	57	187	354	691	1255	2554
416.0 AMU SHORT TERM LOAN	10	53	173	328	640	1163	2366
417.0 FMU SHORT TERM LOAN	7	35	116	218	427	775	1578
420.0							
421.0 TOTAL	31	165	543	1027	2006	3645	7418
422.0							

16 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
DEBT TABLE AND  
COMPOSITE INTEREST RATE

40-60 REA-FFB

LINE NO	1981-1	1981-2	1982-1	1982-2	1983-1	1983-2	TOTAL
430.0 % DEBT ASSUMED BY EACH UTILITY							
432.0 AML & P	18	0	0	0	0	0	18
434.0 CEA	11	0	0	0	0	0	11
436.0 MEA	3	0	0	0	0	0	3
438.0 HEA	0	0	0	0	0	0	0
442.0 FMUS	12	0	0	0	0	0	12
444.0 GVEA	56	0	0	0	0	0	56
446.0 CVEA	0	0	0	0	0	0	0
447.0							
448.0							
449.0							
450.0 DEBT ASSUMED BY EACH UTILITY							
452.0 AML & P	197	660	1751	1335	4909	5551	14404
454.0 CEA	121	403	1070	816	3000	3392	8803
456.0 MEA	33	110	292	223	818	925	2401
458.0 HEA	0	0	0	0	0	0	0
462.0 FMUS	132	440	1168	890	3273	3701	9603
464.0 GVEA	614	2053	5449	4155	15273	17270	44814
466.0 CVEA	0	0	0	0	0	0	0
468.0							
470.0 TOTAL DEBT	1096	3666	9730	7419	27273	30839	80024
472.0							
474.0							
476.0							
510.0 COMPOSITE INTEREST RATE	0.083	0.0	0.0	0.0	0.0	0.0	0.083

15 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
DEBT SERVICE SCHEDULE

20-80 REA-FFB

LINE NO	1984	1985	1986	1987	1988	1989	1990	1991	1992	1993	1994	1995
152.0	APA											
154.0	SINKING FUND	0	0	0	0	0	0	0	0	0	0	0
156.0	INTEREST DUE	0	0	0	0	0	0	0	0	0	0	0
158.0												
160.0	S.FUND+INTEREST	0	0	0	0	0	0	0	0	0	0	0
161.0												
166.0	REA											
168.0	REPAYMENT	350	350	350	350	350	350	350	350	350	350	350
171.0	OUTSTANDING	10853	10503	10153	9803	9453	9103	8753	8403	8052	7702	7352
172.0	INTEREST DUE	560	543	525	508	490	473	455	438	420	403	385
174.0												
176.0	DEBT SERVICE	910	893	875	858	840	823	805	788	770	753	735
177.0												
182.0	CFC											
184.0	REPAYMENT	0	0	0	0	0	0	0	0	0	0	0
187.0	OUTSTANDING	0	0	0	0	0	0	0	0	0	0	0
188.0	INTEREST	0	0	0	0	0	0	0	0	0	0	0
190.0												
192.0	DEBT SERVICE	0	0	0	0	0	0	0	0	0	0	0
193.0												
198.0	FFB											
200.0	REPAYMENT	1400	1400	1400	1400	1400	1400	1400	1400	1400	1400	1400
202.0	OUTSTANDING	43413	42013	40612	39212	37811	36411	35011	33610	32210	30809	29409
203.0	INTEREST	4145	4016	3886	3757	3627	3498	3368	3238	3109	2979	2850
204.0												
206.0	DEBT SERVICE	5546	5416	5287	5157	5028	4898	4768	4639	4509	4380	4250
207.0												
212.0	AMU											
214.0	SINKING FUND	371	371	371	371	371	371	371	371	371	371	371
216.0	INTEREST DUE	936	936	936	936	936	936	936	936	936	936	936
218.0												
220.0	S.FUND+INTEREST	1307	1307	1307	1307	1307	1307	1307	1307	1307	1307	1307
221.0												
228.0	FMU											
230.0	SINKING FUND	234	234	234	234	234	234	234	234	234	234	234
232.0	INTEREST DUE	672	672	672	672	672	672	672	672	672	672	672
234.0												
236.0	S.FUND+INTEREST	906	906	906	906	906	906	906	906	906	906	906
250.0	TOTAL REPAYMENTS OR											
251.0	S. FUND PAYMENTS	2356	2356	2356	2356	2356	2356	2356	2356	2356	2356	2356
253.0	TOT INTEREST DUE	6314	6167	6020	5873	5726	5579	5432	5285	5138	4991	4843
255.0												
257.0	TOTAL DEBT SERVI	8670	8523	8376	8229	8082	7934	7787	7640	7493	7346	7199

15 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
DEBT SERVICE SCHEDULE

40-60 REA-FFB

LINE NO	1984	1985	1986	1987	1988	1989	1990	1991	1992	1993	1994	1995
152.0 APA												
154.0 SINKING FUND	0	0	0	0	0	0	0	0	0	0	0	0
156.0 INTEREST DUE	0	0	0	0	0	0	0	0	0	0	0	0
158.0	-----											
160.0 S.FUND+INTEREST	0	0	0	0	0	0	0	0	0	0	0	0
161.0												
166.0 REA												
168.0 REPAYMENT	700	700	700	700	700	700	700	700	700	700	700	700
171.0 OUTSTANDING	21707	21006	20306	19606	18906	18206	17505	16805	16105	15405	14704	14004
172.0 INTEREST DUE	1120	1085	1050	1015	980	945	910	875	840	805	770	735
174.0	-----											
176.0 DEBT SERVICE	1821	1786	1751	1716	1681	1645	1610	1575	1540	1505	1470	1435
177.0												
182.0 CFC												
184.0 REPAYMENT	0	0	0	0	0	0	0	0	0	0	0	0
187.0 OUTSTANDING	0	0	0	0	0	0	0	0	0	0	0	0
188.0 INTEREST	0	0	0	0	0	0	0	0	0	0	0	0
190.0	-----											
192.0 DEBT SERVICE	0	0	0	0	0	0	0	0	0	0	0	0
193.0												
198.0 FFB												
200.0 REPAYMENT	1050	1050	1050	1050	1050	1050	1050	1050	1050	1050	1050	1050
202.0 OUTSTANDING	32560	31510	30459	29409	28359	27308	26258	25208	24157	23107	22057	21006
203.0 INTEREST	3109	3012	2915	2817	2720	2623	2526	2429	2332	2235	2137	2040
204.0	-----											
206.0 DEBT SERVICE	4159	4062	3965	3868	3771	3673	3576	3479	3382	3285	3188	3091
207.0												
212.0 AMU												
214.0 SINKING FUND	371	371	371	371	371	371	371	371	371	371	371	371
216.0 INTEREST DUE	936	936	936	936	936	936	936	936	936	936	936	936
218.0	-----											
220.0 S.FUND+INTEREST	1307	1307	1307	1307	1307	1307	1307	1307	1307	1307	1307	1307
221.0												
228.0 FMU												
230.0 SINKING FUND	234	234	234	234	234	234	234	234	234	234	234	234
232.0 INTEREST DUE	672	672	672	672	672	672	672	672	672	672	672	672
234.0	-----											
236.0 S.FUND+INTEREST	906	906	906	906	906	906	906	906	906	906	906	906
250.0 TOTAL REPAYMENTS OR												
251.0 S. FUND PAYMENTS	2356	2356	2356	2356	2356	2356	2356	2356	2356	2356	2356	2356
253.0 TOT INTEREST DUE	5838	5706	5573	5441	5309	5177	5045	4913	4780	4648	4516	4384
255.0	-----											
257.0 TOTAL DEBT SERVI	8194	8061	7929	7797	7665	7533	7401	7268	7136	7004	6872	6740

15 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
DEBT SERVICE SCHEDULE

20-80 REA-FFB

LINE NO	1996	1997	1998	1999	2000	2001	2002	2003	2004	2005	2006	2007
152.0 APA												
154.0 SINKING FUND	0	0	0	0	0	0	0	0	0	0	0	0
156.0 INTEREST DUE	0	0	0	0	0	0	0	0	0	0	0	0
158.0												
160.0 S.FUND+INTEREST	0	0	0	0	0	0	0	0	0	0	0	0
161.0												
166.0 REA												
168.0 REPAYMENT	350	350	350	350	350	350	350	350	350	350	350	350
171.0 OUTSTANDING	6652	6302	5952	5602	5252	4901	4551	4201	3851	3501	3151	2801
172.0 INTEREST DUE	350	333	315	298	280	263	245	228	210	193	175	158
174.0												
176.0 DEBT SERVICE	700	683	665	648	630	613	595	578	560	543	525	508
177.0												
182.0 CFC												
184.0 REPAYMENT	0	0	0	0	0	0	0	0	0	0	0	0
187.0 OUTSTANDING	0	0	0	0	0	0	0	0	0	0	0	0
188.0 INTEREST	0	0	0	0	0	0	0	0	0	0	0	0
190.0												
192.0 DEBT SERVICE	0	0	0	0	0	0	0	0	0	0	0	0
193.0												
198.0 FFB												
200.0 REPAYMENT	1400	1400	1400	1400	1400	1400	1400	1400	1400	1400	1400	1400
202.0 OUTSTANDING	26608	25208	23807	22407	21006	19606	18206	16805	15405	14004	12604	11203
203.0 INTEREST	2591	2461	2332	2202	2073	1943	1814	1684	1554	1425	1295	1166
204.0												
206.0 DEBT SERVICE	3991	3862	3732	3603	3473	3344	3214	3084	2955	2825	2696	2566
207.0												
212.0 AMU												
214.0 SINKING FUND	371	371	371	371	371	371	371	371	0	0	0	0
216.0 INTEREST DUE	936	936	936	936	936	936	936	936	0	0	0	0
218.0												
220.0 S.FUND+INTEREST	1307	1307	1307	1307	1307	1307	1307	1307	0	0	0	0
221.0												
228.0 FMU												
230.0 SINKING FUND	234	234	234	234	234	234	234	234	0	0	0	0
232.0 INTEREST DUE	672	672	672	672	672	672	672	672	0	0	0	0
234.0												
236.0 S.FUND+INTEREST	906	906	906	906	906	906	906	906	0	0	0	0
250.0 TOTAL REPAYMENTS OR												
251.0 S. FUND PAYMENTS	2356	2356	2356	2356	2356	2356	2356	2356	1751	1751	1751	1751
253.0 TOT INTEREST DUE	4549	4402	4255	4108	3961	3814	3667	3520	1765	1617	1470	1323
255.0												
257.0 TOTAL DEBT SERVI	6905	6758	6611	6464	6317	6170	6023	5876	3515	3368	3221	3074

15 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
DEBT SERVICE SCHEDULE

40-60 REA-FFB

LINE NO	1996	1997	1998	1999	2000	2001	2002	2003	2004	2005	2006	2007
152.0 APA												
154.0 SINKING FUND	0	0	0	0	0	0	0	0	0	0	0	0
156.0 INTEREST DUE	0	0	0	0	0	0	0	0	0	0	0	0
158.0												
160.0 S.FUND+INTEREST	0	0	0	0	0	0	0	0	0	0	0	0
161.0												
166.0 REA												
168.0 REPAYMENT	700	700	700	700	700	700	700	700	700	700	700	700
171.0 OUTSTANDING	13304	12604	11904	11203	10503	9803	9103	8403	7702	7002	6302	5602
172.0 INTEREST DUE	700	665	630	595	560	525	490	455	420	385	350	315
174.0												
176.0 DEBT SERVICE	1400	1365	1330	1295	1260	1225	1190	1155	1120	1085	1050	1015
177.0												
182.0 CFC												
184.0 REPAYMENT	0	0	0	0	0	0	0	0	0	0	0	0
187.0 OUTSTANDING	0	0	0	0	0	0	0	0	0	0	0	0
188.0 INTEREST	0	0	0	0	0	0	0	0	0	0	0	0
190.0												
192.0 DEBT SERVICE	0	0	0	0	0	0	0	0	0	0	0	0
193.0												
198.0 FFB												
200.0 REPAYMENT	1050	1050	1050	1050	1050	1050	1050	1050	1050	1050	1050	1050
202.0 OUTSTANDING	19956	18906	17855	16805	15755	14704	13654	12604	11553	10503	9453	8403
203.0 INTEREST	1943	1846	1749	1652	1554	1457	1360	1263	1166	1069	972	874
204.0												
206.0 DEBT SERVICE	2993	2896	2799	2702	2605	2508	2410	2313	2216	2119	2022	1925
207.0												
212.0 AMU												
214.0 SINKING FUND	371	371	371	371	371	371	371	371	0	0	0	0
216.0 INTEREST DUE	936	936	936	936	936	936	936	936	0	0	0	0
218.0												
220.0 S.FUND+INTEREST	1307	1307	1307	1307	1307	1307	1307	1307	0	0	0	0
221.0												
228.0 FMU												
230.0 SINKING FUND	234	234	234	234	234	234	234	234	0	0	0	0
232.0 INTEREST DUE	672	672	672	672	672	672	672	672	0	0	0	0
234.0												
236.0 S.FUND+INTEREST	906	906	906	906	906	906	906	906	0	0	0	0
250.0 TOTAL REPAYMENTS OR												
251.0 S. FUND PAYMENTS	2356	2356	2356	2356	2356	2356	2356	2356	1751	1751	1751	1751
253.0 TOT INTEREST DUE	4252	4120	3987	3855	3723	3591	3459	3327	1586	1454	1322	1189
255.0												
257.0 TOTAL DEBT SERVI	6608	6475	6343	6211	6079	5947	5815	5682	3337	3204	3072	2940

15 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
DEBT SERVICE SCHEDULE

20-80 REA-FFB

LINE NO		2008	2009	2010	2011	2012	2013	2014	2015
152.0	APA								
154.0	SINKING FUND	0	0	0	0	0	0	0	0
156.0	INTEREST DUE	0	0	0	0	0	0	0	0
158.0									
160.0	S.FUND+INTEREST	0	0	0	0	0	0	0	0
161.0									
166.0	REA								
168.0	REPAYMENT	350	350	350	350	350	350	350	350
171.0	OUTSTANDING	2451	2101	1751	1400	1050	700	350	0
172.0	INTEREST DUE	140	123	105	88	70	53	35	18
174.0									
176.0	DEBT SERVICE	490	473	455	438	420	403	385	368
177.0									
182.0	CFC								
184.0	REPAYMENT	0	0	0	0	0	0	0	0
187.0	OUTSTANDING	0	0	0	0	0	0	0	0
188.0	INTEREST	0	0	0	0	0	0	0	0
190.0									
192.0	DEBT SERVICE	0	0	0	0	0	0	0	0
193.0									
198.0	FFB								
200.0	REPAYMENT	1400	1400	1400	1400	1400	1400	1400	1400
202.0	OUTSTANDING	9803	8403	7002	5602	4201	2801	1400	0
203.0	INTEREST	1036	907	777	648	518	389	259	130
204.0									
206.0	DEBT SERVICE	2437	2307	2178	2048	1919	1789	1660	1530
207.0									
212.0	AMU								
214.0	SINKING FUND	0	0	0	0	0	0	0	0
216.0	INTEREST DUE	0	0	0	0	0	0	0	0
218.0									
220.0	S.FUND+INTEREST	0	0	0	0	0	0	0	0
221.0									
228.0	FMU								
230.0	SINKING FUND	0	0	0	0	0	0	0	0
232.0	INTEREST DUE	0	0	0	0	0	0	0	0
234.0									
236.0	S.FUND+INTEREST	0	0	0	0	0	0	0	0
250.0	TOTAL REPAYMENTS OR								
251.0	S. FUND PAYMENTS	1751	1751	1751	1751	1751	1751	1751	1751
253.0	TOT INTEREST DUE	1176	1029	882	735	588	441	294	147
255.0									
257.0	TOTAL DEBT SERVI	2927	2780	2633	2486	2339	2192	2045	1898

F-11

15 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
DEBT SERVICE SCHEDULE

40-60 REA-FFB

LINE NO	2008	2009	2010	2011	2012	2013	2014	2015
152.0 APA								
154.0 SINKING FUND	0	0	0	0	0	0	0	0
156.0 INTEREST DUE	0	0	0	0	0	0	0	0
158.0	-----	-----	-----	-----	-----	-----	-----	-----
160.0 S.FUND+INTEREST	0	0	0	0	0	0	0	0
161.0								
166.0 REA								
168.0 REPAYMENT	700	700	700	700	700	700	700	700
171.0 OUTSTANDING	4901	4201	3501	2801	2101	1400	700	0
172.0 INTEREST DUE	280	245	210	175	140	105	70	35
174.0	-----	-----	-----	-----	-----	-----	-----	-----
176.0 DEBT SERVICE	980	945	910	875	840	805	770	735
177.0								
182.0 CFC								
184.0 REPAYMENT	0	0	0	0	0	0	0	0
187.0 OUTSTANDING	0	0	0	0	0	0	0	0
188.0 INTEREST	0	0	0	0	0	0	0	0
190.0	-----	-----	-----	-----	-----	-----	-----	-----
192.0 DEBT SERVICE	0	0	0	0	0	0	0	0
193.0								
198.0 FFB								
200.0 REPAYMENT	1050	1050	1050	1050	1050	1050	1050	1050
202.0 OUTSTANDING	7352	6302	5252	4201	3151	2101	1050	0
203.0 INTEREST	777	680	583	486	389	291	194	97
204.0	-----	-----	-----	-----	-----	-----	-----	-----
206.0 DEBT SERVICE	1828	1730	1633	1536	1439	1342	1245	1147
207.0								
212.0 AMU								
214.0 SINKING FUND	0	0	0	0	0	0	0	0
216.0 INTEREST DUE	0	0	0	0	0	0	0	0
218.0	-----	-----	-----	-----	-----	-----	-----	-----
220.0 S.FUND+INTEREST	0	0	0	0	0	0	0	0
221.0								
228.0 FMU								
230.0 SINKING FUND	0	0	0	0	0	0	0	0
232.0 INTEREST DUE	0	0	0	0	0	0	0	0
234.0	-----	-----	-----	-----	-----	-----	-----	-----
236.0 S.FUND+INTEREST	0	0	0	0	0	0	0	0
250.0 TOTAL REPAYMENTS OR								
251.0 S. FUND PAYMENTS	1751	1751	1751	1751	1751	1751	1751	1751
253.0 TOT INTEREST DUE	1057	925	793	661	529	396	264	132
255.0	-----	-----	-----	-----	-----	-----	-----	-----
257.0 TOTAL DEBT SERVI	2808	2676	2544	2411	2279	2147	2015	1883

F-12

15 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
DEBT REPAYMENT AND SINKING FUND  
ALLOCATION BY UTILITY

20-80 REA-FFH

LINE NO.	1984	1985	1986	1987	1988	1989	1990	1991	1992	1993	1994	1995
352.0 ANL & P												
354.0 REPAYMENT AMOUNT	424	424	424	424	424	424	424	424	424	424	424	424
358.0 OUTSTANDING	4770	4574	4379	4184	3989	3793	3598	3403	3207	3012	2817	2622
360.0 INTEREST DUE	1137	1110	1084	1057	1031	1004	978	951	925	898	872	845
361.0												
362.0 CEA												
364.0 REPAYMENT AMOUNT	259	259	259	259	259	259	259	259	259	259	259	259
368.0 OUTSTANDING	2915	2795	2676	2557	2437	2318	2199	2079	1960	1841	1721	1602
370.0 INTEREST DUE	695	678	662	646	630	614	597	581	565	549	533	517
371.0												
372.0 MEA												
374.0 REPAYMENT AMOUNT	71	71	71	71	71	71	71	71	71	71	71	71
378.0 OUTSTANDING	795	762	730	697	665	632	600	567	535	502	469	437
380.0 INTEREST DUE	189	185	181	176	172	167	163	159	154	150	145	141
381.0												
382.0 HEA												
384.0 REPAYMENT AMOUNT	0	0	0	0	0	0	0	0	0	0	0	0
388.0 OUTSTANDING	0	0	0	0	0	0	0	0	0	0	0	0
390.0 INTEREST DUE	0	0	0	0	0	0	0	0	0	0	0	0
391.0												
402.0 FMUS												
404.0 REPAYMENT AMOUNT	283	283	283	283	283	283	283	283	283	283	283	283
408.0 OUTSTANDING	3180	3050	2919	2789	2659	2529	2399	2268	2138	2008	1878	1748
410.0 INTEREST DUE	758	740	722	705	687	669	652	634	617	599	581	564
411.0												
412.0 GVEA												
414.0 REPAYMENT AMOUNT	1319	1319	1319	1319	1319	1319	1319	1319	1319	1319	1319	1319
416.0 CUMULATIVE	1319	2638	3958	5277	6596	7915	9235	10554	11873	13192	14512	15831
418.0 OUTSTANDING	14839	14231	13624	13016	12409	11801	11194	10586	9979	9371	8764	8156
420.0 INTEREST DUE	3536	3453	3371	3289	3206	3124	3042	2959	2877	2795	2712	2630
421.0												
422.0 CVEA												
424.0 REPAYMENT AMOUNT	0	0	0	0	0	0	0	0	0	0	0	0
426.0 CUMULATIVE	0	0	0	0	0	0	0	0	0	0	0	0
428.0 OUTSTANDING	0	0	0	0	0	0	0	0	0	0	0	0
430.0 INTEREST DUE	0	0	0	0	0	0	0	0	0	0	0	0

F-13

15 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
DEBT REPAYMENT AND SINKING FUND  
ALLOCATION BY UTILITY

40-60 REA-FFB

LINE NO	1984	1985	1986	1987	1988	1989	1990	1991	1992	1993	1994	1995
352.0 AML & P												
354.0 REPAYMENT AMOUNT	424	424	424	424	424	424	424	424	424	424	424	424
358.0 OUTSTANDING	6537	6284	6032	5779	5527	5274	5022	4769	4517	4265	4012	3760
360.0 INTEREST DUE	1051	1027	1003	979	956	932	908	884	860	837	813	789
361.0												
362.0 CEA												
364.0 REPAYMENT AMOUNT	259	259	259	259	259	259	259	259	259	259	259	259
368.0 OUTSTANDING	3995	3840	3686	3532	3378	3223	3069	2915	2760	2606	2452	2298
370.0 INTEREST DUE	642	628	613	599	584	569	555	540	526	511	497	482
371.0												
372.0 MEA												
374.0 REPAYMENT AMOUNT	71	71	71	71	71	71	71	71	71	71	71	71
378.0 OUTSTANDING	1089	1047	1005	963	921	879	837	795	753	711	669	627
380.0 INTEREST DUE	175	171	167	163	159	155	151	147	143	139	135	132
381.0												
382.0 HEA												
384.0 REPAYMENT AMOUNT	0	0	0	0	0	0	0	0	0	0	0	0
388.0 OUTSTANDING	0	0	0	0	0	0	0	0	0	0	0	0
390.0 INTEREST DUE	0	0	0	0	0	0	0	0	0	0	0	0
391.0												
402.0 FMUS												
404.0 REPAYMENT AMOUNT	283	283	283	283	283	283	283	283	283	283	283	283
408.0 OUTSTANDING	4358	4190	4021	3853	3685	3516	3348	3180	3011	2843	2675	2506
410.0 INTEREST DUE	701	685	669	653	637	621	605	590	574	558	542	526
411.0												
412.0 GVEA												
414.0 REPAYMENT AMOUNT	1319	1319	1319	1319	1319	1319	1319	1319	1319	1319	1319	1319
416.0 CUMULATIVE	1319	2638	3958	5277	6596	7915	9235	10554	11873	13192	14512	15831
418.0 OUTSTANDING	20337	19551	18766	17980	17195	16409	15624	14838	14053	13267	12482	11696
420.0 INTEREST DUE	3269	3195	3121	3047	2973	2899	2825	2751	2677	2603	2529	2455
421.0												
422.0 CVEA												
424.0 REPAYMENT AMOUNT	0	0	0	0	0	0	0	0	0	0	0	0
426.0 CUMULATIVE	0	0	0	0	0	0	0	0	0	0	0	0
428.0 OUTSTANDING	0	0	0	0	0	0	0	0	0	0	0	0
430.0 INTEREST DUE	0	0	0	0	0	0	0	0	0	0	0	0

F-14

15 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
DEBT REPAYMENT AND SINKING FUND  
ALLOCATION BY UTILITY

20-80 REA-FFB

LINE NO	1996	1997	1998	1999	2000	2001	2002	2003	2004	2005	2006	2007
352.0 AML & P												
354.0 REPAYMENT AMOUNT	424	424	424	424	424	424	424	424	315	315	315	315
358.0 OUTSTANDING	2426	2231	2036	1840	1645	1450	1255	1059	973	887	800	714
360.0 INTEREST DUE	819	792	766	739	713	687	660	634	318	291	265	238
361.0												
362.0 CEA												
364.0 REPAYMENT AMOUNT	259	259	259	259	259	259	259	259	193	193	193	193
368.0 OUTSTANDING	1483	1363	1244	1125	1005	886	767	647	595	542	489	436
370.0 INTEREST DUE	500	484	468	452	436	420	403	387	194	178	162	146
371.0												
372.0 MEA												
374.0 REPAYMENT AMOUNT	71	71	71	71	71	71	71	71	53	53	53	53
378.0 OUTSTANDING	404	372	339	307	274	242	209	177	162	148	133	119
380.0 INTEREST DUE	136	132	128	123	119	114	110	106	53	49	44	40
381.0												
382.0 HEA												
384.0 REPAYMENT AMOUNT	0	0	0	0	0	0	0	0	0	0	0	0
388.0 OUTSTANDING	0	0	0	0	0	0	0	0	0	0	0	0
390.0 INTEREST DUE	0	0	0	0	0	0	0	0	0	0	0	0
391.0												
402.0 FMUS												
404.0 REPAYMENT AMOUNT	283	283	283	283	283	283	283	283	210	210	210	210
408.0 OUTSTANDING	1618	1487	1357	1227	1097	967	836	706	649	591	534	476
410.0 INTEREST DUE	546	528	511	493	475	458	440	422	212	194	176	159
411.0												
412.0 GVEA												
414.0 REPAYMENT AMOUNT	1319	1319	1319	1319	1319	1319	1319	1319	980	980	980	980
416.0 CUMULATIVE	17150	18469	19789	21108	22427	23746	25065	26385	27365	28345	29326	30306
418.0 OUTSTANDING	7549	6941	6333	5726	5118	4511	3903	3296	3027	2759	2490	2221
420.0 INTEREST DUE	2548	2465	2383	2301	2218	2136	2054	1971	988	906	823	741
421.0												
422.0 CVEA												
424.0 REPAYMENT AMOUNT	0	0	0	0	0	0	0	0	0	0	0	0
426.0 CUMULATIVE	0	0	0	0	0	0	0	0	0	0	0	0
428.0 OUTSTANDING	0	0	0	0	0	0	0	0	0	0	0	0
430.0 INTEREST DUE	0	0	0	0	0	0	0	0	0	0	0	0

F-15

15 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
DEBT REPAYMENT AND SINKING FUND  
ALLOCATION BY UTILITY

40-60 REA-FFB

LINE NO	1996	1997	1998	1999	2000	2001	2002	2003	2004	2005	2006	2007
352.0 AML & P												
354.0 REPAYMENT AMOUNT	424	424	424	424	424	424	424	424	315	315	315	315
358.0 OUTSTANDING	3507	3255	3002	2750	2497	2245	1992	1740	1596	1453	1309	1166
360.0 INTEREST DUE	765	742	718	694	670	646	623	599	285	262	238	214
361.0												
362.0 CEA												
364.0 REPAYMENT AMOUNT	259	259	259	259	259	259	259	259	193	193	193	193
368.0 OUTSTANDING	2143	1989	1835	1680	1526	1372	1217	1063	976	888	800	712
370.0 INTEREST DUE	468	453	439	424	410	395	380	366	174	160	145	131
371.0												
372.0 MEA												
374.0 REPAYMENT AMOUNT	71	71	71	71	71	71	71	71	53	53	53	53
378.0 OUTSTANDING	585	542	500	458	416	374	332	290	266	242	218	194
380.0 INTEREST DUE	128	124	120	116	112	108	104	100	48	44	40	36
381.0												
382.0 HEA												
384.0 REPAYMENT AMOUNT	0	0	0	0	0	0	0	0	0	0	0	0
388.0 OUTSTANDING	0	0	0	0	0	0	0	0	0	0	0	0
390.0 INTEREST DUE	0	0	0	0	0	0	0	0	0	0	0	0
391.0												
402.0 FMUS												
404.0 REPAYMENT AMOUNT	283	283	283	283	283	283	283	283	210	210	210	210
408.0 OUTSTANDING	2338	2170	2001	1833	1665	1496	1328	1160	1064	968	873	777
410.0 INTEREST DUE	510	494	478	463	447	431	415	399	190	174	159	143
411.0												
412.0 GVEA												
414.0 REPAYMENT AMOUNT	1319	1319	1319	1319	1319	1319	1319	1319	980	980	980	980
416.0 CUMULATIVE	17150	18469	19789	21108	22427	23746	25065	26385	27365	28345	29326	30306
418.0 OUTSTANDING	10911	10125	9340	8555	7769	6984	6198	5413	4966	4520	4073	3627
420.0 INTEREST DUE	2381	2307	2233	2159	2085	2011	1937	1863	888	814	740	666
421.0												
422.0 CVEA												
424.0 REPAYMENT AMOUNT	0	0	0	0	0	0	0	0	0	0	0	0
426.0 CUMULATIVE	0	0	0	0	0	0	0	0	0	0	0	0
428.0 OUTSTANDING	0	0	0	0	0	0	0	0	0	0	0	0
430.0 INTEREST DUE	0	0	0	0	0	0	0	0	0	0	0	0

F-16

15 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
DEBT REPAYMENT AND SINKING FUND  
ALLOCATION BY UTILITY

20-80 REA-FFB

LINE NO	2008	2009	2010	2011	2012	2013	2014	2015
352.0 AML & P								
354.0 REPAYMENT AMOUNT	315	315	315	315	315	315	315	315
358.0 OUTSTANDING	628	541	455	369	282	196	110	23
360.0 INTEREST DUE	212	185	159	132	106	79	53	26
361.0								
362.0 CEA								
364.0 REPAYMENT AMOUNT	193	193	193	193	193	193	193	193
368.0 OUTSTANDING	384	331	278	225	173	120	67	14
370.0 INTEREST DUE	129	113	97	81	65	49	32	16
371.0								
372.0 MEA								
374.0 REPAYMENT AMOUNT	53	53	53	53	53	53	53	53
378.0 OUTSTANDING	105	90	76	61	47	33	18	4
380.0 INTEREST DUE	35	31	26	22	18	13	9	4
381.0								
382.0 HEA								
384.0 REPAYMENT AMOUNT	0	0	0	0	0	0	0	0
388.0 OUTSTANDING	0	0	0	0	0	0	0	0
390.0 INTEREST DUE	0	0	0	0	0	0	0	0
391.0								
402.0 FMUS								
404.0 REPAYMENT AMOUNT	210	210	210	210	210	210	210	210
408.0 OUTSTANDING	418	361	303	246	188	131	73	16
410.0 INTEREST DUE	141	124	106	88	71	53	35	18
411.0								
412.0 GVEA								
414.0 REPAYMENT AMOUNT	980	980	980	980	980	980	980	980
416.0 CUMULATIVE	31286	32266	33247	34227	35207	36188	37168	38148
418.0 OUTSTANDING	1953	1684	1416	1147	878	610	341	73
420.0 INTEREST DUE	659	576	494	412	329	247	165	82
421.0								
422.0 CVEA								
424.0 REPAYMENT AMOUNT	0	0	0	0	0	0	0	0
426.0 CUMULATIVE	0	0	0	0	0	0	0	0
428.0 OUTSTANDING	0	0	0	0	0	0	0	0
430.0 INTEREST DUE	0	0	0	0	0	0	0	0

F-17

15 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
DEBT REPAYMENT AND SINKING FUND  
ALLOCATION BY UTILITY

40-60 REA-FFB

LINE NO	2008	2009	2010	2011	2012	2013	2014	2015
352.0 AML & P								
354.0 REPAYMENT AMOUNT	315	315	315	315	315	315	315	315
358.0 OUTSTANDING	1022	879	735	592	448	305	161	17
360.0 INTEREST DUE	190	167	143	119	95	71	48	24
361.0								
362.0 CEA								
364.0 REPAYMENT AMOUNT	193	193	193	193	193	193	193	193
368.0 OUTSTANDING	625	537	449	362	274	186	98	11
370.0 INTEREST DUE	116	102	87	73	58	44	29	15
371.0								
372.0 MEA								
374.0 REPAYMENT AMOUNT	53	53	53	53	53	53	53	53
378.0 OUTSTANDING	170	146	123	99	75	51	27	3
380.0 INTEREST DUE	32	28	24	20	16	12	8	4
381.0								
382.0 HEA								
384.0 REPAYMENT AMOUNT	0	0	0	0	0	0	0	0
388.0 OUTSTANDING	0	0	0	0	0	0	0	0
390.0 INTEREST DUE	0	0	0	0	0	0	0	0
391.0								
402.0 FMUS								
404.0 REPAYMENT AMOUNT	210	210	210	210	210	210	210	210
408.0 OUTSTANDING	681	586	490	394	299	203	107	12
410.0 INTEREST DUE	127	111	95	79	63	48	32	16
411.0								
412.0 GVEA								
414.0 REPAYMENT AMOUNT	980	980	980	980	980	980	980	980
416.0 CUMULATIVE	31286	32266	33247	34227	35207	36188	37168	38148
418.0 OUTSTANDING	3180	2734	2287	1841	1394	947	501	54
420.0 INTEREST DUE	592	518	444	370	296	222	148	74
421.0								
422.0 CVEA								
424.0 REPAYMENT AMOUNT	0	0	0	0	0	0	0	0
426.0 CUMULATIVE	0	0	0	0	0	0	0	0
428.0 OUTSTANDING	0	0	0	0	0	0	0	0
430.0 INTEREST DUE	0	0	0	0	0	0	0	0

F-18

15 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
SINKING FUND ACCUMULATIONS

20-80 REA-FFB

LINE NO	1984	1985	1986	1987	1988	1989	1990	1991	1992	1993	1994	1995
500.0 APA												
502.0 S. FUND PMT	0	0	0	0	0	0	0	0	0	0	0	0
504.0 INTEREST ON FUND	0	0	0	0	0	0	0	0	0	0	0	0
506.0 TOTAL IN FUND	0	0	0	0	0	0	0	0	0	0	0	0
520.0 AMU												
522.0 S. FUND PMT	371	371	371	371	371	371	371	371	371	371	371	371
524.0 INTEREST ON FUND	0	24	50	77	106	137	170	206	243	283	325	371
526.0 TOTAL IN FUND	371	766	1187	1635	2112	2621	3162	3739	4353	5006	5703	6445
530.0 FMU												
532.0 S. FUND PMT	234	234	234	234	234	234	234	234	234	234	234	234
534.0 INTEREST ON FUND	0	16	34	53	73	94	117	142	168	196	227	259
536.0 TOTAL IN FUND	234	485	753	1040	1347	1676	2027	2403	2806	3236	3697	4190

F-19

LINE NO	1996	1997	1998	1999	2000	2001	2002	2003
500.0 APA								
502.0 S. FUND PMT	0	0	0	0	0	0	0	0
504.0 INTEREST ON FUND	0	0	0	0	0	0	0	0
506.0 TOTAL IN FUND	0	0	0	0	0	0	0	0
520.0 AMU								
522.0 S. FUND PMT	371	371	371	371	371	371	371	371
524.0 INTEREST ON FUND	419	470	525	583	645	711	782	856
526.0 TOTAL IN FUND	7235	8076	8972	9926	10942	12024	13177	14404
530.0 FMU								
532.0 S. FUND PMT	234	234	234	234	234	234	234	234
534.0 INTEREST ON FUND	293	330	370	412	457	506	557	613
536.0 TOTAL IN FUND	4718	5282	5886	6533	7224	7964	8756	9603

15 AUGUST 79

ANCHORAGE - FAIRBANKS INTERCONNECTION  
SINKING FUND ACCUMULATIONS

40-60 REA-FFB

LINE NO	1984	1985	1986	1987	1988	1989	1990	1991	1992	1993	1994	1995
500.0 APA												
502.0 S. FUND PMT	0	0	0	0	0	0	0	0	0	0	0	0
504.0 INTEREST ON FUND	0	0	0	0	0	0	0	0	0	0	0	0
506.0 TOTAL IN FUND	0	0	0	0	0	0	0	0	0	0	0	0
520.0 AMU												
522.0 S. FUND PMT	371	371	371	371	371	371	371	371	371	371	371	371
524.0 INTEREST ON FUND	0	24	50	77	106	137	170	206	243	283	325	371
526.0 TOTAL IN FUND	371	766	1187	1635	2112	2621	3162	3739	4353	5006	5703	6445
530.0 FMU												
532.0 S. FUND PMT	234	234	234	234	234	234	234	234	234	234	234	234
534.0 INTEREST ON FUND	0	16	34	53	73	94	117	142	168	196	227	259
536.0 TOTAL IN FUND	234	485	753	1040	1347	1676	2027	2403	2806	3236	3697	4190

F-20

LINE NO	1996	1997	1998	1999	2000	2001	2002	2003
500.0 APA								
502.0 S. FUND PMT	0	0	0	0	0	0	0	0
504.0 INTEREST ON FUND	0	0	0	0	0	0	0	0
506.0 TOTAL IN FUND	0	0	0	0	0	0	0	0
520.0 AMU								
522.0 S. FUND PMT	371	371	371	371	371	371	371	371
524.0 INTEREST ON FUND	419	470	525	583	645	711	782	856
526.0 TOTAL IN FUND	7235	8076	8972	9926	10942	12024	13177	14404
530.0 FMU								
532.0 S. FUND PMT	234	234	234	234	234	234	234	234
534.0 INTEREST ON FUND	293	330	370	412	457	506	557	613
536.0 TOTAL IN FUND	4718	5282	5886	6533	7224	7964	8756	9603

15 AUGUST 79

20-80 REA-FFB

LIVE NO		1984	1985	1986	1987	1988	1989	1990	1991	1992	1993	1994	1995
551.0	CUM. PRIN/S. FUND*	2356	4712	7067	9423	11779	14135	16490	18846	21202	23558	25914	28269
552.0	CUM. INTEREST	6314	12481	18501	24373	30099	35678	41109	46394	51532	56522	61366	66062
553.0													
554.0	CUM. DEBT SERVIC	8670	17192	25568	33796	41878	49812	57600	65240	72734	80080	87279	94331
555.0													
556.0	* NOTE: THE SINKING FUND REPAYMENTS TAKE INTO ACCOUNT												
557.0	THE FACT THAT INTEREST IS ACCRUING ON THE FUND.												
558.0	THE TOTAL OF THIS LINE, THEREFORE, WILL NOT MATCH THE												
559.0	TOTAL PROJECT COST												
560.0													
560.5	CUMULATIVE PRINCIPAL AND SINKING FUND PAYMENTS												
561.0	APA	0	0	0	0	0	0	0	0	0	0	0	0
562.0	REA	350	700	1050	1400	1751	2101	2451	2801	3151	3501	3851	4201
563.0	CFC	0	0	0	0	0	0	0	0	0	0	0	0
564.0	FFB	1400	2801	4201	5602	7002	8403	9803	11203	12604	14004	15405	16805
565.0	AMU	371	742	1113	1484	1855	2226	2597	2968	3339	3710	4081	4452
566.0	FMU	234	468	703	937	1171	1405	1640	1874	2108	2342	2577	2811
567.0													
568.0	TOTAL	2356	4712	7067	9423	11779	14135	16490	18846	21202	23558	25914	28269
569.0													
570.0	INTEREST ON SINKING FUNDS												
571.0	APA	0	0	0	0	0	0	0	0	0	0	0	0
572.0	AMU	0	24	74	151	257	395	565	771	1014	1296	1622	1993
573.0	FMU	0	16	50	103	176	270	387	529	698	894	1121	1379
574.0													
575.0	TOTAL	0	41	124	254	433	665	952	1300	1711	2190	2742	3372
576.0													
578.0	GRAND TOTAL	2356	4752	7192	9677	12212	14799	17443	20146	22913	25748	28656	31641

F-21

15 AUGUST 79

40-60 REA-FFB

LINE NO		1984	1985	1986	1987	1988	1989	1990	1991	1992	1993	1994	1995
551.0	CUM.PRIN/S.FUND*	2356	4712	7067	9423	11779	14135	16490	18846	21202	23558	25914	2826
552.0	CUM. INTEREST	5838	11543	17117	22558	27867	33044	38089	43002	47782	52430	56946	6133
553.0													
554.0	CUM. DEBT SERVIC	8194	16255	24184	31981	39646	47179	54579	61848	68984	75988	82860	8960
555.0													
556.0	* NOTE: THE SINKING FUND REPAYMENTS TAKE INTO ACCOUNT												
557.0	THE FACT THAT INTEREST IS ACCRUING ON THE FUND.												
558.0	THE TOTAL OF THIS LINE, THEREFORE, WILL NOT MATCH THE												
559.0	TOTAL PROJECT COST												
560.0													
560.5	CUMULATIVE PRINCIPAL AND SINKING FUND PAYMENTS												
561.0	APA	0	0	0	0	0	0	0	0	0	0	0	0
562.0	REA	700	1400	2101	2801	3501	4201	4901	5602	6302	7002	7702	840
563.0	CFC	0	0	0	0	0	0	0	0	0	0	0	0
564.0	FFR	1050	2101	3151	4201	5252	6302	7352	8403	9453	10503	11553	1260
565.0	AMU	371	742	1113	1484	1855	2226	2597	2968	3339	3710	4081	445
566.0	FMU	234	468	703	937	1171	1405	1640	1874	2108	2342	2577	281
567.0													
568.0	TOTAL	2356	4712	7067	9423	11779	14135	16490	18846	21202	23558	25914	2826
569.0													
570.0	INTEREST ON SINKING FUNDS												
571.0	APA	0	0	0	0	0	0	0	0	0	0	0	0
572.0	AMU	0	24	74	151	257	395	565	771	1014	1296	1622	199
573.0	FMU	0	16	50	103	176	270	387	529	698	894	1121	137
574.0													
575.0	TOTAL	0	41	124	254	433	665	952	1300	1711	2190	2742	337
576.0													
578.0	GRAND TOTAL	2356	4752	7192	9677	12212	14799	17443	20146	22913	25748	28656	3164

15 AUGUST 79

20-80 REA-FFB

LINE NO		1996	1997	1998	1999	2000	2001	2002	2003	2004	2005	2006	2007
551.0	CUM. PRIN/S. FUND*	30625	32981	35337	37692	40048	42404	44760	47116	48866	50617	52367	54118
552.0	CUM. INTEREST	70611	75014	79269	83377	87338	91153	94820	98340	100104	101722	103192	104516
553.0													
554.0	CUM. DEBT SERVIC	101236	107995	114606	121070	127387	133557	139579	145455	148970	152338	155559	158633
555.0													
556.0	* NOTE: THE SINKING FUND REPAYMENTS TAKE INTO ACCOUNT												
557.0	THE FACT THAT INTEREST IS ACCRUING ON THE FUND.												
558.0	THE TOTAL OF THIS LINE, THEREFORE, WILL NOT MATCH THE												
559.0	TOTAL PROJECT COST												
560.0													
560.5	CUMULATIVE PRINCIPAL AND SINKING FUND PAYMENTS												
561.0	APA	0	0	0	0	0	0	0	0	0	0	0	0
562.0	REA	4551	4901	5252	5602	5952	6302	6652	7002	7352	7702	8052	8403
563.0	CFC	0	0	0	0	0	0	0	0	0	0	0	0
564.0	FFB	18206	19606	21006	22407	23807	25208	26608	28008	29409	30809	32210	33610
565.0	AMU	4823	5194	5565	5936	6307	6678	7049	7420	7420	7420	7420	7420
566.0	FMU	3045	3279	3514	3748	3982	4216	4451	4685	4685	4685	4685	4685
567.0													
568.0	TOTAL	30625	32981	35337	37692	40048	42404	44760	47116	48866	50617	52367	54118
569.0													
570.0	INTEREST ON SINKING FUNDS												
571.0	APA	0	0	0	0	0	0	0	0	0	0	0	0
572.0	AMU	2411	2882	3407	3990	4635	5346	6128	6984	6984	6984	6984	6984
573.0	FMU	1673	2003	2373	2785	3242	3748	4305	4918	4918	4918	4918	4918
574.0													
575.0	TOTAL	4084	4885	5779	6774	7877	9094	10433	11902	11902	11902	11902	11902
576.0													
578.0	GRAND TOTAL	34709	37865	41116	44467	47925	51498	55193	59018	60768	62519	64269	66020

F-23

15 AUGUST 79

40-60 REA-FFB

LINE NO		1996	1997	1998	1999	2000	2001	2002	2003	2004	2005	2006	2007
551.0	CUM.PRIN/S.FUND*	30625	32981	35337	37692	40048	42404	44760	47116	48866	50617	52367	54118
552.0	CUM. INTEREST	65582	69702	73689	77544	81268	84859	88317	91644	93230	94684	96005	97195
553.0		-----											
554.0	CUM. DEBT SERVIC	96207	102683	109026	115237	121316	127263	133077	138760	142096	145300	148373	151313
555.0		-----											
556.0	* NOTE: THE SINKING FUND REPAYMENTS TAKE INTO ACCOUNT												
557.0	THE FACT THAT INTEREST IS ACCRUING ON THE FUND.												
558.0	THE TOTAL OF THIS LINE, THEREFORE, WILL NOT MATCH THE												
559.0	TOTAL PROJECT COST												
560.0		-----											
560.5	CUMULATIVE PRINCIPAL AND SINKING FUND PAYMENTS												
561.0	APA	0	0	0	0	0	0	0	0	0	0	0	0
562.0	REA	9103	9803	10503	11203	11904	12604	13304	14004	14704	15405	16105	16805
563.0	CFC	0	0	0	0	0	0	0	0	0	0	0	0
564.0	FFB	13654	14704	15755	16805	17855	18906	19956	21006	22057	23107	24157	25208
565.0	AMU	4823	5194	5565	5936	6307	6678	7049	7420	7420	7420	7420	7420
566.0	FMU	3045	3279	3514	3748	3982	4216	4451	4685	4685	4685	4685	4685
567.0		-----											
568.0	TOTAL	30625	32981	35337	37692	40048	42404	44760	47116	48866	50617	52367	54118
569.0		-----											
570.0	INTEREST ON SINKING FUNDS												
571.0	APA	0	0	0	0	0	0	0	0	0	0	0	0
572.0	AMU	2411	2882	3407	3990	4635	5346	6128	6984	6984	6984	6984	6984
573.0	FMU	1673	2003	2373	2785	3242	3748	4305	4918	4918	4918	4918	4918
574.0		-----											
575.0	TOTAL	4084	4885	5779	6774	7877	9094	10433	11902	11902	11902	11902	11902
576.0		-----											
578.0	GRAND TOTAL	34709	37865	41116	44467	47925	51498	55193	59018	60768	62519	64269	66020

15 AUGUST 79

20-80 REA-FFB

LINE NO		2008	2009	2010	2011	2012	2013	2014	2015	
551.0	CUM. PRIN/S. FUND*	55868	57619	59369	61120	62870	64621	66371	68122	
552.0	CUM. INTEREST	105692	106721	107604	108339	108927	109368	109662	109809	
553.0		-----								
554.0	CUM. DEBT SERVIC	161560	164340	166973	169459	171797	173989	176034	177931	
555.0		-----								
556.0	* NOTE: THE SINKING FUND REPAYMENTS TAKE INTO ACCOUNT									
557.0	THE FACT THAT INTEREST IS ACCRUING ON THE FUND.									
558.0	THE TOTAL OF THIS LINE, THEREFORE, WILL NOT MATCH THE									
559.0	TOTAL PROJECT COST									
560.0		-----								
560.5	CUMULATIVE PRINCIPAL AND SINKING FUND PAYMENTS									
561.0	APA	0	0	0	0	0	0	0	0	
562.0	REA	8753	9103	9453	9803	10153	10503	10853	11203	
563.0	CFC	0	0	0	0	0	0	0	0	
564.0	FFB	35011	36411	37811	39212	40612	42013	43413	44814	
565.0	AMU	7420	7420	7420	7420	7420	7420	7420	7420	
566.0	FMU	4685	4685	4685	4685	4685	4685	4685	4685	
567.0		-----								
568.0	TOTAL	55868	57619	59369	61120	62870	64621	66371	68122	
569.0		-----								
570.0	INTEREST ON SINKING FUNDS									
571.0	APA	0	0	0	0	0	0	0	0	
572.0	AMU	6984	6984	6984	6984	6984	6984	6984	6984	
573.0	FMU	4918	4918	4918	4918	4918	4918	4918	4918	
574.0		-----								
575.0	TOTAL	11902	11902	11902	11902	11902	11902	11902	11902	
576.0		-----								
578.0	GRAND TOTAL	67771	69521	71272	73022	74773	76523	78274	80024	

F-25

15 AUGUST 79

40-60 REA-FFB

LINE NO		2008	2009	2010	2011	2012	2013	2014	2015
551.0	CUM.PRIN/S.FUND*	55868	57619	59369	61120	62870	64621	66371	68122
552.0	CUM. INTEREST	98252	99177	99970	100631	101160	101556	101821	101953
553.0		-----							
554.0	CUM. DERT SERVIC	154120	156796	159340	161751	164030	166177	168192	170075
555.0		-----							
556.0	* NOTE: THE SINKING FUND REPAYMENTS TAKE INTO ACCOUNT								
557.0	THE FACT THAT INTEREST IS ACCRUING ON THE FUND.								
558.0	THE TOTAL OF THIS LINE, THEREFORE, WILL NOT MATCH THE								
559.0	TOTAL PROJECT COST								
560.0		-----							
560.5	CUMULATIVE PRINCIPAL AND SINKING FUND PAYMENTS								
561.0	APA	0	0	0	0	0	0	0	0
562.0	REA	17505	18206	18906	19606	20306	21006	21707	22407
563.0	CFC	0	0	0	0	0	0	0	0
564.0	FFB	26258	27308	28359	29409	30459	31510	32560	33610
565.0	AMU	7420	7420	7420	7420	7420	7420	7420	7420
566.0	FMU	4685	4685	4685	4685	4685	4685	4685	4685
567.0		-----							
568.0	TOTAL	55868	57619	59369	61120	62870	64621	66371	68122
569.0		-----							
570.0	INTEREST ON SINKING FUNDS								
571.0	APA	0	0	0	0	0	0	0	0
572.0	AMU	6984	6984	6984	6984	6984	6984	6984	6984
573.0	FMU	4918	4918	4918	4918	4918	4918	4918	4918
574.0		-----							
575.0	TOTAL	11902	11902	11902	11902	11902	11902	11902	11902
576.0		-----							
578.0	GRAND TOTAL	67771	69521	71272	73022	74773	76523	78274	80024

ANCHORAGE-FAIRBANKS INTERCONNECTION

FINANCIAL COMPARISON

OF

ALTERNATIVE REA/FFB LOAN PACKAGES

(COMPARE)

# PRESENT VALUE COMPARISON OF REA/FFB COMBINATION LOAN PACKAGES

Discounted @ 14 Percent

ALT.1- 20% REA@ 5%/80% FFB@ 9 1/4%  
35 YEAR AMORTIZATION

INTEREST ONLY

32 YEAR REPAYMENT PERIOD

20 AUGUST 79

LINE NO	YEAR	0	1	2	3	4	5	6	7	8	9	10	11
800.0	ADJUSTED DEBT SERVICE FOR:												
802.0	LOAN 1 (REA)	0	17	92	356	910	893	875	858	840	823	805	788
804.0	LOAN 2 (FFB)	0	108	593	2283	4996	4884	4772	4659	4547	4434	4322	4210
812.0													
815.0	TOTAL	0	125	686	2639	5907	5777	5647	5517	5387	5257	5127	4997
820.0	DISCOUNTED VALUE	0	109	528	1781	3497	3000	2573	2205	1888	1617	1383	1182
822.0	PRESENT VALUE	26363	0	0	0	0	0	0	0	0	0	0	0

LINE NO	12	13	14	15	16	17	18	19	20	21	22	23
800.0	ADJUSTED DEBT SERVICE FOR:											
802.0	LOAN 1 (REA)	770	753	735	718	700	683	665	648	630	613	595
804.0	LOAN 2 (FFB)	4097	3985	3873	3760	3648	3535	3423	3311	3198	3086	2974
812.0												
815.0	TOTAL	4868	4738	4608	4478	4348	4218	4088	3958	3829	3699	3569
820.0	DISCOUNTED VALUE	1010	863	736	627	534	455	387	328	279	236	200
822.0	PRESENT VALUE	0	0	0	0	0	0	0	0	0	0	0

LINE NO	24	25	26	27	28	29	30	31	32	33	34	35
800.0	ADJUSTED DEBT SERVICE FOR:											
802.0	LOAN 1 (REA)	560	543	525	508	490	473	455	438	420	403	385
804.0	LOAN 2 (FFB)	2749	2637	2524	2412	2299	2187	2075	1962	1850	1738	1625
812.0												
815.0	TOTAL	3309	3179	3049	2919	2790	2660	2530	2400	2270	2140	2010
820.0	DISCOUNTED VALUE	143	120	101	85	71	60	50	41	34	28	23
822.0	PRESENT VALUE	0	0	0	0	0	0	0	0	0	0	0

# PRESENT VALUE COMPARISON OF REA/FFB COMBINATION LOAN PACKAGES

Discounted @ 14 Percent

ALT.2- 40% REA@ 5%/60% FFB@ 9 1/4%  
35 YEAR AMORTIZATION

20 AUGUST 79

20 AUGUST 79		INTEREST ONLY												32 YEAR REPAYMENT PERIOD																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																							
LINE NO	YEAR	0	1	2	3	4	5	6	7	8	9	10	11																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																								</

LINE NO		12	13	14	15	16	17	18	19	20	21	22	23
800.0	ADJUSTED DEBT SERVICE FOR:												
802.0	LOAN 1 (REA)	1540	1505	1470	1435	1400	1365	1330	1295	1260	1225	1190	1155
804.0	LOAN 2 (FFB)	3073	2989	2904	2820	2736	2652	2567	2483	2399	2315	2230	2146
812.0													
815.0	TOTAL	4613	4494	4375	4256	4136	4017	3898	3778	3659	3540	3421	3301
820.0	DISCOUNTED VALUE	958	818	699	596	508	433	369	313	266	226	192	162
822.0	PRESENT VALUE	0	0	0	0	0	0	0	0	0	0	0	0

LINE NO		24	25	26	27	28	29	30	31	32	33	34	35
800.0	ADJUSTED DEBT SERVICE FOR:												
802.0	LOAN 1 (REA)	1120	1085	1050	1015	980	945	910	875	840	805	770	735
804.0	LOAN 2 (FFB)	2062	1977	1893	1809	1725	1640	1556	1472	1387	1303	1219	1135
812.0													
815.0	TOTAL	3182	3063	2943	2824	2705	2586	2466	2347	2228	2108	1989	1870
820.0	DISCOUNTED VALUE	137	116	98	82	69	58	48	40	34	28	23	19
822.0	PRESENT VALUE	0	0	0	0	0	0	0	0	0	0	0	0

F-29